



Power Sector – PEM Noida

Technical Pre - Qualification Requirements

(For Open/Global Tender)

To be read in conjunction with PEM General PQR

Project: 1x500 MW Unchahar TPP  
Package: LUBE OIL TRANSFER PUMP

DEPARTMENT: MECHANICAL AUXILIARY

Sheet 1 of 2

REV 00

Dt.- 13/05/2014

Lube oil pumps supply packages with following technical details:

- Pumps should be of gear type.

Supplier should have designing/manufacturing capability and having testing facility (in house or outsourced).

Product/package should have been successfully in use for at least one year in power plant or other industries e.g. refinery/steel/process/commercial etc. For this the supplier has to submit either of following supporting documents meeting below mentioned conditions

- I. Copy of minimum two performance certificate from end user along with copy of related Purchase Order specifying that the product is running successfully for one(1) year from date of commissioning.  
OR
- II. Minimum three customer's/third party inspection reports along with purchase order copy meeting the minimum pre-qualifying requirement.  
OR
- III. Minimum three purchase orders (placed with minimum gap of 6 months from previous purchase order) from same purchaser meeting the minimum pre-qualifying requirement

**Note:**


- 1) Vendor shall submit design documents to substantiate technical parameters specified in PQR, if the same is not mentioned in performance certificate/purchase order.
- 2) Minimum two (2) nos. Purchase orders shall be submitted which should not be more than ten (10) years old as on date of application for registration/bid submission, for establishing continuity in business.
- 3) Vendor may also qualify based on the credential of principal meeting package specific pre-qualifying requirements having technical valid collaboration/licensing agreement.
- 4) In case documents submitted for meeting PQR are in language other than English, notarized English translation shall also be submitted.

**General :**

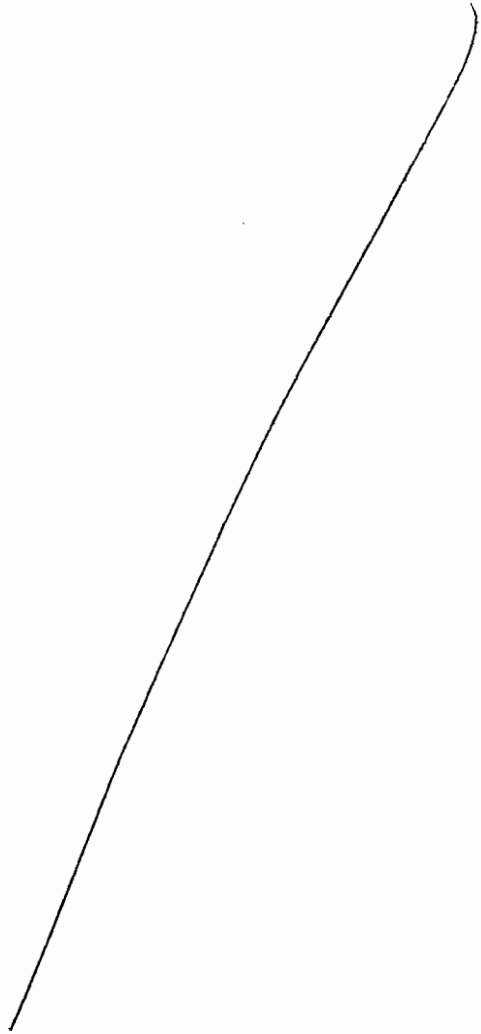
1. PEM registered vendors without technical limit are not required to submit the credentials to meet the PQR in case of open/global tender, however credentials may be required to be submitted for customer approval.




PREPARED BY			CHECKED & REVIEWED BY			APPROVED BY		
SAURABH SINGH		13/05/14	HARISH KUMAR		13/05/14	PRAVEEN KISHORE		13/05/14
NAME	SIGNATURE	DATE	NAME	SIGNATURE	DATE	NAME	SIGNATURE	DATE

000000

	<b>Power Sector – PEM Noida</b>  <b>Technical Pre - Qualification Requirements</b>  (For Open/Global Tender)  To be read in conjunction with <b>PEM General PQR</b>	<b>Project:</b> <b>Package: LUBE OIL TRANSFER PUMP</b>  <b>DEPARTMENT: MECHANICAL AUXILIARY</b>
	Sheet 2 of 2	REV 00

2. PEM registered vendors with technical limit are required to check PQR in case of open/global tender and will submit the credentials, if project specific PQR is more stringent than technical limit of registration in PEM. In such case, the bidder will be evaluated based on credentials and if technically recommended, Engg will initiate note for reviewing of technical limit.



PREPARED BY			CHECKED & REVIEWED BY			APPROVED BY		
SAURABH SINGH		13/05/14	HARISH KUMAR		13/05/14	PRAVEEN KISHORE		13/05/14
NAME	SIGNATURE	DATE	NAME	SIGNATURE	DATE	NAME	SIGNATURE	DATE