

## **Annexure – C to Tender BAP/CAP/2013-14/OT-21**

### **Design, Supply, Installation and Commissioning of Trilingual (Tamil, Hindi and English) Neon Sign Board - “BOILER AUXILIARIES PLANT”**

#### **Dimension:**

TAMIL in Blue colour, each letter size- Height: Min 9 inches and breadth: Min 9 inches  
HINDI in Green Colour, each letter size- Height: Min 9 inches and breadth: Min 9 inches  
ENGLISH in Red colour, each letter size- Height: Min 12 inches and breadth: Min 8 inches


Each language board must be 1.5 feet Height and 24 feet Breadth. And the gap between board must be min 6 inches.

#### **SCOPE:**

- a) Dismantling of the existing English Neon Sign Board including the steel structure & concrete foundation etc., and handing over to the section in-charge
- b) Metal board must be of min of 26 swg GI sheet or higher thickness and it is to be powder coated with White colour.
- c) Using of single tubing neon and the load current must be equally distributed among the HT transformers.
- d) Supply of powder coated supporting MS structure and maintenance platform with necessary accessories w.r.t. Safety aspects.
- e) Proper supporting Concrete basement to the structures also in supplier scope.
- f) All the new installations to be properly earthed.

#### **Note:**

1. The drawings must be sent for approval with in two weeks from the date of release of Purchase order. And the delivery is 45 days from the date of drawing approval.
2. The space between the letters and words must be appropriate to give good appearance.
3. These boards are to be fixed on the top of Administrative Building front Entrance gate (Approximately 15feet from the ground level).
4. Sample layout drawing is enclosed.

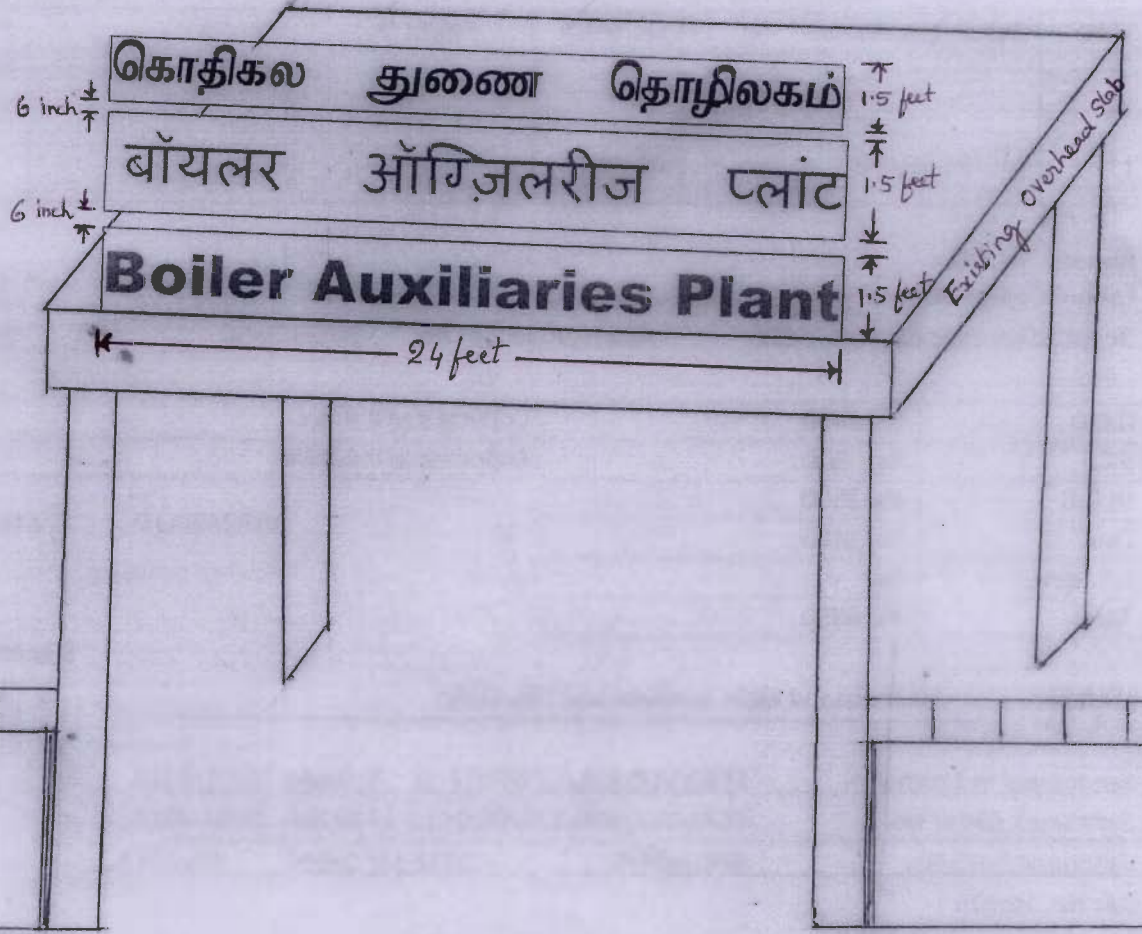

R. Jayakumar

01/02/13

R. JAYAKUMAR

Sr. Engineer / Ele. Mtoe / M&S  
 BHEL / BAP / RANIPET - 632 406.