



# Bharat Heavy Electricals Limited

(A Govt. Of India Undertaking)

Power Sector, Eastern Region

BHEL BHAWAN, PLOT NO. DJ-9/1 , SECOTR II ,  
SALT LAKE CITY , KOLKATA ,WEST BENGAL, INDIA

Phone : 033-23216130-31,033-23216130 FAX : 033-23211960

Sub	TENDER CHANGE NOTICE (TCN-01 DTD. 31/05/2016)
Job	RATE CONTRACT FOR "IN-SITU SEAT CUTTING/REPAIRING/REPLACEMENT OF SEAT OF BHEL/SUZLER MAKE HP BYPASS MAIN VALVES AND HPBP SPRAY VALVES DURING OVERHAULING OF 200/210/250/500/550 MW TG SETS" AT BHEL-PSER.
Ref	TENDER NO.: PSER: PUR: SAS: RC-S221:16 (ENQ:16:PP:0015:PUR:26) DATE: 13/05/2016

1) [With reference to above, following clarifications, relevant to tender, may please be noted and complied with while submitting the offer.](#)

Sl. no.	Description/ Tender clause	Bidder's Query	BHEL's reply
1	Scope of Work, Annexure-I.	Please provide cross section drawing of the valve along with dimensional details.	Enclosed Schematic Diagram of HP BYPASS MAIN VALVES & HPBP SPRAY VALVES

2) 'No deviation certificate' is attached. Bidder to submit their offer along with stamped & signed copy of this TCN & 'No deviation certificate' as per attached format only.

3) All other terms & conditions shall remain unchanged.


Thanking you,

Yours faithfully,  
for BHARAT HEAVY ELECTRICALS LTD


SR. MANAGER (PURCHASE)

(Signature, date & seal of authorized representative of the contractor)

# SCHMATIC DIAGRAM MAIN VALVE

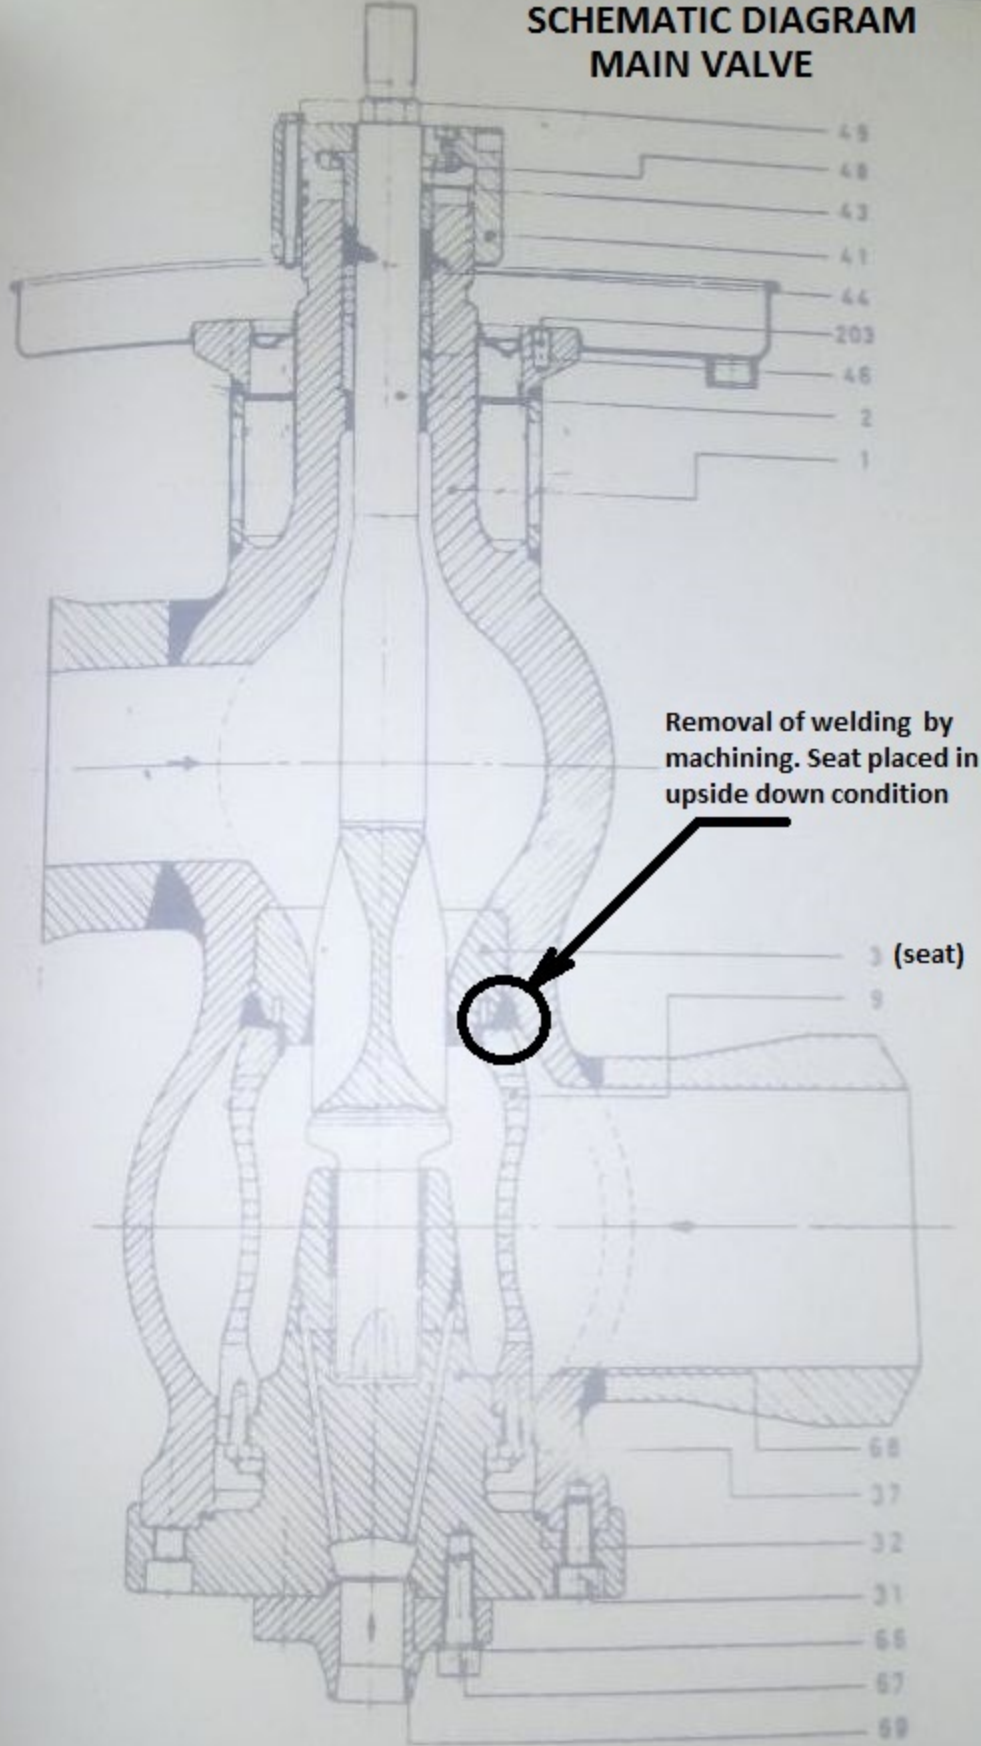

**SCHEMATIC DIAGRAM  
SPRAY VALVE**

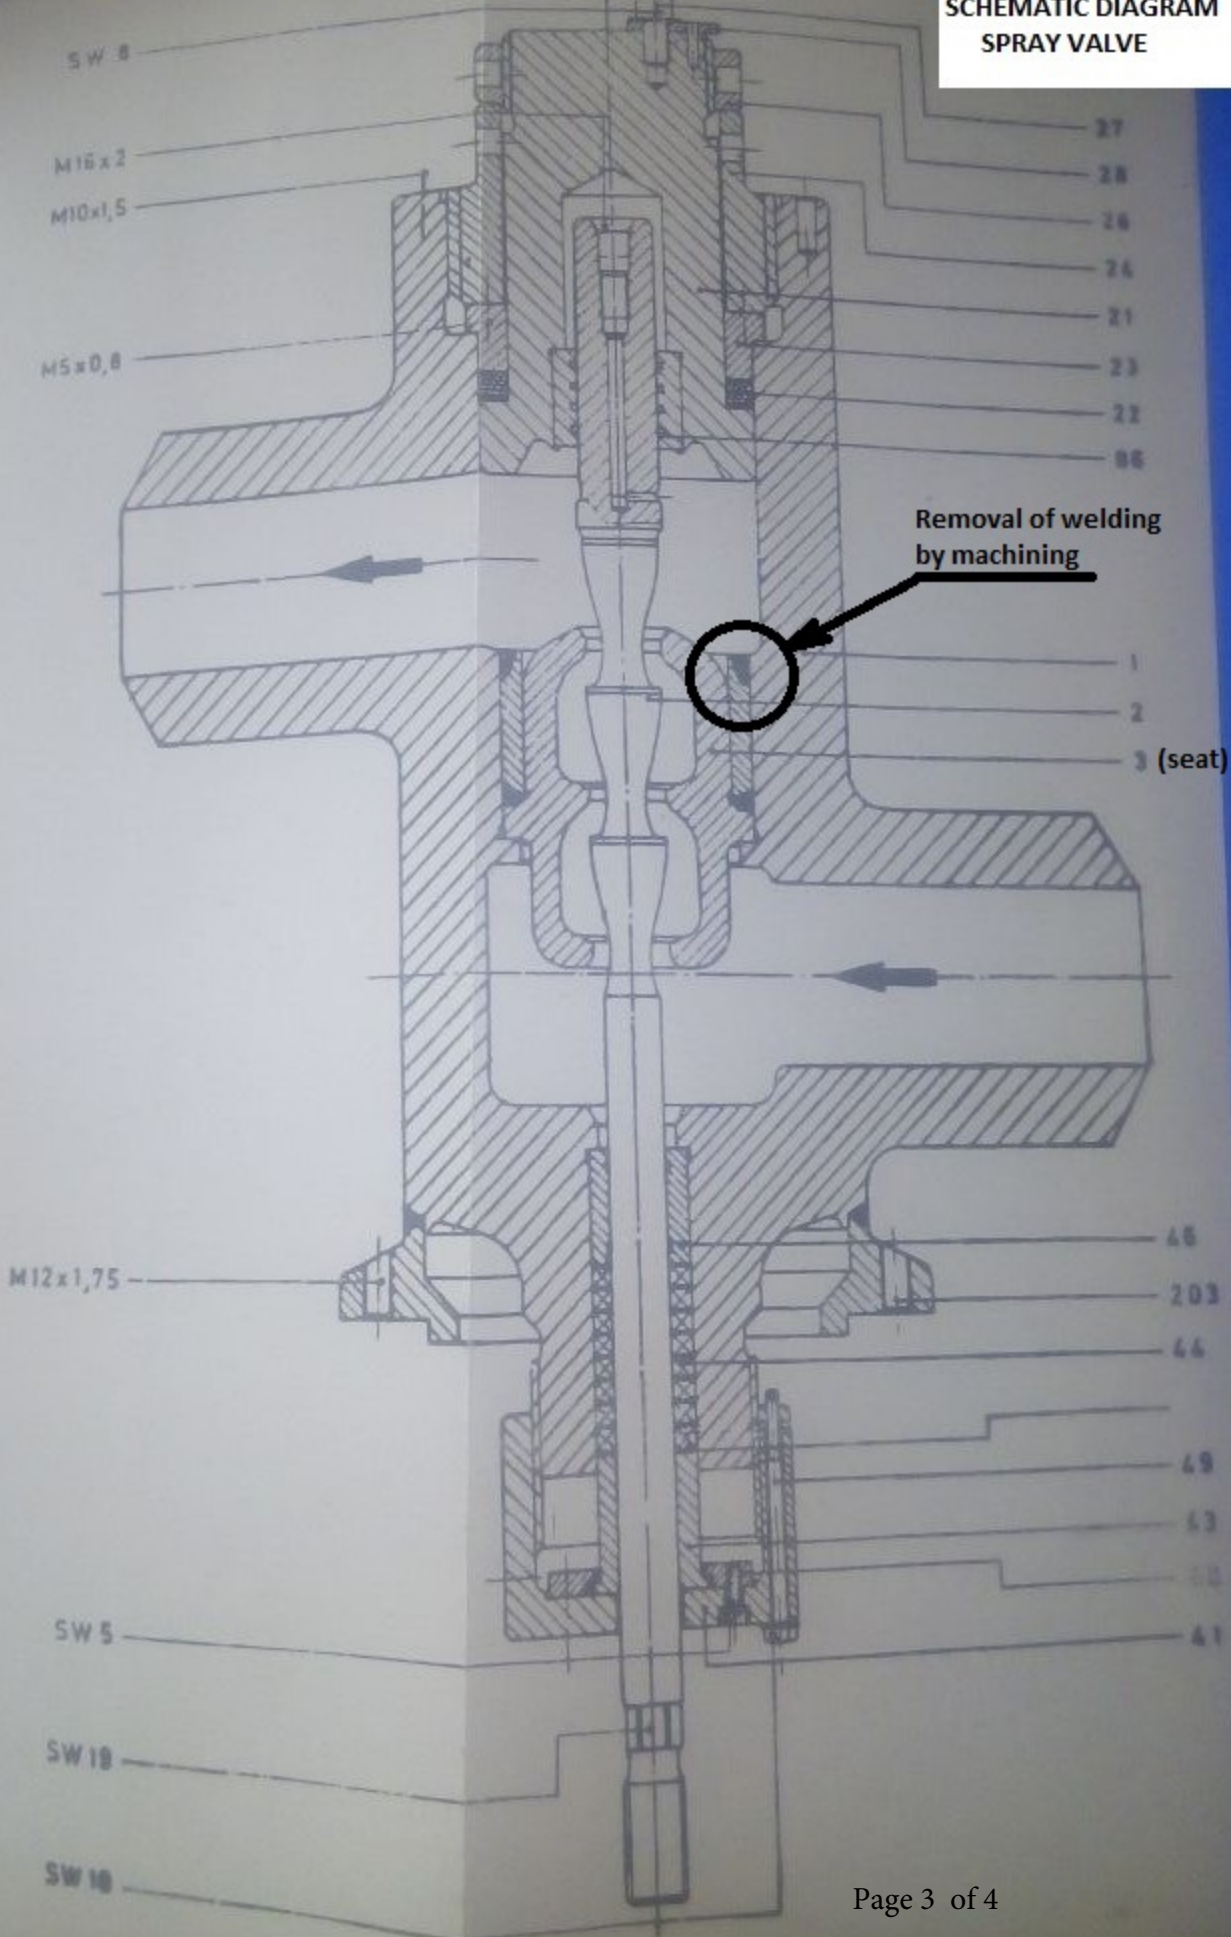

ANNEXURE - IV

**FORMAT FOR NO DEVIATION CERTIFICATE**  
**(To be submitted in the bidder's letter head)**

To,  
Bharat Heavy Electricals Limited,  
POWER SECTOR – EASTERN REGION  
2<sup>nd</sup> FLOOR, Block-DJ, Plot- 9/1, SECTOR-2  
SALT LAKE CITY, KOLKATA – 700 091  
FAX – 033-23211960

**Sub: NO DEVIATION CERTIFICATE FOR TENDER FOR RATE CONTRACT FOR “IN-SITU SEAT CUTTING/REPAIRING/REPLACEMENT OF SEAT OF BHEL/SUZLER MAKE HP BYPASS MAIN VALVES AND HPBP SPRAY VALVES DURING OVERHAULING OF 200/210/250/500/550 MW TG SETS” AT BHEL-PSER.**

**Tender No. PSER: PUR: SAS: RC-S221:16 (ENQ:16:PP:0015:PUR:26) DATE: 13/05/2016 along with TCN-01 DTD. 31/05/2016.**

Dear Sirs,

**With** reference to above, this is to confirm that as per tender conditions, we have visited site before submission of our offer and noted the job content & site conditions etc. We also confirm that we have not changed/modified the tender documents as appeared in the website/newspapers and in case of observance at any stage, it shall be treated as null and void.

**We** hereby confirm that we have not taken any deviation from tender clauses together with other references as enumerated in the above referred NIT *and confirm our acceptance to **reverse auctioning process*** and we hereby convey our unqualified acceptance to all terms and conditions as stipulated in the tender and NIT.

In the event of observance of any deviation in any part of our offer at a later date whether implicit or explicit, the deviations shall stand null & void.

We confirm to have submitted offer strictly in accordance with tender instructions.

Thanking you,

Yours faithfully,

(Signature, date & seal of authorized representative of the contractor)