



भारत हेवी इलेक्ट्रिकल्स लिमिटेड

(भारत सरकार का उपक्रम)

BHARAT HEAVY ELECTRICALS LIMITED

(A Govt. of India Undertaking)

TCN – 04

Ref: PSER:SCT:DPL-C1154:TCN-04

Date: 22-01-2011

Sub	Tender change notice (TCN) 04.	
Job	Construction of 220M high RCC single flue brick lined chimney including supply, erection, commissioning etc of equipments/ material, complete, for 1x250 MW unit at DPL, Durgapur.	
Ref	1.0	Tender no PSER:SCT:DPL-C1154:10.
	2.0	BHEL's NIT, vide reference no PSER:SCT:DPL-C1154:2435, dated 15-12-10.
	3.0	BHEL's TCN-01, vide reference no PSER:SCT:DPL:C1154:TCN-01, dated 01-01-11.
	4.0	BHEL's TCN-02, vide reference no PSER:SCT:DPL:C1154:TCN-02, dated 11-01-11.
	5.0	BHEL's TCN-03, vide reference no PSER:SCT:DPL:C1154:TCN-03, dated 14-01-11.
	6.0	All other pertinent issues till date.

With reference to above, following points/ documents, relevant to tender, may please be noted and complied with while submitting offer.

- 1.0 Chimney GA drawing, no PE-DG-360-620-C001, Rev-A for tender purpose only as per enclosed Annexure-A.
- 2.0 Revised 'No deviation certificate' as per enclosed Annexure-2. Bidder shall submit no deviation certificate as per enclosed format only.
- 3.0 All other terms & conditions shall remain unchanged.

In case offer has already been sent, bidder may take back the offer & submit new offer or submit supplementary offer.

Thanking you,

Yours faithfully,
for BHARAT HEAVY ELECTRICALS LTD

SDGM (SCT)

Encl










- 1.0 As above.

पावर सेक्टर पूर्वी क्षेत्र (मुख्यालय)


POWER SECTOR EASTERN REGION, DJ-9/1, SECTOR-II, SALT LAKE CITY, KOLKATA - 700 091

फैक्स/Fax : (033) 23211960




फोन/Phone : बोर्ड/EPABX : 23211691, 23211798, 23211796

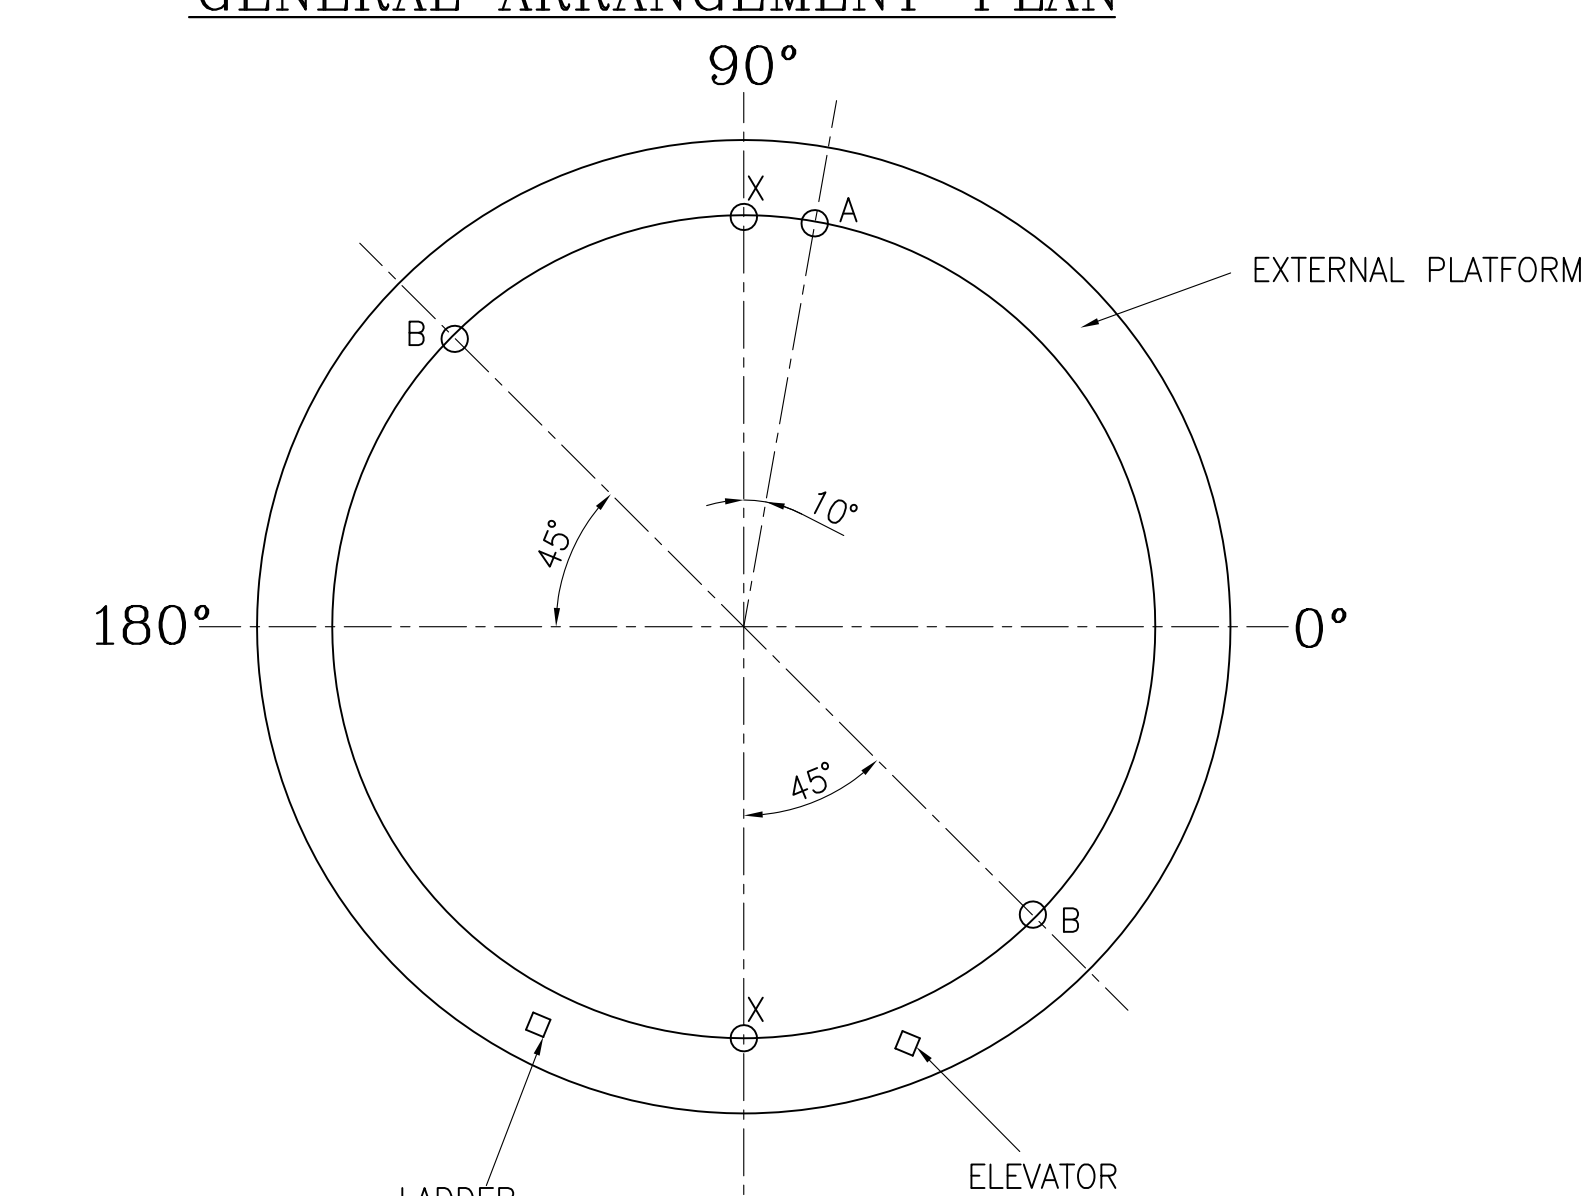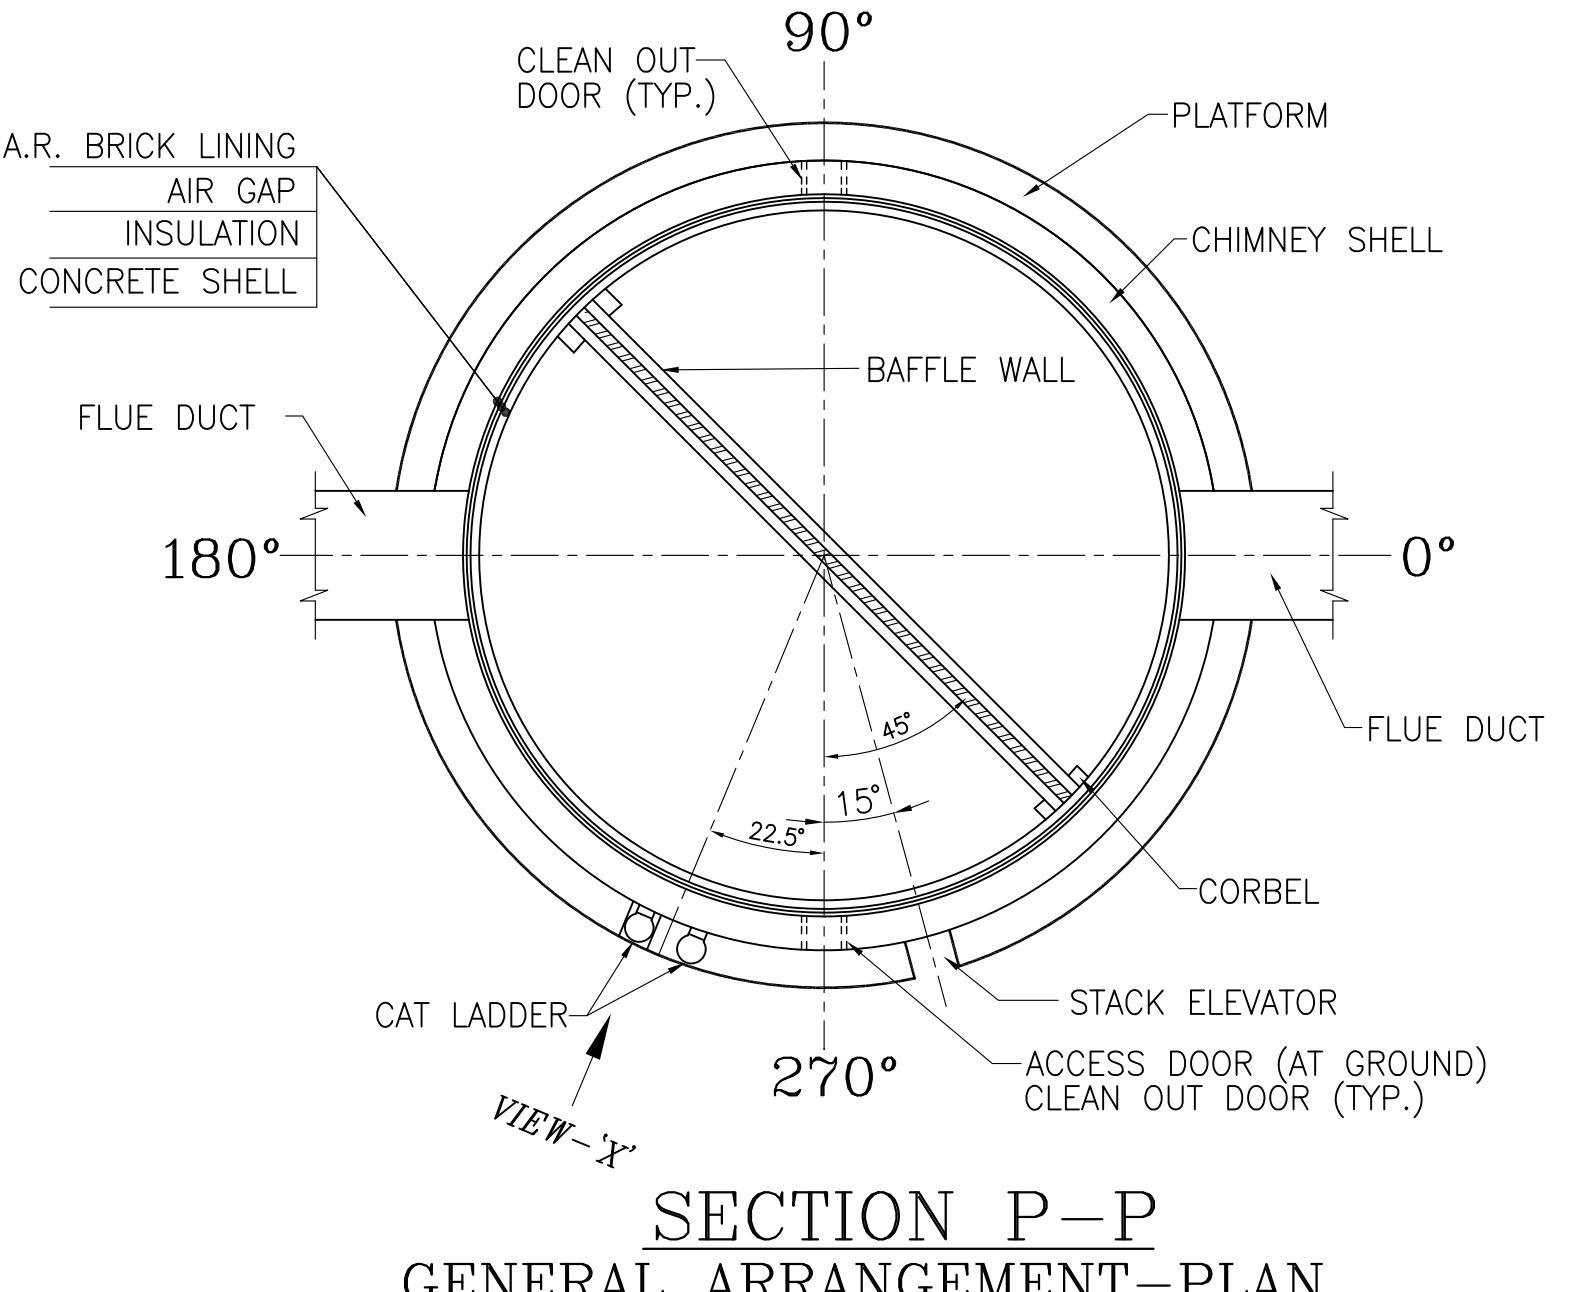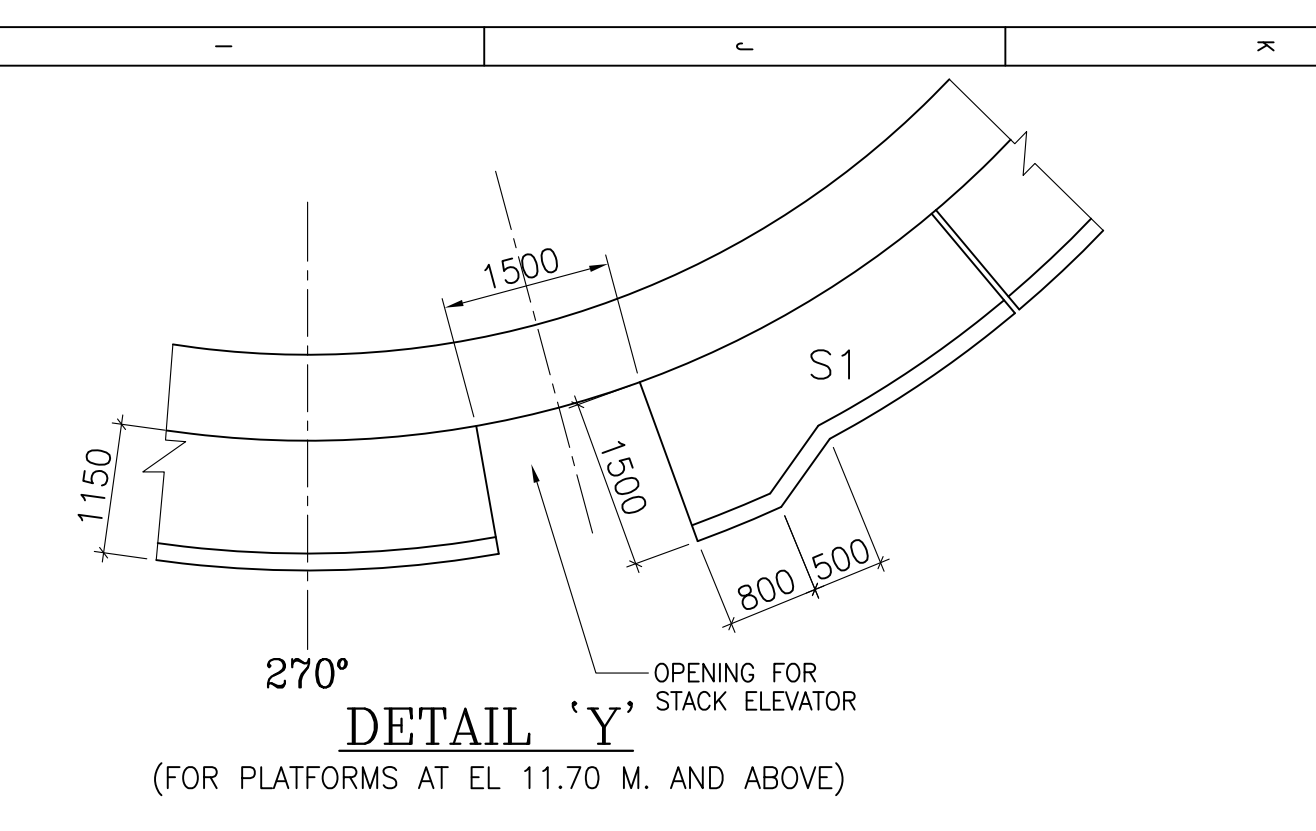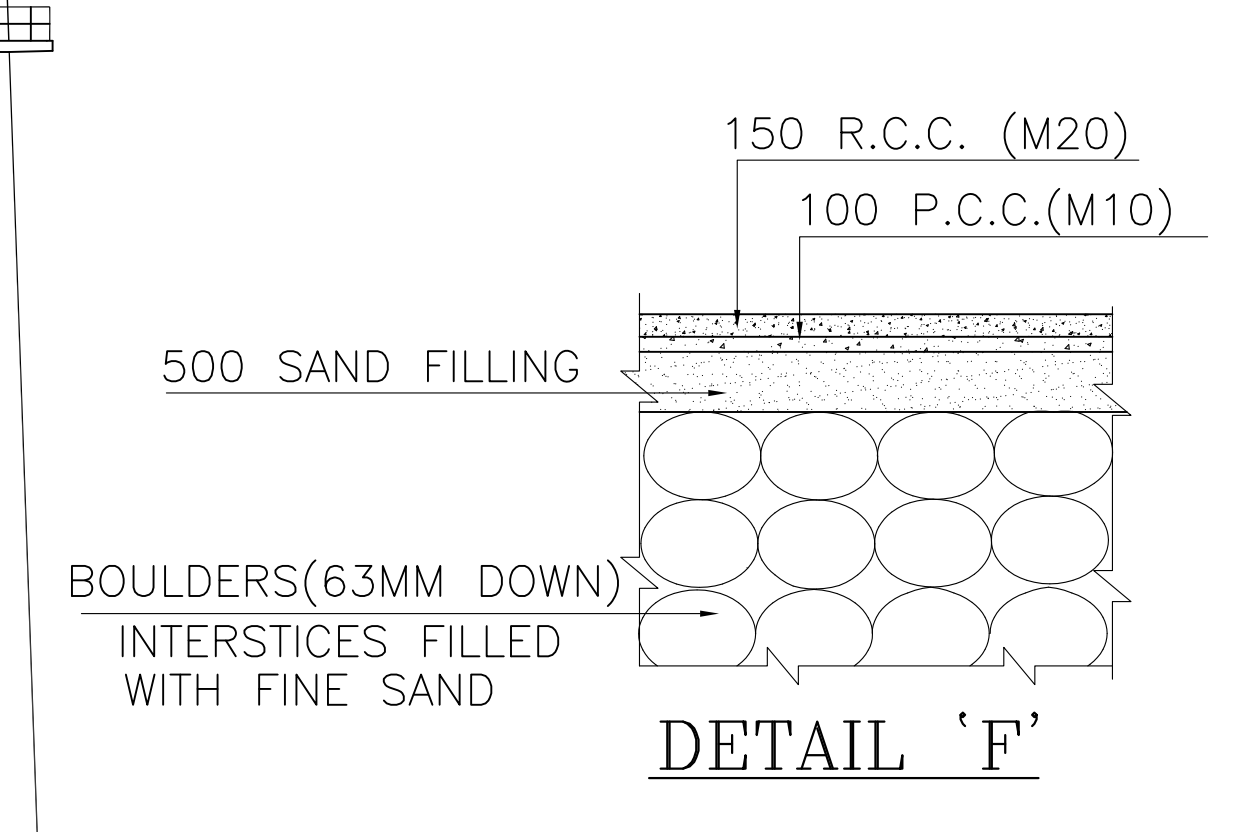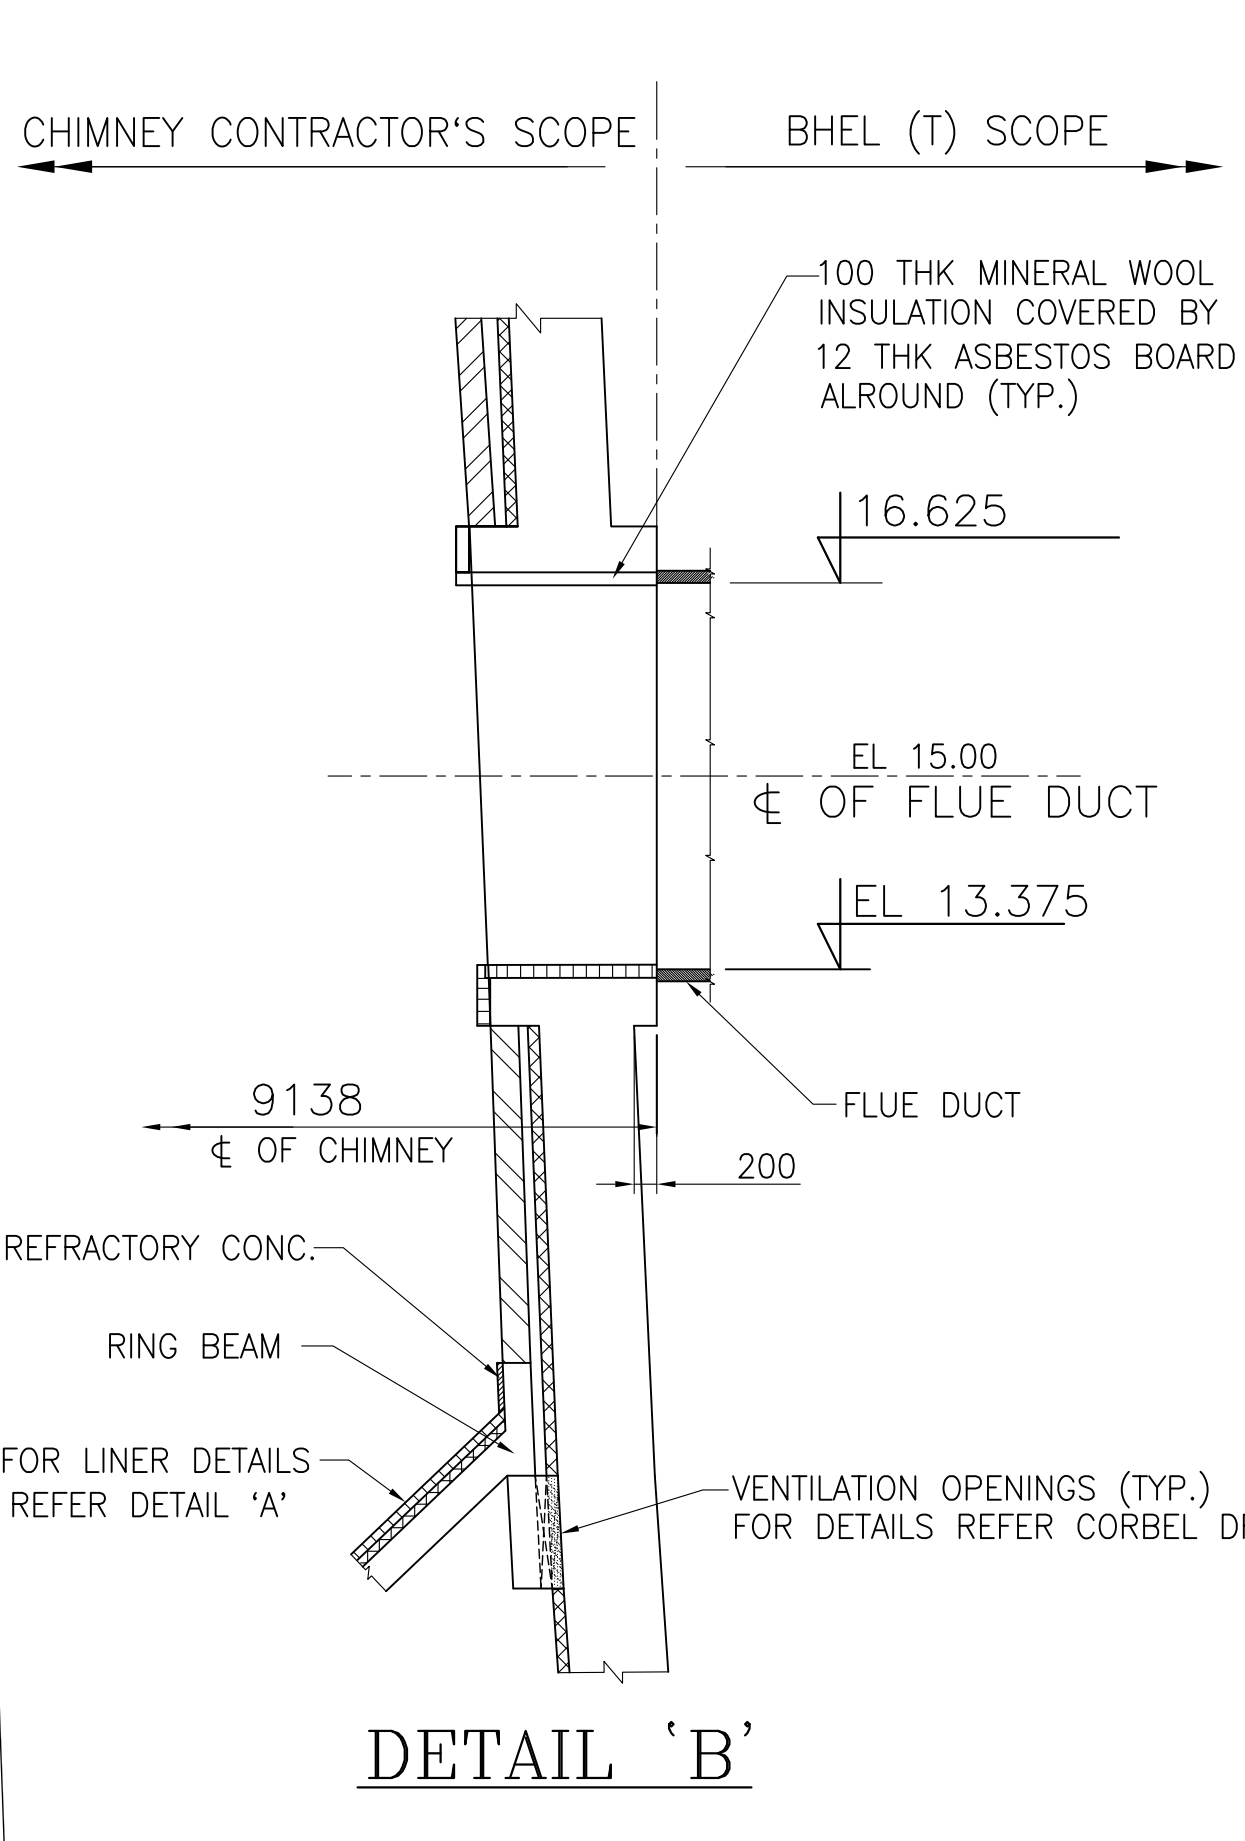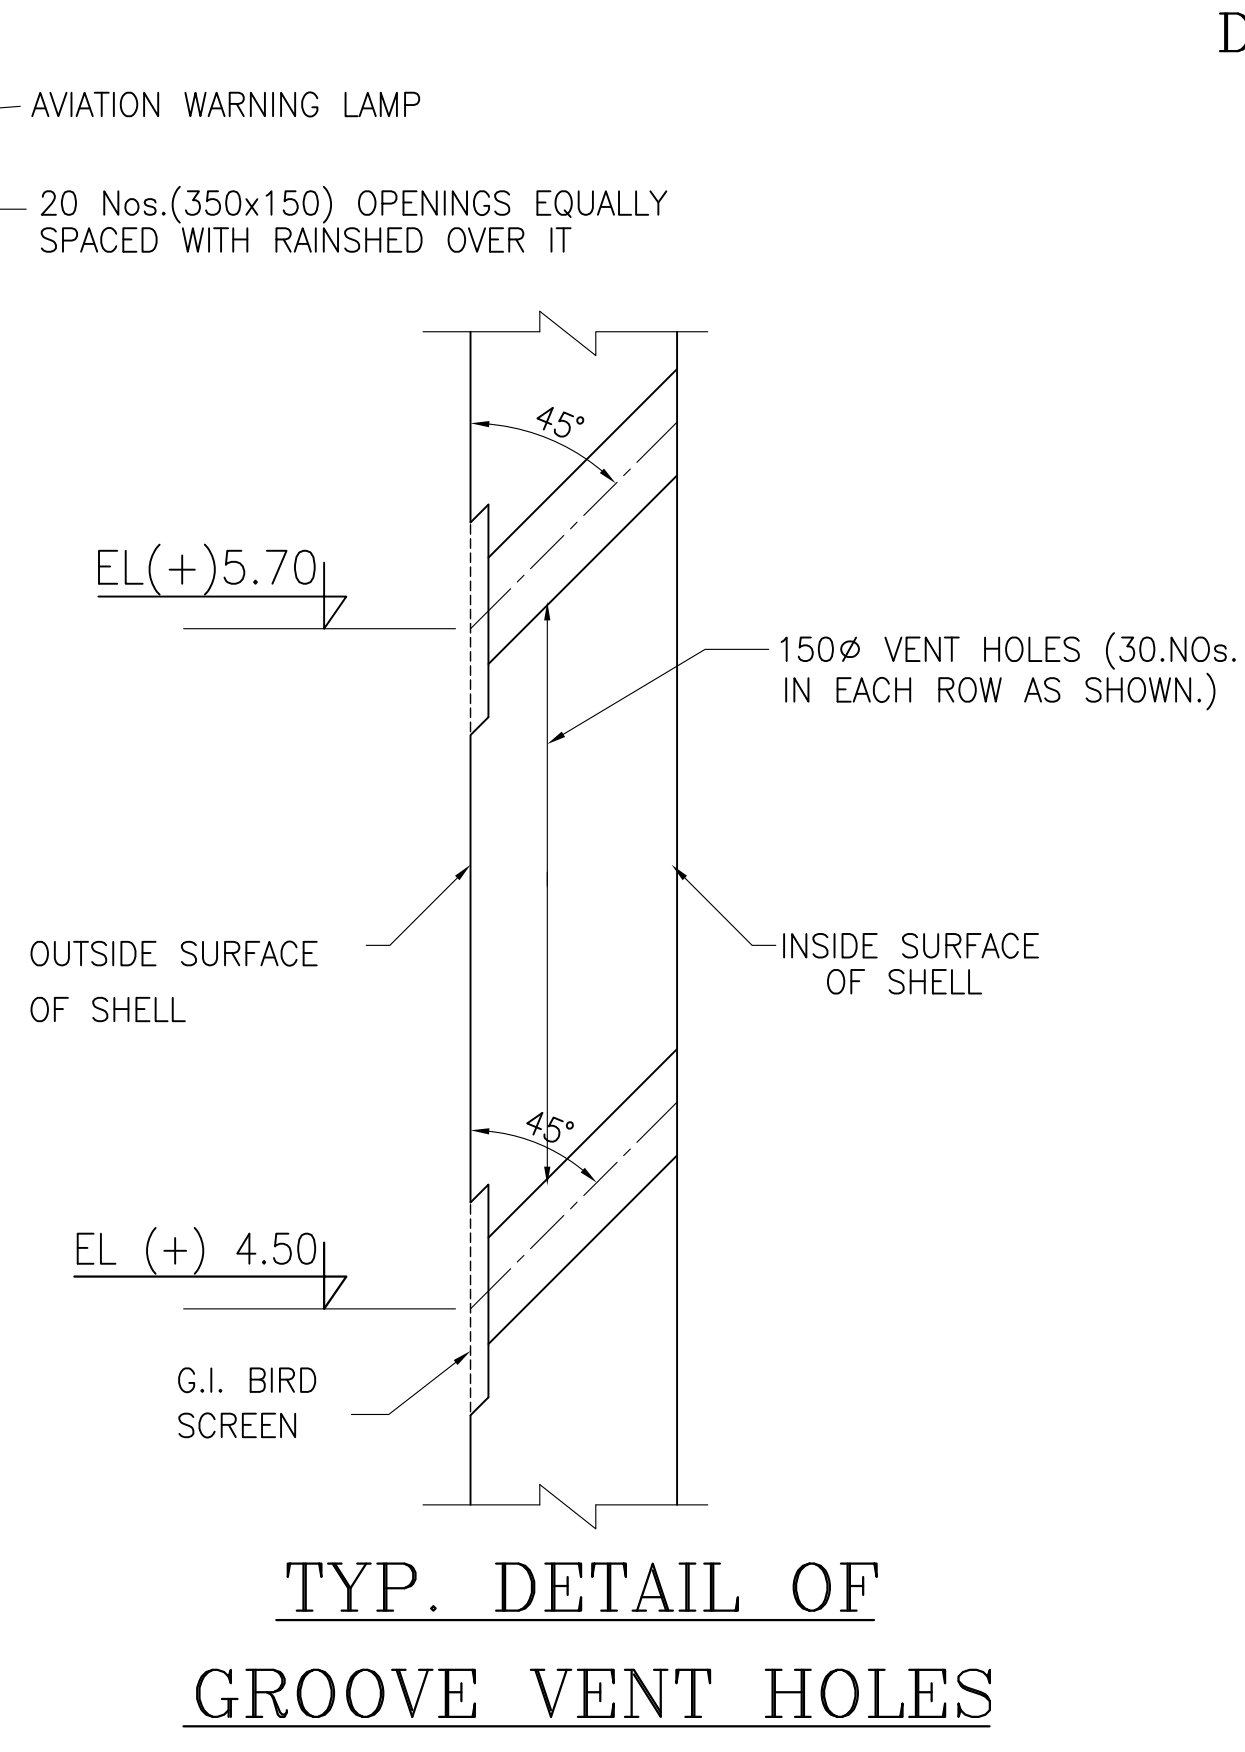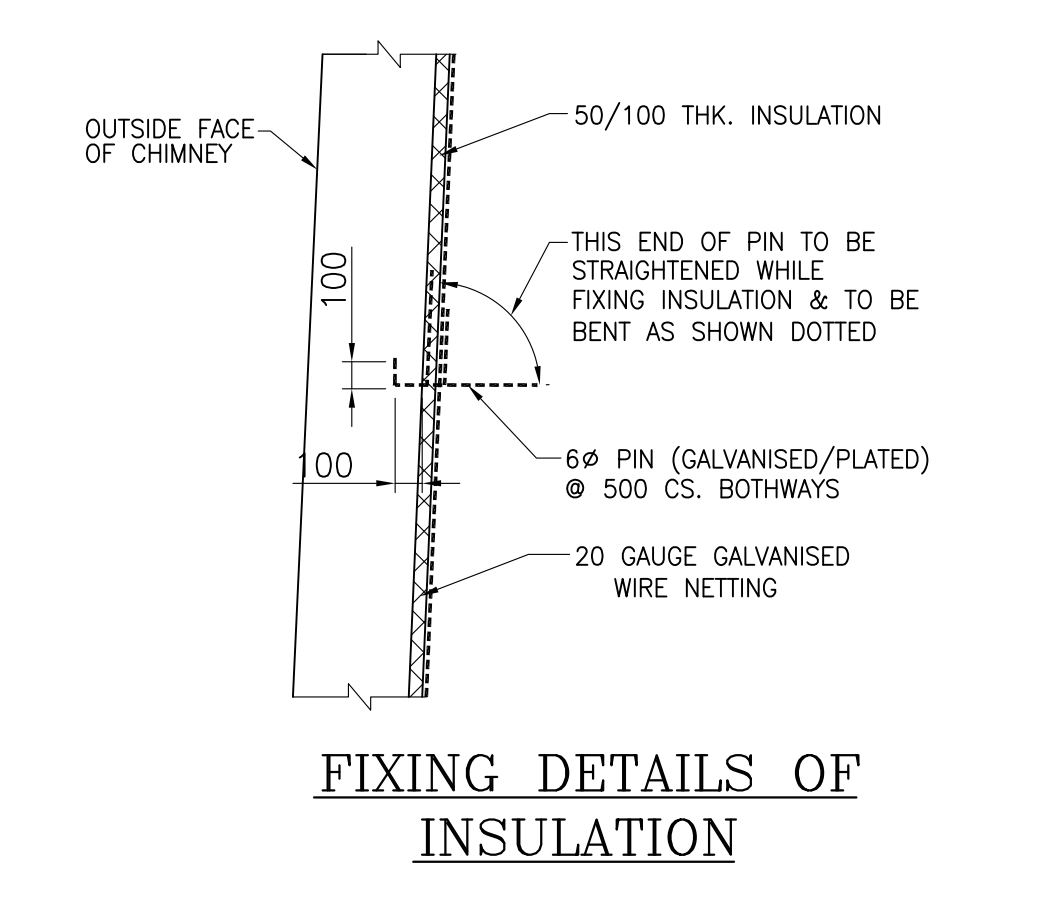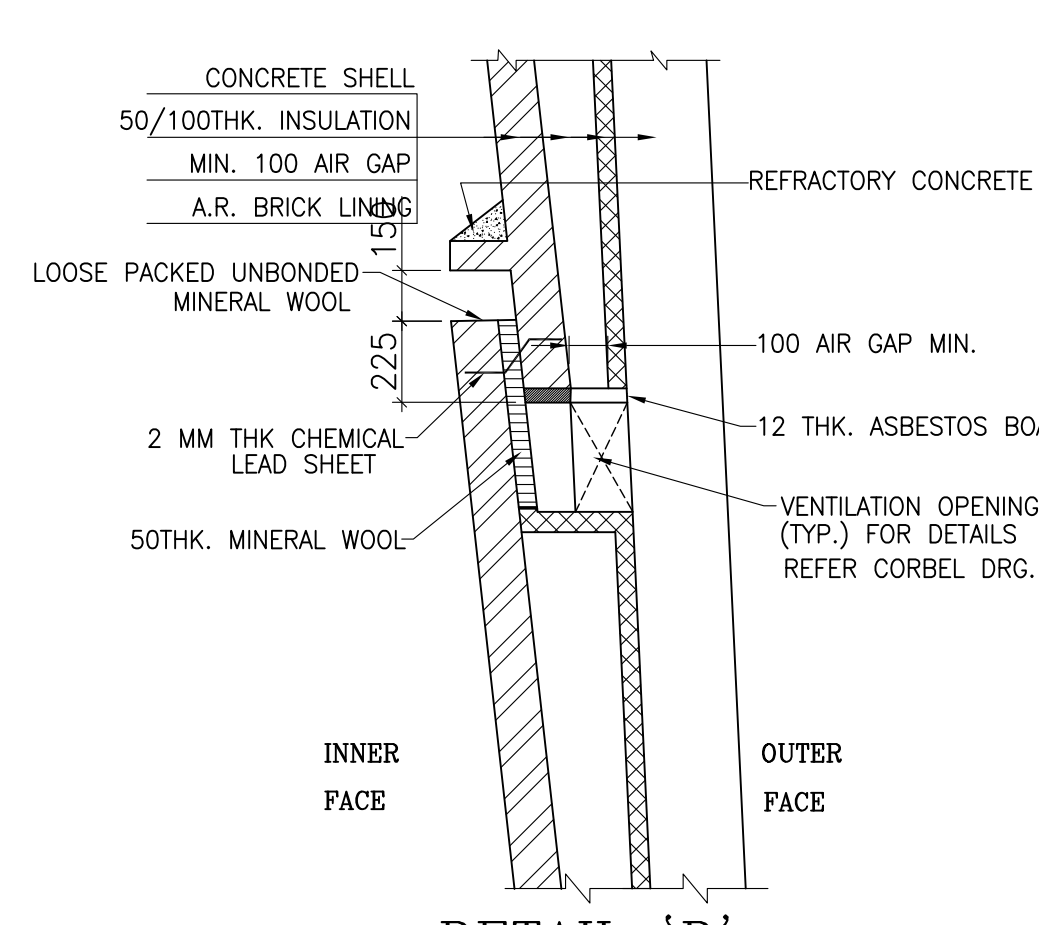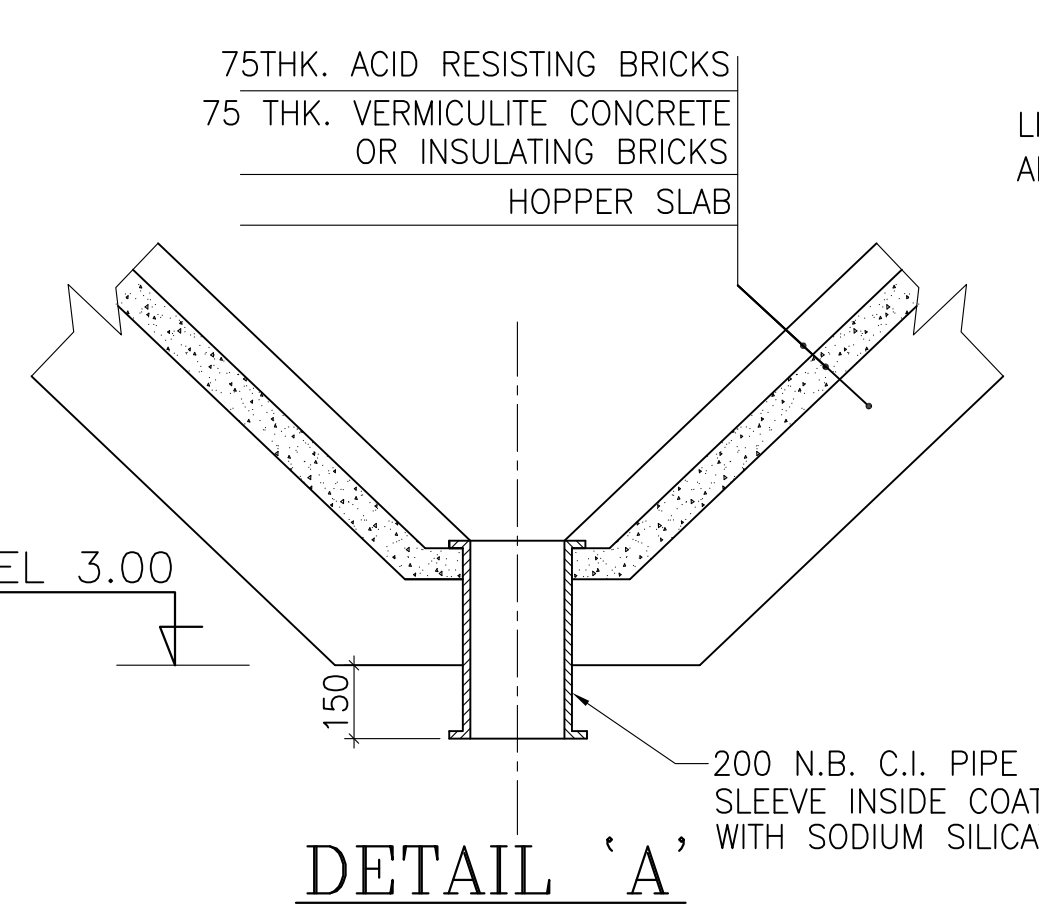

FOR DETAILS REFER DRG. NO. PE-DG-360-620-C014
X- PORT FOR SMOKE DENSITY/DUST ANALYSER AT EL(+).121.5 M.
A- PORT FOR TEMPERATURE SENSOR AT 121.5 M
B- SO₂/NO_x/CO/CO₂ ANALYSER/PORTS AT EL(+).81.20 M

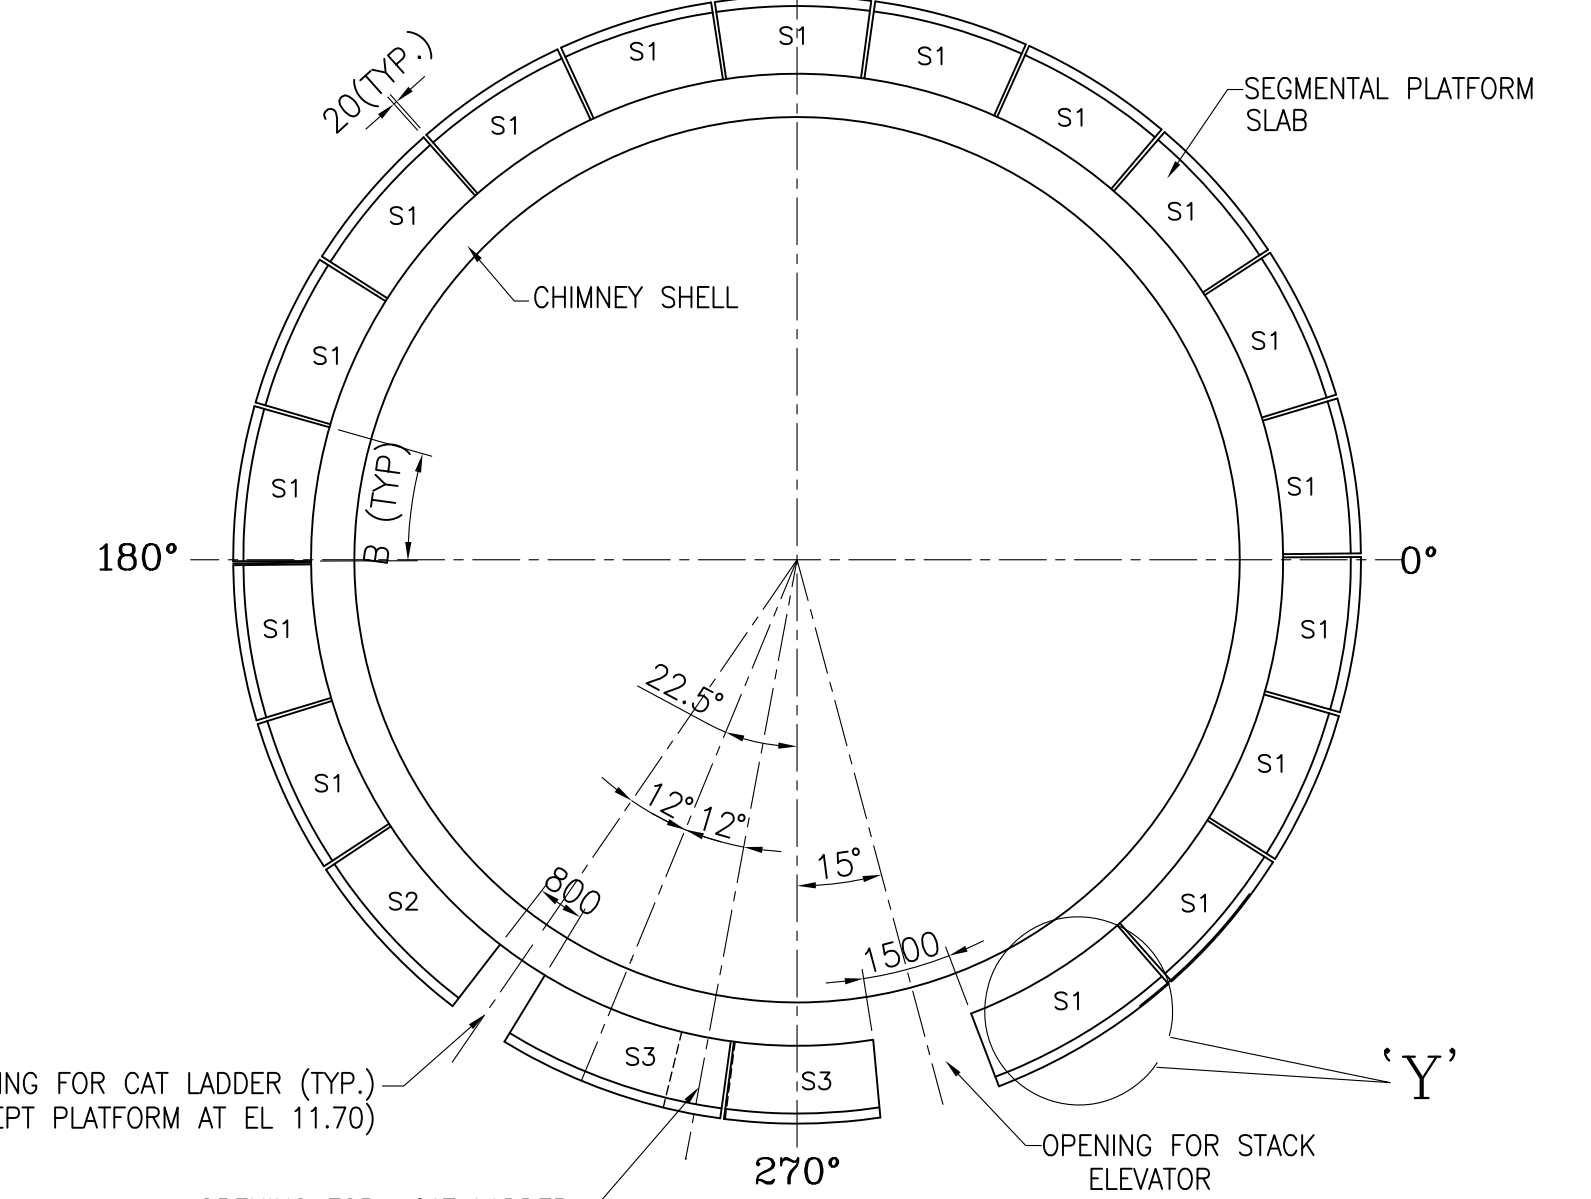

FOR DETAILS OF LADDER REFER DRG. NO. PE-DG-360-620-C012
CLEAR WIDTH OF PLATFORM AT ALL LEVEL EXCEPT 40.80 & 120 M. LEV. = 1000 MM
CLEAR WIDTH OF PLATFORM AT 40.80 & 120 M. LEV. = 1500 MM

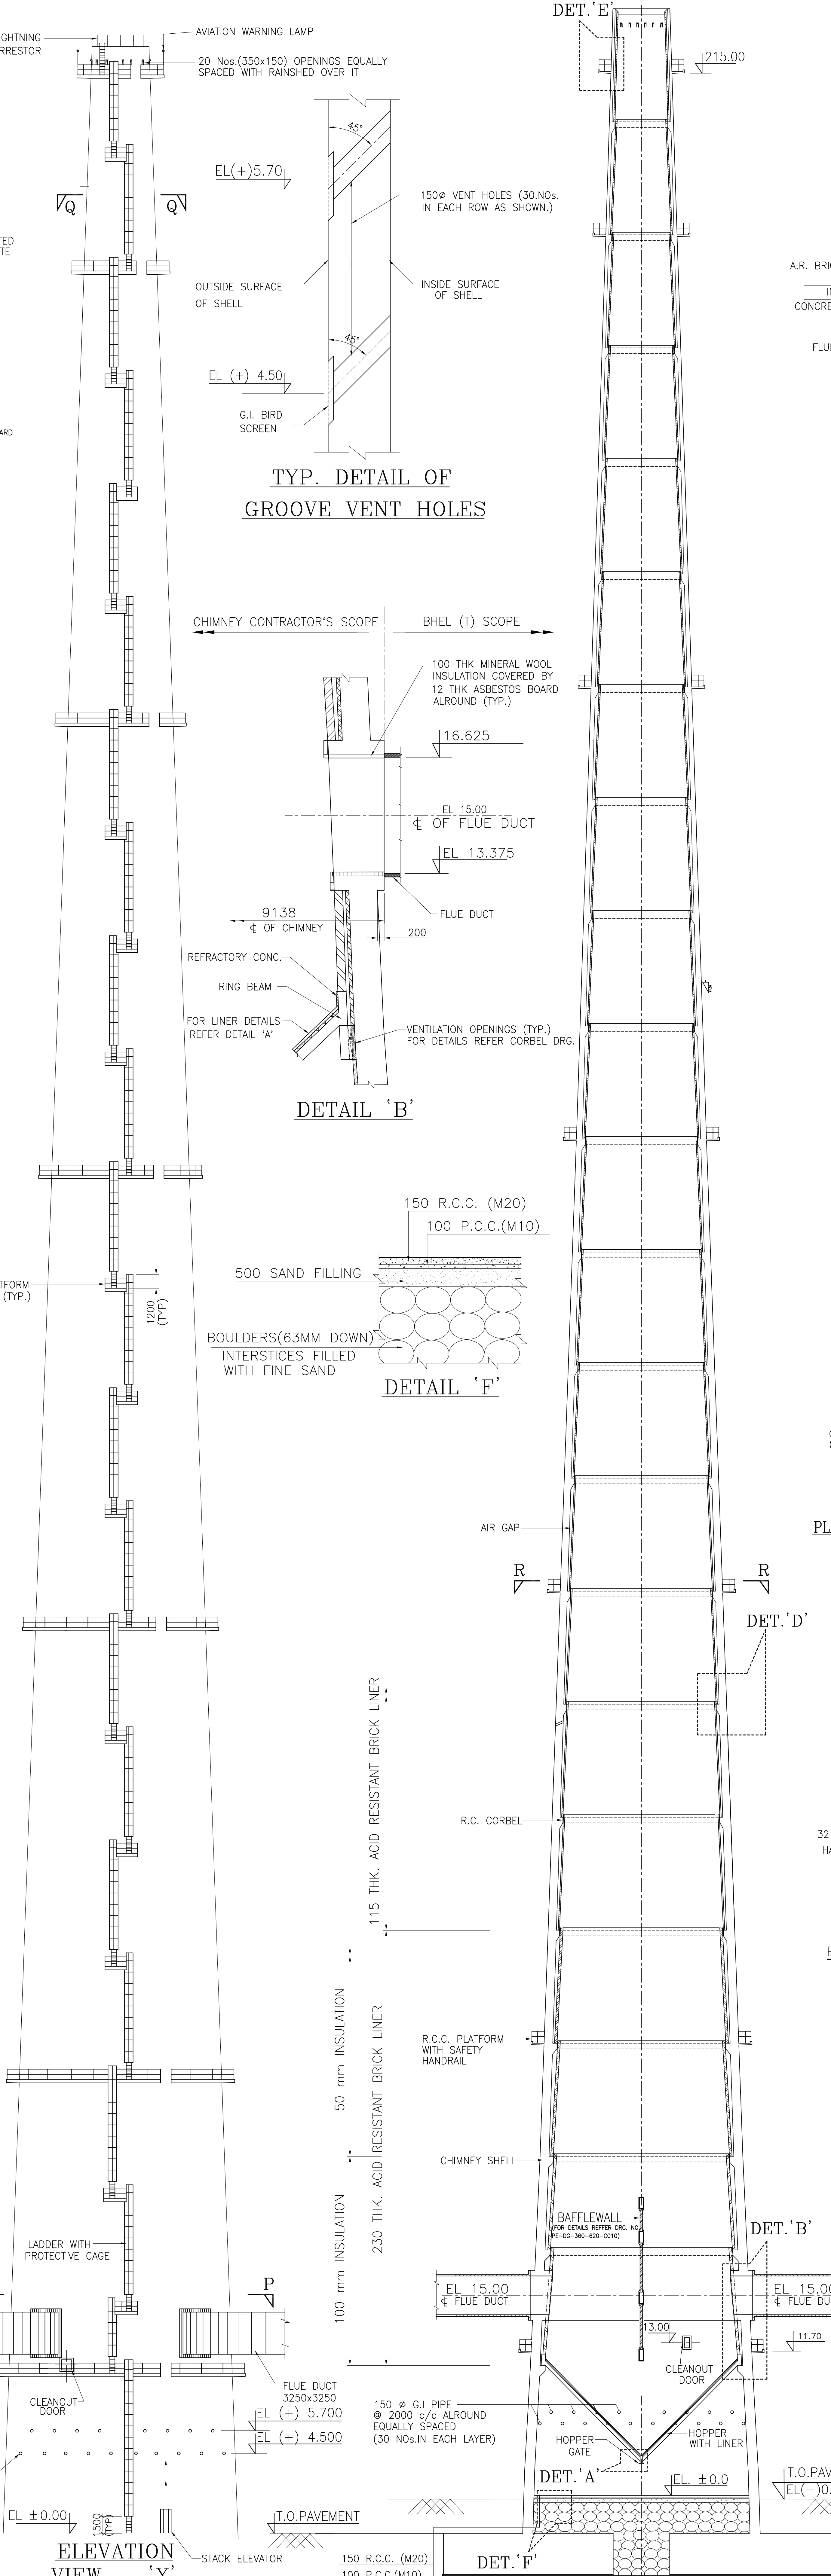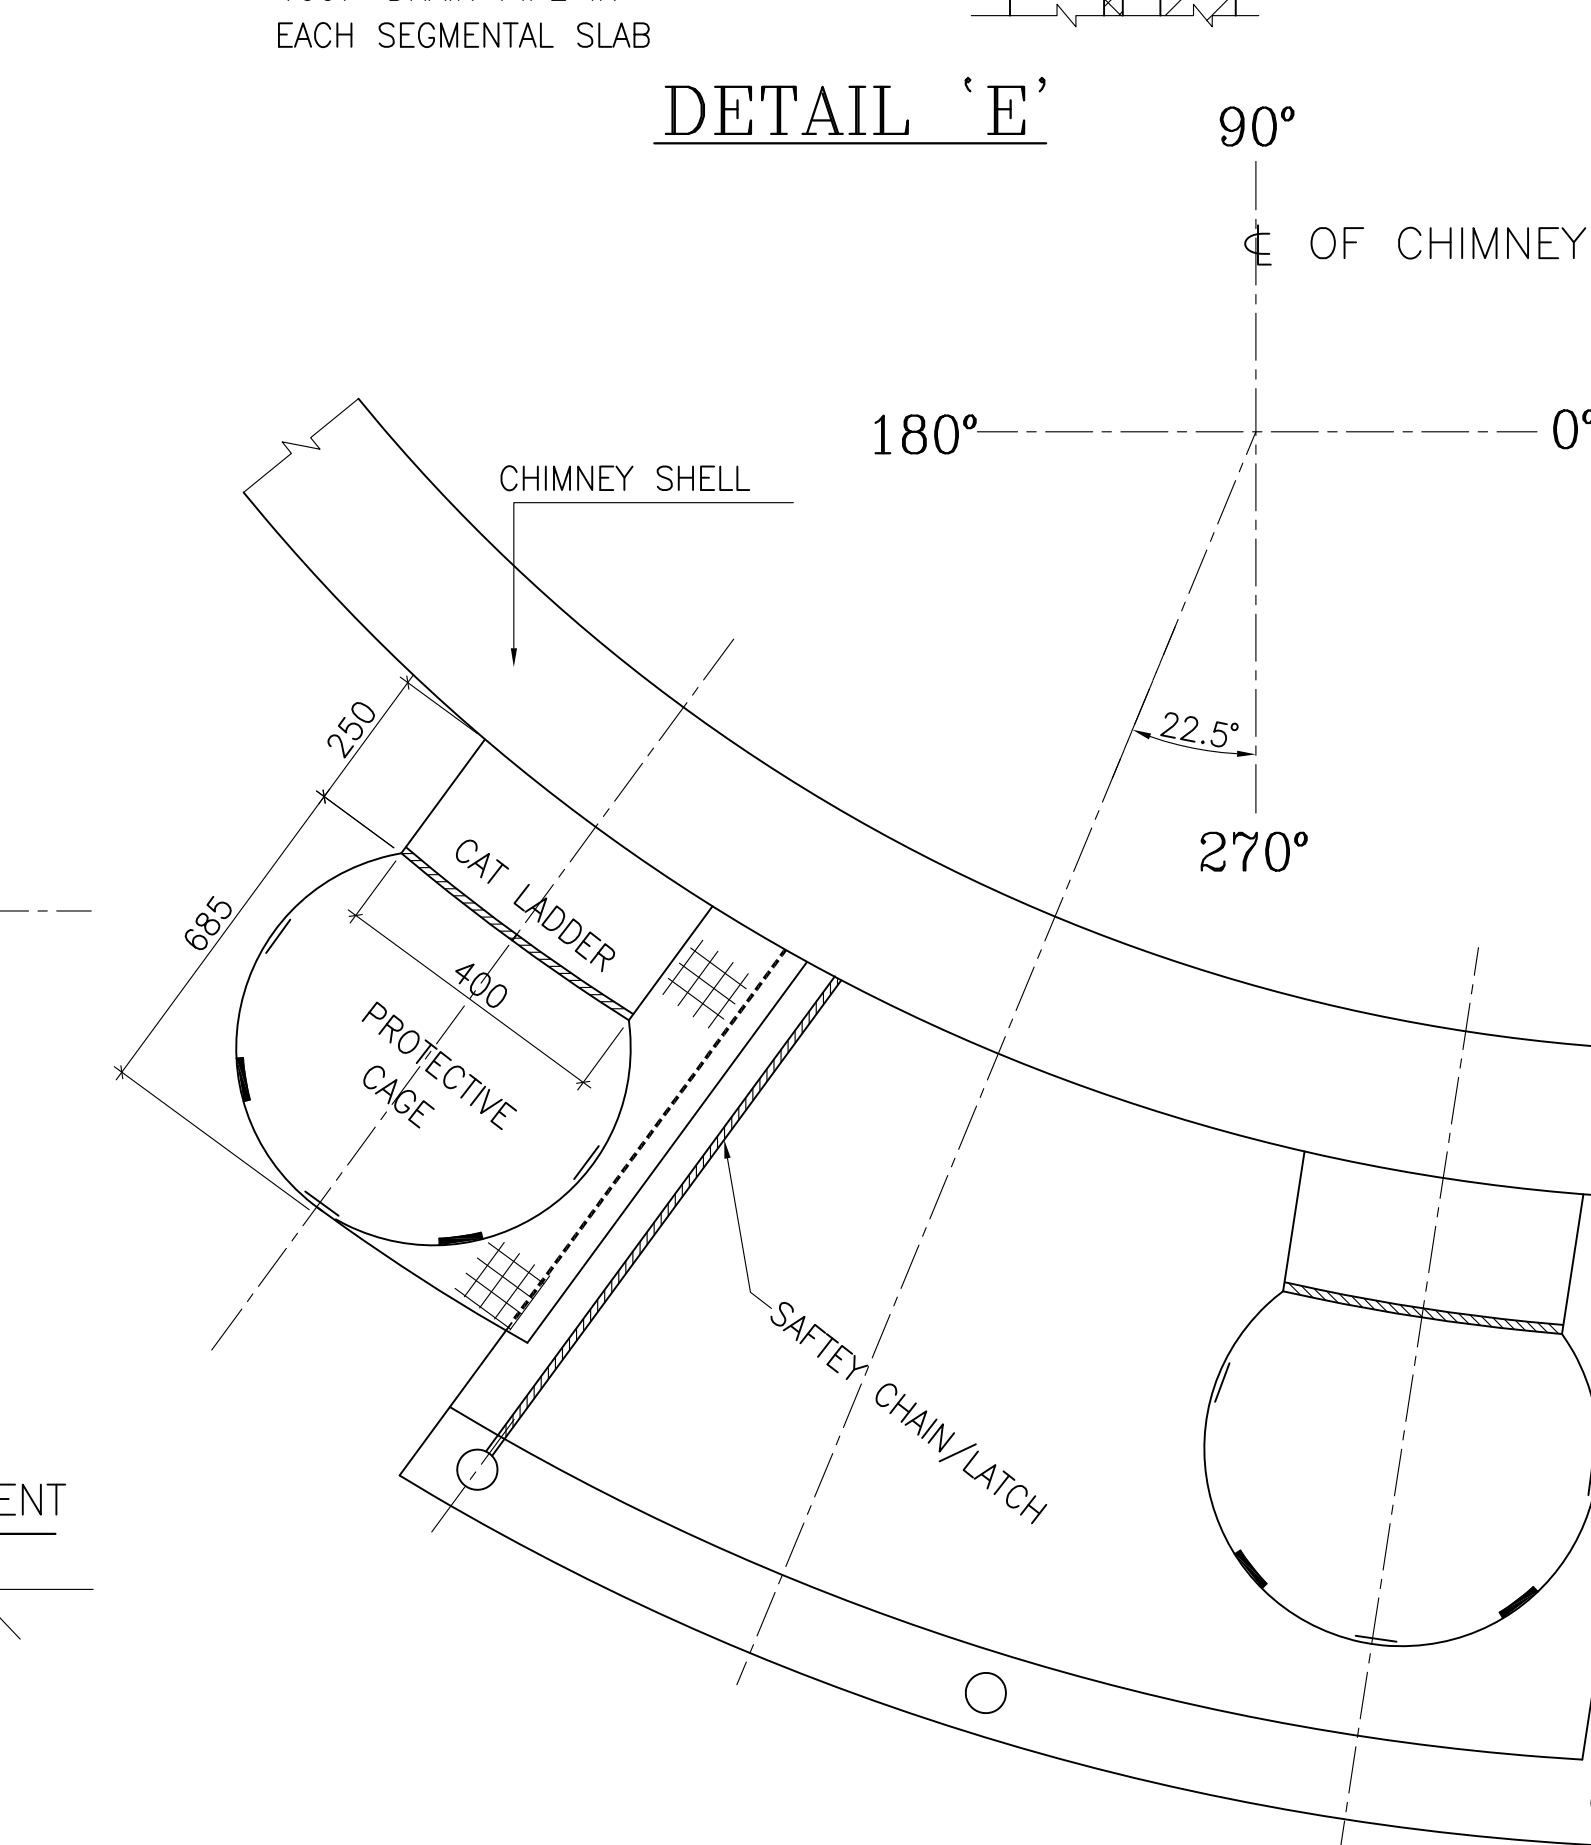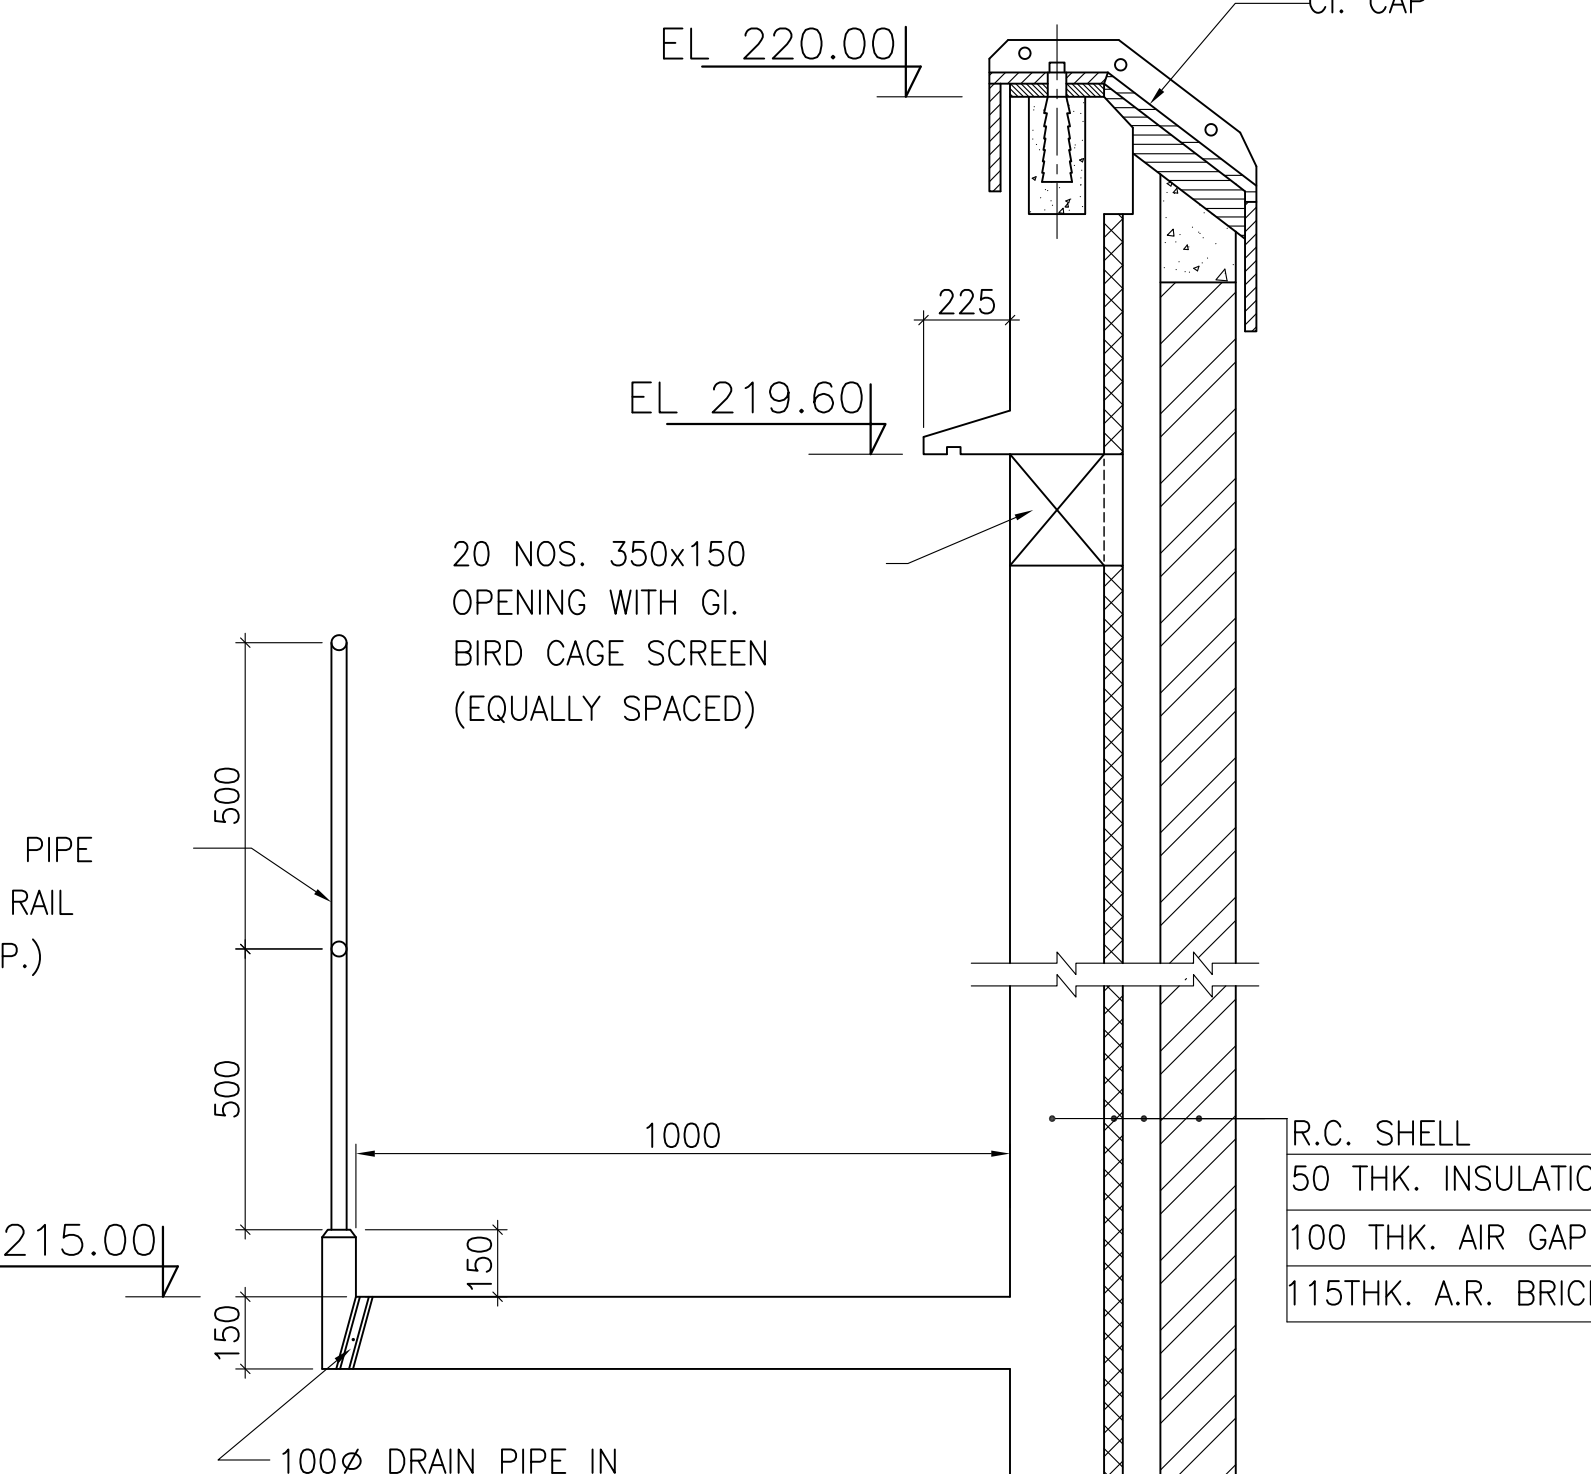

FOR TENDER PURPOSE ONLY

NOTES:-

1. ALL DIMENSIONS ARE IN MM AND LEVELS ARE IN M.(DIMENSIONS NOT TO BE SCALED)
2. THIS DRG. SHOWS THE FINALLY DESIGNED GEOMETRIC & GENERAL ARRANGEMENT OF THE CHIMNEY CONFORMING TO IS:4998-1992
3. EL. ±0.00 CORRESPONDS TO R.L. 82.00 M.

OWNER	DURGAPUR PROJECTS LIMITED (DPL)
CLIENT	DURGAPUR PROJECTS POWER STATION UNIT-8 (1x250 MW)
CONSULTANT	DEVELOP CONSULTANTS PVT. LTD.
ENGINEER	KOLKATA, WEST BENGAL.
CONTRACTOR	BHARAT HEAVY ELECTRICALS LTD.
PROJECT ENGINEERING	POWER SECTION
PROJECT NO.	360
SCALE	1:100
DRAWING NO.	PE-DG-360-620-C001
DATE	10/01/2011

F64-5
F64-4
F64-3
F64-2
F64-1
 SHEET 1 OF 1
 Jan 22, 2011 - 2:50pm
 P:\MKTG\360-620-C001

FORMAT FOR NO DEVIATION CERTIFICATE
(To be submitted in the bidder's letter head)

BHARAT HEAVY ELECTRICALS LIMITED,
 Power Sector - Eastern Region,
 Plot no 9/1, DJ Block, Sector – II, Salt Lake City,
Kolkata – 700 091

Sub	No Deviation Certificate.	
Job	Construction of 220M high RCC single flue brick lined chimney including supply, erection, commissioning etc of equipments/ material, complete, for 1x250 MW unit at DPL, Durgapur.	
Ref	1.0	Tender no PSER:SCT:DPL-C1154:10.
	2.0	BHEL's NIT, vide reference no PSER:SCT:DPL-C1154:2435, dated 15-12-10.
	3.0	BHEL's TCN-01, vide reference no PSER:SCT:DPL-C1154:TCN-01, dated 01-01-11.
	4.0	BHEL's TCN-02, vide reference no PSER:SCT:DPL-C1154:TCN-02, dated 11-01-11.
	5.0	BHEL's TCN-03, vide reference no PSER:SCT:DPL-C1154:TCN-03, dated 14-01-11.
	6.0	BHEL's TCN-04, vide reference no PSER:SCT:DPL-C1154:TCN-04, dated 22-01-11.
	7.0	All other pertinent issues till date.

Dear Sirs,

With reference to above, this is to confirm that as per tender conditions, we have visited site before submission of our offer and noted the job content & site conditions etc. We also confirm that we have not changed/ modified the tender documents as appeared in the website/ issued by you and in case of such observance at any stage, it shall be treated as null and void.

We hereby confirm that we have not taken any deviation from tender clauses together with other references as enumerated in the above referred NIT. We hereby confirm our unqualified acceptance to all terms & conditions, unqualified compliance to technical specification, integrity pact (if applicable) and acceptance to reverse auctioning process.

In the event of observance of any deviation in any part of our offer at a later date whether implicit or explicit, the deviations shall stand null & void.

We confirm to have submitted offer in accordance with tender instructions and as per aforesaid references.

Thanking you,

Yours faithfully,

(Signature, date & seal of authorized
representative of the bidder)

<p>पावर सेक्टर पूर्वी क्षेत्र (मुख्यालय) POWER SECTOR EASTERN REGION DJ-9/1, SECTOR-II, SALTLAKE CITY, KOLKATA - 700 091 फैक्स/Fax : (033) 23211960 फोन/Phone : बोर्ड/EPABX : 23211691, 23211798, 23211796</p>
--