

**400 MW, MARIB GTPS, PHASE-II.**  
**PUBLIC ELECTRICITY CORPORATION, MINISTRY OF**  
**ELECTRICITY AND ENERGY, REPUBLIC OF YEMEN.**

**VOLUME: IIB & III.**


**TECHNICAL SPECIFICATION**  
**FOR**  
**SEWAGE TREATMENT PLANT**

**SPECIFICATION NO.: PE-TS-372-673-A001**



**BHARAT HEAVY ELECTRICALS LIMITED**


**POWER SECTOR**  
**PROJECT ENGINEERING MANAGEMENT**  
**PPEI, NOIDA, INDIA.**

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>	VOLUME <b>II-B</b>	
	<b>400 MW, MARIB GTPS, PHASE-II</b>	SECTION	
	<b>PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	REV. NO. 00	DATE:
		PAGE	

**CONTENTS- VOLUME-IIB & III**

**VOLUME-IIB**


SECTION	DESCRIPTION	PAGE NO.
SECTION – A	SCOPE OF ENQUIRY	1-3
SECTION – B	PROJECT INFORMATION	4-6
	• ANNEXURE I : ELECTRICAL DETAILS	7
SECTION – C	SPECIFIC TECHNICAL REQUIREMENT	8
	<b>SECTION – C1 : SPECIFIC TECHNICAL REQUIREMENT (MECHANICAL)</b>	9-15
	• DATA SHEET-A FOR STP	16-19
	• INDICATIVE SUB VENDOR LIST	20-25
	• P & ID OF STP	26-27
	• QUALITY PLAN –MECHANICAL (INCLUDING QAP FOR SUBMERSIBLE PUMPS)	28-33
	<b>SECTION – C2 : SPECIFIC TECHNICAL REQUIREMENT (ELECTRICAL)</b>	34
	• ELECTRICAL EQUIPMENT SPECIFICATION	35
	• ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR	36-37
	• DATA SHEET A OF MOTOR	38-39
	• ELECTRICAL LOAD DATA	40
	• CABLE SCHEDULE FORMAT	41
	<b>SECTION – C3 : SPECIFIC TECHNICAL REQUIREMENTS (CONTROL &amp; INSTRUMENTATION)</b>	42-43
SECTION – D	GENERAL TECHNICAL REQUIREMENT	44
	<b>SECTION – D1: GENERAL TECHNICAL REQUIREMENT (MECHANICAL)</b>	45-46
	• TECHNICAL SPECIFICATION OF SUBMERSIBLE PUMP	47-50
	• PAINTING REQUIREMENT	51-77
	• TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING	78-130
	• SHIPPING INSTRUCTIONS	131-140
	• INSTRUCTIONS FOR KKS NUMBERING	141-147
	<b>SECTION – D2 : GENERAL TECHNICAL REQUIREMENT (ELECTRICAL)</b>	148
	• SPECIFICATION FOR ELECTRICAL MOTORS	149-154
	• DATA SHEET C FOR MOTORS	155-158
	• SPECIFICATION FOR MISCELLENEOUS ELECTRIC REQUIREMENT	159-162
	• QUALITY PLAN FOR MOTORS	163-174

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>	VOLUME <b>II-B</b>	
	<b>400 MW, MARIB GTPS, PHASE-II</b>	SECTION	
	<b>PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	REV. NO. 00	DATE:
		PAGE	


	<b>SECTION – D3 : GENERAL TECHNICAL REQUIREMENT FOR C&amp;I</b>	175
	• TECHNICAL SPECIFICATION, DATA SHEET, QUALITY PLAN AND FAT FOR PROGRAMMABLE LOGIC CONTROLLER SYSTEM	176-197
	• TECHNICAL SPECIFICATION AND QUALITY PLAN FOR INSTRUMENTS	198-226
	• TECHNICAL SPECIFICATION FOR FIBRE OPTICAL CABLE	227-231
	• TECHNICAL SPECIFICATION, DATASHEET AND QUALITY PLAN FOR LOCAL CONTROL PANEL	232-249
	• SPECIFICATION FOR PAINT FOR C&I ITEMS	250-251
	• LIST OF DELIVERABLES REQUIRED BY C&I DEPARTMENT	252-253

**VOLUME-III**

	• SCHEDULE OF PRE-BID CLARIFICATIONS	254
	• SCHEDULE OF DEVIATIONS	255
	• COMPLIANCE CERTIFICATE	256
	• SCHEDULE OF DECLARATION	257
	• SUGGESTIVE PRICE SCHEDULE	258


	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>	VOLUME <b>II-B</b>	
	<b>400 MW, MARIB GTPS, PHASE-II PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	SECTION -A	
		REV. NO. 00	DATE:
		PAGE	

**SECTION - A**  
**(SCOPE OF ENQUIRY)**


	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>	VOLUME <b>II-B</b>	
	<b>400 MW, MARIB GTPS, PHASE-II</b>	SECTION –A	
	<b>PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	REV. NO. 00	DATE:
		PAGE	

## 1.0 SCOPE:


- 1.1 This specification is intended to cover design, engineering, manufacturing, painting, inspection & testing at manufacturer's works, complete with all accessories including start up, erection and commissioning spares, seaworthy packing, and delivery to CHA Godown Mumbai Port. In addition, the bidder's scope shall include supervision of erection and commissioning, site testing, trial run, performance demonstration for the **SEWAGE TREATMENT PLANT for 400 MW, MARIB GTPS, PHASE-II. PEC, MINISTRY OF ELECTRICITY AND ENERGY, REPUBLIC OF YEMEN.** The scope of supply shall fully cover the requirement of the Design Criteria and Technical Specification of this specification.
- 1.2 It is not the intent to specify all the details of the design & manufacture. However, the equipment shall conform in all respect to high standard of design, engineering & workmanship and shall be capable of performing the required duties in a manner acceptable to Engineer / Purchaser, who will interpret the meaning of drawing & the specification & shall be entitled to reject any work or material, which is not in full accordance herewith.
- 1.3 The bidder's scope shall also include any other services, etc. if called for in the succeeding sections of the specification.
- 1.4 Items though not specifically mentioned but needed to make the system complete as stipulated under these specifications are also to be furnished unless otherwise specifically excluded.
- 1.5 In case of any deviation / clarification, the Bidder shall indicate the same clause by clause in the deviation / clarification schedule. In the absence of the same it will be construed that the bid conform strictly to the specification.
- 1.6 General terms & conditions, instructions to the bidder and other attachments referred to elsewhere, made part of tender specification. The bidder shall be responsible for all governed by requirements stipulated hereinafter.
- 1.7 In case of any data/requirement stipulated in the drawing but not in the specification and vice-versa such data/requirement shall be deemed to be contained in both. Contradictions between drawings and specifications, if any, shall be brought to the attention of the BHEL / customer by the bidder and the correct requirement shall be obtained.
- 1.8 In the event of any conflict between two clauses of specification bidder has to point out those points in pre award stage in clarification format attached with the specification. In absence of the same BHEL / customer interpretation will prevail after award of contract during detailed engineering.
- 1.9 Deviations along with cost of withdrawal (positive or negative), if any, should be very clearly brought out clause by clause in the enclosed schedule; otherwise, it will be presumed that the vendor's offer is strictly in line with NIT specification.
- 1.10 The equipment covered under this specification shall not be dispatched unless the same have been finally inspected, accepted and shipping release issue by BHEL/Customer.

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>	VOLUME <b>II-B</b>	
	<b>400 MW, MARIB GTPS, PHASE-II PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	SECTION –A	
		REV. NO. 00	DATE:
		PAGE	

- 1.11 BHEL's / Customer's representative shall be given full access to the shop in which the equipments are being manufactured or tested and all test records shall be made available to him.
- 1.12 Bidder is required to depute his qualified personal to power station site to supervise in erection, commissioning, trial run and Performance demonstration as per BHEL requirement.
- 1.13 Unpriced copy of the price bid shall be furnished along with the technical bid. Unpriced schedule is enclosed in volume –III.
- 1.14 The omission of specific references to any component / accessory necessary for the proper performance of Sewage Treatment System shall not relieve the bidder of the responsibility of providing such facilities to complete the supply of equipment at quoted prices.

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>	VOLUME <b>II-B</b>	
	<b>400 MW, MARIB GTPS, PHASE-II PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	SECTION -B	
		REV. NO. 00	DATE:
		PAGE	

**SECTION - B  
(PROJECT INFORMATION)**

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>	VOLUME <b>II-B</b>	
	<b>400 MW, MARIB GTPS, PHASE-II</b>	SECTION -B	
	<b>PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	REV. NO. 00	DATE:
		PAGE	

1.	<b>Owner</b>	PUBLIC ELECTRICITY CORPORATION, MINISTRY OF ELECTRICITY AND ENERGY , REPUBLIC OF YEMEN
2.	<b>Project</b>	400 MW MARIB GTPS PHASE-II
3.	<b>Owner's consultant</b>	The Kuljian corporation , Philadelphia , USA
4.	<b>Location</b>	Marib , Yemen
5.	<b>Nearest Airport</b>	El Rahaba Airport (SAH), Sana'a, Yemen
6.	<b>Nearest Railway Station</b>	No rail network in Yemen
7.	<b>Access to site</b>	<p>a. <u>Through sea</u>:</p> <ul style="list-style-type: none"> <li>Distance of site: From Aden Port (Gulf of Aden): 419 Km</li> </ul> <p>b. <u>By Air</u> : Sana'a Airport</p> <ul style="list-style-type: none"> <li>Distance from site : 172 Km</li> </ul>
8.	<b>Site data</b>	
<b>A</b>	<b>Altitude</b>	1100 m above Mean Sea Level
<b>B</b>	<b>Ambient Air Temperature</b>	45 °C
<b>C</b>	<b>RELATIVE HUMIDITY</b>	
	Design Relative Humidity	60%
<b>D</b>	<b>RAINFALL</b>	
1.	Average Rainfall per annum	< 100 mm
<b>E</b>	<b>WIND VELOCITY &amp; PRESSURE</b>	
1.	Max. Design Wind Velocity	120 km/h
2.	Max. Barometric Pressure	1023.6 mbar
	Barometric Pressure at sea level	887.7 mbar
<b>F</b>	<b>SEISMIC ZONE</b>	UBC 1997,Zone-2 A
<b>9.0</b>	Design Ambient temperature for Gas Turbine &	



TITLE:  
**TECHNICAL SPECIFICATION FOR  
SEWAGE TREATMENT PLANT**  
  
**400 MW, MARIB GTPS, PHASE-II  
PEC, MINISTRY OF ELECTRICITY AND  
ENERGY REPUBLIC OF YEMEN**

BHEL DOCUMENTS NO.: PE-TS-372-673-A001  
VOLUME **II-B**  
SECTION -B  
REV. NO. 00      DATE:  
PAGE

<b>A</b>	Mechanical equipment	45 °C
<b>B</b>	Design Ambient temperature of electrical equipment	50 °C
<b>10.0</b>	Electrical Details	Refer attached Annexure-I

**ANNEXURE - I**

**Electrical Power Sources and Equipment Voltage Rating**

- i. 400,000±10% Volts, 3-phase, 50 Hz, solidly grounded system.
- ii. 33,000±10% Volts, 3-phase, 50 Hz, solidly grounded system.
- iii. 6600±10% volts, 3-phase, 50 Hz, low resistance grounded system.
- iv. 400±10% volts, 3-phase, 50 Hz, solidly grounded system
- v. 230±10% volts, 1-phase, 50 Hz, (PH/N of 400 volt) for lighting, receptacles and small power
- vi. AC 230 ± 5% volts, 50 Hz, 1-phase, for instrumentation and controls .
- vii. 220V / 125 / 24 / 48V (+) 10% to (-) 15% volts (DC), ungrounded system

**Electric Equipment Voltage Rating**


**AC Equipment Voltage Rating**

- i. Motors larger than 250 kW : 6.6 KV, 3-ph, 50 Hz
- ii. Motors less than and equal to 250 kW : 400V, 3-ph, 50 Hz
- iii. Lighting with associated equipment : 230V, 1-ph, 50 Hz
- iv. MOV motors : 400V, 3-ph, 50 Hz

Frequency : 50 Hz ± 5%


**Fault Level**

- i. 400,000 volts system : 31.5KA for 3 sec. (In line with Phase - I)
- ii. 33,000 volts system : 31 kA for 3 sec. (In line with Phase - I)
- iii. 6600 volts system : 25 kA for 3 sec. (In line with Phase - I)
- iv. 400 volts system : Min. 50 kA for 1 sec. in line with Phase-I to be updated based on calculation to be submitted for Phase - II.
- v. 220 VDC system : 15 kA for 1sec

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
		VOLUME II-B	
		SECTION –C	
		REV. NO. 00	DATE:
		PAGE	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II</b> <b>PEC, MINISTRY OF ELECTRICITY AND ENERGY</b> <b>REPUBLIC OF YEMEN</b>		


**SECTION – C**

**SPECIFIC TECHNICAL REQUIREMENTS**

	<b>TITLE:</b> <b>TECHNICAL SPECIFICATION FOR  SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II</b> <b>PEC, MINISTRY OF ELECTRICITY AND ENERGY</b> <b>REPUBLIC OF YEMEN</b>	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
		VOLUME <b>II-B</b>	
		SECTION –C1	
		REV. NO. 00	DATE:
		PAGE	

## SECTION – C1

### SPECIFIC TECHNICAL REQUIREMENTS (MECHANICAL)

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
		VOLUME II-B	
		SECTION –C1	
		REV. NO. 00	DATE:
		PAGE	
<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II</b> <b>PEC, MINISTRY OF ELECTRICITY AND ENERGY</b> <b>REPUBLIC OF YEMEN</b>			

## 1. GENERAL

The **Sewage Treatment Plant** and associated accessories shall conform to the technical specification.


## 2. SCOPE OF SUPPLY (MECHANICAL)

Broad scope of work of this package includes all equipment and accessories for completion of the system in line with tender requirement.

Following are the broad scope of work in bidder's scope. In addition to the following please also refer the respective sections of electrical, C&I and civil for bidder's scope of work.

### i. The Sewage Treatment Plant consisting of the following shall be in bidder's scope:-

- a) Two numbers (2x100%) Septic tank over flow transfer pumps along with motors, accessories, instruments and valves. Please note that pumps shall be supplied with base plate & outlet pipe spool with valves, instruments and flanges mounted on the outlet pipe to facilitate the easy erection at site. The outlet pipe shall be of SS-304 material.
- b) Two numbers (2x100%) Treated water transfer pumps with motors, accessories, instruments and valves. Please note that pumps shall be supplied with base plate & outlet pipe spool with valves, instruments and flanges mounted on the outlet pipe to facilitate the easy erection at site. The outlet pipe shall be of SS-304 material.
- c) Two numbers (2x100 %) air blowers with, motors along with accessories & instruments mounted on a skid. The blowers should be housed in an acoustic hood. Please note that blower shall be skid mounted with valves, instruments and flanges mounted on the skid. The outlet pipe with diffusers shall be of SS-304 material. The prefabricated pipe & diffusers shall be supplied separately.
- d) Air diffusers for Aerobic treatment chamber.
- e) 600 m of 63 mm OD HDPE piping.
- f) 650 nos of piping clamps for 63 mm OD HDPE Pipe.
- g) Fittings, valves, instruments, accessories etc. as defined in the data sheet as required to meet the system requirement.
- h) The equipment to be packed in crates with sea worthy packing as per Annexure F.
- i) Painting and color code shall be decided during detailed engineering and shall subject to customer and BHEL approval.
- j) Bidder to note that the equipment, valves, instruments indicated in the P&ID (PE-DG-372-673-A001) attached in the technical specification are minimum and same shall be in bidder's scope. During detailed engineering, bidder to furnish complete and detailed scheme in all respects including all valves, instruments, piping equipment's. fittings etc. for smooth, safe, efficient and trouble free operation of the plant meeting the specification requirement.
- k) Bidder to note that the pipe shall be supplied in pre-fabricated form. Bidder shall develop the isometric drawings for piping work and the pipe shall be tagged properly for easy co-relation and erection at site.
- l) The complete STP shall be designed in such a way that items are mounted on skid to minimize the site erection work. The skid mounting possibility shall be exercised during detailed engineering and the same shall be finalized during detailed engineering by BHEL.
- m) Supports for all the piping as per the requirement shall be in bidder's scope. Embedment plates with lugs shall also be provided by bidder as per system requirement.

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
		VOLUME II-B	
		SECTION -C1	
		REV. NO. 00	DATE:
		PAGE	
<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II</b> <b>PEC, MINISTRY OF ELECTRICITY AND ENERGY</b> <b>REPUBLIC OF YEMEN</b>			

- n) All auxiliary structure (U-clamps, nuts, bolts etc.) for fixing pipes on pedestal or trestles.
- o) All necessary flanges and counter flanges to interconnect the pipes.
- p) All necessary drains, vents and sampling points, with valves, as specified and as required.
- q) Start-up, erection and commissioning spares as required.
- r) All special tools necessary for proper maintenance or adjustment of the equipment packed in permanent box.
- s) Finish paints for touch up painting of equipments after erection at site in sealed container.
- t) Initial charge of all lubricants and grease.

### 3. SCOPE OF SUPPLY (ELECTRICAL)

Complete electrical as per specification / details indicated in Section C2 (Specific Technical Requirement Electrical) and D2 (General Technical Requirement Electrical)

### 4. SCOPE OF SUPPLY (C&I)

Complete C&I as per specification / details indicated in Section C3 (Specific Technical Requirement C&I) and D3 (General Technical Requirement C&I)

### 5. SCOPE OF SUPPLY (CIVIL)

Total Civil is in BHEL's Scope of work, however detailed Civil Design Input drawings (equipment GA drawings indicating complete loading details) shall be provided by bidder.

### 6. SCOPE OF SERVICE

The bidder's scope also includes following services:


- a) 07 man days of Supervision of Erection and commissioning including performance demonstration. Vendor shall depute the experienced & competent person who can complete the assigned job.
- b) Performance Demonstration.
- c) Painting as per enclosed painting schedule. However, any variation in the painting schedule as finally approved by customer shall be taken care by the bidder without any commercial and delivery implication. Color-coding scheme shall be provided to vendor during detailed engineering.
- d) Touch up paint shall be done on site under bidder's supervision.
- e) Third Party Inspections as applicable.

### 7. TERMINAL POINT:

- a) Treated water line from Aerobic Treatment chamber upto N-Pit of DM Plant shall be in bidder's scope.

### 8. EXCLUSION

- a) Potable water and service water upto the terminal point.
- b) All Civil works
- c) M.C.C. / Switch fuse feeder panels for the power plant and control cabling up to & beyond the battery limit (Refer electrical section for scope).
- d) Air conditioning, ventilation & fire fighting facilities. However, bidder to furnish the requirement of the same after award of contract.

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>	VOLUME <b>II-B</b>	
	<b>400 MW, MARIB GTPS, PHASE-II</b>	SECTION –C1	
	<b>PEC, MINISTRY OF ELECTRICITY AND ENERGY</b>	REV. NO. 00	DATE:
	<b>REPUBLIC OF YEMEN</b>	PAGE	

## 9. ERECTION AND COMMISSIONING SPARES

All the necessary commissioning spares shall be supplied as a part of base offer. Bidder will submit the list of commissioning spares for Sewage Treatment Plant along with the offer.

## 10. SEAWORTHY PACKING

To prevent damage to the equipment of the system during transit, seaworthy packing to be provided as per Technical specification for seaworthy packing and shipping instructions given in Section D-1.

## 11. QP AND SUB VENDOR APPROVAL

- a) Requirement of detailed QP, inspection checklist, certificate of conformance etc. for each equipment and sub-vendor shall be finalized during detailed engineering stage; decision of BHEL/customer shall be binding on vendor in this regard. Any changes/additional tests insisted upon by Owner during approval of QAP's shall be accepted by bidder without any commercial/delivery implication to BHEL/Owner. Bidder shall submit the quality plans in BHEL format during detailed engineering stage. Bidder to note further that during detailed engineering all the QAP's/check lists etc. shall be submitted to Owner/BHEL for approval. All inspection & testing etc. shall be carried out accordingly.
- b) Approved sub vendor list is enclosed elsewhere of this specification. However, any additional sub-vendor shall be subject to BHEL and Customer approval during detailed engineering.

## 12. DESIGN/CONSTRUCTION

In addition to the requirements of Section-C & D the following shall also be complied under scope of this specification:


The P&ID is enclosed herein in this section for bidder's compliance.

The material of construction specified in Data Sheet-A are minimum requirements and material of construction for other components not specified shall be similarly selected by the bidder for intended duty which shall be subjects to customer and BHEL approval during detailed engineering.

## 13. DRAWING/DOCUEMNTS REQUIREMENT (Please refer electrical and C&I portion also)

After award of LOI, following drawing/documents shall be submitted by the bidder for BHEL/Customer approval. However, any additional drawing/documents if found necessary for completion of the engineering, the same shall be submitted by bidder without any commercial and delivery implication ton BHEL and customer.

SL. NO.	BHEL DRG NO	DRG TITLE	No. of weeks/days for document submission from date of LOI / PO	DOCUME NT SIZE
1	PE-V10-372-673-A001	P&I Diagram for Sewage Treatment Plant	4 weeks	A1
2	PE-V10-372-673-A002	layout of Sewage Treatment Plant	4 weeks	A1
3	PE-V10-372-673-A003	Process Design and sizing calculations including pressure drop calculations (STP).	4 weeks	A3
4	PE-V10-372-673-A004	Sub vendor list	5 weeks	A4
5	PE-V10-372-673-A005	Operation & Control Philosophy	4 weeks	A4
6	PE-V10-372-673-A006	Electrical load data	6 weeks	A4
7	PE-V10-372-673-A007	Piping Layout of STP ( inside STP area)	6 weeks	A1
8	PE-V10-372-673-A008	Mech. GA drawings of All Sewage Sumps And Tanks	8 weeks	A1

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
		VOLUME II-B	
		SECTION -C1	
		REV. NO. 00	DATE:
		PAGE	
<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II</b> <b>PEC, MINISTRY OF ELECTRICITY AND ENERGY</b> <b>REPUBLIC OF YEMEN</b>			


9	PE-V10-372-673-A009	Data sheet of all valves, instruments, pumps, motor and blowers	8 weeks	A4
10	PE-V10-372-673-A010	QAP for all valves, instruments, pumps, motor and blowers	8 weeks	A3
11	PE-V10-372-673-A011	Instrument schedule	10 weeks	A3
12	PE-V10-372-673-A012	Valve schedule	10 weeks	A4
13	PE-V10-372-673-A013	Cable tray/trench & conduit routing diagram of STP	10 weeks	A3
14	PE-V10-372-673-A014	PLC details for STP (complete documentation as described in C&I deliverables)	10 weeks	A4
15	PE-V10-372-673-A015	QAP for PLC	12 weeks	A3
16	PE-V10-372-673-A016	Detailed Erection procedure.	12 weeks	A4
17	PE-V10-372-673-A017	Yard Piping Layout of STP	10 weeks	A3
18	PE-V10-372-673-A018	Cable Schedule	12 weeks	A4
19	PE-V10-372-673-A019	Performance demonstration procedure for Sewage Treatment Plant	14 weeks	A4
20	PE-V10-372-673-A020	Engineering BOQ	14 weeks	A4
21	PE-V10-372-673-A021	O&M manual for Sewage Treatment Plant covering catalogue of all the items.	16 weeks	As applicable
22	PE-V10-372-673-A022	Sea worthy packing drawing and details.	16 weeks	A4
23	PE-V10-372-673-A023	Storage instruction	14 weeks	A4
24	PE-V10-372-673-A024	List of Erection & Commissioning spares.	14 weeks	A4

**Note:-**

1. Detailed BOQ in every engineering drawing and document shall be provided by bidder.
2. Bidder to note that the Drawing documents submitted should be of highest quality with micro details as erection and commissioning has to be done by BHEL based on the drawings submitted by the bidder. Bidder to also provide packing drawings and details.
3. Drawings submitted shall be complete in all respects with revised drawing submitted incorporating all comments. Any incomplete drawing submitted shall be treated as non-submission with delays to bidder's account. For any clarification/ discussion required to complete the drawings, the bidder shall himself depute his personal to BHEL for across the table discussions/ finalisations/ submissions of drawings.
4. Any other document/drawing required for STP by BHEL/customer, shall be provided by vendor without any implication.

**14. DRAWING/DOCUMENTS REQUIRED ALONG WITH THE BID (Please refer Electrical, C&I portion and Vol III also).**

- a) Clarification, if any, in the BHEL format in pre bid stage.
- b) Any deviation in BHEL format with cost of withdrawal of deviation
- c) Unprice Schedule duly filled.
- d) List of Spares (Commissioning spares).
- e) Electrical load data format (filled).
- f) Compliance certificate.
- g) Declaration sheet

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>	VOLUME II-B	
	<b>400 MW, MARIB GTPS, PHASE-II</b>	SECTION –C1	
	<b>PEC, MINISTRY OF ELECTRICITY AND ENERGY</b>	REV. NO. 00	DATE:
	<b>REPUBLIC OF YEMEN</b>	PAGE	

**Note-1:** - Any item/work either supply of equipment or erection material which have not been specifically mentioned in but are necessary to complete the works for trouble free and efficient operation of the plant shall be deemed to be included within the scope of this specification. The bidder without any extra charge shall provide the same.

**Note-2:** All major drawings/documents shall be approved by BHEL/CUSTOMER during detailed engineering stage. Successful bidder shall comply with the observations of the BHEL/CUSTOMER without price & delivery implication.

**Note-3:** Bidder to note that drg/doc submission shall be made through web based Document Management System. Bidder would be provided access to the DMS for drg/doc approval and adequate training for the same. Detailed methodology would be finalized during the kick-off meeting. Bidder to ensure following at their end.

- Internet explorer version – Minimum Internet Explorer 7
- Internet speed – 2 mbps (Minimum preferred)
- Pop ups from our external DMS IP (124.124.36.198) should not be blocked
- Vendor’s Internal proxy setting should not block DMS application’s link.

(<http://124.124.36.198/wrenchwebaccess/login.aspx>)


**NOTE-4:** Bidder to note that specific technical requirements as per Section – C will prevail over general Technical requirements given elsewhere in this specification.

## 15. DRAWING DOCUMENT DISTRIBUTION SCHEDULE


SNo.	Document	Total Copies	Distribution		
			Purchaser		Consultant
			HQ	SITE	
1	Approved drawings, documents etc.	20	6	8	6
2	Instruction manuals for erection and O&M	15	5	6	4
3	As built drawings	20	4	8	8

## 16. Miscellaneous requirements


- Successful bidder shall furnish detailed erection manual for each of the equipment supplied under this contract at least 3 months before the scheduled erection of the concerned equipment / component or along with supply of concerned equipment / component whichever is earlier.
- Document approval by customer under Approval category or information category shall not absolve the vendor of their contractual obligations. Any deviation from specified requirement shall be reported by the vendor in writing and require written approval. Unless any change in specified requirement has been brought out by the vendor during detail engineering in writing while submitting the document to customer for approval, approved document (with implicit deviation) will not be cited as a reason for not following the specification requirement.
- In case vendor submits revised drawing after approval of the corresponding drawing, any delay in approval of revised drawing shall be to vendor’s account and shall not be used as a reason for extension in contract completion. However, in case changes are necessitated due to any constraints at customer end, delay in review/ approval of drawing beyond one month will be to customer’s account.

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
		VOLUME II-B	
		SECTION -C1	
		REV. NO. 00	DATE:
		PAGE	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II</b> <b>PEC, MINISTRY OF ELECTRICITY AND ENERGY</b> <b>REPUBLIC OF YEMEN</b>		

- d) Bidder to submit the document (basic engineering documents like P&ID, layout and GA, process and sizing calculation) within 04 weeks from the date of purchase order/LOI and subsequent revision in 07 days of comments. BHEL will take 2 weeks' time for observation on all drawing.
- e) Vendor to attend regular meeting with BHEL and customer fortnightly in BHEL or customer office as decided during detailed engineering.
- f) Latest version of all codes and standards to be followed.
- g) Bidder can ask their clarification if any during pre-bid stage for clarity.

	<b>TITLE:</b> <b>TECHNICAL SPECIFICATION FOR  SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II</b> <b>PEC, MINISTRY OF ELECTRICITY AND ENERGY</b> <b>REPUBLIC OF YEMEN</b>	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
		VOLUME <b>II-B</b>	
		SECTION -C1	
		REV. NO. 00	DATE:
		PAGE	

## DATA SHEET -A OF STP

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>	VOLUME <b>II-B</b>	
	<b>400 MW, MARIB GTPS, PHASE-II PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	SECTION -C1	
		REV. NO. 00	DATE:
		PAGE	


**DATA SHEET – A**

1	AIR BLOWER	
1.1	Number	Two (2x100%)
1.2	Type	Twin lobe type with acoustic hood
1.3	Pressure gauge	Two (nos) One per blower
a	Type	Bourdon Type
b	Make	a) A.N.Inst Narendrapur b) General Inst Consortium Mumbai / Goa c) Gluck Mumbai d) Goa Thermostatic Goa A With Imported Bourdon Tube For Pressure Gauge e) Manometer Mumbai f) Wika Pune
1.4	Capacity & Head	Minimum 30 cum/hr and 5 mwc or to suit the system requirement
1.5	Operating Speed	1500 rpm
1.6	Discharge Line (minimum)	50 NB
1.7	MOC of air blower	
a	Casing	Cast Iron Gr. FG 260 to IS 210
b	Shaft	Carbon Steel to EN 8
c	Base Frame	MS Common for Blower and motor. The same should be MS with epoxy coating.
1.8	Accessories for each blower	Suction Filter Suction and Discharge Silencer Companion Flange for Blower Spring Load relief valves Belt Guard and Filter hood Non Return Valve
1.9	Make	a) SWAN PNEUMATIC NOIDA b) EVEREST TRANSMISSION NEW DELHI c) KAY INTERNATIONAL NEW DELHI / SONEPAT d) EVEREST BLOWER BAHADURGARH
1.10	Spares for Blower	a) Set of Bearing – 1 Set b) Set of Oil Seal – 1 Set c) Suction Filter – 1 Set
1.11	Noise	85 dBA @ 1 m from blower
1.12	Inspection and Testing	As per the approved quality Plan
1.13	Motors	Two (One for each blower)
a	Type	As per motor Data Sheet.
b	Make for motors	a) CGL, Ahmednagar b) Bharat Bijlee Mumbai c) Siemens India d) ABB Faridabad / Bangalore
2	OVER FLOW TRANSFER PUMP	
2.1	Number	Two (2X100%)
2.2	Type	Submersible Non Clog Pump
2.3	Capacity & Head	5 CuM/Hr (each) and Head 10 M




<b>TITLE:</b> <b>TECHNICAL SPECIFICATION FOR          SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II          PEC, MINISTRY OF ELECTRICITY AND ENERGY          REPUBLIC OF YEMEN</b>	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	VOLUME <b>II-B</b>	
	SECTION –C1	
	REV. NO. 00	DATE:
	PAGE	

2.4	Make	a) Darling Pumps Pvt. Ltd Indore b) Aqua Machinery Ahmedabad c) Kishor Pumps Pvt. Ltd. Pune d) KSB
2.5	Delivery Size	50 NB
2.6	Operating Speed	1500 rpm
2.7	Flange Standard	DIN / equivalent
2.8	Minimum installation depth	1.5 m.
2.9	MOC	
a	Casing	2% Ni Cast Iron FG 260 IS 210
b	Line Shaft	SS 410
c	Pump shaft	SS 316
d	Impeller	SS-316
e	Base plate	MS with epoxy coating
2.10	Pump Accessories	Pump Motor with Cable Auto coupling with bend
2.11	Motors	Two (One for each pump)
a	Type	As per motor Data Sheet.
b	Make for motors	a) CGL, Ahmednagar b) Bharat Bijlee Mumbai c) Siemens India d) ABB Faridabad / Bangalore
2.12	Spares	a) Set of Bearing – 1 Set
<b>3</b>	<b>TREATED WATER TRANSFER PUMPS</b>	
3.1	Number	Two (2X100%)
3.2	Type	Submersible Non Clog Pump
3.3	Capacity & Head	5 CuM/Hr (each) and Head 50 M (or to suit the system requirement)
3.4	Make	a) Darling Pumps Pvt. Ltd Indore b) Aqua Machinery Ahmedabad c) Kishor Pumps Pvt. Ltd. Pune
3.5	Delivery Size	50 NB
3.6	Operating Speed	1500 rpm
3.7	Flange Standard	DIN / equivalent
3.8	Minimum installation depth	1.5 m.
3.9	MOC	
a	Casing	2% Ni Cast Iron FG 260 IS 210
b	Line Shaft	SS-304
c	Pump shaft	SS-304
d	Impeller	SS-316
e	Base plate	MS with epoxy coating.
3.10	Pump Accessories	Pump Motor with Cable Auto coupling with bend
3.11	Motors	Two (One for each pump)
a	Type	As per motor Data Sheet.
b	Make	d) CGL, Ahmednagar e) Bharat Bijlee Mumbai f) Siemens India g) ABB Faridabad / Bangalore
3.12	Spares	a) Set of Bearing – 1 Set
<b>4</b>	<b>PIPE AND FITTINGS</b>	
4.1	HPDE Pipe	Size – 63 mm OD, Quantity – 600 m (in six numbers of coils of 100 meter each) Specification – PE 100-PN 10 carbon


	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>	VOLUME <b>II-B</b>
	<b>400 MW, MARIB GTPS, PHASE-II PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	SECTION -C1
		REV. NO. 00      DATE:
		PAGE

		black quality suitable for both above ground and buried pipe protection Design Standard : ISO 4427
4.2	90 deg elbow of compression fittings	Size – suitable for 63 mm OD pipe, Quantity – 50 m Specification – PE 100-PN 10 carbon black quality suitable for both above ground and buried pipe protection Design Standard : ISO 4427
4.3	Compression Flange Adaptor	Size – suitable for 63 mm OD pipe, Quantity – 50 m Specification – PE 100-PN 10 carbon black quality suitable for both above ground and buried pipe protection Design Standard : ISO 4427 Drilling to meet system requirement & counter flange requirement.
4.4	Compression coupler	Size – suitable for 63 mm OD pipe, Quantity – 50 m Specification – PE 100-PN 10 carbon black quality suitable for both above ground and buried pipe protection Design Standard : ISO 4427
4.5	Compression T	Size – suitable for 63 mm OD pipe, Quantity – 50 m Specification – PE 100-PN 10 carbon black quality suitable for both above ground and buried pipe protection Design Standard : ISO 4427
5	<b>VALVES</b>	
5.1	<b>GLOBE VALVES</b>	
a	Type	STRAIGHT, RISING STEM , WITH OUTSIDE SCRES
b	Design standard	IS:778 CLASS 2
c	Make	Leader, Jalandhar H. Sarkar, Howrah Bankim & compony, Howrah
5.2	<b>NON RETURN VALVE</b>	
a	Type	SWING CHECK ( REFLUX TYPE) OR DUAL PLATE TYPE AND FLANGED ENDS
b	Make	Majestic Works, Mumbai BDK, Hubli H. Sarkar, Howrah Leader, jalandhar


NOTE : Vendor to please not that sub vendor listed above are indicative only and is subject to approval /acceptance by customer and BHEL during detail engineering. Bidder to propose his sub vendor list with back up documents (experience list, end user certificate as applicable) etc. The same shall subject to BHEL and customer approval during detail engineering stage without any commercial & delivery implication to BHEL and customer.

	<b>TITLE:</b>  <b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
		VOLUME-IIB	
		SECTION –C1	
		REV. NO. 00	DATE:
		PAGE	


## INDICATIVE SUB-VENDOR LIST

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	VOLUME-IIB	
		SECTION -C1	
		REV. NO. 00	DATE:
		PAGE	


S. No	ITEM	SUPPLIERS	PLACE	SUB-VENDOR STATUS	QP / INSPN CAT	REMARKS
1	<b>SUBMERSIBLE PUMPS</b>	DARLING PUMPS PVT. LTD	INDORE	A		
		AQUA MACHINERY	AHMEDABAD	A		
		KISHOR PUMPS PVT. LTD.	PUNE	A		
		SU PUMPS	MUMBAI	A		
		SAM TURBO INDIA LTD.	COIMBATORE			
		WPIL				
		JYOTI				
2	<b>AIR BLOWERS</b>	SWAN PNEUMATIC	NOIDA	A		
		EVEREST TRANSMISSION	NEW DELHI	A		
		KAY INTERNATIONAL	NEW DELHI / SONEPAT	A		
		EVEREST BLOWER	BAHADURGARH	A		
3	<b>GATE / GLOBEVALVES UP TO 300 NB PN 10</b>	LEADER	JALANDHAR	A		
		H SARKAR	HOWRAH	A		
		BANKIM & COMPANY	HOWRAH	A		
4	<b>CHECK VALVE / NRV (LINED / UNLINED), FLAP TYPE SIZE UPTO 50 NB</b>	MAJESTIC WORKS	MUMBAI	A		
		BDK	HUBLI	A		
		H SARKAR	HOWRAH	A		
		LEADER (FOR CHECK VALVE ONLY)	JALANDHAR	A		
5	<b>MS PIPES (IS: 1239 &amp; 3589)</b>	SAIL	ROURKELA.	A		
		JINDAL TUBES	GAZIABAD	A		UPTO 350 NB
		SURYA ROSHINI	BHADURGARH	A		UPTO 300 NB
		TISCO	JAMSHEDPUR	A		UPTO 150 NB
		WELSPUN	ANJAR	A		UPTO 400 NB
		MSL (FOR IS 3589)	RAIGAD	A		200 NB TO 500 NB
6	<b>METALLIC FITTINGS</b>	MS FITTINGS				KOLKATA
		SIDHARTHA & GAUTAM				FARIDABAD
		EBY				MUMBAI
		BHARAT FORGE				PUNE
		TUBE PRODUCTS				BARODA
		NITIN PROFILE				BARODA

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	VOLUME-IIB	
		SECTION –C1	
		REV. NO. 00	DATE:
		PAGE	

7	<b>METALLIC FLANGES (IS 2064 GR B &amp; SA 515/516 GR 60/70)</b>	MOSHI ENGG. WORKS				MUMBAI
		ALLIANCE ENGG.				PUNE
		JAYA MBE				MUMBAI
		SIDHI FORGE				MUMBAI
	<b>HDPE PIPES</b>					
	<b>HDPE FITTINGS</b>					
4	<b>LEVEL TRANSMITTER (CAPACITANCE TYPE)</b>	E&H	GERMANY	A		
		LEVCON	KOLKATA	A		
		PUNE TECHTROL	PUNE	A		
		MAGNETROL	BELGIUM	A		
		NIVO CONTROL	INDORE	A		
		SBEM	PUNE	A		
		WIKA	PUNE	A		
5	<b>LEVEL TRANSMITTER (GUIDED WAVE RADAR)</b>	K TECH	USA	A		
		E&H	GERMANY	A		
		EMERSON (SAB ROSEMOUNT)	SWEDEN	A		
		MAGNETROL	BELGIUM	A		
		EMERSON	DAMAN	A		
		CHEMTROL	GOA	DR		
6	<b>LEVEL TRANSMITTER (ULTRASONIC TYPE)</b>	KAB INSTRUMENTS	SOUTH AFRICA	A		
		SIEMENS MILLTRONICS	CANADA	A		
		K TECH	USA	DR		
		E&H	GERMANY	A		
		KRISTLER MORSE	USA	DR		
		EMERSON	USA / DAMAN	A		
7	<b>PRESSURE GUAGE</b>	A.N.INST	NARENDRAPUR	A		
		GENERAL INST CONSORTIUM	MUMBAI / GOA	A		
		GLUCK	MUMBAI	A		

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	VOLUME-IIB	
		SECTION -C1	
		REV. NO. 00	DATE:
		PAGE	


		GOA THERMOSTATIC	GOA	A		WITH IMPORTE D BOURDO N TUBE FOR PRESSU RE GAUGE
		MANOMETER	MUMBAI	A		
		WIKA	PUNE	DR		
8	PRESSURE / DP TRANSMITTER	EMERSON PROCESS MANAGEMENT	USA / DAMAN	A		
		FUJI ELECTRIC	JAPAN	A		
		HONEYWELL	USA	A		
		YOKOGAWA	JAPAN	A		
		ABB	ITALY / FARIDABAD	A		
9	INST PIPE FITTINGS	AURA INCORPORATED	NEW DELHI	A		
		HYD-AIR ENGG	MUMBAI	A		
		METPRESS ENGG	KOLKATA	A		
		PRECISION ENGG	MUMBAI	A		
		SWITZER INST	CHENNAI	A		
		VIKAS INDUSTRIAL	NOIDA	A		
10	CONTROL PANEL	PROCON INST	CHENNAI	A		
		CONTROL & SWGR CO	NOIDA	A		
		INDUSTRIAL CONTROLS & APPS	MUMBAI	A		
		PYROTECH	UDAIPUR	A		
		ELECMECH	AHEMDABAD	A		
		POSITRONICS	BARODA	A		
11	JUNCTION BOXES	BALIGA LIGHTING EQUIP	CHENNAI	A		
		CREATIVE INST	BANGLORE	A		
		DEVI POLY	CHENNAI	A		
		INFO CONTROL	BANGLORE	A		
		K.S.INTRUMENTS	BANGLORE	A		
		MANISHA ENTERPRISE	PUNE	A		
		SUCHITRA INDUSTRIES	BANGLORE	A		
12	INST TUBE FITTINGS	AURA INCORPORATED	NEW DELHI	A		

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	VOLUME-IIB	
		SECTION –C1	
		REV. NO. 00	DATE:
		PAGE	


		HYD-AIR ENGG	MUMBAI	A		
		METPRESS ENGG	KOLKATA	A		
		PRECISION ENGG	MUMBAI	A		
		SWITZER INST	CHENNAI	A		
		VIKAS INDUSTRIAL	NOIDA	A		
13	INSTRUMENT CABLE	DELTON CABLES	FARIDABAD	A		
		PARAMOUNT CABLES	KHUSKHERA	A		
		RELIANCE	BANGLORE	A		
		POLYCAB	DAMAN	A		
		UNIVERSAL CABLES	SATNA	A		
		NICCO	KOLKATTA	A		
		CORDS	BHIWADI	A		
		INCAB	PUNE	A		
14	SCREENED INSTRUMENT CABLE – PVC / FRLS	PARAMOUNT CABLES	KHUSKHERA	A		
		POLYCAB	DAMAN	A		
		RELIANCE	BANGLORE	A		
		DELTON CABLES	FARIDABAD	A		
		CORDS	BHIWADI	A		
		UNIVERSAL CABLES	SATNA	A		
		INCAB	PUNE	A		
		NICCO CORPORATION LIMITED	KOLKATTA	A		
15	CABLE LUGS	CHETNA	MUMBAI	A		
		DOWELL	MUMBAI	A		
		ELECTRO BILLETS (3D)	VALSAD	A		
16	PLC	ABB	BANGALORE	A		
		GE FANUC	BANGALORE	A		
		L&T LTD	MUMBAI	A		
		ROCKWELL	GHAJIABAD	A		
		SIEMENS	NASIK	A		
		SCHNEIDER ELECTRIC	NEW DELHI	A		

**NOTE:**


- i) VENDOR TO PLEASE NOTE THAT FINAL SUB VENDOR SELECTED OUT OF THE ABOVE RECOMMENDED SUB VENDORS SUBJECT TO CUSTOMER APPROVAL DURING DETAILED ENGINEERING WITHOUT ANY TECHNICAL, COMMERCIAL AND DELIVERY IMPLICATIONS TO BHEL AND CUSTOMER.
- ii) BIDDER TO ALSO CHECK THE LAWS AND REGULATIONS REGARDING SELECTING THE SUB VENDORS WHO CAN SUPPLY THE ITEMS TO MARIB, YEMEN.

	<b>TITLE:</b>  <b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
		VOLUME-IIB	
		SECTION –C1	
		REV. NO. 00	DATE:
		PAGE	

- iii) THE INSPECTION CATEGORY WILL BE INTIMATED AFTER AWARD OF CONTRACTOR BY BHEL/CUSTOMER. HOWEVER THE SAME WILL BE ADHERED BY THE BIDDER WITHOUT ANY COMMERCIAL, TECHNICAL AND DELIVERY IMPLICATION.

	<b>TITLE:</b> <b>TECHNICAL SPECIFICATION FOR          SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II</b> <b>PEC, MINISTRY OF ELECTRICITY AND ENERGY</b> <b>REPUBLIC OF YEMEN</b>	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
		VOLUME <b>II-B</b>	
		SECTION -C1	
		REV. NO. 00	DATE:
		PAGE	

## P&ID OF SEWAGE TREATMENT PLANT

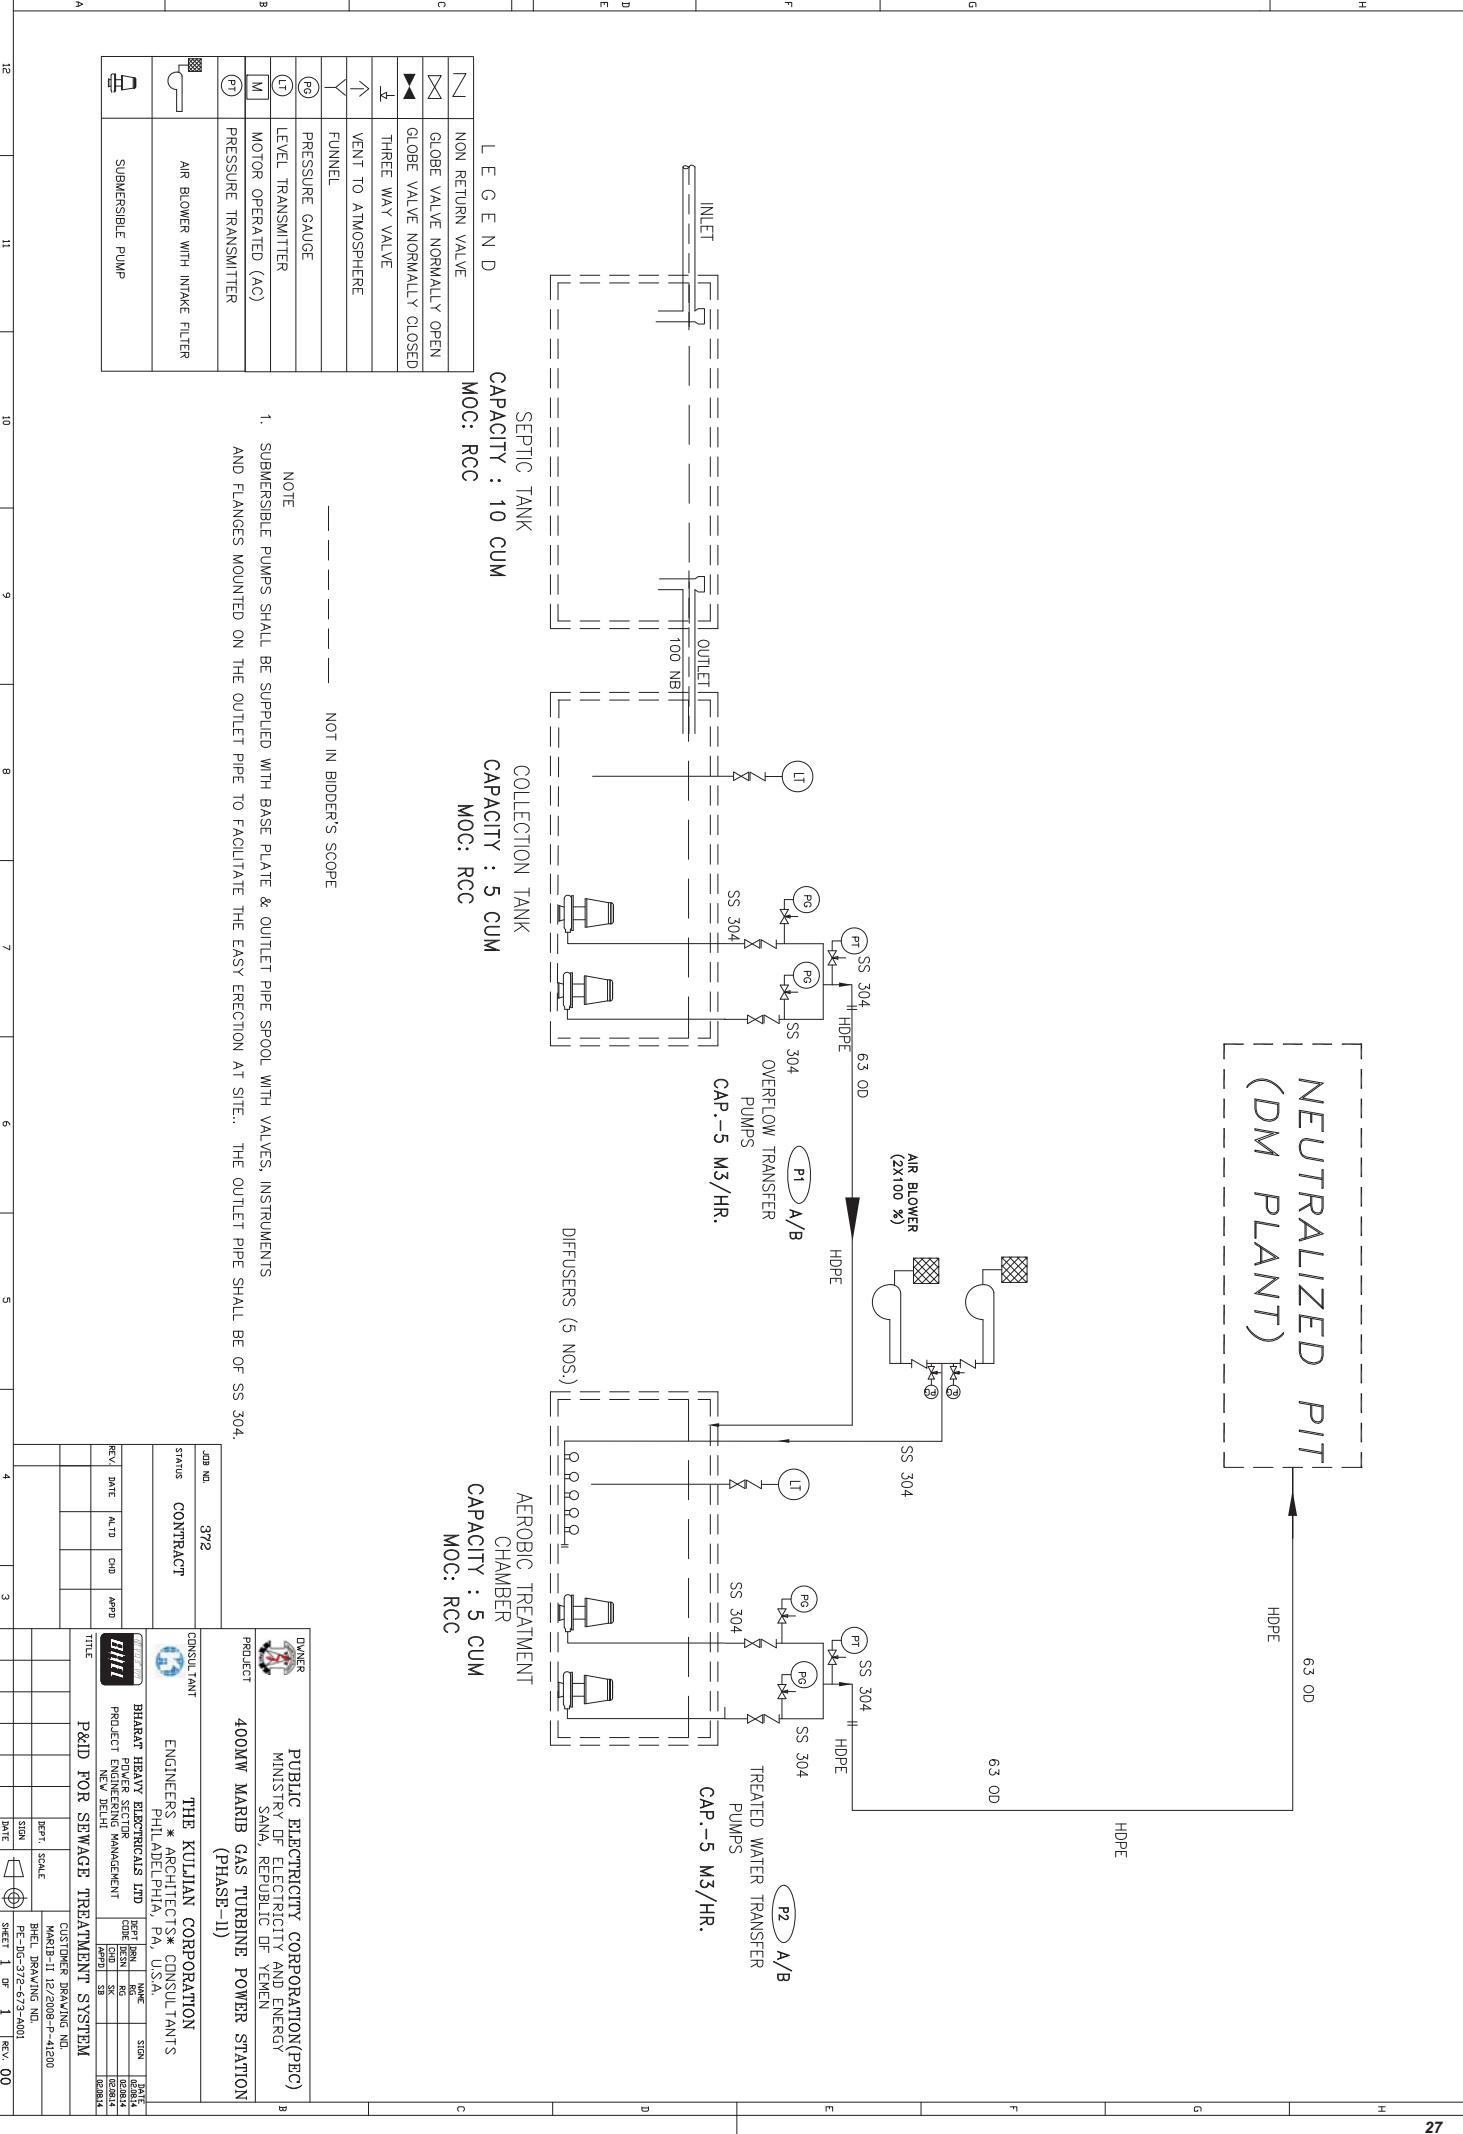

SEPTIC TANK  
 CAPACITY : 10 CUM  
 MOC: RCC

COLLECTION TANK  
 CAPACITY : 5 CUM  
 MOC: RCC

AEROBIC TREATMENT CHAMBER  
 CAPACITY : 5 CUM  
 MOC: RCC

NOTE  
 1. SUBMERSIBLE PUMPS SHALL BE SUPPLIED WITH BASE PLATE & OUTLET PIPE SPOOL WITH VALVES, INSTRUMENTS AND FLANGES MOUNTED ON THE OUTLET PIPE TO FACILITATE THE EASY ERECTION AT SITE. THE OUTLET PIPE SHALL BE OF SS 304.

LEGEND

	NON RETURN VALVE
	GLOBE VALVE NORMALLY OPEN
	GLOBE VALVE NORMALLY CLOSED
	THREE WAY VALVE
	VENT TO ATMOSPHERE
	FUNNEL
	PRESSURE GAUGE
	LEVEL TRANSMITTER
	MOTOR OPERATED (A.C.)
	PRESSURE TRANSMITTER
	AIR BLOWER WITH INTAKE FILTER
	SUBMERSIBLE PUMP

NOT IN BIDDER'S SCOPE

JOB NO.	372
STATUS	CONTRACT


OWNER: PUBLIC ELECTRICITY CORPORATION(PEC)  
 MINISTRY OF ELECTRICITY AND ENERGY  
 SANA'A, REPUBLIC OF YEMEN

PROJECT: 400MW MARIAB GAS TURBINE POWER STATION (PHASE-II)

CONSULTANT: THE KULJIAN CORPORATION  
 ENGINEERS \* ARCHITECTS \* CONSULTANTS  
 PHILADELPHIA, PA, U.S.A.

DESIGNER: BHHA  
 PROJECT MANAGER: BHHA  
 PROJECT ENGINEER: BHHA

CLIENT: BHHA  
 PROJECT NO: 7-1600  
 SHEET NO: 1 OF 1  
 REV: 00

	<b>TITLE:</b> <b>TECHNICAL SPECIFICATION FOR          SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II</b> <b>PEC, MINISTRY OF ELECTRICITY AND ENERGY</b> <b>REPUBLIC OF YEMEN</b>	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
		VOLUME <b>II-B</b>	
		SECTION –C1	
		REV. NO. 00	DATE:
		PAGE	

## QUALITY PLAN-MECHANICAL

QUALITY ASSURANCE																
Tests/Check  Items Components	Material Test	WPS/PQR/Weider Qualification	DPT/MPI	Assembly Fit up	Dimension	RT	Hydraulic / Water Fill	Pneumatic Test	Functional/operational Test	Bleeding resistance tests	Adhesion/ Spark Test	Performance Test	Other Test	All Test as per relevant Std/ Appd Data Sheets	Dynamic Balancing	Remarks
Diaphragm Valves	Y <sup>a</sup>				Y		Y <sub>6</sub>	Y <sup>6</sup>						Y <sup>7</sup>		
Butterfly Valves ( Low Pressure)					Y		Y <sub>6</sub>		Y				Y <sup>8</sup>			
1. Body (Cast)	Y <sup>a</sup>		Y <sup>b</sup>													
2. Disc (Cast)	Y <sup>a</sup>		Y <sup>b</sup>													
3. Shaft	Y <sup>a</sup>		Y									Y <sup>c</sup>				
Rotary Blowers				Y	Y							Y		Y		
1. Casing	Y <sup>a</sup>		Y <sup>b</sup>				Y									
2. Rotor	Y <sup>a</sup>		Y									Y			Y	

**QUALITY ASSURANCE**

**Notes:**

1. Heat Treatment shall be done as per ASME code.
2. Bleeding Resistance tests shall be done by keeping the sample in 33% HCl, 48% NaOH and DM Water for 72 Hrs.
3. Hydro Test shall be conducted, before Rubber lining.
4. As per code requirements.
5. As per HIS, USA.
6. Hydro test of body before Rubber lining. Seat Leakage test for Actuator operated valves shall be done by closing the Valves with Job Actuator.
7. Tests on Rubber parts such as Diaphragms shall be done per batch of Rubber mix, such as Tensile, Hardness, Adhesion, Spark Test, Bleed Resistance test and Flex test. Life Cycle test for Diaphragms for 50000 cycles etc shall also be done.
8. Hydro Test of Body, Seat & Disc Strength shall be carried out in accordance with latest edition of AWWA C-504 Standard. Proof of Design Test in accordance with latest edition of AWWA C-504 Standard shall also be carried out, if not carried out earlier. Seat Leakage test for Actuator operated valves shall be done by closing the Valves with Job Actuator. Seat leakage test shall be carried out in both directions.
  - a) One per Heat/Heat Treatment batch/Lot
  - b) On machined surfaces only.
  - c) UT shall be done for shafts with Dia 50 mm or above.
9. For all other Misc. items, refer Table on LP piping.

MANUFACTURING QUALITY PLAN										
Submersible Pumps for P.O. No.: PW/PE/P/NGNCH/P-77/13										
ITEM : QP No: 1323105/Pump_QAP										
DI.: 05.06.2013 MODEL SUBMERSIBLE PUMPS										
REV No.: R0										
DATE: 11.06.2013										
PAGE 1 OF 2										
MAIN SUPPLIER: BHEL, Noida										
AGENCY RECORD										
M B N										
10										
REMARKS										
SR. NO	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD	AGENCY	REMARKS
1.0	Raw Material and Bought out Control		4	5	M	7	8	9	D*	
1.1a	Pump Casing	Physical Properties - Tensile Strength & Hardness / Chemical Composition	CR	Physical / Chemical Analysis	1 / Heat / Batch	Appd. C S Drg.	APPROVED DRAWING/DATA SHEET	Lab Report	P	V
1.1b	Impeller	Physical Properties - Tensile Strength, Yield Strength & Elongation, Chemical Composition	CR	Physical / Chemical Analysis	1 / Heat / Batch	Appd. C S Drg.	APPROVED DRAWING/DATA SHEET	Lab Report	P	V
1.2	Heat treatment of Stainless Steel Castings	Heat Cycle	MA	Verification of HT chart	All batches	Appd. C S Drg.	APPROVED DRAWING/DATA SHEET	Correlated HT charts	P	V
		IGC TEST	MA	CHEMICAL	1 SAMPLE/HT BATCH	ASTM A 262	PRACTICE - "E"	TC	P	V
1.3	Bars / forgings for pump and motor shafts	Physical/Chemical Properties	CR	Physical / Chemical Analysis	1/Bar	Appd. C S Drg.	APPROVED DRAWING/DATA SHEET	Mill TC or lab report	P	V
		Dimensions	MA	Measurement	100%	Manufacturers Drawing	Manufacturers Drawing	IR	P	V
		Internal defects for 40 min and above diameter	CR	UT	100%	ASTM A-388	Refer Note 1	IR	P	V
1.4	Cable Type: PVC insulated, multicore, copper conductor	Routine TC and acceptance TC as per IS 694/IS 1554	MA	Measurement	100%	Approved Datasheet / IS 694/IS 1554	Approved Datasheet / IS 694/IS 1554	IR & TC	P	V
1.5	Bearings	Make, Bearing No., Surface finish	MA	Visual Examination	100%	Manufacturers Sid	Manufacturers Sid	IR	P	V
2.0	Inprocess Control									
2.1	All Components	Visual Defects	MA	Visual	100%	Manufacturers Drawing	No harmful defects	Log book / IR	P	
		Dimensions	MA	Measurement	100%	Manufacturers Drawing	Manufacturers Drawing	Log book / IR	P	
2.2	Pump discharge casing	Leak tightness	CR	Hydro test (Duration 30 minutes min.)	100%	Refer Remark	No leakage	IR	P	V
		Leak tightness	CR	Air test (Duration 30 minutes min.)	100%	Air testing at 0.5 Kg / cm <sup>2</sup> ( gauge pressure )	No leakage	IR	P	V
2.3	Casing & Impeller (M/C surfaces)	Surface Defects	CR	DPT	100%	ASTME:165	No Surface defect	IR	P	V
2.4	Impeller	Static & Dynamic residual unbalance	CR	Static, Dynamic balancing	100%	ISO : 1940	ISO 1940 Gr. 6.3	IR	P	V
2.5	Pump & Motor Shaft	Surface Defects	CR	DPT	100%	ASTME:165	No Surface defect	IR	P	V
3.0	Sub-Assembly, Assembly Control									
3.1	Pump, Motor, Rotor	Eccentricity	MA	Measurement	100%	Manufacturers Drawing	Manufacturers Drawing	Log book / IR	P	V
3.2	Pump and Motor assembly	Completeness, correctness	MA	Visual Examination	100%	Manufacturers Drawing	Manufacturers Drawing	IR	P	V
<p>LEGEND: RECORDS IDENTIFIED WITH 'TICKIT' SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION</p> <p>** M: MANUFACTURER/SUB CONTRACTOR</p> <p>B: BHEL, N: CUSTOMER</p> <p>P: PERFORM W: WITNESS V: VERIFICATION AS APPROPRIATE</p>										
BHEL										
CONTRACTOR										
TURE										
NAME AND SIGN OF APPROVING AUTHORITY AND SEAL										
BHEL DOC No.: PE-V8-307-172-N005										
ENGG DIV / QA & I										

MANUFACTURING QUALITY PLAN													
ITEM :													
Submersible Pumps for P.O No.: PW/PE/PGNCHP-77/13													
DI.: 05.06.2013 MODEL SUBMERSIBLE PUMPS													
OP No: 1323105/Pump_QAP													
REV No.: R0													
DATE: 11.06.2013													
PAGE 2 OF 2													
MAIN SUPPLIER: BHEL, Noida													
SR. NO	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	CHECK	QUANTUM OF	REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD	AGENCY	REMARKS		
1	2	3	4	5	6	7	8	9	10	M	B	N	
4.0	Final Inspection, Test, Packing, Dispatch Control				M	B							
4.1	Pump set (Pump+ Motor)	Q Vs Head Q Vs Power Q Vs Efficiency Noise & Vibration	CR	Performance test	100%	1 Pump Per type	ENCLOSED TEST PROCEDURE	Tech. Spec., Appd. Data Sheet, Appd. Curves, HIS	Performance test record, Plotted Curves	✓	P	W	V
4.2	Routine Test on motor	HV, IR, Locked Rotor, No Load, Make, type, rating	CR	Electrical tests	100%	1 Pump Per type	IS 325	Approved Data Sheet	IR	✓	P	W	V
4.3	Strip down after Performance test	Undue wear, tear and breakages	CR	Visual examination of Casing & Impeller after stripping	1 / type	1 / type	Undue wear, tear and breakages	No undue wear, tear and breakages	IR	✓	P	V	V
4.4	Complete Pump	Completeness, Correctness, Workmanship and finish, overall dimensions	MA	Visual examination	100%	100%	Approved G.A. drawing	Approved G.A. drawing	IR	✓	P	V	V
4.5	Completion of all stages	Completion	MA	Verification of IR's TC's	100%	100%	Approved QP	Approved QP	IR	✓	P	V	V
4.6	Painting	Surface Preparation		Visual examination	100%	100%	Approved DataSheet	Approved DataSheet	IR		P	V	
4.7	Wooden Packing	Uniformity and thickness Soundness, Aesthetic		Visual Measurement Visual	100%	100%	As per Painting Schedule Manufacturer's Standard	As per Painting Schedule Manufacturer's Standard	IR		P	W	V
									IR		P		
													Compliance report by KPPL

Note : For accessories and bought out items, KISHOR will submit Compliance for review.

1. For UT test on shaft, acceptance criteria : Defect echo < 20 % full screen height when back wall echo set @ 100 % screen height. Reduction in back wall echo to be <20%

Defect height > 20 % of FSH is not acceptable, also loss in back wall echo > 20 % not acceptable

2. IP 68 protection certificate for test conducted on similar motor shall be submitted for review

3. Compliance of thermic switch for over heating protection of winding, reverse rotation protection device shall be submitted by KPPL

LEGEND: RECORDS IDENTIFIED WITH 'TICK' ( ) SHALL BE

ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION

\*\* M: MANUFACTURER/SUB CONTRACTOR

B: BHEL N: CUSTOMER

P: PERFORM W: WITNESS V: VERIFICATION AS APPROPRIATE

\*\* Motor IR to be checked before pump is tested and after pump is tested

BHEL DOC No.: PE-V8-307-172-N005

NAME AND SIGN OF APPROVING AUTHORITY AND SEAL

ENGG DIV / QA & I


MANUFACTURING QUALITY PLAN																					
SUPPLIER NAME & ADDRESS		MANUFACTURERS NAME & ADDRESS		ITEM : Composite Control Panel for Submersible Pumps for P.O Nr.: PW/PE/PG/INCH/P-77/13 Dt. 05.06.2013			PROJECT MAIN SUPPLIER: I		OP No: 1323105/PANEL_QAP												
REV No.: RO		DATE: 10.07.2013		PAGE 1 OF 1		FORMAT OF RECORD		AGENCY		REMARKS											
SR. NO		COMPONENT & OPERATIONS		CHARACTERISTICS CHECKED		CATEGORY		TYPE / METHOD OF CHECK		EXTENT OF CHECK		REFERENCE DOCUMENT		ACCEPTANCE NORM		INSPECTION REPORT		AGENCY		REMARKS	
1		FINAL INSPECTION		3		4		5		6		7		8		9		10			
1	COMPLETE CONTROL PANEL	WORKMANSHIP AND FINISH PAINT SHADE	MA	VISUAL	100%	TANGEDCO / APPROVED DRAWING / RELEVANT IS	TANGEDCO SPECIFICATION / APPROVED DRAWING	INSPECTION REPORT	P	V	V										
		ADHESION	MA	VISUAL	100%	TANGEDCO SPECIFICATION / APPROVED DRAWING / RELEVANT IS	TANGEDCO SPECIFICATION / APPROVED DRAWING	INSPECTION REPORT	P	W	V										
		THICKNESS	MA	VISUAL	100%	TANGEDCO SPECIFICATION / APPROVED DRAWING / RELEVANT IS	TANGEDCO SPECIFICATION / APPROVED DRAWING	INSPECTION REPORT	P	W	V										
		DEGREE OF PROTECTION BY PAPER INSERTION	MA	VISUAL	100%	TANGEDCO SPECIFICATION / APPROVED DRAWING / RELEVANT IS	TANGEDCO SPECIFICATION / APPROVED DRAWING	INSPECTION REPORT	P	W	V										
		WIRING LAYOUT	MA	VISUAL	100%	- DO -	- DO -	- DO -	P	W	V										
		COMPONENT LAYOUT, FITTING ACCESSIBILITY & SAFETY	MA	VISUAL	100%	- DO -	- DO -	- DO -	P	W	V										
		COMPONENT IDENTIFICATION (MARKING / NAME PLATES)	MA	VISUAL	100%	TANGEDCO SPECIFICATION / APPROVED DRAWING / RELEVANT IS	TANGEDCO SPECIFICATION / APPROVED DRAWING / RELEVANT IS	INSPECTION REPORT	P	W	V										
		PROPER WIRE TERMINATION	MA	PULLING MANUALLY	SAMPLE	- DO -	NO LOOSE CONNECTIONS, ALL TERMINATIONS TO BE LUGGED	- DO -	P	W	V										
		DOOR AND LOCK FUNCTIONING	MA	OPERATION	100%	- DO -	NO MISMATCH	- DO -	P	W	V										
		OVERALL DIMENSIONS	MA	MEASUREMENT	SAMPLE	- DO -	APPROVED DRAWING	- DO -	P	W	V										
		CONTINUITY	CR	ELECT	100%	CUSTOMER SPECIFICATION / APPROVED DRAWING	CUSTOMER SPECIFICATION / APPROVED DRAWING	INSPECTION REPORT	P	W	V										
		IR / HV	CR	ELECT	100%	HV test 2.5 kv for Power & 1.5 kv for Control, 1 Mohm at 500 V		- DO -	P	W	V										THESE TESTS TO BE DONE BEFORE OPERATIONAL TEST
		OPERATION LOCK ETC	CR	ELEC OPERATION & FUNCTION IN ENERGISED CONDITION	1/TYPE	TANGEDCO APPROVED DRAWING & SPECIFICATION		- DO -	P	W	V										
		EARTHING OF MOTOR BODY	MA	VISUAL	100%	- DO -	- DO -	- DO -	P	W	V										

Note: ~~Control Panel~~ shall be packed in wooden packing.

LEGEND: RECORDS IDENTIFIED WITH "TICK" (✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION  
 \*\* M: MANUFACTURER / SUPPLIER TO BHEL  
 B: BHEL N° CUSTOMER  
 P: PERFORM W: WITNESS V: VERIFICATION AS APPROPRIATE

BHEL DOC No.: PE-V8-307-172-N005

NAME AND SIGN OF APPROVING AUTHORITY AND SEAL

	<b>TITLE:</b> <b>TECHNICAL SPECIFICATION FOR          SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II</b> <b>PEC, MINISTRY OF ELECTRICITY AND ENERGY</b> <b>REPUBLIC OF YEMEN</b>	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
		VOLUME <b>II-B</b>	
		SECTION –C2	
		REV. NO. 00	DATE:
		PAGE	

## SECTION – C2

### SPECIFIC TECHNICAL REQUIREMENTS (ELECTRICAL)



**TECHNICAL SPECIFICATION FOR  
Sewage Treatment Plant (ELECTRICAL  
PORTION)**

SPECIFICATION NO. PE-TS-372-  
VOLUME II B  
SECTION-C  
REV 00                      DATE 04.08.2014  
PAGE 1 OF 1

**ELECTRICAL EQUIPMENT SPECIFICATION FOR SEWAGE TREATMENT PLANT**

**1.0 EQUIPMENT & SERVICES TO BE PROVIDED BY BIDDER/ PURCHASER**

- 1.1 Scope for supply, and erection & commissioning of various equipment forming part of electrical system for this package shall be as per Annexure-I to Section – C [Electrical Scope between BHEL & Vendor].
- 1.2 Make of various equipment/ items in the scope of bidder shall be to approval of owner during detailed engineering stage without any commercial implications.
- 1.3 Bidder shall furnish all 400V AC loads required for the system such as motor feeders, supply feeders in PEM format along with the offer.
- 1.4 All electrical equipment shall be suitable for the power supplies, fault levels and climatic conditions indicated in project information enclosed with the specification.
- 1.5 All drawings, data sheets, Quality Plan, calculations, test reports, test certificates, etc. shall be submitted during detailed engineering stage. The same shall be subject to approval without any commercial implications.
- 1.6 Technical requirements shall be as per specifications listed in Clause 4.1, 4.2, 4.3 & 4.4 below.

**3.0 DOCUMENTS TO BE SUBMITTED ALONG WITH BID**

- 3.1 Bidder shall confirm total compliance to the electrical specification without any deviation from the technical/ quality assurance requirements stipulated. In line with this, the bidder as technical offer shall furnish two signed and stamped copies of the following:
  - a) A copy of this sheet “Electrical Equipment Specification for Sewage Treatment Plant” and sheet “Electrical Scope between BHEL and Vendor” with bidder’s signature and company stamp.
  - b) List of Erection and Commissioning spares.
  - c) List of Erection & Maintenance tools & tackles.
  - d) Electrical load requirement in the load data format.
- 3.2 No technical submittal such as copies of data sheets, drawings, write-up, quality plans, type test certificates, technical literature, etc, is required during tender stage. Any such submission even if made, shall not be considered as part of offer.

**4.0 LIST OF ENCLOSURES**

- 4.1 Electrical Scope Matrix between BHEL & vendor (Annexure-I).
- 4.2 Technical specification and Data Sheets for 400V Electric Motors.
- 4.3 Technical Specification for Miscellaneous electrical item
- 4.4 Quality Plan for motors.
- 4.5 Load data format (Annexure-II).

**ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR****PROJECT: MARIB 400MW GTPS PROJECT, PHASE-II****PACKAGE: SEWAGE TREATMENT PLANT**  
(Civil in BHEL scope)


S.NO	DETAILS	SCOPE SUPPLY	SCOPE E&C	REMARKS
1	400V MCC	BHEL	BHEL	1. BHEL will provide single phase 230 V AC(supply feeder)/ 400V, 3-phase 4-wire supply based on load data provided by vendor for all equipment supplied by vendor as part of contract. Any other voltage level (AC/DC) required will be derived by the vendor. Any other local panels if required shall be in vendor scope. 2. Interposing relays (RE 302 of Jyoti make or equivalent), if required for PLC based system, shall be provided by BHEL in MCCs. Requirement of these relays shall be furnished by vendor during detailed engineering stage.
2	Local Push Button Station (for motors)	BHEL	BHEL	Located near the motor.
3	Power cables, control cables and screened control cables for a) both end equipment in BHEL's scope b) both end equipment in vendor's scope c) one end equipment in vendor's scope	BHEL BHEL BHEL	BHEL BHEL* BHEL	1. Sizes and quantity of cables required shall be informed by vendor at contract stage (based on inputs provided by BHEL). Finalisation of cable sizes shall be done by BHEL. Vendor shall provide lugs & glands accordingly. 2. Termination at BHEL equipment terminals by BHEL. 3. Termination at Vendor equipment terminals by BHEL*.
4	Any special type of cable like compensating, co-axial, prefab, MICC etc.	Vendor	BHEL*	
5	Cable trays, accessories & cable trays supporting system within sewage treatment plant battery limit	Vendor	BHEL*	Cable trays shall be of tough FRP. Drawings shall be subject to customer/BHEL approval at contract stage without any price implication.
6	Cable glands and lugs for equipments supplied by Vendor	Vendor	BHEL*	1. Cable glands shall be Double compression type, tinned brass, shrouded, complete with necessary armour clamp and tapered washers etc. (suitable for selected cable size). 2. Heavy duty tinned copper lugs (suitable for selected cable size). Lugs for power cables shall be of compression type, whereas lugs for control cables shall be of insulated terminal crimping type.
7	Conduit and conduit accessories for cabling between equipments supplied by vendor	Vendor	BHEL*	Conduits shall be of rigid steel, hot-dip galvanized, furnished in standard lengths threaded at both ends. Minimum diameter of conduits shall be 20 mm. All conduits shall be heavy duty suitable for electrical installation.

S.NO	DETAILS	SCOPE SUPPLY	SCOPE E&C	REMARKS
				Flexible conduits where required, near equipment terminations, shall be made with bright, cold rolled, annealed and electro- galvanized mild steel strips. In corrosive areas epoxy coated conduits shall be provided. Makes of conduits shall be subject to customer/BHEL approval at contract stage.
8	Lighting	BHEL	BHEL	
9	Equipment grounding & lightning protection	BHEL	BHEL	
10	Below grade grounding	BHEL	BHEL	
11	LT Motors with base plate and foundation hardware	Vendor	BHEL*	Makes shall be subject to customer/ BHEL approval at contract stage.
12	Junction boxes	Vendor	BHEL*	Wherever required as per system requirement
13	E & C spares, erection & maintenance tools & tackle.	Vendor	-	As per specification
14	Any other equipment/material/service required for completeness of system but not specified above (to ensure trouble free and efficient operation of the system).	Vendor	BHEL*	
15	a) Input cable schedules (C & I) b) Cable interconnection details for above c) Cable block diagram	Vendor Vendor Vendor	- - -	Cable listing for C & I systems for vendor supplied equipment shall be furnished during detail engineering by vendor in soft copies in the BHEL cable schedule format.
16	Equipment layout drawings	Vendor	-	For ensuring cabling requirements are met, vendor shall furnish layout drawings (both in print form as well as in AUTOCAD) of the complete plant (including electrical area) indicating location and identification of all equipments requiring cabling, and shall incorporate cable trays routing details marked on the drawing as per PEM interface comments. Electrical equipment layout drawing shall be to BHEL approval.
17	Electrical Equipment GA drawing	Vendor	-	For necessary interface review.

**NOTES:**

1. Make of all electrical equipments/items supplied shall be reputed make & shall be subject to approval of BHEL/customer after award of contract.
2. All QPs shall be subject to approval of BHEL/customer after award of contract without any commercial implication.  
For skid mounted system (if applicable), 2 nos. (1W+1S) supply of 400V, 3 phase 4-wire AC shall be provided by BHEL. Complete electrical distribution for the skid including changeover between feeder/starters/LCP/inter-locks/protection devices / any other supply etc. shall be in bidder's scope.  
FURTHER THE CABEL REQUIRED INSIDE THE SKID SHALL BE IN BIDDERS SCOPE.  
BHEL\* means E & C by BHEL and supervision by vendor.

THIS IS A PART OF TECHNICAL SPECIFICATION PE-TS-372-673-A001

	<b>TITLE:</b> <b>TECHNICAL SPECIFICATION FOR          SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II</b> <b>PEC, MINISTRY OF ELECTRICITY AND ENERGY</b> <b>REPUBLIC OF YEMEN</b>	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
		VOLUME <b>II-B</b>	
		SECTION -C2	
		REV. NO. 00	DATE:
		PAGE	

## DATA SHEET A FOR MOTORS

FICHTNER

Volume - V

Project	Subject	Tender Doc. No.	Rev	Section
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-EPC-700-001	C	8.8
				Sheet No. 7

**8.8.5 Specified Design Data**

**SECTION : ELECTRIC MOTORS**

**8.8.5.1 AC Motors**

**Rated Voltage**

Less than and equal to 250 kW

V 400

Larger than 250 kW

V 6600 V

**Rated Frequency**

Hz 50

**Voltage variation**

±10%

**Frequency Variation**

±5%

**Absolute sum of variation**

10%

**Rated Voltage for DC Motors**

V 220 V ±10% to -15% (125 +10% to -15% if GTG supplier's standard)

**Class of Insulation for all Motors**

Class 'F' with temperature Limited to Class 'B'

**Starting Current**

6 times FLC.

**Degree of protection**

IP 44/IP W 55

**Method of cooling**

TEFC/CACA

**Fault withstand capability of terminal box**

Fault current for 0.2 sec. for breaker controlled motors

**No. of consecutive hot starts with initial temperature of motor at final steady working temperature**

Two


**No. of hourly starts uniformly distributed from final temperature**

Three (3)

FORM19-P REV/B





	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
		VOLUME II-B	
		SECTION –C3	
		REV. NO. 00	DATE:
		PAGE	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II</b> <b>PEC, MINISTRY OF ELECTRICITY AND ENERGY</b> <b>REPUBLIC OF YEMEN</b>		

## SECTION – C3

### SPECIFIC TECHNICAL REQUIREMENTS (CONTROL AND INSTRUMENTATION)



**SPECIFIC TECHNICAL  
REQUIREMENT**

SPECIFICATION NO.

VOLUME **II-B**


SECTION

REV. NO. 00

DATE: 09/09/2014


SHEET 1 OF 1

1. Bidder to include Field instrumentation and Field Junction Box (JB's), in his scope of supply. Field instrument specification and Data Sheet are given elsewhere in this spec.
2. All field cabling for instruments/motor/pump/blower to JB is in bidder's scope and details are given elsewhere in this spec. JB to PLC shall be provided by BHEL as free issue whereas cable schedule, cable interconnections and wiring diagram for the same shall be in bidders' scope.
3. Instrument installation drawings are to be provided by bidder. All instrument fitting and erection hardware as per instrument installation diagram shall be in bidder's scope.
4. All manual valves at pump discharge shall be provided with Open and Close Limit Switches.
5. PLC control system as defined in the enclosed specs and DATA Sheets shall be in bidder scope. The PLC system shall comprise of (i) PLC based local panel (ii) UPS Power supply (iii) Operator interface in the form of CRT, keyboard and OWS along with required furniture.
6. The redundant I/O's shall be provided for all Controls.
7. PLC shall have the facility to synchronize its time with BHEL supplied GPS. Necessary Hardware (IRIG-B port) for same at PLC end to be provided by bidder. The cable connecting PLC and GPS shall be in BHEL scope.
8. PLC shall be connected to DCS through serial link with MODBUS connection on TCP/IP Protocol compliant for monitoring. Dual redundant fibre optic cable from PLC to DCS shall be in bidders' scope. For bidding purpose bidder to consider 300 meters approximate distance between PLC and DCS. Necessary Patch Chord/ Converters, LIU at PLC end, shall be in bidder scope.
9. All furniture (tables, chairs etc.) required for PLC operator HMI shall be in bidder's scope. Chairs shall be capable of being adjusted for height and position of backrest. The chairs shall be mounted on five castors, shall swivel and shall have arm rests'. One table and chair shall be provided for each operator station and separate table for each printer.


	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
		VOLUME II-B	
		SECTION -D	
		REV. NO. 00	DATE:
		PAGE	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II</b> <b>PEC, MINISTRY OF ELECTRICITY AND ENERGY</b> <b>REPUBLIC OF YEMEN</b>		

## SECTION – D

### GENERAL TECHNICAL REQUIREMENTS

	<b>TITLE:</b> <b>TECHNICAL SPECIFICATION FOR          SEWAGE TREATMENT PLANT</b>  <b>400 MW, MARIB GTPS, PHASE-II          PEC, MINISTRY OF ELECTRICITY AND          ENERGY REPUBLIC OF YEMEN</b>	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
		VOLUME <b>II-B</b>	
		SECTION -D1	
		REV. NO. 00	DATE:
		PAGE	

**SECTION-D1**  
**GENERAL TECHNICAL REQUIREMENT (MECHANICAL)**

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>	VOLUME <b>II-B</b>	
	<b>400 MW, MARIB GTPS, PHASE-II PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	SECTION –D1	
		REV. NO. 00	DATE:
		PAGE	

**GENERAL**

The scope covers the basis of design, system philosophy, equipment selection and Control Philosophy of **SEWAGE TREATMENT PLANT** for **400 MW MARIB GAS TURBINE POWER STATION PHASE II REPUBLIC OF YEMEN**.

**1.0 SEWAGE TREATMENT PLANT (Ref. Drg. no. PE-DG- 372-673-A001)**

Plant sewerage is collected in a septic tank. Overflow from the septic tank is collected in a collection chamber. From the collection chamber overflow is pumped to the aerobic treatment chamber by means of 2x100 % overflow transfer pumps. Extended aeration is done in the aerobic treatment chamber with the help of air supply from blowers. The treated water after aerobic treatment is transferred to the N-Pit (DM Plant) by means of 2X100% treated water transfer pumps.

**2.0 Control Philosophy.**

The interlocks required for operation of pumps in various systems shall be PLC based.

The control of all pumps and blower is PLC. In addition, each pump will be provided with one local start/stop push button (lockable type) stations. Suitable weather protection shall be provided for LSSPB (Local start stop push button) located near each pump.

The sewage waste from buildings is collected in a septic tank through gravity. The overflow from septic tank is collected in a collection tank. Once the level in the collection tank is high, one out of the two overflow transfer pumps (1W+1S) shall be started remote/manually and the waste is transferred to aerobic treatment chamber. Overflow transfer pumps shall be interlocked to trip with the low/high level of the tank via level transmitter.

The aerobic process in the aerobic treatment chamber is a batch process. Once the waste enters the aerobic treatment chamber, one out of the two Air blowers (1W +1S) shall be started automatically/manually. The batch timing is around 8 hours. Once the process is completed after 8 hours, Air blowers shall be stopped automatically/ manually and one out of the two Treated water Transfer Pumps (1W+1S) shall be started automatically/ manually. Treated water transfer pumps shall be interlocked to trip with the low/high level of the tank via level transmitters.


ON/OFF/TRIP interlocks for submersible pumps and air blower shall be provided by providing suitable arrangement to meet the system requirement.

**3.0 Sewage Treatment Plant is designed for the following sewage flow rate and characteristics:**

Flow Rate : 0.5 m3/hr.  
BOD : 300 mg/l

**4.0 Effluent from Sewage Treatment Plant shall meet the following norms-**

Parameter	Maximum value
BOD	20 ppm


	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-673-A001	
	<b>TECHNICAL SPECIFICATION FOR SEWAGE TREATMENT PLANT</b>	VOLUME <b>II-B</b>	
	<b>400 MW, MARIB GTPS, PHASE-II PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	SECTION -D1	
		REV. NO. 00	DATE:
		PAGE	

## GENERAL TECHNICAL REQUIREMENT FOR SUBMERSIBLE PUMP

CLAUSE NO.	TECHNICAL REQUIREMENTS
	<b>SUBMERSIBLE PUMPS</b>
<b>1.00.00</b>	<b>SCOPE</b>
1.01.00	This specification covers general requirements in respect of design, material, manufacture, construction, testing & inspection at Vendor's / sub-vendor's delivery to site, of submersible pumps.
<b>2.00.00</b>	<b>CODES AND STANDARD</b>
	The design manufacture and performance of submersible pumps shall be comply with all currently applicable statues, regulation, and safely codes in the locality where the Equipment will be installed. The Equipment shall also conform to the latest applicable Indian standards listed below other Nation Standards are acceptable, if they are established to be equal or superior to the listed standards. Nothing in these specifications shall be construed to relieve the contractor of this responsibility.
2.01.00	<b>List of Applicable Indian Standards</b>
	IS:8034                      -              Submersible pumps for clear cold fresh water
	IS:5120                      -              Technical requirement of Rotodynamic Special Purpose pumps.
	In case of any contradiction with aforesaid standards and the stipulations as per technical specification as specified hereinafter the stipulation of the technical specification shall prevail.
<b>3.00.00</b>	<b>DESIGN AND PERFORMANCE REQUIREMENTS</b>
	a)        The pump shall be of single stage mono - block type with non-clog design.
	b)        Components of Identical pumps shall be interchangeable.
	c)        Pumps shall have a continuously rising head characteristic.
<b>4.00.00</b>	<b>MOTOR RATING</b>
	Continuous motor rating (at 50 deg. C ambient) for pumps shall be at least ten percent (10%) above the maximum load demand of the driven equipment in the complete operating range to take care of the system frequency variations.
<b>5.00.00</b>	<b>FEATURES OF CONSTRUCTION</b>
	a)        Pumps shall be of Submersible, wet pit type.

CLAUSE NO.	TECHNICAL REQUIREMENTS
6.00.00	<p>b) Pumps shall be able to pass through solids upto 40 mm and capable of handling waste water which may contain, sludge, plastic solids etc.</p> <p>c) Coupling device shall ensure leak proof joint between the pump and discharge elbow. This shall also enable pump to be removed from the sumps without the necessity of dismantling any nuts, bolts etc.</p> <p>d) Pumps shall be portable type and capable of using in any sump as and when required. Pump shall be provided with required stool, flexible, hoses chain connection etc. for easy installation, removal and maintenance. Adequate length of chain required for lowering the pump into the sump and flexible type discharge pipe shall be provided.</p> <p>e) Impeller</p> <p>Impeller type shall be open/semi-closed type/closed as indicated elsewhere. Enclosed impellers shall be equipped with seal rings on their hubs. In case of open impeller, the pump shall be design to take care of the additional thrust produced.</p> <p><b>MOTOR</b></p> <p>i) Motor shall be coupled directly to the impeller shaft.</p> <p>ii) The motor shall be suitable for operation when submersed in water. The housing shall have required degree of protection.</p> <p>iii) Necessary arrangement to be made to make cable entry absolutely water tight, with cores cast in insulation along with cable gland 'O' ring seat.</p> <p>iv) Built in temperature sensors are to be provided to enable tipping of motor if temperature rises above the design temperature limit. These sensors are to be used directly in the circuiting of control panel. The control circuit should trip the motor if the temperature rises beyond safe limits.</p> <p>v) Moisture sensors are to be embedded in motor chamber to trip the motor in case of moisture entry in motor due to failure of pump mechanical seal.</p> <p>vi) Motor shall be oil filled/oil lubricated or water filled type. Pressure equalizing diaphragm and sand guards with seal shall be provided to prevent the water and sand entering the motor.</p> <p>vii) Power supply to the motor and control connections shall be preferably combined in one cable and shall be flexible copper conductor PVC insulated, armored and overall hard grade PVC sheathed, and suitable for under water service. The cable gland shall be properly sealed to prevent entry of pumped liquid the motor. Length of the cable shall be of suitable for site conditions. The cable shall be terminated on the control panel with necessary facility to terminate with the power receptacle.</p>

CLAUSE NO.	TECHNICAL REQUIREMENTS
7.00.00	<p>viii) For pumps which are specified under portable application, Cable shall be suitable for continuous winding/un winding duty on a cable reeling drum and shall be installed on a trolley mounted on wheels. Associated control panel is also to be mounted on the trolley.</p> <p>ix) Water level controller shall be provided which should be with two level controls, high to start and low to stop.</p> <p><b>EQUIPMENT DATA SHEET</b></p> <p>Type of pump : Submersible type fixed inside pits/ sump with guides /lifting chains</p> <p>Type of Working Fluid : Drains with particle size upto 40 mm</p> <p>Type of impeller : Open</p> <p>Type of lubrication : Self / Grease / Oil</p> <p>Speed : Preferably 1500 rpm (maximum)</p> <p><b>Material of Construction</b></p> <p>a) Casing : 2% Nickel Cast Iron, IS:210 Grade FG 260;</p> <p>b) Impeller : SS-316</p> <p>c) Shaft : SS- 410</p> <p>d) Bolts &amp; nuts : SS-316</p> <p>e) Accessories : Suction Strainer, Pump stand, Adaptors for discharge flange, Level measuring devices/ Controllers, Lifting hook &amp; chain handle to agitate debris etc, Discharge hose connected with piping upto the drains etc.</p> <p>f) The discharge, suction /column pipes shall be heavy grade Carbon steel externally lined with epoxy or galvanised.</p>

	TITLE:	BHEL DOCUMENTS NO.: PE-TS-372-164-A001	
	<b>TECHNICAL SPECIFICATION FOR EFFLUENT TREATMENT PLANT</b>	VOLUME <b>II-B</b>	
	<b>400 MW, MARIB GTPS, PHASE-II PEC, MINISTRY OF ELECTRICITY AND ENERGY REPUBLIC OF YEMEN</b>	SECTION – C1	
		REV. NO. 00	DATE:
		PAGE	

## PAINTING REQUIREMENT

**FICHTNER**

**Volume - IV**

PROJECT	SUBJECT	TENDER DOC. NO.	REV	SECTION
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C	7.6
				<b>SHEET NO.</b>
				1

**(PEC TENDER NO.: 12/2008)**

**VOLUME IV  
SECTION 7.6  
CLEANING, PROTECTIVE COATING AND PAINTING**

FORMT9-P REV-B

**FICHTNER**

**Volume - IV**

PROJECT	SUBJECT	TENDER DOC. NO.	REV	SECTION
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C	7.6
				<b>SHEET NO.</b>
				2

**(PEC TENDER NO.: 12/2008)**

**Table of Contents**

7.6.0	CLEANING, PROTECTIVE COATING AND PAINTING	3
7.6.1	GENERAL	3
7.6.2	MECHANICAL CLEANING AT MANUFACTURER'S WORKS	4
7.6.3	ALTERNATIVE CHEMICAL CLEANING AT MANUFACTURER'S WORKS	5
7.6.4	PROTECTION AT MANUFACTURER'S WORKS	5
7.6.5	WEATHER CONDITIONS	5
7.6.6	SURFACE PREPARATION	5
7.6.7	RUB DOWN AND TOUCH UP OF PRIMER	8
7.6.8	NON COMPATIBLE SHOP COAT PRIMER	8
7.6.9	PAINT MATERIALS	9
7.6.10	STORAGE	9
7.6.11	PREPARATION OF COATING MATERIALS	9
7.6.12	APPLICATION	10
7.6.13	SAFETY REQUIREMENTS	10
7.6.14	DRY FILM THICKNESS (DFT)	10
7.6.15	PROTECTIVE COATINGS AND PAINT SYSTEMS	11
7.6.16	COLOUR CODE FOR PIPING	11
7.6.17	IDENTIFICATION OF VESSELS, PIPING ETC.	12
7.6.18	INSPECTION AND TESTING	12
7.6.19	PRIMER APPLICATION	13
7.6.20	GUARANTEE	13
7.6.21	SCOPE OF AREAS TO BE PAINTED AND PAINTING SYSTEMS	13
7.6.22	GALVANIZING	13
7.6.23	SPRAYED METAL COATINGS	15
7.6.24	SAFETY OF WORK	15

FORMT9-P REV-B

FICHTNER

Volume - IV

PROJECT	SUBJECT	TENDER DOC. NO.	REV	SECTION
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C	7.6
				SHEET NO.
				3

**7.6.0 CLEANING, PROTECTIVE COATING AND PAINTING**

**7.6.1 General**

This specification covers the general requirements related to the cleaning protective coating and painting of equipment, components and system. The components and/or equipment shall be mechanically and /or chemically cleaned during the following stages of the Contract.

- Cleaning in workshop
- Cleaning before painting and/or corrosion protection (application of prime coat)
- Cleaning before erection and during installation.

Cleaning of fabricated component items shall be carried out after fabrication and final heat treatment or welding at manufacturer's works or at site, as appropriate.

For cleaning in workshop and before painting mechanical cleaning as opposed to alternative chemical cleaning is the preferred method for works cleaning except where this is precluded by design or access considerations.

Machined surfaces shall be protected during the cleaning operations.

In the event of the surfaces not being cleaned to the purchaser's satisfaction, such parts of the cleaning procedures or agreed alternatives as are deemed necessary to overcome the deficiencies shall be carried out at the supplier's sole expense.

For reclining small areas, hand cleaning by wire brushing may be permitted. Wire brushes used on austenitic steel bristles.

Austenitic stainless steels, copper and aluminium alloys, cast iron, bimetallic and metallic/plastic items, and components fabricated by spot welding or riveting shall not be chemically cleaned. All weld areas shall be suitably stress relieved before chemical cleaning.

**Codes and Standards**

Internationally recognized codes and standards with purchasers approval shall be followed for the work covered by this contract.

**Surface Preparation Standards**

The following standards shall be followed for surface preparations:

- Swedish standard Institution - SIS-05 5900-1967 (Surface preparation standards for painting steel surfaces).
- Steel structures painting council, U.S.A. (Surface Preparation Specifications (SSPC-SP).
- British Standards Institution (Surface Finish of Blast cleaned steel for painting) BS-4232.
- National Association of Corrosion Engineers, U.S.A. (NACE).
- Various international standards equivalent to Swedish standard for surface preparation are given in Table-1.

FORMT9-P REV-B

**FICHTNER**

**Volume - IV**

PROJECT	SUBJECT	TENDER DOC. NO.	REV	SECTION
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C	7.6
				<b>SHEET NO.</b>
				4

The contractor shall arrange, at his own cost, to keep a set of latest edition of the above standards and codes at site.

The paint manufacturer's instruction shall be followed as far as practicable at all times. Particular attention shall be paid to the following:

- a) Proper storage to avoid exposure as well as extremes of temperature.
- b) Surface preparation prior to painting.
- c) Mixing and thinning
- d) Application of paints and the recommended limit on time intervals between coats.
- e) Shelf life for storage.

Any painting work (including surface preparation) on piping or equipment shall be commenced only after the system tests have been completed and clearance for taking up painting work is given by the Engineer, who may, however, at his discretion authorise in writing, the taking up of surface preparation or painting work in any specific location, even prior to completion of system test.

**Equipment**

All tools, brushes, rollers, spray guns, blast material, hand power tools for cleaning and all equipment, scaffolding materials, shot/sand blasting equipment & air compressors etc. shall be arranged by the contractor at the site in sufficient quantity at his own cost. He shall arrange at his own cost, for suitable paint thickness measuring instrument like Elkometers acceptable to the Engineer (with calibration facilities).

Mechanical mixing shall be used for paint mixing operations in case of two pack systems except that the Engineer may allow the hand mixing of small quantities at his discretion.

**7.6.2 Mechanical Cleaning at Manufacturer's Works**

Mechanical cleaning shall preferably be carried out by abrasive blasting. The Owner is prepared to consider alternative methods provided they achieve the necessary surface condition.

Surface condition:

The Metal surfaces shall be clean and free of mill scale, rust, dirt, grease and any other deleterious matter.

Where metal surfaces are to be painted the surface profiles shall conform with the painting specification requirements.

Where this does not apply surfaces shall have a surface texture not coarser than Grade 80 abrasive paper.

Abrasives:

Abrasives containing silica, silicates or slag residues shall not be used for water/steam side surfaces of plant except for cleaning sand castings, where hydro blasting with sand may be used.

For austenitic materials only, abrasives containing 98% or more of alumina, Al<sub>2</sub> O<sub>3</sub>, shall be used.

Removal of abrasive and debris:

FORMT9-P REV-B

FICHTNER

Volume - IV

PROJECT	SUBJECT	TENDER DOC. NO.	REV	SECTION
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C	7.6
				<b>SHEET NO.</b>
				5

After cleaning, abrasive and debris shall be thoroughly removed from components.

**7.6.3 Alternative Chemical Cleaning at Manufacturer's Works**

The procedure shall comprise:

- Pre-treatment
- Acid treatment

To achieve cleanliness equivalent to that specified for mechanical cleaning. The procedure to be adopted must meet with the purchaser's approval.

**7.6.4 Protection at Manufacturer's Works**

As soon as all items have been cleaned and within four hours of the subsequent drying, they shall be given suitable anti-corrosion protection.

All water, air and steam side surfaces shall be protected by the application of approved water soluble corrosion inhibitors, or vapour phase inhibitors that can be subsequently removed by site water washing or steam blowing.

The rate of application of volatile corrosion inhibitors shall be at least 10 grams per square metre or 35 grams per cubic metre, whichever is the greater, except for pipes up to 300 mm diameter for which the minimum application rates shall be 5 grams per square metre.

Immediately after the protective treatment has been applied all vessels and pipes shall be suitably sealed off by discs or caps or approved alternatives to prevent ingress from the surrounds. Cylindrical plugs shall not be driven into the ends of pipes. These protective covers shall not be removed until immediately before final connection is made to the associated equipment.

**7.6.5 Weather Conditions**

Painting shall be done only when the surface temperature is above 5°C. surface temperature must be at least 3°C above dewpoint to ensure that condensation does not occur on the surface.

Reasonable protection against precipitation, corrosive fumes and vapours shall be exercised for the painting of outdoor parts.

Precautions shall also be taken against solar radiation to ensure that the specified dry film thickness of priming or finish coats is obtained.

Any prime coat exposed to excess humidity, rain, dust etc., before drying, shall be permitted to dry and the damaged area of primer shall be removed and the surface prepared and primed again.

Sheltered or unventilated horizontal surfaces on which dew may collect require more protection, and to achieve this an additional top coat of paint shall be applied.

**7.6.6 Surface Preparation**

In preparing any surface to be coated, all loose paint, dirt, grease, rust, scale, weld slag or spatter or any other extraneous material shall be removed and defects repaired, so as to obtain a clean, dry, even surface to receive the priming or finishing coat (s) as called for in the

FORMT9-P REV-B

FICHTNER

Volume - IV

PROJECT	SUBJECT	TENDER DOC. NO.	REV	SECTION
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C	7.6
				SHEET NO.
				6

painting schedules. Sharp edges should be rounded, especially when tank linings have to be applied.

All machined surfaces, including flange faces, shall be suitably covered to prevent damage during surface preparation.

All surfaces should be blast cleaned whenever possible.

Surface preparation methods

Bare steel surfaces should be prepared by one of the methods described below in order of preference and in accordance with Swedish Standard SIS 05 59 00 or Steel Structures Painting Council, SSPC, Vis 1, or DIN 55928, section 4.

**(a) White metal blast cleaning:** Sa 3 or SSPC - SP 5

Sa 3 Blast cleaning to bare metal. Mill scale, rust and foreign matter must be removed completely. Subsequently, the surface is cleaned with vacuum cleaner, clean dry compressed air or a clean brush. It must then have a uniform metallic colour and correspond in appearance to the prints designated Sa 3.

**(b) Near white metal blast cleaning** Sa 2 1/2 or SSPC - SP 10

Sa 2 1/2. Very thorough blast cleaning. Mill scale, rust and foreign matter shall be removed to the extent that the only traces remaining are slight imperfections in the form of spots or stripes. Subsequently, the surface is cleaned with a vacuum cleaner, clean dry compressed air or a clean brush. It must then correspond in appearance to the prints designated sa 2 1/2.

Mechanical cleaning should only be used when procedures (a) and (b) are not practicable.

**(c) Commercial Blast Cleaning** Sa 2

Sa 2 Blast cleaning until atleast two-thirds of each element of surface area is free of all visible residues. This method of Blasing is suitable for steel required to be painted with conventional paints for exposure to mildly corrosive atmesphere for longer life of the paint systems.

**(d) Near white metal blast cleaning** P Sa 2 1/2 DIN 55928

Very thorough blast cleaning. Very adhesive coatings remain. From all other surface mill scale and rust are to be removed to such an extent that the only traces remaining are slight imperfections in the form of spots or stripes. Further treatment see Sub b).

The adhesivity of residual coatings in the transition zone has to be tested even after the application of the primer.

**(e) very thorough mechanical scraping and wire burshing** St 3

St 3 very thorough scraping and wire-burshing - machine brushing - grinding - etc. are to be preferred. Surface preparation as for st 2. But much more thoroughly. After the removal of dust, the surface must have a pronounced metallic sheen and correspond to the prints designated St. 3.

**(f) Thorough scraping and wire brushing:** St 2

St 2 Thorough scraping and wire-brushing - machine brushing - grinding - etc. The treatment shall remove loose mill scale, rust and foreign matter. Subsequently, the surface is cleaned

FORMT9-P REV-B

**FICHTNER**

**Volume - IV**

PROJECT	SUBJECT	TENDER DOC. NO.	REV	SECTION
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C	7.6
				<b>SHEET NO.</b>
				7

with a vacuum cleaner, clean dry compressed air or a clean brush. It should then have a faint metallic sheen. The appearance must correspond to the prints designated St 2.

**Table-1 (Surface Preparation Standards)**

Surface preparation method	SIS 055900	DIN 55928, Part 4	BS 4232 only for blasting	SSPC-Vis
blasting acc.to item (a)	Sa 3	first quality	white metal	SP 5
blasting acc. to item (b)	Sa 2 1/2	second quality	near white	SP 10
blasting acc.to item (c)	Sa 2	Third quality	Commercial Blast	SP 6
derusting acc to item (f)	St 2	–	Hand tool/ power tool Cleaning	SP 2
acc. to items (e)	St 3	–	Power tool Cleaning	SP 3
Flame jet cleaning	F1	–	Flame cleaning	SP 4
Pickling	Be	–	Pickling	

Steel structures to be blast cleaned have to be free of pitting and other severely corroded places in accordance with B.S. 4232 and SIS 055900.

The abrasives used for blast-cleaning shall be graded flint, grit, shot or silica sand and shall be such that they will produce an average keying profile on the blast-cleaned surface of not more than 40 microns.

An air pressure of 7 bar g at the nozzle shall be used.

After blast-cleaning, all accumulated grit, sand, dust, etc., must be removed leaving the surface clean, dry and free of mill scale, rust grease and other foreign matter.

FORMT9-P REV-B

**FICHTNER**

**Volume - IV**

PROJECT	SUBJECT	TENDER DOC. NO.	REV	SECTION
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C	7.6
				SHEET NO.
				8

In the event of rusting after completion of the surface preparation, the surface must be cleaned again in the manner specified.

Oil, grease, soil, cement, salts, acids or other corrosive chemicals shall be cleaned from steel surfaces, by the use of solvents, emulsions or cleaning compounds. The final wiping shall be with clean solvent and clean rags or brushes. There shall be no detrimental residue left on the surface.

Primed areas which suffer damage must be spot blasted on site to a degree of cleanliness P Sa 2 1/2 before touching up.

Protective coating must be applied as quickly as possible after the completion of surface preparation no matter what cleaning method has been used.

No blast-cleaned surface shall be allowed to remain uncoated overnight.

Steel work protected by shop primer after arrival on site must be cleaned of salt, sand, oil etc. before the first coat of paint is applied on site. Shop primer damaged during transport must be rectified by blast-cleaning and coating before application of the site coats.

Wood surfaces shall be sanded clean. All nail holes shall be puttied and sanded before priming.

Concrete: If a protective coating is required, concrete shall be allowed to cure before painting.

**7.6.7 Rub Down and Touch up of Primer**

The shop coated surfaces shall be rubbed down thoroughly with emery paper to remove all dust, rust and other foreign matters, washed, degreased, then cleaned with warm fresh water and air dried. The portions, from where the shop coat has peeled off, shall be touched up and allowed to dry before applying a coat of primer. The compatibility between shop coat and field primer should be ascertained from the paint manufacturer. In case degreasing with white spirit is not effective, the surface should be finally wiped clean with aromatic solvent like xylol or light naphtha.

**7.6.8 Non Compatible Shop Coat Primer**

The compatibility of finishing coat should be confirmed from the paint manufacturer. In the event of use of primer such as zinc rich epoxy, inorganic zinc silicate etc., the paint system shall depend on condition of shop coat. If the shop coat is in satisfactory condition showing no major defect, the shop coat shall not be removed. The touch up primer and finishing coat(s) shall be identified for application by Engineer.

Shop coated (coated with primer & finishing coat) equipment shall not be repainted unless paint is damaged.

Shop primed equipment and surfaces shall only be 'spot cleaned' in damaged areas by means of power tool brush cleaning or hand tool cleaning and then spot primed before applying one coat of field primer unless otherwise specified. If shop primer is not compatible with field primer then shop coated primer shall be completely removed before application of selected paint system for particular environment.

For package units/equipment, shop primer shall be as per the paint system given for particular environment.

FORMT9-P REV-B

**FICHTNER**

**Volume - IV**

PROJECT	SUBJECT	TENDER DOC. NO.	REV	SECTION
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C	7.6
				<b>SHEET NO.</b>
				9

In case of existing paint, compatibility between finishing coat and new selected finish coat shall be ascertained before application of finish coat. In case the coat is selected for upgrading existing alkyd coating to high performance coating, then surface preparation can be by manual/mechanical means to remove loose rust, peeled off/damaged paint, but sound old coating need not be removed. It should be touched with red oxide zinc chromate primer wherever it has peeled of before application of tie coat. The tie coat shall be applied after 7 days of curing of red oxide zinc chromate primer. If new paint system is not suitable to upgrade existing coating then complete paint shall be removed by mechanical or blast cleaning before application of new coating system.

**7.6.9 Paint Materials**

Plant and equipment shall be painted according to the colour scheme followed in Phase-I

**7.6.10 Storage**

All paints and painting material shall be stored only in rooms to be provided by the contractor and approved by Engineer for the purpose. All necessary precautions shall be taken to prevent fire. The storage building shall preferably be separated from adjacent buildings. A signboard bearing the words "PAINT STORAGE - NO NAKED LIGHT - HIGHLY INFLAMMABLE - DANGER - NO SMOKING" shall be clearly displayed outside. All paints should be stored in the safest manner so that no container rolls down and causes accidents. The shelf life of the paints should be ensured so that the paint materials are not in storage and use after the date of expiry.

**7.6.11 Preparation of Coating Materials**

All container shall remain un-opened until required for use.

Primers and paints which have livered, gelled or otherwise deteriorated shall not be used.

The oldest primer or paint of each kind shall be used first.

All ingredients in any container shall be thoroughly mixed before use, and shall be agitated frequently during application to keep the primer in suspension.

Primer or paint mixed in the original container shall not be transferred until all settled pigment is incorporated into the body of the liquid.

Mixing in open containers shall be done in a well ventilated area.

Primer or paint shall be mixed in a manner ensuring the breakdown of all lumps, complete dispersion of pigment and uniform composition.

Two-component primers shall be mixed in accordance with the manufacturer's instructions.

Thinners shall not be added to primers or paints unless necessary for proper application according to the manufacturer's instructions.

When use of thinners is permitted, it must be added to the primer or paint during mixing.

FORMT9-P REV-B

**FICHTNER**

**Volume - IV**

PROJECT	SUBJECT	TENDER DOC. NO.	REV	SECTION
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C	7.6
				<b>SHEET NO.</b>
				10

**7.6.12 Application**

Health and safety of work

The supplier has to check all painting work to be carried out according to the specification of the paint supplier further to all relevant prescriptions and regulations concerning the health and safety of work.

The paint supplier has to present a written specification including at least the flash point of the paints, ventilation requirements, handling precautions such as inhalation, eye and skin protection, and first aid procedure, storage requirements, spill or leak procedure, fire precaution, waste disposal.

**7.6.13 Safety Requirements**

Protection of the blast cleaner operator's eyes and respiratory system should be given prime consideration in any open blast cleaning operation. Airfed helmets, respiratory filters, air conditioned hoods etc. should be provided in sufficient number to the blast cleaning operators to avoid the harmful effect of blast cleaning abrasives. Also, an automatic shut-off device which will shut-off the air supply to the blasting machine should be installed which will prevent the dangerous whipping of an operating blast hose if an operator becomes disabled.

**Methods**

Temporary corrosion protections are to be completely removed prior to applying the definite one.

All prime coatings shall be applied by brush or airless spray or a combination of these methods, as approved by the coating manufacturer.

All doors, windows, stairways, handrails (if painted), bolts, flanges and equipment supports shall be finish painted by brush.

Spray guns should not be used outside in windy weather or near surfaces of a contrasting colour unless the latter is properly protected.

All cold-spray painting shall be done using standard equipment in accordance with accepted standards and methods.

Care has to be taken not to connect spraying devices for nitro and backelite paints simultaneously to oil based paints.

Paint applied to items that are not be painted shall be removed at the supplier's expense, leaving the surface clean, unstained and undamaged.

**7.6.14 Dry Film Thickness (DFT)**

FORMT9-P REV-B

FICHTNER

Volume - IV

PROJECT	SUBJECT	TENDER DOC. NO.	REV	SECTION
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C	7.6
				SHEET NO.
				11

To the maximum extent practicable the coats shall be applied as a continuous film of uniform thickness and free of pores. Overspray, skips, runs, sags and drips should be avoided. The different coats shall not be of the same colour.

Each coat of paint shall be allowed to harden before the next is applied. For epoxy paint the hardening time normally is 12-14 hours. Suppliers' recommendations regarding hardening time of epoxy paints must be followed.

Particular attention must be paid to full film thickness at edges.

The minimum total dry film thickness of the paint systems shall be as recommended in the following table. The dft is given in microns (millionths of a metre).

**7.6.15 Protective Coatings and Paint Systems**

The type and number of protective coats for any item requiring painting are to be in accordance in the attached tables "Paint Systems" (Annex-1).

Alternative to the 'paint system' specified, are to be presented on the schedule Departure from Specification, as indicated elsewhere.

Generally, all parts shall receive the specified prime coat (s) at the supplier's works to ensure that no corrosion occurs during transport to the site and storage at the site.

Parts which cannot be damaged during transport shall receive the full number of coats.

**7.6.16 Colour Code for Piping**

The colour code scheme is intended for identification of the individual group of the pipeline. The system of colour coding consists of a ground colour and colour bands superimposed on it. The colour coding for the identification of pipelines should comply with the requirements of Phase-I.

Ground Colour shall be applied throughout the entire length for uninsulated pipes. For insulated pipes, on the metal cladding or on the pipes of material such as non-ferrous metals, austenitic stainless steel etc. Ground colour coating of minimum 2m length or of adequate length not to be mistaken as colour band shall be applied at places requiring colour bands. Colour band(s) shall be applied at the following location.

- a. At battery limit points
- b. Intersection points & change of direction points in piping ways.
- c. Other points, such as midway of each piping way, near valves, junction joints of service appliances, walls, on either side of pipe culverts.
- d. For long stretch/yard piping at 50 M interval.
- e. At start and terminating points.

**Identification Sign**

Flow direction shall be indicated by an arrow in the location stated in Para a,b,c & d and as directed by Engineer.

Colours of arrows shall be black or white and in contrast to the colour on which they are superimposed. The size of the arrows shall confirm to relevant standards.

Product names shall be marked at pump inlet, outlet and battery limit in a suitable size as approved by Engineer.

FORMT9-P REV-B

**FICHTNER**

**Volume - IV**

PROJECT	SUBJECT	TENDER DOC. NO.	REV	SECTION
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C	7.6
				<b>SHEET NO.</b>
				12

**Colour Bands**

The width of colour band shall conform to the requirements of Phase-I

Whenever it is required by the Engineer to indicate that a pipeline carries a hazardous material, a hazard marking of diagonal stripes shall be made as per the requirements of Phase-I

**7.6.17 Identification of Vessels, Piping etc.**

Equipment number shall be stenciled in black or white on each vessel, column, equipment & machinery (insulated or uninsulated) after painting. Line number in black or white shall be stenciled on all the pipe lines of more than one location as directed by Engineer, size of letters printed shall be as per applicable codes & standards

Identification of storage tanks: The storage tanks shall be marked as detailed in the respective drawing.

**7.6.18 Inspection and Testing**

All painting materials including primers and thinners brought to site by the contractor for application shall be procured directly from manufacturer as per specifications and shall be accompanied by manufacturer's test certificates. Paint formulations without certificates are not acceptable.

Engineer at his discretion, may call for tests for paint formulations. Contractor shall arrange to have such tests performed including batchwise test of wet paints for physical & chemical analysis. All costs thereof shall be borne by the contractor.

The paints shall be tested as per applicable codes & standards approved by the Owner.

The painting work shall be subject to inspection by Engineer at all times. In particular, following stagewise inspection shall be performed and contractor shall offer the work for inspection and approval of every stage before proceeding with the next stage. The record of inspection shall be maintained in the registers. Stages of inspection are as follows:

- a. Surface preparation
- b. Primer application
- c. Each coat of paint

In addition to above, record should include type of shop primer already applied on equipment e.g. Red oxide zinc chromate or zinc chromate or Red lead primer etc.

Any defect noticed during the various stages of inspection shall be rectified by the contractor to the entire satisfaction of Engineer before proceeding further. Irrespective of the inspection, repair and approval at intermediate stages of work, contractor shall be responsible for making good any defects found during final inspection/guarantee period/defect liability period as defined in general condition of contract. Dry film thickness (DFT) shall be checked and recorded after application of each coat and extra coat of paint should be applied to make-up the DFT specified without any extra coat to owner.

FORMT9-P REV-B

**FICHTNER**

**Volume - IV**

PROJECT	SUBJECT	TENDER DOC. NO.	REV	SECTION
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C	7.6
				SHEET NO.
				13

**7.6.19 Primer Application**

After surface preparation, the primer should be worked by brush application to cover the crevices, corners, sharp edges etc. in the presence of inspector nominated by Engineer.

The shades of successive coats should be slightly different in colour in order to ensure application of individual coats, the thickness of each coat and complete coverage should be checked as per provision of this specification. This should be approved by Engineer before application of successive coats.

The contractor shall provide standard thickness measurement instrument with appropriate range(s) for measuring.

Elcometer for measuring the Dry film thickness of each coat, surface profile gauge for checking of surface profile in case of sand blasting, Holiday detectors and pinhole detectors for checking the painted surface discontinuities should be provided by the contractor.

At the request of Engineer, the contractor shall make arrangements for paint manufacturer to provide expert technical service at site as and when required. This service should be free of cost and without any obligation to the Purchaser, as it would be in the interest of the manufacturer to ensure that both surface preparation and application are carried out as per their recommendations.

Final inspection shall include measurement of paint dry film thickness, check of finish and workmanship. The thickness should be measured at as many points/locations as decided by the Engineer and shall be within + 10% of the dry film thickness.

**7.6.20 Guarantee**

The contractor shall guarantee that the chemical and physical properties of paint materials used are in accordance with the specifications contained herein/to be provided during execution of work.

The contractor shall produce test reports from the manufacturer regarding the quality of the particular batch of paint supplied. The Engineer shall have the right to test wet samples of paint at random for quality of the same. Batch test reports of the manufacturer's for each batch of paints supplied shall be made available by the contractor.

**7.6.21 Scope of areas to be Painted and Painting Systems**

The paint system adopted shall be suitable for Coastal and Marine environment as given in Annex - 1.

Primers and finish coats for any particular paint system shall be from same manufacturer in order to ensure compatibility.

**7.6.22 Galvanizing**

Galvanizing works shall conform in all respect to applicable standards and shall be performed by the hot dip process, unless otherwise specified.

It is essential that details of steel members and assemblies which are to be hot-dip galvanized should be designed in accordance with applicable standards.

FORMT9-P REV-B

**FICHTNER**

**Volume - IV**

PROJECT	SUBJECT	TENDER DOC. NO.	REV	SECTION
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C	7.6
				<b>SHEET NO.</b>
				14

Vent-holes and drain-holes should be provided to avoid high internal pressures and air-locks during immersion, which may cause explosions, and to ensure that molten zinc is not retained in pockets during withdrawal.

Careful cleaning of welds is necessary before welded assemblies are dipped. The welds and the surrounding metal should be cleaned separately, preferably by blast-cleaning, because the usual preliminary pickling cannot be relied on to remove the welding slag.

All defects of the steel surface including cracks, surface laminations, laps and folds shall be removed in accordance with relevant applicable standards. All drilling, cutting, welding, forming and final fabrication of unit members and assemblies shall be completed, where feasible, before the structures are galvanized. The surface of the steelwork to be galvanized shall be free from paint, oil, grease and similar contaminants. The weight of zinc coating per unit area has to be noted in the manufacturing documents.

Structural steel items shall be initially grit-blasted to B.S. 4232, second quality, (Sa 21/2) or by pickling in a bath and the minimum average coating weight on steel sections 5 mm thick and over shall be 900 g/m<sup>2</sup>.

On removal from the galvanizing bath, the resultant coating shall be smooth, continuous, free from gross surface imperfections such as bare spots, lumps, blisters and inclusions of flux, ash or dross.

Galvanized contact surfaces to be joined by high-tensile friction-grip bolts shall be roughened before assembly so that the required slip factor is achieved. care shall be taken to ensure that the roughening is confined to the area of the mating faces.

Bolts, nuts and washers, including general grade high-tensile friction grip bolts shall be hot dip galvanized and subsequently centrifuged. Nuts shall be tapped up to 0.4 mm oversize after galvanizing and the threads oiled to permit the nuts to be finger-turned on the bolt for the full depth of the nut. No lubricant, applied to the projecting threads of galvanized high-tensile friction-grip bolt after the bolt has been inserted through the steelwork, must be allowed to come into contact with the mating faces of the steelwork,. A local remelting of the galvanized parts to achieve the nuts to be finger turned on the bolt is to be done as per the relevant standards.

Protected slings must be used for offloading and erection. Galvanized work which is to be stored at the works or on site shall be stacked so as to provide adequate ventilation to all surfaces to avoid wet storage staining (white rust).

Small areas of the galvanized coating damaged in any way shall be restored in accordance with relevant standards.

- Cleaning the area of any weld slag rust and other impurities and by thorough wire brushing to give a metallic clean surface.
- application of suitable number of coats of zinc-rich paint containing more than 90 % w/w of zinc in dried film. The dry film thickness shall exceed at least 50 % the thickness of the desired galvanization. In case of application of a low melting point zinc alloy repair rod, the rods shall be in accordance with applicable codes, the thickness of the alloy shall be at least as of the desired galvanization.

The restored area is not to exceed 1 % of the galvanized surface.

Surface restoration of parts in contact with drinking water is not allowed and the quality of the galvanization is to be in accordance with relevant standards.

FORMT9-P REV-B

**FICHTNER**

**Volume - IV**

PROJECT	SUBJECT	TENDER DOC. NO.	REV	SECTION
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C	7.6
				<b>SHEET NO.</b>
				15

After fixing, bolt heads, washers and nuts shall receive two coats of zinc-rich paint. Connections between galvanized surfaces and copper, copper alloy or aluminum surfaces shall be protected by suitable preferably hydrophobe tape wrappings to the owner's approval.

**7.6.23 Sprayed Metal Coatings**

Corrosion protection may be also achieved by spraying of suitable metals as zinc and/or aluminium on the surfaces of structures. For special cases tin, copper, lead can be used as well. Methods of surface preparation have to conform to relevant applicable standards. A proper treatment of the surface followed by an immediate spraying is to apply to ensure adhesion of the sprayed metal. The surface has to be clean, free of impurities, rust, millscale and rough enough to have binding properties to ensure good enticulation with the sprayed layer. Suitable roughness can be achieved by blast cleaning acc. to BS 4232. Welds are to be cleaned and prepared with special care. All surfaces to be treated have to be dry and accessible.

Application of coatings, requirements for thickness, adhesion, composition of coating metals, and subsequent treatment have to conform to relevant standards.

Testing of the spray coated layer are to be carried out in accordance with relevant standards.

The contractor has to specify the type, composition and thickness of the sprayed metal and of the sealing coating acc. to relevant applicable standards including the corresponding warranties and tests if sprayed metal coating will be applied.

**7.6.24 Safety of Work**

All precautions connected with this type of application of corrosion protection have to be in accordance with relevant standards.

Sprayed, unfused coating of metals and metallic compounds applied by combustion gas flame, plasma arc, detonation and similar processes, and the preparation of components, spraying techniques, sealing, finishing and inspection shall be according to relevant standards.

The hot galvanized surface has to be cleaned before the application of the coats to remove corrosion products, dirt, dust, grease.

The cleaning can be achieved by

- brush off
- washing with 1 - 1.5 % ammonia water with up to 0.1 % detergent added and followed by wet grinding using e.g. scotch britt to turn the foam to grey color,
- steam blasting,

FORMT9-P REV-B

<b>FIGHTNER</b>		<b>Volume - IV</b>	
<b>PROJECT</b>	<b>SUBJECT</b>	<b>TENDER DOC. NO.</b>	<b>REV</b>
REPUBLIC OF YEMEN PEC – ME	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C
400 MW MARIB GTPS – II			
			<b>SECTION</b> 7.6
			<b>SHEET NO.</b> 16

**ANNEX - 1**

**PAINT SYSTEM - COASTAL AND MARINE ENVIRONMENT**

SL. NO.	SURFACE/LOCATION	TEMP. °C	SURFACE PREPARATION	PAINT SYSTEM		GENERIC TYPE	PER COAT MICRONS Dft	APPLICATION	
				COAT	NO. OF COATS			IN SHOP	ON SITE
1	Structural steel work, piping (oil + water), tanks outside surface, transmiss, towers, cranes, steel floors, galleries, stairways, outdoor.	upto 130°C	Sa 2½	Prime	2	P6	35	x	
				Intermediate	1	P7	35	x	x
				Finish	1	F2	50		x
						Total min. dft	<b>220</b>		
2	Structural steel work, piping, indoor and outdoor	130 to 200°C	Sa 2½	Prime	1	F9	75	x	
				Intermediate	1	F9	20		x
				Finish	2	F11	20		x
						Total min. dft	<b>135</b>		x
3	Structural steelwork, piping, uninsulated carbon steel, indoor and outdoor	200 to 400°C	Sa 3	Prime	1	F9	75	x	

**FICHTNER**

**THIS IS A PART OF TECHNICAL SPECIFICATION PE-TS-372-673-A001**

**Volume - IV**

<b>PROJECT</b>	<b>SUBJECT</b>	<b>TENDER DOC. NO.</b>	<b>REV</b>	<b>SECTION</b>
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C	7.6
				<b>SHEET NO.</b>
				17

SL. NO.	SURFACE/LOCATION	TEMP. °C	SURFACE PREPARATION	COAT	PAINT SYSTEM NO. OF COATS	GENERIC TYPE	PER COAT MICRONS Dft	APPLICATION	
								IN SHOP	ON SITE
4	Structural steel work, piping (oil + water), tanks, indoor	upto 130°C	Sa 2½	Intermediate	1	F12	20		x
				Finish	1	F12	20 115		x
5 (a)	Structural steel work in the battery rooms,	Ambient	Sa 3	Prime	2	P8	30 30	x x	
				Finish	2	F6	100 100		x x
(b)	Uninsulated - equipment, tanks and piping etc.	upto 80°C	Sa 3	Prime	2	P3	35 35	x x	
				Finish	2	F6	100 100		x x
						Total min. dft	<b>170</b>		
						Total min. dft	<b>260</b>		
						Total min. dft	<b>270</b>		

**FIGHTNER**

**Volume - IV**

<b>PROJECT</b>	<b>SUBJECT</b>	<b>TENDER DOC. NO.</b>	<b>REV</b>
REPUBLIC OF YEMEN PEC – ME	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C
400 MW MARIB GTPS – II			
			<b>SECTION</b>
			7.6
			<b>SHEET NO.</b>
			18

SL. NO.	SURFACE/LOCATION	TEMP. °C	SURFACE PREPARATION	COAT	PAINT SYSTEM NO. OF COATS	GENERIC TYPE	PER COAT MICRONS Dft	APPLICATION IN SHOP	APPLICATION ON SITE
6	Steel tanks inside surface (total) for oil storage	normal	Sa 2½	Prime	2	P3	35 35	x x	
7	Steel tanks inside surface (total) for water storage (potable and distilled water)	normal	Sa 2½	Prime	2	F6	100 100		x x
						Total min. dft	<b>270</b>		
8	Cast iron water pipe lines-outside surface, buried in the soil	upto 60°C	Sa 3	Prime	2	P2	50	x	
						F3	50		
						Total min. dft	<b>160</b>		x x
9	Steel pipes inside surface such as cooling water lines	upto 60°C	Sa 2½	Prime	2	P8	30	x	
						F7	30		
						Total min. dft	<b>435</b>		x x x
						F7	125		x
						Total min. dft	<b>500</b>		x x x
						F7	125		x
						Total min. dft	<b>500</b>		x x x

**FIGHTNER**

**Volume - IV**

<b>PROJECT</b>	<b>SUBJECT</b>	<b>TENDER DOC. NO.</b>	<b>REV</b>
REPUBLIC OF YEMEN PEC – ME 400 MW MARIB GTPS – II	TENDER DOCUMENT FOR ENGINEERING, PROCUREMENT & CONSTRUCTION (EPC)	7195-GE-SPC-700-001	C
			<b>SECTION</b>
			7.6
			<b>SHEET NO.</b>
			19

SL. NO.	SURFACE/LOCATION	TEMP. °C	SURFACE PREPARATION	COAT	PAINT SYSTEM		GENERIC TYPE	PER COAT MICRONS Dft	APPLICATION IN SHOP	APPLICATION ON SITE
					NO. OF COATS					
10	Water pipelines - outside surface, indoor	upto 60°C	Sa 3	Prime	2		P2	50	x	
				Finish	3		F3	50	x	
							Total min. dft	30		x
								30		x
								30		x
								<b>190</b>		
11	Oil pipelines - outside surface, above ground	upto 90°C	Sa 3	Prime	2		P3	50	x	
				Finish	2		F6	50	x	
							Total min. dft	100		x
								100		x
								<b>300</b>		

\* For Details of Primer and Finish coats, refer Annex to paint systems.

## 6.12 Colours

6.12.1 The finish colours of components shall be those defined in the following table (preliminary), except for those components whose finishing colour has a technical or security function (heat dissipation, caution, etc). Appendix D attached also includes finish colours of miscellaneous items. In case of two different colours being specified for the same item (according to 6.12 and Appendix D) it shall be the Owner to decide which colour to apply.












COMPONENT	COLOR
<b>Mechanical</b>	
Sampling racks	Grey RAL 7035
Pumps	Green RAL 6002
Compressors	Blue RAL 5014
Supports	Grey RAL 7035
Valves and piping without insulation and with maximum operating temperature of 120 °C (except for FP service)	Identification colour (6.12.2)
Tanks	Beige RAL 1001 or defined by the Purchaser
Insides of tanks to be painted (according to data sheet indications)	Light colour
Chillers and heaters	Blue RAL 5002
Cranes, hoisting equipment with their beams and rails	
Cranes	Yellow RAL 1004
Hoisting equipment and associated motors	Blue RAL 5009
Ventilation equipment (including supports and accessories)	Grey RAL 7032
Valve actuators	Grey RAL 7032
Turbine	Defined by Supplier

COMPONENT	COLOR
Stack and hot structures (without insulation)	Defined by Supplier
Hot valves without insulation	Aluminum RAL 9006
Above-ground gas piping	Yellow RAL 1021
Fire protection equipment, piping and valves	Red RAL 3000
Remaining equipment	Grey RAL 7035
Mechanical equipment structures and foundations	Grey RAL 7035 or as supported equipment
<b>Electrical</b>	
Main control room panels and cabinets	Beige RAL 1015
Electronics, energy and communications room panels and cabinets	Light beige RAL 1015
Auxiliary transformer earthing resistance cabinet	Light beige RAL 1015
Cabinets (switchgear, power centers, MCC, lighting and direct service centers, emergency centre, dc, UPS)	Light beige RAL 1015
Local panels and cabinets	Light beige RAL 1015
Motors	Blue RAL 5010
Power generator	Defined by Supplier
Transformers	Grey RAL 7030
Remaining cabinets	Light beige RAL 1015
Remaining structures and electrical equipment foundations	Grey RAL 7035 or as supported equipment
<b>Civil</b>	
Metallic structures	Grey RAL 7035
Handrails (except for galvanized ones)	Grey RAL 7035
<b>Instrumentation</b>	








GREEN BELT PROJECT, ARRANGED BY UTE MAUCKERT W725 / H. G. MEIER W721 / R. LUCÉ W721

**UMA STEAM TURBINE BUILDING**  
("A" ONLY VALID FOR UMA)

**UMB GAS TURBINE BUILDING**  
("B" ONLY VALID FOR UMB)








DADO WALL (SOLID CONSTRUCTION)	RAL	1001		BEIGE
IF BRICKWORK				RED BROWN
WALL CLADDING (TRAPEZOIDAL METAL SHEETS)	RAL	1013		OYSTER WHITE
ROOF CLADDING (TRAPEZOIDAL METAL SHEETS)	RAL	9010		PURE WHITE
GUTTER	RAL	9010		PURE WHITE
RAINWATER DOWN PIPES	RAL	1013		OYSTER WHITE
LOUVERS IN WALL CLADDING	RAL	1013		OYSTER WHITE
LOUVERS IN DADO WALL	RAL	1001		BEIGE
STEEL DOORS	RAL	1017		SAFFRON YELLOW
ROLLER SHUTTER; SLIDING DOORS	RAL	1017		SAFFRON YELLOW
AIR INTAKE FILTER HOUSE	"B" RAL	5018		TURQUOISE BLUE
STEEL DOORS IN AIR INTAKE FILTER HOUSE	"B" RAL	5018		TURQUOISE BLUE

STEEL STAIRS				GALVANIZED
STEEL PLATFORMS				GALVANIZED
HAND RAILS				GALVANIZED
GRATINGS				GALVANIZED
CAT LADDERS				GALVANIZED

MAIN STEEL STRUCTURE	RAL	5007		BRILLANT BLUE
INTERNAL STEEL STRUCTURE	RAL	5007		BRILLANT BLUE
INTERNAL WALLS	RAL	9002		GREY WHITE
INTERNAL CEILINGS	RAL	9010		PURE WHITE
INTERNAL FLOORS	RAL	7023		CONCRETE GREY
CRANES	RAL	1017		SAFFRON YELLOW
AIR DUCTS GABLE END OF TURBINE BUILDING	RAL	7035		LIGHT GREY


THIS IS A PART OF TECHNICAL SPECIFICATION PE-TS-372-673-A001

**GREEN BELT PROJECT, ARRANGED BY UTE MAUCKERT W725 / H. G. MEIER W721 / R. LUCÉ W721**


GT PURGE PACKAGE	"B"	RAL	6010		GRASS GREEN
GT NO <sub>x</sub> -WATER PACKAGE	"B"	RAL	6010		GRASS GREEN
AIR INTAKE DUCTS GASTURBINE (INSIDE)	"B"				GALVANIZED
ST (SOUND ENCLOSURE)	"A"				GALVANIZED
ST CASING (INCLUSIVE COMPONENTS)	"A"	RAL	7030		STONE GREY
ST OIL SUPPLY UNIT	"A"	RAL	8001		OCHER BROWN
CONDENSER COVERINGS AND COMPONENTS		RAL	6010		GRASS GREEN
GENERATOR (FROM MÜLHEIM AND CHARLOTTE)		RAL	1017		SAFFRON YELLOW
GENERATOR (FROM ERFURT)		RAL	7030		STONE GREY
VENTILATION SYSTEM (INCL. AIR DUCTS)					GALVANIZED







**GENERAL**

GALVANIZED STEEL (IF OTHERWISE REQUIRED USE COLOUR OF MAIN STEEL STRUCTURE)					WITHOUT PAINTING
STAINLESS STEEL					WITHOUT PAINTING
ALUMINIUM AND PLASTICS					WITHOUT PAINTING

TANKS		RAL	7035		LIGHT GREY
COMPONENTS WITH FINAL FINISH					DEPENDS ON SUPPLIER

FIRE PROTECTION SYSTEM (GENERAL)		RAL	3000		FLAME RED
----------------------------------	--	-----	------	---	-----------

PIPING FOR PROCESS SERVICES, EXTERIOR AND INTERIOR		RAL	7035		LIGHT GREY
--	--	-----	------	---	------------

HV-TRANSFORMERS		RAL	7032		PEBBLE GREY
LV-TRANSFORMER HOUSING		RAL	7032		PEBBLE GREY
PCC CONTAINER	"B"	RAL	1015		LIGHT IVORY
MV/LV SWITCHGEARS		RAL	7032		PEBBLE GREY
HV/LV MOTORS; ACC. MANUFACTURER STANDARD					
ELECTRICAL / CONTROL ENCLOSURES; MANUFACTURER STANDARD; PEEFERABLY	ACC.	RAL	7032		PEBBLE GREY
GENERATOR BUS DUCTS		RAL	9010		PURE WHITE

## 1. General

This standard specifies the colours and methods for the identification of pipelines according to the medium.

## 2. Siemens PG Standard

The Siemens /PG Standard is based on DIN 2403 (1984).

The media through pipelines are divided into groups in accordance with their general properties, and their basic identification colours are given in following table:

Pipe contents	Group	Colour Name according DIN 2403	Nearest colour sample in accordance with RAL 840 HR
Water	1	Green	RAL 6018
Steam	2	Red	RAL 3000
Air	3	Grey	RAL 7001
Combustible gases	4	Yellow with auxiliary red	RAL 1021 with RAL 3000
Non-Combustible gases	5	Yellow with auxiliary black	RAL 1021 with RAL 9005
Acids	6	Orange	RAL 2003
Alkalis	7	Violet	RAL 4001
Combustible liquids	8	Brown with auxiliary red	RAL 8001 with RAL 3000
Non-Combustible liquids	9	Brown with auxiliary black	RAL 8001 with RAL 9005
Oxygen	0	Blue	RAL 5015

*Table 1: Basic identification colours acc. DIN 2403*


Pipes will be painted in uniform colour RAL7035 light grey. Identification colour will be applied by "colour banding".

Hot galvanized, austenitic, plastic, non-ferrous and insulated pipes:  
identification colour applied by colour banding;

Pipes for fire fighting:  
identification colour applied by colour banding;

## 2.1. Pipes painted according PG-standard Ral 7035 light grey

Identification rings (adhesive foil) in the group colour shall be applied at important workpoints (e.g.: at both sides of each valve, at all junctions, wall penetrations, etc.) over a length of 150 mm. For the groups 4, 5, 8, and 9 additional colour rings are required. The distance between two identification rings should be max. 10 m inside of a building and 100 m for pipe runs.

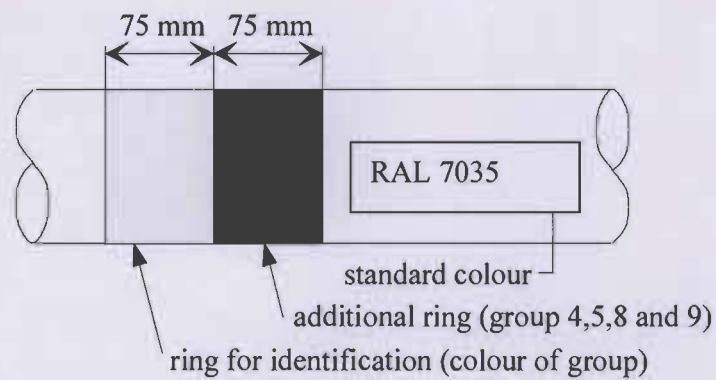

*Figure 1: Application of identification rings  
(e.g.: combustible gases - identification ring: yellow; additional ring: red)*

## 2.2. Hot galvanized, austenitic, plastic, non-ferrous metals and insulated pipes

The Identification of galvanized, plastic, austenitic and non-ferrous metals as well as insulated pipes shall be applied with identification rings (adhesive foil) over a length of 150 mm at important workpoints (e.g.: at both sides of each valve, at all junctions, wall penetrations, and on both side of barriers etc.). For the groups 4, 5, 8 and 9 additional colour rings are required (also adhesive foil). The distance between two identification rings should be max. 10 m inside of a building and 100 m for pipe runs.

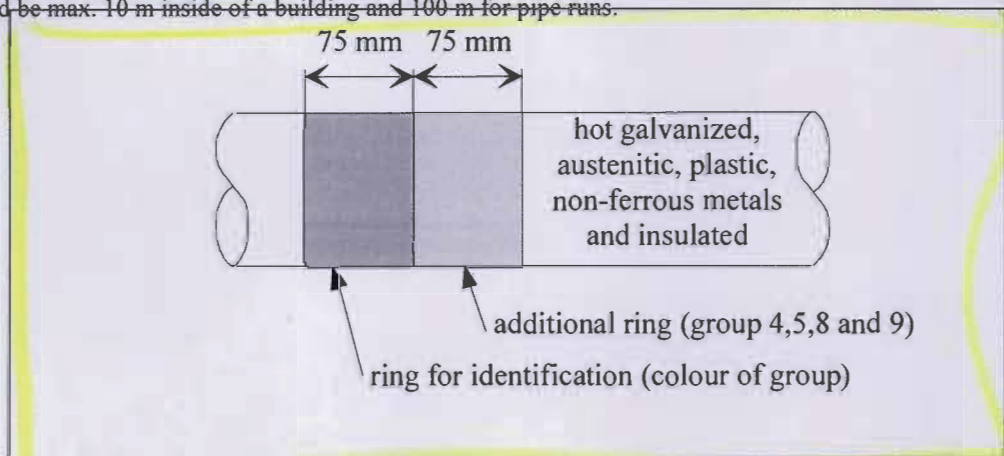


Figure 2: Application of identification rings

## 2.3. Pipes for Fire fighting

Galvanized pipes for fire fighting have to be marked with red tapes (RAL 3000) at important workpoints (e.g.: at both sides of each valve, at all junctions, wall penetrations, etc.). To avoid confusions with pipes for steam, an additional white tape with the letter F in the colour of the fire extinguishing agent (e.g. green for water or red for steam) is to be put up.

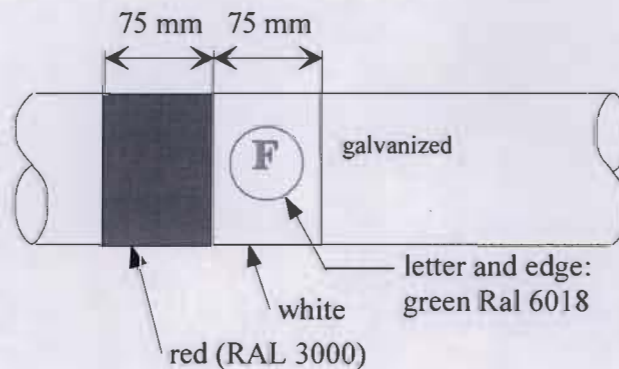


Figure 3: Application of fire fighting identification rings (using steam as fire fighting agent)


**VOLUME IIB**

**TECHNICAL SPECIFICATION  
FOR  
SEAWORTHY PACKING FOR EXPORT JOBS**

**SPECIFICATION NO. PE-TS-888-100-A001**



**BHARAT HEAVY ELECTRICALS LIMITED  
POWER SECTOR  
PROJECT ENGINEERING MANAGEMENT  
NEW DELHI, INDIA**

	<b>TITLE</b>	SPECIFICATION NO. <b>PE-TS-888-100-A001</b>	
	<b>TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS</b>	VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 1	OF 52

**1.0 Purpose**

The purpose of this specification is to describe minimum packing requirements for the different items/equipment for all export Project and also to define marking and shipping requirements during transportation by ship, road and air for all export jobs.

**2.0 SCOPE**

For export jobs, sea worthy packing capable of performing all necessary functions like prevention of damage to the contents, sufficient to support frequent handling and lengthy period of outdoor storage in adverse weather conditions are required. Workmanship and materials used shall be of high standard meeting the technical requirements and in accordance with best commercial export packing practices. Vendor shall be responsible for sea worthy export packing, however it shall meet the minimum requirements specified herein. Equivalent or better packing methods may be deployed subject to approval of the BHEL/Purchaser. Vendor shall submit the packing procedure for its equivalent for purchaser's approval during detailed engineering.

The scope this specification is to define VENDOR's responsibilities in terms of:

- Preservation of the GOODS/items/equipments before packing.
- Packing of the GOODS for road, rail, sea and/or air transportation to desired destination i.e. project site
- Making cases/crates
- Chemical Treatment/Fumigation before packing to prevent fungus, damage due to termite, borer, rats, etc.
- Marking of cases/crates.
- Other Services required.


**3.0 Application**

This specification is applicable to all the goods to be transported to project site and requires to be in transit for longer duration. *However, for "Misc cable erection items", "Fire sealing system" & "Exothermic welding material", the packing requirements shall be as per the procurement specification.*

**4.0 Definitions**

- "BHEL" : Main EPC vendor
- "OWNER" : Customer for a particular export project.
- "VENDOR" : Company(ies)/VENDOR(s) to whom the BHEL has placed Purchase Order for GOODS/ items/system/package.
- "GOODS": means all or part of the articles, material, equipment supplies including technical documentation, as described in the Purchase Order, to be supplied by VENDOR.
- "PACKER": Packaging Company to whom VENDOR intends to sub-contract the packing in case they do not have own packing capability/facilities .
- "FREIGHT FORWARDER" : Means the Company responsible for performing freight forwarding activities.

**5. General Information**

	<b>TITLE</b>	SPECIFICATION NO. <b>PE-TS-888-100-A001</b>	
	<b>TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS</b>	VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 2	OF 52

The following requirements are intended as minimum requirements, and compliance to these requirements in no way absolves or relieves VENDOR of any responsibility or obligation outlined in the Purchase Order. In all circumstances, the packing will be designed and constructed in order to support GOODS during transportation as well as to prevent the Goods from damage due to impact, extreme climatic conditions, sun and rain. It must be ensured that the delivery of the GOODS to the jobsite by sea, road or air, in good condition.

GOODS shall be export packed in compliance with the best-established practices for international projects, in accordance with the following instructions. In the event of any conflict between these specified requirement and the established practices, specification requirement shall govern.

Due to climatic conditions and the complex transport operation(s), it is essential that protection and packing is of the highest standard. Packing means to efficiently protect the GOODS during the total transport operation; from the moment they leave the factory until they are delivered to the jobsite, including handling operations (loading/unloading) and storage.

When VENDOR do not have packing capabilities/facilities of their own and therefore intends to sub-contract, VENDOR have to inform BHEL/Purchaser of the name and address of proposed PACKER(s) for approval.

**6.0 Criteria for Selection of Packaging**

Packages are to be made according to categories, described in articles 8.1 to 8.5, depending on the type of materials, their fragility and size.

These categories have been established for the protection of equipment and material during multi-mode transports, i.e.: combination of overland and sea transport; containerization, air transportation.

In a general manner, the GOODS have to be packed in such a way that crates, bundles, pallets can be stored into General Purpose containers, wherever possible.

If VENDOR has any doubt about the correct method of protection or packing, he should contact BHEL/Purchaser in order to mutually agree on the adequate type of packing to be used.

Materials can be classified in following categories

- Hazardous Material
- Non-Hazardous Material
- 


Further to above categorisation, non-hazardous materials can be sub- categorised for selection of packing.

**6.1 Hazardous Materials**

Though handling of hazardous material may is not applicable in the scope of this specification. All hazardous material must be packed in adherence to the detailed requirement relating to packing, marking and labelling set out in the most recent report of the Board's Standard Advisory Committee on the Carriage of Dangerous Goods in Ships for sea freight, and the Restricted Articles Regulations, laid down by the International Air Transport Association for airfreight.

**6.2 Non-Hazardous GOODS**

The scope of this specification is to provide necessary guidelines for packing for power plant equipment, components, Pipings & Valves, Fittings, other structural items, electrical items, spare parts and erection materials. The procedure is defined in subsequent paragraphs in details in clause no. 8.0.

	<b>TITLE</b>	SPECIFICATION NO. <b>PE-TS-888-100-A001</b>	
	<b>TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS</b>	VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 3	OF 52

**7.0 Marking Instructions & Despatch details, Storage Code**

**7.1 Marking Instructions & despatch details**

Packages and crates will be marked with indelible black paint, resistant to seawater. Marking must be perfectly legible.

The shipping marks, which will be as per fig-13, shall be stencilled on two sides and one end in clear characters at least 5 centimetres high (where crate size permits, otherwise use optimum size for each package dimension).

When the GOODS are to be shipped in containers then marking may be stencilled on one end only. However, packages must be stowed in a manner that shows these marks.

Crates containing fragile articles must be packed with special precaution against risk of breakage and must be stencilled on all sides "FRAGILE - HANDLE WITH CARE". Where crates are not to be overturned, VENDOR must show on the crates, clear and readily visible identification as per fig-12, to ensure they are kept in the correct position.

Packages/equipment of 2,000 kg or more must be marked with slinging points on all sides, in addition to the centre of gravity marks.

Number packages consecutively i.e. 1 of 10, 2 of 10, etc. Do not duplicate package numbers. VENDOR is responsible for any loss or damage caused by incorrect marking.

All cases/crates shall also be marked with the appropriate international standard graphic symbols for handling as shown in Fig 12.

As a minimum, all cases/crates are to be marked clearly on all four sides with:

- "HANDLE WITH CARE"
- "RIGHT SIDE UP"
- "KEEP DRY"

In the case of packages with a single gross weight totalling 2,000 kg and/or a height of more than 1m, the centre of gravity shall be clearly marked with the symbol on two adjoining sides. For all items of equipment with an eccentric centre of gravity this symbol shall be marked at the bottom, side and top of the package.


The slinging and lashing points shall be marked with a chain symbol.

When packing in cases/crates, these packages shall also have metal corners at the slinging points. (Fig-11)

External front and rear sides of the boxes to be planed for writing instructions.

Dispatch details such as consigner/consignee address, contract and case details, country of origin, port of delivery, stacking instructions shall be written on one side of the boxes. An anodized aluminum plate as per details and specifications given in fig-13 shall be provided on one side of the boxes.

One copy of packing slip wrapped in polyethylene bag covered with aluminum packing slip holder to be nailed on the external surface of the box. One more copy of the packing slip wrapped in polyethylene bag is to be kept inside the box at the pertinent place.

	<b>TITLE</b>	SPECIFICATION NO. PE-TS-888-100-A001	
	<b>TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS</b>	VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 4	OF 52

**7.2 Storage Code**

The type of storage required is required to be specified, it will be shown on each packaging in RED colour.

- X Crates or packages to be stored outdoor without covers
- XX Crates or packages to be stored under tarpaulin
- XXX Crates or packages to be stored in covered or enclosed premises
- XXXX Crates or packages which must be stored in air-conditioned premises

**8.0 GUIDELINES FOR PACKING GOODS**

**8.1** In the subsequent paragraphs details of different types of packings for different types of GOODS are defined. Vendor shall make packing details/procedure based on the guidelines and submit for approval.

**8.1.1 Packing for Pipe, Fittings, Flanges and Valves, Structural Steel**

Particular attention should be brought to pipe, fittings, flanges, valves and structural steel. Packing categories for piping and fittings will differ according to the diameter and wall thickness of these products. VENDOR shall comply with the following established practice.

**IMPORTANT NOTE:**

*Depending on the project schedule and availability of ocean vessels, the piping and structural steel may be shipped in containers. In this event, VENDOR has to arrange the packages in such a way it allows the stuffing into Open Top in gauge containers.*

**8.1.2 Pipe**

Where practicable, pipe lengths shall be limited to 11.8 meters.

All pipes 2" included and below shall be packed in crates. All pipes to be capped and ends sealed with waterproof tape.

Pipes over 2" up to 6", shall be bundled and banded in bundles of uniform length. Bundling is carried out with U-IRON or traversal planks, joined with threaded connecting rods with locknuts. Quantities and strapping positions depend on the lengths, with a 120 cm spacing to prevent distortion. Bundle weight shall not exceed 2,000 kg. All pipes are to be capped and ends sealed with waterproof tape (tape is not necessary if end caps are of the pre-shrunk or self-sealing type).

Pipes larger than 6" shall be shipped as single lengths with the ends capped. End caps are to be of the recessed type to enable the use of soft faced hooks, but still completely sealing the end and also protecting the weld.

All stainless steel piping must be packed separately in wooden crates. Any banding of bundles is to be with the same material.


All SS pipes to be packed separately in crates irrespective of the pipe size.

**Pipe Fittings, Flanges and Valves**

All pipe fittings, flanges and valves up to 6", are to be packed in cases/crates. For items over 6", these may be fixed securely to a pallet base and enclosed in a crate, for protection. Where valves have actuators attached, rigidity must be ensured for the valve and actuator. The vulnerable parts of the actuator are to be completely protected within a wooden crate.

All stainless steel fittings, flanges and valves of all sizes, must be packed separately in wooden crates. Any strapping is to be with the same material.

**8.1.4 Structural Steel**

	<b>TITLE</b>  <b>TECHNICAL SPECIFICATION                  FOR SEAWORTHY PACKING                  FOR EXPORT JOBS</b>	SPECIFICATION NO. PE-TS-888-100-A001	
		VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 5	OF 52

Structural Steel, reinforcing rods, bars, etc., should be packed in bundles of uniform length. Refer to articles 8.1.2, for strapping requirements. Bundle weight not normally to exceed 2,000 kg. Fabricated structures and structural steelwork, etc, should be bundled and packed using wooden beams and long bolting to secure the load.


**8.2 Bundling – Packing Category I**

**8.2.1 Type of Equipment**


All SS pipes to be packed separately in crates irrespective of the pipe size.

Equipment which is not subject to damage by corrosion or mechanical effect, i.e. pipes, piping, structural steel.


**Packing category I**

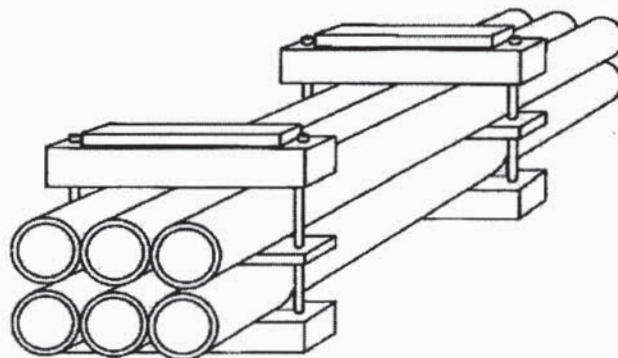

**Bundling by U-shaped iron – packing category I A**

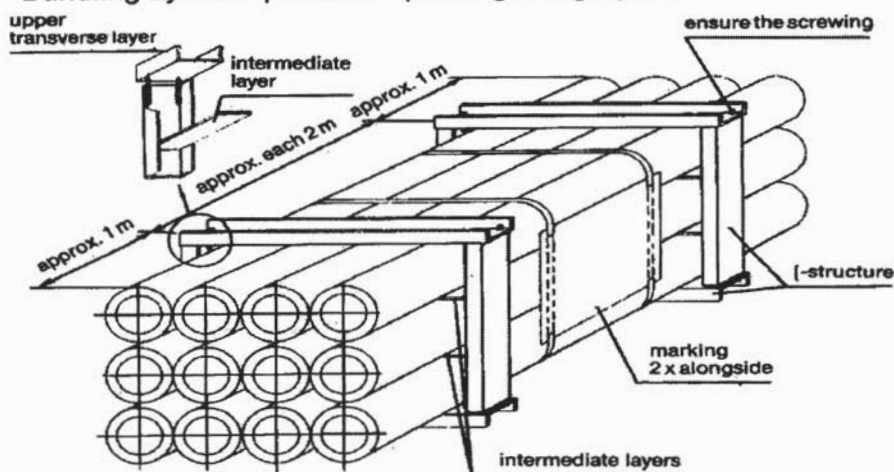

**8.2.2 Type of Construction**

	<b>TITLE</b>	SPECIFICATION NO. PE-TS-888-100-A001	
	<b>TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS</b>	VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 6	OF 52

- Bundling has to be effected
- By squared timber and threaded rods.
- With an intermediate layer (threaded on tightening bolts) according to the weight of the package.
- Wedge-shaped timbers must be added at the outer points of lower layer.
- Between the bolts a spacer must be nailed.
- The bolts must be secured (e.g. by locking nut).
- If single parts could protrude, an appropriate protection must be installed (flat iron or plates).
- Bundling with steel straps or PVC straps is not accepted.

**8.3 Skids, Square Timber Constructions, Casings – Packing (Category II)**


**8.3.1 Type of Equipment**


Voluminous apparatus, tanks and/or heavy pieces those are not vulnerable to mechanical or corrosive effects.

**8.3.2 Type of Construction**

- The construction skid can be made of wood or of metal.
- The fastening of the packages on the skid will be made by steel straps (flat iron) which have to be elastically lined, non-slip and securely bolted onto the skids.
- Flange openings have to be closed with gaskets and blind flanges or, if necessary, provided with cover.
- Skid constructions may not be less than the dimensions of the package in length or in width.
- Tanks and apparatus with their own support cradles must be supplied with an anti-slip lining.

**PACKING CATEGORY-II**

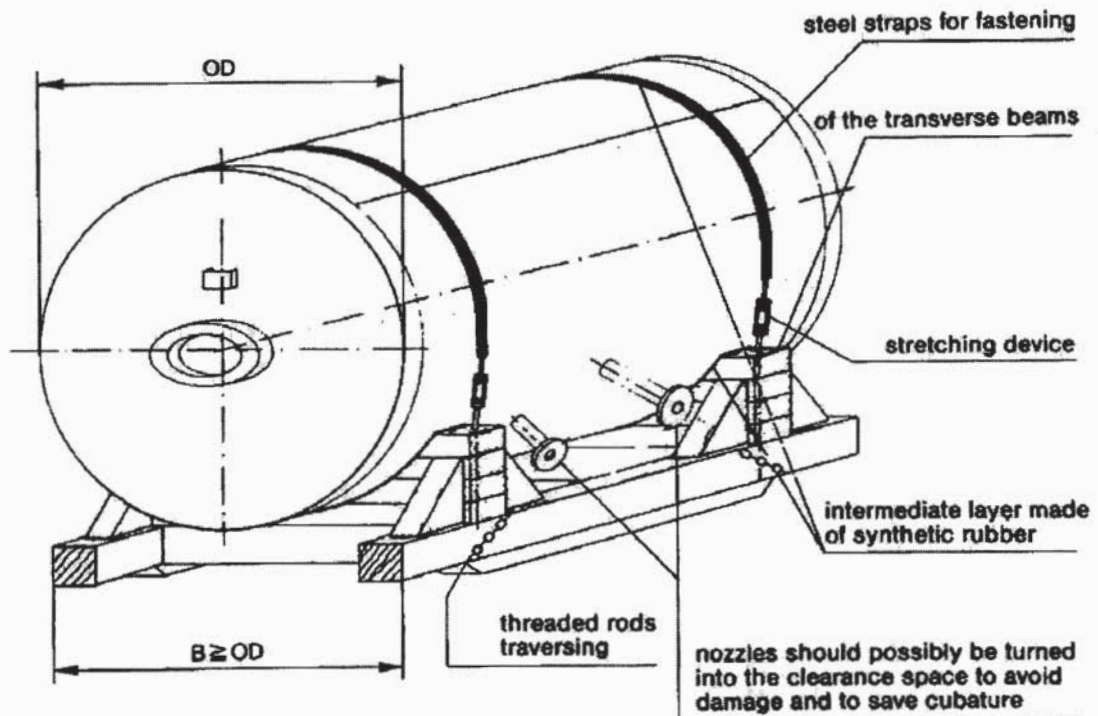

	TITLE	SPECIFICATION NO. PE-TS-888-100-A001		
	<b>TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS</b>	VOLUME II B		
		SECTION D		
		REV. NO. 0	DATE 10/08/2010	
		SHEET 7 OF 52		

**8.4 Packing of GOODS in Wooden Crates/Cases/Boxes**

The construction of wooden crate/cases/boxes shall be as per the details indicated in clause 9.0 & Fig 1 to 11. Details indicated in the sketches for different categories Packing crates/boxes are only for a typical equipment considered for illustration.

**8.4.1 Packing Category III**

**8.4.1.1 Type of Equipment**

All SS pipes to be packed separately in crates irrespective of the pipe size.


Fabricated equipment, which cannot be transported on cradles; frame-works, prefabricated piping and fittings, mechanical and electrical assemblies. This type of packing is recommended where many parts of the equipment/component/assembly are not protruding out.


**8.4.1.2 Type of Construction**

The equipment must be safely fastened to the bottom with bolts, possibly by the runners or to be spread in such a manner that no protruding parts are possible. For parts, sensitive to rainwater and/or debris, a protection has to be made by a foil cap.

If it is possible that single part could protrude through the front/back side wall, they shall be closed completely. The marking of the package shall be done on plywood plates at the prescribed sides.

**Packing Category III**

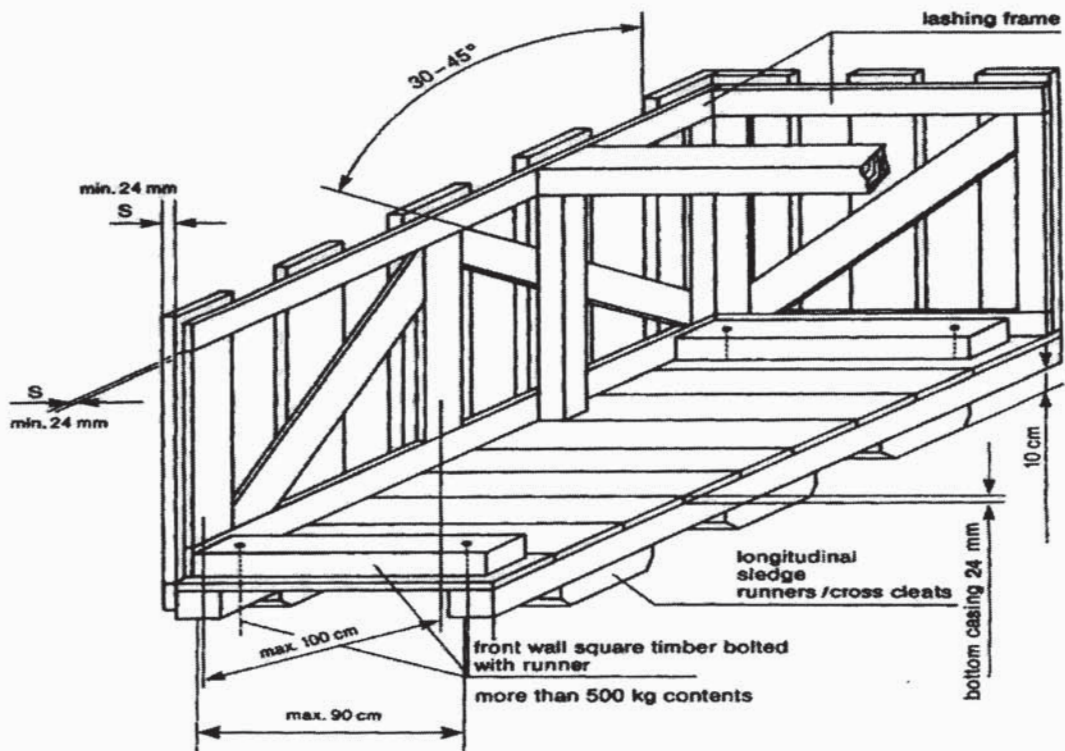

	<b>TITLE</b>	SPECIFICATION NO. PE-TS-888-100-A001	
	<b>TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS</b>	VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 8	OF 52

**8.4.2 Cases with Lining – Packing Category IV**


**8.4.2.1 Type of Equipment**

*Recommended for equipment and mechanical parts Equipment sensitive to mechanical damage or parts and components that are particularly at risk of theft or loss; pumps, elbows, flanges, fittings, tools, erection materials, etc.*

**8.4.2.2 Type of Construction**


The same type of construction as article 8.4.1.2, but with all sides completely boarded without space between the boards. Sides to be provided with waterproof lining; fabric-reinforced waterproof tar paper or polyethylene-foils resistant to ultraviolet rays can be used. Polyethylene-foil shall be fixed under the lid cover to avoid penetration of water. At weights of more than 500 kg the longitudinal runner must be bolted to the front all square timber. For ventilation inside the case, an opening in the waterproof lining must be placed between the diagonal battens and diagonal joists.


**Packing Category IV**

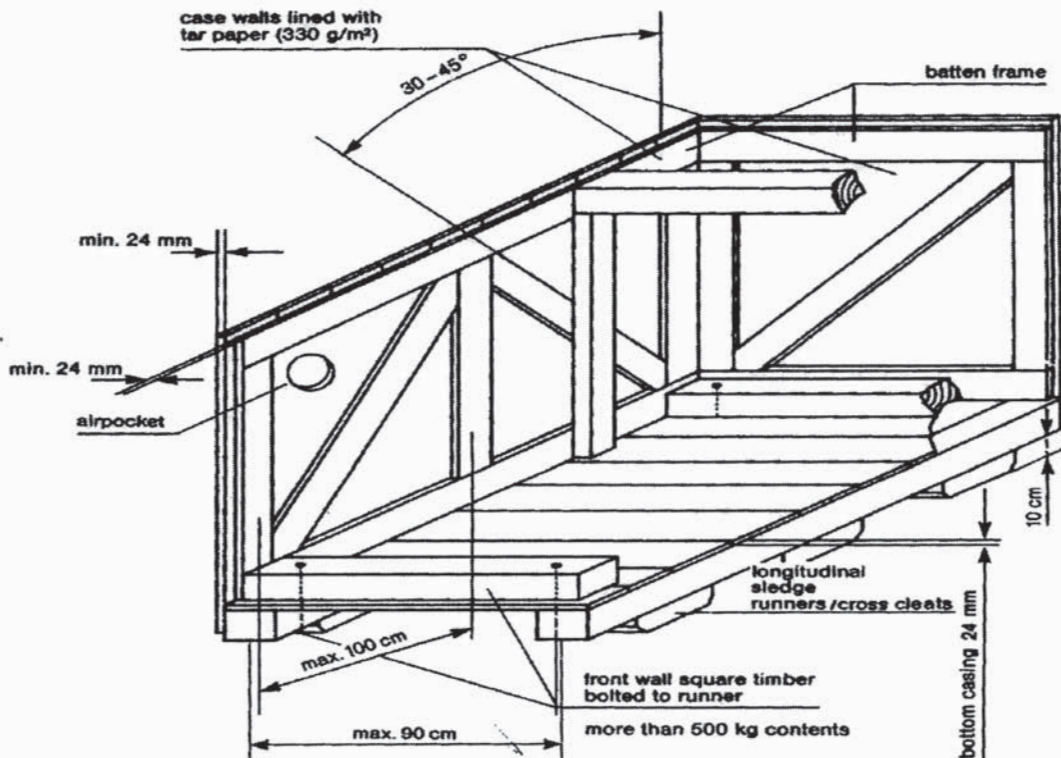

**8.4.3 Cases with Alternative Surface Materials**

**8.4.3.1 Plywood Box – Packing Category IV A**

	<b>TITLE</b>	SPECIFICATION NO. PE-TS-888-100-A001	
	<b>TECHNICAL SPECIFICATION FOR SEAWORTHY PACKING FOR EXPORT JOBS</b>	VOLUME II B	
		SECTION D	
		REV. NO. 0	DATE 10/08/2010
		SHEET 9	OF 52

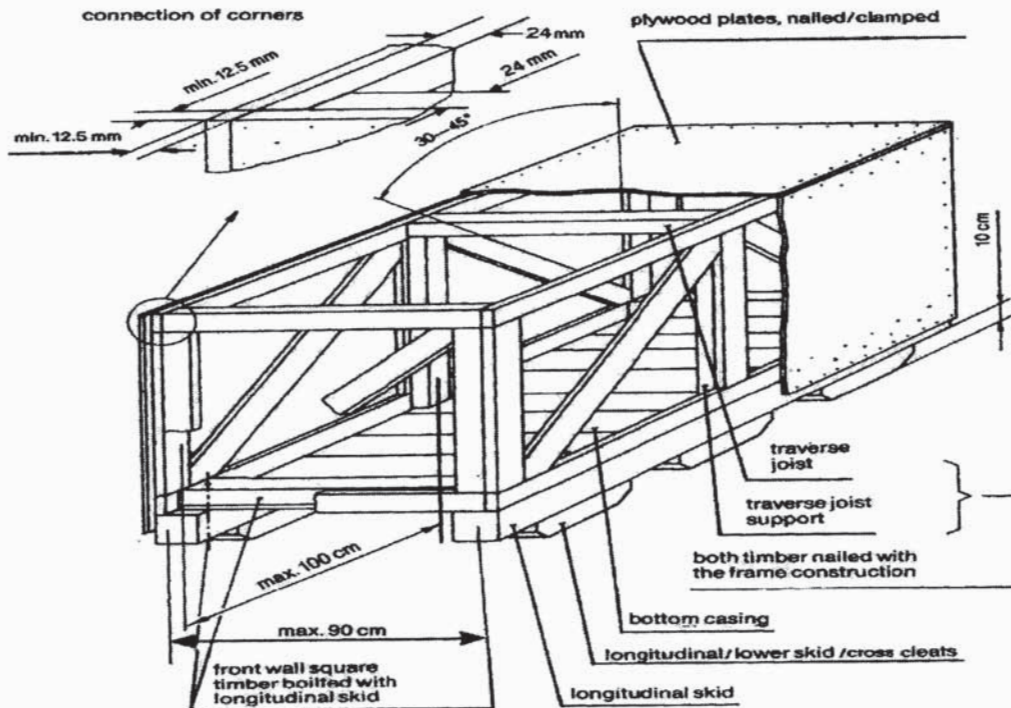

Case constructed of 5 layers of watertight, glued plywood with a total thickness of 12.5 mm. The frame must be constructed from minimum 24 mm timber or as per guide lines given above against clause 8.0, Fig 1 to 11 and must be suitable for the weight and nature of the parts to be packed. Planed square timber must be bolted with longitudinal skid and covered with diagonal joists. If applicable, construction of the cover and sides is to include diagonal bracing. Covers consisting of several layers of plywood are to be sealed with durable elastic putty or additional water-resistant sheets to be fixed.

**8.4.4 Case with Barrier Material – Polyethylene Foil – Packing Category V**

**8.4.4.1 Type of Equipment**

Sensitive equipment, simple electrical equipment, insulation materials, fire-resistant materials, with non-corrosion- guarantee for a period up to twelve (12) months.

**8.4.4.2 Type of Construction**

Preservation by welding in polyethylene-foil with addition of desiccants and if necessary, application of non-corrosive contact agents, otherwise, type of construction as indicated in article 8.4.2.2.

Additional marking:

- Case with desiccants.

**8.4.5 Case with Barrier Material – Aluminium Compound Foil – Packing Category VI**

**8.4.5.1 Type of Equipment**