



**TELANGANA STATE POWER GENERATION  
CORPORATION LTD.**

**1 X 800 MW KOTHAGUDEM STPP**

**STAGE-VII, UNIT#12**

**VOLUME IIB & III**

**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPECIFICATION NO.: PE-TS-410-502-A001**



**BHARAT HEAVY ELECTRICALS LIMITED**

**(A Govt. of India Undertaking)**

**POWER SECTOR**

**PROJECT ENGINEERING MANAGEMENT**

**NOIDA, U.P**


**INDIA**



|  |                                      |
|--|--------------------------------------|
| <b>TITLE</b><br><br><b>1X800 MW KOTHAGUDEM STPP</b><br><br><b>ELEVATOR</b> | SPECIFICATION NO. PE-TS-410-502-A001 |
|  | VOLUME: II B                         |
|  | REV 00                               |
|  | SHEET 1 OF 1                         |

**INDEX**  
**VOLUME – IIB**

| SECTIONS                 | TITLE  | Page                                   |  |       |
|--------------------------|--|--|--|-------|
| SECTION-A                | INTENT OF SPECIFICATIONS/ SCOPE OF ENQUIRY   | 1-3                                    |  |       |
| SECTION-B                | PROJECT INFORMATION WITH WIND AND SEISMIC DESIGN CRITERIA  | 4-7                                    |  |       |
| SECTION-C                | <b>TECHNICAL SPECIFICATION</b>   |  |  |       |
|                          | SECTION C1   | SPECIFIC TECHNICAL REQUIREMENT         | 8-26   |       |
|                          |  | SUPPLY PRICE PERCENTAGE BREAK-UP       |  |       |
|                          | SECTION C2   | CUSTOMER SPECIFICATION                 |  |       |
|                          |  | C2-A                                   | TECHNICAL REQUIREMENT  | 27-46 |
|                          |  | C2-B                                   | GENERAL TECHNICAL REQUIREMENT                                      | 47-70 |
|                          |  |  | FUNCTIONAL / PERFORMANCE / DEMONSTRATION GUARANTEE (AS APPLICABLE) | 71-72 |
|                          |  |  | PAINTING SPEC  | 73-86 |
|                          |  |  | QUALITY ASSURANCE  | 87-91 |
|                          |  | REQUIREMENT OF SPARES TOOLS & TACKLES. | 92-96  |       |
| SECTION C-3              | TECHNICAL SPECIFICATION (ELECTRICAL PORTION)   | <b>97-136</b>                          |  |       |
| SECTION -D               | STANDARD TECHNICAL SPECIFICATION   | <b>137-142</b>                         |  |       |
| SECTION-E                | ANNEXURE-I- LIST OF MAKES  | 143-145                                |  |       |
|                          | ANNEXURE-II- MANDATORY SPARE LIST  | 146-148                                |  |       |
|                          | ANNEXURE-III- LIST OF TOOLS & TACKLES  | 149-150                                |  |       |
|                          | ANNEXURE-IV- DRAWING / DOCUMENT SUBMISSION SCHEDULE  | 151-153                                |  |       |
|                          | ANNEXURE-V- MAIN DRAWING LIST WITH SCHEDULE OF SUBMISSION  | 154                                    |  |       |
|                          | ANNEXURE-VI- FORMAT FOR OPERATION AND MAINTENANCE MANUAL   | 155-157                                |  |       |
|                          | ANNEXURE-VII- SITE STORAGE AND PRESERVATION.   | 158-172                                |  |       |
|                          | ANNEXURE-VIII- CIVIL INPUT   | 173                                    |  |       |
| <b><u>VOLUME-III</u></b> |  |  |  |       |
| 1                        | LIST OF DOCUMENTS TO BE SUBMITTED WITH BID   | 176                                    |  |       |
| 2                        | COMPLIANCE CUM CONFIRMATION CERTIFICATE  | 177-178                                |  |       |
| 3                        | PRE BID CLARIFICATION SCHEDULE   | 179                                    |  |       |
| 4                        | SCHEDULE OF TECHNICAL DEVIATION / NO DEVIATION CERTIFICATE                                       | 180                                    |  |       |
| 5                        | ELECTRICAL LOAD LIST   | 181                                    |  |       |
| 6                        | DRAWINGS<br>1-ARCHITECTURAL PLAN OF SERVICE BUILDING AT 0.0 M.<br>2-TG EQUIPMENT LAYOUT AT 0.0 M | 182-183                                |  |       |

|   |   |                                     |                 |
|---|---|-------------------------------------|-----------------|
|  | TITLE   | SPEC. NO. PE – TS -410 - 502 – A001 |                 |
|   | <b>TECHNICAL SPECIFICATION<br/>FOR<br/>ELEVATOR</b> | VOLUME                              | II B            |
|   |   | SECTION                             | A               |
|   |   | REV 0                               | DATE 02.05.2016 |
|   |   | SHEET                               | OF              |

# SECTION - A

## SCOPE OF ENQUIRY

|   |   |                                     |                 |
|---|---|-------------------------------------|-----------------|
|  | TITLE   | SPEC. NO. PE – TS -410 - 502 – A001 |                 |
|   | <b>TECHNICAL SPECIFICATION<br/>FOR<br/>ELEVATOR</b> | VOLUME II B                         |                 |
|   |   | SECTION A                           |                 |
|   |   | REV 0                               | DATE 02.05.2016 |
|   |   | SHEET                               | OF              |

### SCOPE OF ENQUIRY / INTENT OF SPECIFICATION

- 1.1 This specification includes, but not limited to design, engineering, material selection, manufacturing and assembly, inspection, testing at manufacturer's works, packing, forwarding and transportation to site, unloading, storage & handling at site, erection & commissioning, carrying out trial run and acceptance / functional guarantee test at site & final painting of passenger elevator for **1X800 MW KOTHAGUDEM STPP at Paloncha, Khammam district, TELANGANA STATE** and necessary accessories including supply of mandatory spares, erection and commissioning spares, special maintenance tools and tackles etc.
- 1.2 The contractor shall be responsible for providing all material, equipment & services, which are required to fulfil the intent of ensuring operability, maintainability, reliability and complete safety of the complete work covered under this specification, irrespective of whether it has been specifically listed herein or not. Omission of specific reference to any component / accessory necessary for proper performance of the equipment shall not relieve the responsibility of providing such facilities to complete the supply, erection and commissioning of the **Elevators** and its accessories.
- 1.3 It is not the intent to specify herein all the details of design and manufacture. However, the equipment shall conform in all respects to high standards of design, engineering and workmanship and shall be capable of performing the required duties in a manner acceptable to purchaser who will interpret the meaning of drawings and specifications and shall be entitled to reject any work or material which in his judgement is not in full accordance herewith.
- 1.4 The extent of supply under the contract includes all items shown in the drawings, notwithstanding the fact that such items may have been omitted from the specification or schedules. Similarly, the extent of supply also includes all items mentioned in the specification and /or schedules, notwithstanding the fact that such items may have been omitted in the drawing.
- 1.5 The general term and conditions, instructions to tenderer and other attachment referred to elsewhere are made part of the tender specification. The equipment materials and works covered by this specification is subject to compliance to all attachments referred to in the specification. The bidder shall be responsible for and governed by all requirements stipulated herein.
- 1.6 While all efforts have been made to make the specification requirement complete & unambiguous, it shall be bidders' responsibility to ask for missing information, ensure completeness of specification, to bring out any contradictory / conflicting requirement in different sections of the specification and within a section itself to the notice of BHEL and to seek any clarification on specification requirement in the format enclosed under Vol-III of the specification. In absence of any such clarifications, in case of any contradictory requirement, the more stringent requirement as per interpretation of Purchaser/Customer shall prevail and shall be complied by the bidder without any commercial implication on account of the same. Further in case of any missing information in the specification not brought out by the prospective bidders as part of pre-bid clarification, the same shall be furnished by Purchaser/ Customer as and when brought to their notice either by the bidder or by purchaser/ customer themselves. However, such requirements shall be binding on the successful bidder without any commercial & delivery implication.
- 1.7 The bidder's offer shall not carry any sections like clarification, interpretations and /or assumptions.
- 1.8 Deviations, if any, should be very clearly brought out clause by clause in the enclosed schedule; otherwise, it will be presumed that the vendor's offer is strictly in line with NIT specification.
- 1.9 In case all above requirements are not complied with, the offer may be considered as incomplete and would become liable for rejection.

|   |   |                                     |                 |
|---|---|-------------------------------------|-----------------|
|  | TITLE   | SPEC. NO. PE – TS -410 - 502 – A001 |                 |
|   | <b>TECHNICAL SPECIFICATION<br/>FOR<br/>ELEVATOR</b> | VOLUME II B                         |                 |
|   |   | SECTION A                           |                 |
|   |   | REV 0                               | DATE 02.05.2016 |
|   |   | SHEET                               | OF              |

1.10 Unless specified otherwise, all through the specification, the word contractor shall have same meaning as successful bidder /vendor and Customer/ Purchaser/Employer will mean BHEL and /or customer including their consultant as interpreted by BHEL in the relevant context.

1.11 The standard quality plan is included in this specification to enable the bidder to understand the extent of inspection and testing requirements to execute this job. The successful bidder has to follow the quality plan as minimum requirement during manufacturing and testing.

1.12 Site Visit before submission of offer.

Bidders shall make Site visit in order to familiarize themselves with existing condition of site before submitting the bid in order to make their offer complete. During detail engineering also, the successful bidder shall be responsible for the correctness of details wrt existing facility at site. Customer approval on any drawing having details of existing facility shall not be cited by the successful bidder a valid reason for any shortcoming in the work by them. BHEL shall also not entertain any cost implication for any lack of input data with regard to site during detail engineering.


1.13 Compliance cum confirmation certificate is to be accepted by bidder without any modification.

1.14 Other requirements

Successful bidder shall furnish detailed erection manual for each of the equipment supplied under this contract at least 3 months before the scheduled erection of the concerned equipment / component or along with supply of concerned equipment / component whichever is earlier.

Document approval by customer under Approval category or information category shall not absolve the vendor of their contractual obligations of completing the work as per specification requirement. Any deviation from specified requirement shall be reported by the vendor in writing and require written approval. Unless any change in specified requirement has been brought out by the vendor during detail engineering in writing while submitting the document to customer for approval, approved document (with implicit deviation) will not be cited as a reason for not following the specification requirement.

In case vendor submits revised drawing after approval of the corresponding drawing, any delay in approval of revised drawing shall be to vendor's account and shall not be used as a reason for extension in contract completion.

|   |   |  |      |      |            |
|---|---|--|------|------|------------|
|  | TITLE<br><b>TECHNICAL SPECIFICATION<br/>FOR<br/>BUILDING ELEVATOR</b> | SPECIFICATION NO. PE -TS -410 - 502 - A001 |      |      |            |
|   |   | VOLUME                                     | II B |      |            |
|   |   | SECTION                                    | B    |      |            |
|   |   | REV  | 0    | DATE | 02.05.2016 |
|   |   | SHEET                                      | 1    | OF   | 1          |

# SECTION - B

## PROJECT INFORMATION

## CONTENT

| CLAUSE NO. | DESCRIPTION         |
|------------|---------------------|
| 1.00.00    | INTRODUCTION        |
| 2.00.00    | APPROACH TO SITE    |
| 3.00.00    | LAND                |
| 4.00.00    | SOURCE OF COAL      |
| 5.00.00    | SOURCE OF WATER     |
| 6.00.00    | ASH DISPOSAL AREA   |
| 7.00.00    | SALIENT DESIGN DATA |

## VOLUME : IIA

### SECTION-II

#### PROJECT SYNOPSIS AND GENERAL INFORMATION

##### 1.00.00 INTRODUCTION

The proposed 1x800 MW Kothagudem Thermal Power Station (KTPS), Stage-VII, Unit-12 would be set up by Telangana State Power Corporation Ltd. (TSGENCO) at Kothagudem, Telangana. The proposed Power Plant will be installed adjacent to the existing D colony of Kothagudem Thermal Power Station, at Kothagudem.

The Bidder shall acquaint himself by a visit to the site, if felt necessary, with the conditions prevailing at site before submission of the bid. The information given here in under is for general guidance and shall not be contractually binding on the Owner. All relevant site data /information as may be necessary shall have to be obtained /collected by the Bidder.

##### 2.00.00 APPROACH TO SITE

Site is located in the existing D Colony of Kothagudem Thermal Power Station, which is at a distance 30 km from temple town of Bhadrachalam and 300 km from Hyderabad by road. The Nearest railway station is Bhadrachalam Road (Known as Kothagudem) at a distance of 12 km. Kothagudem- Bhadrachalam National Highway branches off to the power station site near village Paloncha.

##### 3.00.00 LAND

Land is primarily required for the main plant & auxiliaries (BTG) and balance of plant (BOP) like ash handling, coal storage, cooling tower, switchyard etc., which is available within the existing plant boundary.

The existing colony is to be dismantled, and the land of about 137 acres will be used for the main plant building, water facilities, switchyard, coal handling etc. The raw water reservoir will be located adjacent to the existing raw water reservoirs.

230 acres of land required for Ash Dyke will be procured. Land is available for staff colony, which is to be constructed by the EPC contractor.

##### 4.00.00 SOURCE OF COAL

100% Imported and Blended coal (50% imported + 50% indigenous) will be used. Indigenous coal shall be sourced from Suliyari coal mines, Madhya Pradesh.

5.00.00 **SOURCE OF WATER**

Source of water (total quantity of water is 2192 m<sup>3</sup>/hr) is Godavari River near Burgampahad & water will be pumped through existing GRP pipe line (of length approx. 26 km).

6.00.00 **ASH DISPOSAL AREA**

Ash shall be dumped in the ash dump area which will be about 9 km from plant. The ash dyke area of 230 acres is adequate for 1x800 MW unit as per MOEF norms.

7.00.00 **SALIENT DESIGN DATA**

7.01.00 Meteorological data of site is given below:-

|                             |           |                                    |
|-----------------------------|-----------|------------------------------------|
| Elevation above MSL         | :         | 89 m                               |
| Monthly highest temperature | :         | 44.9 °C                            |
| Monthly lowest temperature. | :         | 12.9 °C                            |
| Rainfall                    |           |                                    |
|                             | Average.: | 1031 mm                            |
|                             | Max. :    | 100 mm/ hr                         |
| Mean Wind speed             | :         | 44 m/sec                           |
| Relative Humidity           |           |                                    |
|                             | Max :     | 82%                                |
|                             | Min :     | 35%                                |
| Seismic Zone                | :         | Zone-III as per IS- 1893 (Part-IV) |

[Climatological data of Khammam is attached for reference].



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 1 OF 13**

# **SECTION – C1**



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 2 OF 13**

## **SECTION C1-A**

### **SCOPE OF SUPPLY & SERVICES, EXCLUSION AND TERMINAL POINTS.**



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 3 OF 13**

## 1.0 Introduction

Passenger elevator shall be provided for access to various operating floors / platforms in TG building and Service building for 1X800 MW KOTHAGUDEM TPS to facilitate movement of operating and maintenance personnel.

## 2.0 Scope of equipment supply and services

**2.0.1** Design, Engineering, Manufacture, Inspection & Testing at manufacturer's works or at their sub-vendor's works, Painting at manufacturer's or at their sub-vendor's works, duly packed for transportation to site, delivery to site, storage and handling at site, mandatory spares, Erection & Commissioning, carrying out trial run and Acceptance / functional tests at site & final painting of Passenger Elevators for 1 X 800 MW KOTHAGUDEM STPP as listed below:-

| Sl. no | Building         | No. of elevators | Capacity | No. of landings  | Total rise | Type                              | Speed   |
|--------|------------------|------------------|----------|--|------------|-----------------------------------|---------|
| 1      | TG building      | 1 No.            | 1088 Kg  | Six including ground (0.0m, 8.5m, 17.0m, 24.0m, 29.5m & last landing at 35.5m) | 35.5 M     | Conventional (passenger elevator) | 0.5 M/s |
| 2      | Service Building | 1 Nos.           | 1088 Kg  | Five including ground (0.0m, 4.25m, 8.5m, 12.75m, & last landing at 17.0m )    | 17 M       | Conventional (passenger elevator) | 0.5 M/s |

**2.0.2** Elevator shall include but shall not be limited to the following:-

- 1) Elevator car with SS 304, 1.5 mm (min) thick sheet of hair line finish.
- 2) Guide rails for car and counterweights.
- 3) Counterweight.
- 4) DCEM brakes.
- 5) Spring buffer for car and counterweight.
- 6) Driving arrangement including motor, gear box, sheaves etc.
- 7) All electrical equipment including power cable, control cable, controller panel, safety devices including push buttons, limit switches, safety switches, indicators etc.
- 8) Isolating switch / MCBs.
- 9) Car doors, car ceiling and hoist way doors of SS 304, 1.5 MM (min) thick sheet of hair line finish.



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**


**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 4 OF 13**

- 10) Car operating panel, digital control, car position indicator at all floors, luminous hall buttons, auto door operating mechanism, alarm bell, car light & car fan.
- 11) Intercom connection through EPABX.
- 12) Ropes for hoisting.
- 13) Circuit breaker, switch fuse unit etc. in machine room for terminating the power supply cable (power supply cable provided by purchaser up to machine room level), other power/control and trailing cabling and equipment earthing.
- 14) Ladder in pits.
- 15) Emergency light with rechargeable battery.
- 16) All fixing materials require fixing rails, brackets, equipment including nuts and bolts.
- 17) Fascia plates (750 mm minimum) & sill angels.
- 18) Full length infra-red Curtain safety feature in door along with pressure limiter as an extra mechanical safety.
- 19) ELCB if required as per statutory requirement.
- 20) Any other equipment required to meet the requirement of local statutory and regulatory body and prevailing lift etc.
- 21) Car lighting, recessed fluorescent light fittings for illumination level of 100 lux on car floor.
- 22) Elevator shaft, pit cable conduit fixtures, switches 3 pin or as required by bidder during erection / maintenance purpose at every 3 m.
- 23) Mirror for the car rear panel.
- 24) Floor announcement cum music system to be provided.
- 25) Special maintenance tools and tackles along with un-priced list with the offer.
- 26) Three (3) sided SS- mirror finish hand railing at suitable height.
- 27) Minor civil work including grouting as well as foundation bolt grouting as required during installation of elevator.
- 28) Bidder shall include scaffoldings required in their scope of supply.

|   |   |                                     |                         |
|---|---|-------------------------------------|-------------------------|
|  | <b>TITLE:</b>                                       | <b>SPEC. NO. PE-TS-410-502-A001</b> |                         |
|   | <b>TECHNICAL SPECIFICATION<br/>FOR<br/>ELEVATOR</b> | <b>VOLUME IIB</b>                   |                         |
|   |   | <b>SECTION C</b>                    | <b>SUB-SECTION</b>      |
|   |   | <b>REV. 00</b>                      | <b>DATE: 02.05.2016</b> |
|   |   | <b>SHEET 5 OF 13</b>                |                         |

- 29) Automatic rescue device with battery drive - Modern advanced electronic drive system of rescuing passenger trapped in an elevator shall be provided.
- 30) Emergency safety devices - The lift shall be provided with safety device attached to the lift car frame and sustaining the lift car up at governor tripping speed with full rated load in car.
- 31) All steel embedment for fixing landing doors / indicators etc. to the elevator well shaft and fascia plate shall be supplied by the bidder
- 32) Guide rails complete with supporting brackets for the car and counter weights.
- 33) Elevator drive machines complete with electric motor, reduction gear unit, suspension ropes, buffers for the cars and the counter weights and other drives and control mechanism. All foundation anchor bolts, sleeves, anchoring steels and any item required to complete the job satisfactorily shall be provided by the bidder. The bidder shall also provide for the grouting of anchor bolts, sleeves, anchoring steel etc. and other anchorages.
- 34) Any other steel works as well as all other accessories / components not specified in the technical specification but necessary for making the elevator complete.
- 35) All minor building works including the supply of steel items, associated with installations of equipments in the machine room hoist way, hoist way door, frames and elevator pit, shall form part of bidder's scope of supply, BHEL / customer will provide the elevator well complete with foundation and brick walls around the lift well together with overhead machine room. The machine room will be provided with RCC floor slab with necessary pockets for anchor bolts and slots.
- 36) Dummy landing/s, as required in case travel between two consecutive landings is more than 10 m, shall be considered by bidder in his offer.
- 37) Any other requirement stipulated by state statutory body and prevailing local lift act requirement shall also to be included by bidder in their scope.
- 38) Bidder shall use latest IS 14665 (all parts) for outline dimensions of elevator & shaft, installation, operation, maintenance & inspection and testing and for elevator components design.
- 39) **Mandatory Spares:**

A complete unused and new set of Mandatory Spare parts shall be supplied. The items supplied shall be of the best quality and specially protected against rusting in tropical climate. The minimum requirement of mandatory spare parts is listed in Annexure –II section-C, volume II-B of this specification.



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 6 OF 13**

**NOTES:**

- 1) Flooring for all elevators shall be MS CHQ plate as indicated in the Data sheet.
- 2) Functional Guarantee test shall be carried out at site for over speed test and over load test, travel and hoist speed checks as per latest IS.
- 3) Car, landing door and car ceiling shall be of SS-304 sheet with thickness (min) 1.5 mm.
- 4) Min dimensions as specified in applicable IS 14665 (all five parts) shall be considered / provided for lift shaft / pit / car / M/c Room. Safety requirement shall be as per latest IS 14665 (Relevant part). Bidder to refer the layout attached in the specification for different buildings.
- 5) Elevators pit for TG Building & Service Building shall be bare pit (i.e. pit without any RCC block / pedestal for buffer for CAR & CWT). Accordingly, MS structure & buffer required for elevator resting shall be provided by bidders.
- 6) All Equipment's / facilities needed for erection & commissioning shall be in bidder's scope.
- 7) Bidder to note that all LT Power cables (Fixed power and control cables etc), Trailing cable and instrument / signal cable for elevator shall be as per electrical specification. Trailing cable shall be FRLS type (with strain bearing member).
- 8) Make of various bought out items & QAP shall subject to approval of BHEL / Customer during detail engineering stage without any commercial implication at contract stage.
- 9) Bidder shall supply erection and commissioning spares as required during E&C stage without any commercial implication.
- 10) Car frame and structure (guide brackets, supports etc) shall be painted with epoxy based paint for all elevators.
- 11) Protection class for motor shall be IP 54 and main control panel shall be min IP 54 and elevator control shall be VVVF type. Push buttons, Car operating Panel, Landing Operating Panel, Landing door motor and other equipment shall be IP-54.
- 12) Factor of safety for rope shall be 12 (min).
- 13) All Landing door shall be fire rated for at min 2 hour or as per latest IS / as per the state statutory requirement whichever is more stringent.
- 14) Motor shall be S4 / S5 duty with insulation class F & temp rise limited to class B.



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 7 OF 13**

- 15) Bidder shall submit the following documents (min) for BHEL/customer approval during detail engineering stage:-
  - a) General arrangement of Elevator
  - b) Technical data sheet of elevator
  - c) Technical data sheet of motor along with power, control and trailing cable details
  - d) Wiring schematic diagram
  - e) MQP for elevator along with test procedure of various components.
- 16) Bidder shall comply to the quality requirements as enclosed with specification. Quality plan shall be submitted by the successful bidder for approval during detail engineering.
- 17) Bidder shall confirm that supply, installation and commissioning of elevator shall be completed within project schedule as indicated elsewhere from placement of intent / letter of intent.
- 18) Bidder shall be responsible for obtaining all necessary approval from statutory and regulatory body and lift inspector. However, purchaser will furnish required information time to time basis, if required.
- 19) Elevator shall be provided with AC VVVF type drive control system.

**Bidder shall furnish the following documents only during tender stage as a part of technical bid. Any other technical documents furnished by bidder shall not be considered as the part of offer :-**


- 1) Signed and stamped copy of electrical load list for each elevator
- 2) Signed and stamped copy of Deviation schedule (if any).
- 3) Signed and stamped copy of Compliance cum confirmation sheet.

**Note : In case bidder fails to furnish any document specified above, bidder's offer shall be treated as incomplete and shall liable to be rejected.**

### **3.0 SCOPE OF SERVICES**

Scope of services will broadly include the followings:-

- 1) Complete erection, testing and commissioning including all testing and commissioning materials, consumables and other tools and tackles required for erection of complete elevator package.
- 2) Painting of all equipments / items within the battery limit.
- 3) Unloading, storage, handling and transportation at site for all items of elevator.
- 4) Minor civil and structural works shall be carried out by the bidder if required at site for which no additional commercial implication shall be entertained by BHEL.

|   |   |                                     |                         |
|---|---|-------------------------------------|-------------------------|
|  | <b>TITLE:</b>                                       | <b>SPEC. NO. PE-TS-410-502-A001</b> |                         |
|   | <b>TECHNICAL SPECIFICATION<br/>FOR<br/>ELEVATOR</b> | <b>VOLUME IIB</b>                   |                         |
|   |   | <b>SECTION C</b>                    | <b>SUB-SECTION</b>      |
|   |   | <b>REV. 00</b>                      | <b>DATE: 02.05.2016</b> |
|   |   | <b>SHEET 8 OF 13</b>                |                         |

- 5) Necessary consumables and instrumentation as required for inspection and testing at works as well as at site including pre-commissioning activities, if any, shall be arranged by the successful bidder at their own cost.
- 6) Functional testing of complete elevator package.
- 7) Preparation of civil input drawings including elevator pit, shaft, machine room etc.
- 8) Preparation of all necessary drawings / data sheets / documents / calculations as required for obtaining necessary local administration permits / approval from statutory authority and make arrangements for inspection and tests required thereby for necessary approval on behalf of the customer. Fees as required for obtaining approval from statutory bodies shall also be included in the scope of work of the bidder.
- 9) Any other service as required for making the installation complete in all respect and satisfactory erection and commissioning of the system.
- 10) Relevant requirements as per GCC, ECC & SCC.
- 11) Split Air conditioner of min 2 Ton capacity in the machine room which includes fans, air filter and accessories to prevent dust ingress in the machine room. However, successful bidder shall furnish the heat load calculation and capacity of air conditioner after considering all actual heat loads of elevator machine room during detail engineering stage for selection of final capacity of air conditioner.
- 12) 1/2 Kg CO2/suitable type Fire extinguisher in bidder scope. Fixing arrangement shall be provided in Car accordingly.


#### **4.0 Exclusion**

- 1) Complete civil works for hoist way, machine room, pit complete with the side enclosure (brick / RCC), interconnecting platform (if any) and monorail beam.
- 2) Electric hoist with travelling trolley of 3T capacity to facilitate handling of equipment in the machine room.
- 3) Power supply cable (AC 415 V, 3 Ph, 50 Hz) up to machine room level. Further cabling (all cables including power, control and instrumentation as per tender specification) shall be provided by the bidder.
- 4) Electrical exclusion as per separate scope sheet attached in the specification.

#### **5.0 Operation**

Elevator shall have provision to meet followings operational requirements:-

- a) Selective simplex / duplex collective, automatic operation with or without attendant through illuminated push button station located inside the lift car.

|   |   |                                     |                         |
|---|---|-------------------------------------|-------------------------|
|  | <b>TITLE:</b>                                       | <b>SPEC. NO. PE-TS-410-502-A001</b> |                         |
|   | <b>TECHNICAL SPECIFICATION<br/>FOR<br/>ELEVATOR</b> | <b>VOLUME IIB</b>                   |                         |
|   |   | <b>SECTION C</b>                    | <b>SUB-SECTION</b>      |
|   |   | <b>REV. 00</b>                      | <b>DATE: 02.05.2016</b> |
|   |   | <b>SHEET 9 OF 13</b>                |                         |

- b) Door operating shall be automatic door operation and electronic door protection system for opening / closing of car and landing doors.
- c) Bidder shall provide car operating panel with luminous buttons, car position indication in car (both visual and audio) combined with direction arrows, overload warning indicator, battery operated alarm bell and emergency light and fan and hands free speaker telephone set with suitable battery, charger and controls.
- d) Bidder shall provide emergency indicator to indicate the location of elevator in case of elevator being stuck up between the floors through automatic flashers/ display (both audio and visual as out of service).
- e) Two (2) push buttons, one for upward movement and the other for downward movement at each intermediate landing and one (1) push button at each terminal landing shall be provided in order to call the car. Digital hall position indicator at all floors, tell lights at all floors shall also be provided by the bidder.
- f) All fixtures shall be in stainless steel face plates.
- g) Push buttons shall be fixed in the car for holding the door open for any length of time required.
- h) All other safety / protection / operation interlocks as required by IS – 14665 (all parts) latest edition.

#### **6.0 Electric Motor**

The driving motors shall conform to IS 325 and suitable for variable voltage variable frequency (VVVF) application. All motors shall be squirrel cage induction type, suitable for operation at 415 V (+/- 10% variation), 3 Phase, 3 wire, 50 Hz (+3% to -5% variation) supply. Motors shall be provided with class F insulation & temp rise limited to class 130 (B).

#### **7.0 Controls**

The control shall be variable voltage and variable frequency type and shall provide smooth and constant acceleration and retardation under all conditions of operation. Suitable control panels shall be provided in the machine room. The lift will be automatically stopped by upper and lower terminal switches. The elevators will have an emergency stop switch, limit switches and other safety devices according to statutory rule.

#### **8.0 Cables and wirings**

The circular trailing cables shall be either in accordance with IS 4289 Part-I (elastomer insulated) or IS 4289 Part-II (PVC insulated). The flat type trailing cables if offered shall be in accordance with IEC 60227-6. The voltage grade shall be 1100 V.



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 10 OF 13**

All wiring / cabling between the equipments in the lift machine room and that between the machine room and equipment in the lift well and at the landing shall be wired in HDP conduits / galvanised steel conduits to be supplied by the bidder. Alternatively, armoured cables may be used. However, bidder shall refer detailed specification of cables / wirings in the specification- Electrical portion.


## **9.0 Earthing**

The elevator structures and all electrical equipments, including metal conduits shall be effectively earthed with the earth conductors provided in the machine room as per IS 3043.

## **10.0 DESIGN CRITERIA**

The design criteria and equipment specification will be as follows:

- i) The rated speed will be 0.5 m/sec. Proper allowance will be made for impact and wear and the factor of safety for rope shall not be less than twelve (12) or as per IS 14665 (all parts). The suspension wire rope will confirm to IS-14665 or approved equivalent international standard.
- ii) The lift will be providing with automatic travelling device which will take care of overrun and under run of the car and rope stretch that the car floor is within 6.0 mm from the landing level at the floors while in operation.
- iii) The lift will be equipped with upper and lower terminal switches arranged to stop the car automatically within the limit of the top car clearance and bottom run-by, from the any normal operating speed.
- iv) The elevator car shall be provided with SS-304 sheet fabricated, bright finished to approved shade (including landing doors of the car). Vitrified ceramic tile of matt finish flooring as indicated in the data sheet - A, concealed fan and indirect lighting, emergency lighting, intercom, car position and travel direction indicator.
- v) As the elevator is to provide service in a power station, it is necessary for the equipment to be specially coated (painted). This will include application of anticorrosive paint as applicable. The electrical equipment will have enclosures meeting degree of protection as covered under electrical specification.
- vi) The elevator as a whole will comply with relevant Indian Standard i.e. 14665 or approved international standard. The outline dimensions of electric lift shall meet the requirements of IS 14665 (latest edition).
- vii) The elevator shall be provided with AC VVVF type drive control system.

|   |   |                                     |                         |
|---|---|-------------------------------------|-------------------------|
|  | <b>TITLE:</b>                                       | <b>SPEC. NO. PE-TS-410-502-A001</b> |                         |
|   | <b>TECHNICAL SPECIFICATION<br/>FOR<br/>ELEVATOR</b> | <b>VOLUME IIB</b>                   |                         |
|   |   | <b>SECTION C</b>                    | <b>SUB-SECTION</b>      |
|   |   | <b>REV. 00</b>                      | <b>DATE: 02.05.2016</b> |
|   |   | <b>SHEET 11 OF 13</b>               |                         |

- viii) Doors are automatic, center opening with emergency key opening at all landings, horizontal sliding type for car as well as for hoist way.  
Trap door for each elevator in machine room shall be provided by civil contractor as per IS-14665 (latest edition).

#### **11.0 Other Technical Requirements**

- 1) Characteristic curves of all motors shall be furnished by the bidder during detail engineering stage for approval showing torque, speed, current and voltage.
- 2) Electrical requirements shall be as per requirements enclosed elsewhere in the specification.
- 3) Complete elevator installation shall be in accordance with the requirements of concerned approving authority.
- 4) In case of any contradictory requirement amongst the various clauses within the specification and clarifications not having been sought by the bidders, the most stringent requirement as per interpretation of BHEL's engineer shall be final and binding on the bidder for which BHEL will not entertain any commercial implication.
- 5) Data sheets of various items shall be prepared by the bidder and shall be submitted to BHEL / customer / consultant for approval after placement of order and any changes required by BHEL / customer / consultant for the same shall be incorporated and adhered by the bidder without any commercial implications.
- 6) GA drawing indicating design data, material of construction etc. shall be prepared by the bidder during detail engineering stage based on specification / contractual requirement and there should be no commercial implication on account of finalization of the drawings and documents.
- 7) O & M manual shall be furnished to BHEL / customer / consultant for approval during detailed engineering stage.
- 8) Field quality plan / quality assurance plan / check list shall be prepared by the bidder for each item of elevator and shall be submitted to BHEL / customer / consultant for approval after placement of order and any changes required by BHEL / customer / consultant for the same shall be incorporated and adhered by the bidder without any commercial implications.
- 9) All possible efforts shall be made by the bidder to get the approval of drawings and documents from BHEL / customer / consultant at the earliest and the documents prepared / generated by them or their sub-vendors shall be checked by their competent authority before submission to BHEL.



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**


**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**


**SHEET 12 OF 13**

- 10) Revision made by the bidder in any drawings and documents shall be highlighted by indicating the no. of revisions in a triangle without fail so that the minimum time is required by BHEL to review the drawings and documents.
- 11) Bidder to note that all the drawings shall be prepared in Auto Cad - 2010 version and required number of hardcopies and soft copies shall be furnished to BHEL during detailed engineering stage. Exact requirement of number of hard copies and soft copies of all drawings and documents as required by BHEL / customer / consultant shall be informed to the successful bidder during detail engineering stage and bidder to furnish the same for which no additional cost shall be entertained.
- 12) 21 days' time is required by BHEL to offer their comments on the drawings and documents being submitted by the bidder (during detailed engineering stage in the event of L.O.I being placed) from the date of receipt.
- 13) Civil works will be provided by BHEL / customer. Hence, bidder has to furnish the civil inputs in time. Bidder has to carry out the rectification in the civil works in the event of any changes in the civil input data furnished by them or delay in submission of input data by them. Bidder to furnish the civil foundation drawing along with the loading data for approval during detailed engineering stage showing / indicating the followings :-
  - a) Scope of work by BHEL and bidder shall be indicated with different legend or in the form of note.
  - b) Recommended locations of earthing pads.
  - c) Civil loads along with detailed calculation of loading
  - d) Details of pockets / cut outs as required for anchor bolts.
- 14) Bidder to depute competent designer (s) at BHEL's office during detailed engineering stage to discuss drawings and other technical documents as and when required by BHEL. However, minimum seven (7) days' notice shall be served for the same.
- 15) All the drawings which are required to be furnished to BHEL during detailed engineering stage shall include technical parameters, details of paints, BOQ / BOM etc in tabular form indicating all components including bought out items and their quantity, material of construction indicating its applicable code / standard, weight, make etc.
- 16) All drawings and documents including general arrangement drawing, data sheet, calculation etc. shall be furnished to BHEL during detailed engineering stage and shall include / indicate the following details for clarity w.r.t. inspection, construction, erection and maintenance etc.:-

|   |   |                                     |                         |
|---|---|-------------------------------------|-------------------------|
|  | <b>TITLE:</b>                                       | <b>SPEC. NO. PE-TS-410-502-A001</b> |                         |
|   | <b>TECHNICAL SPECIFICATION<br/>FOR<br/>ELEVATOR</b> | <b>VOLUME IIB</b>                   |                         |
|   |   | <b>SECTION C</b>                    | <b>SUB-SECTION</b>      |
|   |   | <b>REV. 00</b>                      | <b>DATE: 02.05.2016</b> |
|   |   | <b>SHEET 13 OF 13</b>               |                         |

- a) All drawings and documents shall bear BHEL's title block and drawing / document number. However, BHEL's drawing / document numbering scheme shall be furnished to the successful bidder after the placement of L.O.I.
- b) All drawings and documents shall indicate the list of all reference drawings including general arrangement.
- c) All drawings shall include / show plan, elevation, side view, cross - section, skin section, blow - up view, all major self manufactured and bought out items shall be labeled and included in BOQ / BOM in tabular form.
- d) Specification / schedule of painting shall be made as a part of general arrangement drawing of each item indicating at least three (3) makes.
- 17) Bidder to assess the capability of their sub-vendors in terms of preparation of drawings, calculations, documents, quality assurance, supply of material etc. as per project schedule before placing the order on them. No deviations shall be entertained.
- 18) Bidder to furnish prices and unit price of each item of proposed system as per BHEL's price format only along with the final price bid.
- 19) Bidder shall check that specifications of all the items are available in the NIT specification. However, in the event of absence of specification for any item, bidder will approach BHEL to furnish the specification of missing items and new specification will be adhered by the bidder for which no commercial implication shall be entertained by BHEL.
- 20) Bar chart, list of drawings and documents including data sheet, manual calculation, quality plan, field quality plan, PG test procedure, list of sub – vendors (mechanical, C & I and erection and commissioning), technical specification and material of construction, painting specification / schedule, dispatch schedule etc. of various items as required by BHEL / customer / consultant shall be submitted to BHEL / customer / consultant during detail engineering stage for approval and the approved drawings / documents shall be adhered by the bidder without any commercial implication.
- 21) List of commissioning spares and tools and tackles in terms of numbers shall be furnished by the bidder along with the offer.
- 22) "Technical deviations" shall be clearly indicated in bidder's offer in prescribed format only.
- 23) All drawings shall be prepared as per BHEL's title block and bear BHEL's drawing No. and customer / consultant's drawing no; which will be forwarded to the successful bidder during detail engineering stage.

| <b>SUPPLY PRICE PERCENTAGE BREAKUP</b> |   |                         |   |
|--|---|-------------------------|---|
| <b>S.No.</b>                           | <b>Details of Works or Equipment/System</b>   | <b>Qty (LOT / Nos.)</b> | <b>Percentage (%) Break up proposed for billing purpose during contract</b> |
| 1.1                                    | Total lumpsum firm price inclusive of all taxes duties and other levies as applicable for design, engineering, manufacturing, inspection and testing, painting, supply of mechanical, electrical equipments and control system & equipments with delivery duly packed at project site including scaffolding supply in line with technical specification for TG building, One (1) nos. 1088 Kg capacity passenger elevator (conventional type) with speed 0.5 m/s, six (6) nos. of landings including ground and 35.50 M (last landing elevation) Total travel, complete with all accessories for the total scope defined as per technical specification PE-TS-410-502-A001, including E&C spares taking into account all clarifications, confirmations and agreements.    | 1 No. Elevator          | 54  |
| 1.2                                    | Total lumpsum firm price inclusive of all taxes duties and other levies as applicable for design, engineering, manufacturing, inspection and testing, painting, supply of mechanical, electrical equipments and control system & equipments with delivery duly packed at project site including scaffolding supply in line with technical specification for Service building, one (1) nos. 1088 Kg capacity passenger elevator (conventional type) with speed 0.5 m/s, Five (5) nos. of landings including ground and 17 M (last landing elevation) Total travel, complete with all accessories for the total scope defined as per technical specification PE-TS-410-502-A001, including E&C spares taking into account all clarifications, confirmations and agreements. | 1 No. Elevator          | 45  |
| 1.3                                    | Total lumpsum firm price inclusive of all taxes duties and other levies as applicable for supply/delivery duly packed at project site including freight , unloading, storage and handling at site, and handing over to the customer in line with drawings/ documents approved by BHEL/Customer for one set of Maintenance tools and Tackles common for all elevators. (as per Annexure -IV, Bidder to indicate the applicable Tools & tackle).  | 1 Sets.                 | 1   |
|  | <b>Total of 1.1 to 1.3 (Should match with 1.0.0) of annexure-I of Main supply price format. These prices shall be used for billing purpose during contract stage.</b>   |                         |   |

|   |  |  |                 |
|---|--|--|-----------------|
|  | TITLE<br><b>TECHNICAL SPECIFICATION<br/>FOR<br/>ELEVATOR</b> | SPECIFICATION NO. PE – TS – 410 - 502 – A001 |                 |
|   |  | VOLUME II B                                  |                 |
|   |  | SECTION C                                    |                 |
|   |  | REV 0  | DATE 02.05.2016 |
|   |  | SHEET 1                                      | OF 1            |

# SECTION – C1

## DATA SHEET A



**TITLE:**

**DATA SHEET - A  
FOR  
BUILDING ELEVATOR**

SPEC. NO. PE-TS-410-502-A001

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 1 OF 4**

| S. No. | DESCRIPTION  | PASSENGER ELEVATOR   |                                       |
|--------|--|--|---------------------------------------|
|        |  | TG building  | Service building                      |
| 1.     | Elevator   |  |                                       |
| 2.     | Type of Service  | Passenger elevator, Conventional Type  | Passenger elevator, Conventional Type |
| 3.     | Rated Load on Elevator   | 1088 KG (16 Person)  | 1088 KG (16 Person)                   |
| 4.     | Quantity   | 1 No. (One no.)  | 1 Nos. (One nos.)                     |
| 5.     | Rated Speed of Lift  | 0.5 M/Sec  | 0.5 M/Sec                             |
| 6.     | Total Travel   | 35.5 M   | 17.0 M                                |
| 7.     | Nos. of floors to be served  | Six (6) Nos. including Ground.   | Five (5) Nos. including Ground        |
| 8.     | Method of control.   | ACVVVF Control with automatic level adjustment.  |                                       |
| 9.     | Position of Machine Room   | Directly above the lift Shaft.   |                                       |
| 10.    | Car enclosure construction, design and finish car.   | SS -304, min 1.5 mm thick. sheet,  |                                       |
| 11.    | Design, construction, installation codes including car size, door size, Shaft size, Size of platform and car entrance. | As per IS: 14665 (all parts), latest edition   |                                       |
| 12.    | Car and landing door   | Protected by central opening sliding stainless steel door (Horizontal bi-parting door).  |                                       |
| 13.    | Flooring   | MS CHQ Plate.  |                                       |
| 14.    | Operation  | Automatic simplex collective with and without attendant with provision for locking control in "auto" or "Attendant" position. Key type lock switch shall be provided.  |                                       |
| 15.    | Signal   | Car position indicator in car, car position indicator at car floors, telltale lights at all floors, battery operated alarm bell and emergency light with suitable battery, battery charger and controls, Remote alarm shall be provided. |                                       |
| 16.    | Method of operation of car and landing doors.  | Power operated with automatic door opening and closing devices.  |                                       |
| 17.    | Lighting & fan   | One cabin fan, two recessed fluorescent light fittings on car roof. Lux level : 100 min.   |                                       |
| 18.    | Power supply :<br>a) Power<br>b) Lighting & fan  | 415 Volts, (+/- 10% variation), 3 Phase, 50 Hz (+5% to -5% variation), combined voltage variation 10%, 4 wire system,<br><br>240 Volts, 1 Phase, 50 c/s.   |                                       |
| 19.    | Other requirements   | Internal telephone wiring and telephone hand set to be provided. The external connection shall be provided by  |                                       |



**TITLE:**

**DATA SHEET - A  
FOR  
BUILDING ELEVATOR**

SPEC. NO. PE-TS-410-502-A001

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 2 OF 4**

|     |  |  |
|-----|--|--|
|     |  | Customer. Also, automatic rescue device shall be provided.   |
| 20. | Additional requirements :-   |  |
| a)  | Isolating cushion between car and car frame shall be provided.           | Type of cushion shall be rubber pad or spring which shall be as per manufacturer's standard.                   |
| b)  | Three pin plug with socket on car top                                    | 5/15A, 3 pin plug socket with switch on top of lift car and inside shaft to take care maintenance requirement. |
| c)  | Car frame Material and type of construction                              | Steel and bolted construction  |
| d)  | Landing Door   | Fire rated for min. 2 hours  |
| e)  | Type of operation  | Automatic  |
| f)  | Door hanger tracks along with accessories shall be provided.             | Required   |
| g)  | Safety shoes complete with accessories shall be provided.                | Yes  |
| h)  | Safety device for door operation shall be provided.                      | Full length Infrared light curtain along with pressure limiter as an extra mechanical safety is required.      |
| i)  | Handrails on three sides of car  | Mirror finish stainless steel  |
| j)  | False ceiling  | Powder painted   |
| k)  | Emergency stop switch  | Yes  |
| 21. | Control and operation  |  |
|     | (a) Type of control  | Simplex  |
|     | (b) Type of drive  | Variable voltage variable frequency drive  |
| 22. | Car operating panel  | Provided   |
|     | (a) Type of construction   | Partial Height car operating panel (COP), Removable type from Car with SS face plate.                          |
|     | (b) Push Buttons   | Luminous push buttons with IP 54   |
| 23. | Car position indicator   | Provided.  |
|     | (a) Type of construction   | As per manufacturer's standard   |
|     | (b) Type of display  | 7 segment LED display.   |
| 24. | Push button station and call registered tell tale lights at each landing | Provided in each landing   |
|     | (a) Type of construction   | Box type with SS face plate  |
|     | (b) Push Buttons   | Luminous push buttons with IP 54   |
| 25. | Apron / Facia Plate provided as per IS 14665                             | Yes (To be provided by supplier)   |
| 26. | Emergency Light  | Required   |
| 27. | Terminal buffers, their types and number of buffers                      | Spring buffers shall be Provided as per IS 14665.  |
| 28. | Load plate   | As per manufacturer's standard / as applicable   |



**TITLE:**

**DATA SHEET - A  
FOR  
BUILDING ELEVATOR**

SPEC. NO. PE-TS-410-502-A001

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 3 OF 4**

|     |   |  |
|-----|---|--|
| 29. | Counter weights frame                                       | Fabricated Steel Construction  |
| 30. | Counter weight fillers                                      | Cast Iron  |
| 31. | Number of Limit Switches                                    | As per requirement   |
|     | a) Location   | Bottom & top terminal  |
|     | b) Type   | Electromechanical  |
|     | c) Operation  | Cam Operated   |
| 32. | Controller and type   | Selective Collective Controller with variable voltage variable frequency drive and Microprocessor based software controlled logic system |
| 33. | Reverse phase relay and other protective devices            | Required   |
| 34. | Car Safety & Governor                                       |  |
|     | a) Stopping distance  | As per IS:14665  |
|     | b) Type and mode of operation of Over speed Governor device | Centrifugal action   |
|     | c) Tripping speed and design code conforming to             | As per IS 14665  |
|     | d) Location   | At machine room  |
| 35. | Motor details   |  |
|     | (a) Type  | 3 phase AC squirrel Cage Induction motor   |
|     | (b) Type of Duty  | Lift Duty  |
|     | (c) Motor Duty  | S4 /S5   |
|     | (d) Duty Cycle of Motor                                     | 60%  |
|     | (e) Applicable standard                                     | IS:325   |
|     | f) No. Of Starts Per Hour                                   | Elevator Motor shall be suitable for minimum of 150 Starts per hour.   |
|     | g) Direction of rotation                                    | Both Clockwise & Anticlockwise   |
|     | h) Class of Insulation                                      | F, temp rise limited to class B. Motor shall be provided with thermal class 130 (B) or better insulation.                                |
|     | i) Method of Starting                                       | AC Variable Voltage Variable Frequency Drive   |
| 36. | Door Motor  |  |
|     | a) Equipment driven by Motor                                | Door   |
|     | b) Direction of rotation                                    | Both Clockwise & Anticlockwise   |
|     | c) Type of enclosures                                       | IP54   |
| 37. | Metallic Wire Mesh between Car & Counter Weight             | Required   |
| 38. | Fire Man Switch   | Required   |
| 39. | Sound Reducing Material                                     | Isolation Rubber / other arrangement in the Machine shall be provided  |
| 40. | Automatic Rescue Device (Battery Drive)                     | Provided   |
| 41. | Trailing cables   | FRLS type.   |
| 42. | Design seismic coefficient                                  | According to IS 1893 - 1977  |



**TITLE:**

**DATA SHEET - A  
FOR  
BUILDING ELEVATOR**

SPEC. NO. PE-TS-410-502-A001

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 4 OF 4**

|     |   |   |
|-----|---|---|
| 43. | Split Air condition in machine room                                 | As per Machine room area (not less than 2T Capacity). |
| 44. | 1/2 Kg CO2/suitable type Fire extinguisher with fixing arrangement. | Provided.   |



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 1 OF 1**

**SECTION C2-A  
TECHNICAL REQUIREMENT**

## CONTENT

| CLAUSE NO. | DESCRIPTION                      |
|------------|----------------------------------|
| 1.00.00    | CODES AND STANDARDS              |
| 2.00.00    | SCOPE OF WORKS                   |
| 3.00.00    | OPERATION AND CONTROL PHILOSOPHY |
| 4.00.00    | PERFORMANCE REQUIREMENT          |
| 5.00.00    | DESIGN AND CONSTRUCTION          |
| 6.00.00    | INSPECTION AND TESTING           |
| 7.00.00    | DRAWINGS, DATA AND INFORMATION   |

## ATTACHMENTS

|              |   |
|--------------|---|
| ANNEXURE-I   | GOODS CUM PASSENGER ELEVATORS<br><del>FOR STEAM GENERATOR &amp; MILL AREA</del> |
| ANNEXURE-II  | GOODS CUM PASSENGER ELEVATORS<br>FOR POWER HOUSE BUILDING                       |
| ANNEXURE-III | DEGREE OF PROTECTION FOR<br>VARIOUS EQUIPMENT                                   |

**VOLUME : IIIF**

**SECTION-IV**

**ELEVATORS**

1.00.00 **CODES AND STANDARDS**

1.01.00 The design, manufacture and testing of the elevators and components thereof shall, unless specifically stated otherwise, conform to the following specific codes and standards as applicable, including its latest amendments subsequent to the date of publication as mentioned below :

1.01.01 IS-14665 : Electric Traction Lifts.

1.01.02 IS-2365 : Specification for Steel Wire Suspension Ropes for Lifts and Hoists.

1.01.03 State Elevator and Escalator Act

1.01.04 State Elevator and Escalator Rules

1.01.05 Indian Electricity Act.

1.01.06 Indian Electricity Rules

1.01.07 Any other acts/standards as applicable as mentioned in volume : II-A of this specification.

1.02.00 The installation of the elevators under this section shall be carried out in conformity with the local acts/rules with latest amendments which are in force, including the rules of fire lifts, as shall be required by the Bidder to obtain license for the elevator from concerned authorities.

1.03.00 Technical requirements of the elevators shall be as given in Attachments enclosed to this section.

1.04.00 Minimum acceptable degree of protections for various equipment are presented in Annexure-III.

1.05.00 In case of any contradiction between the above standards and attachments the stipulation in the attachments shall prevail and shall be binding on the Contractor.

Stipulations in this section shall prevail in case of any contradiction between this section and other relevant sections/ volumes.

2.00.00 **SCOPE OF WORKS**

The scope of works under this section shall be as below. Items though not specifically mentioned but needed to make the installation of the elevators complete in all respects are also to be furnished by the Contractor.

2.01.00 **Scope of Supply**

2.01.01

- a) ~~One (1) goods elevator complete with all accessories shall be furnished for steam generator unit at the suitable locations so that the same can be used for the movement of materials of the various steam generator parts. The lift shall be connected to the steam generator structural steel and as such part of the lift load shall be transferred to the steam generator columns. The Bidder shall ensure that the steam generator columns are designed to take the loads due to the lift shafts and connecting platforms at different elevations.~~
- b) ~~One (1) passenger elevator complete with all accessories shall be furnished for steam generator unit at the suitable locations so that the same can be used for the movement of man for the inspection and maintenance of the various steam generator parts. The lift shall be connected to the steam generator structural steel and as such part of the lift load shall be transferred to the steam generator columns. The Bidder shall ensure that the steam generator columns are designed to take the loads due to the lift shafts and connecting platforms at different elevations.~~
- c) ~~One (1) passenger cum goods elevator complete with all accessories shall be furnished for crusher house at the suitable locations so that the same can be used for the movement of man & materials for the various equipments. The lift shall be connected to the crusher house structure and as such part of the lift load shall be transferred to the building column. The Bidder shall ensure that the crusher house columns are designed to take the loads due to the lift shafts and connecting platforms at different elevations.~~
- d) One (1) passenger elevators shall be included in TG building at "C Row" near to control room upto D/A floor level. The landing for the elevator shall be provided for all the floors in TG building. This shall put into operation before commissioning activities start. These shall be connected to the power house/structural steelwork and as such part of their loads may be transferred to the main power house/ structural steelwork columns. The Bidder shall ensure that these columns are designed to take care of the loads due to elevator shafts and connecting platforms at different elevations.
- e) One (1) passenger elevator complete with all accessories shall be provided in the Service House Building to have access in various floors.

2.01.02 The above elevators shall be provided with the following accessories as applicable, for all the above elevators.

- a) Elevator car complete with door, door hangers and tracks, push button station and operating panel, car position indicators, fan, telephone hooked upto EPABX of the plant and illumination fittings and other required accessories.
- b) All required structural steel members and components to accommodate the elevator and accessories in the elevator shaft, steel guides for car and counter weight, necessary steel items associated with elevator such as machine supporting beams, bearing plates, supporting channels, sill supporting angles etc.
- c) Counter weight, counter weight guard, sheaves and beams, ropes, hoist rope compensation, terminal buffers and guide rail lubricator device.
- d) Complete drive machinery and accessories, electrical and control equipment including power and lighting distribution boards and switch fuse units for power and lighting. Necessary brakes and also automatic leveling device, terminal and final limit switches and all required protective devices including starters, switch fuse unit etc. Complete drive machinery shall include motors, starters, switchgears, fuses, switches, relays, junction boxes etc. as minimum requirement.
- e) Hoist way doors and push button station with tell-tale lights at all the elevator landings.
- f) Any other fittings and accessories required for the safe and efficient operation of the elevators.
- g) All required foundation plates and/or base plates, inserts, anchor bolts, lifting lugs, eye bolts etc. wherever necessary.
- h) Fireman's switch as per rules of fire lifts.
- i) Earth leakage circuit breaker.

2.02.00 For detailed scope of services, Volume IIA of this specification shall be referred to.

### 3.00.00 **OPERATION AND CONTROL PHILOSOPHY**

3.01.00 The elevators, while starting from any level, shall start at rated speed but during stopping, elevator shall slow down to lower speed when the car reaches around one meter of the selected landing floor and stop when reached the landing floor. The control system shall be microprocessor based with AC variable voltage and variable frequency drive.

- 3.02.00 The elevators specified herein shall be operated in selective collective automatic mode of operation as defined in IS-14665. Operation and Control features of this elevator shall be as follows :
- 3.02.01 One push button for each of the all landings shall be provided inside the car. Two push buttons, one "UP" button and one "DOWN" button, shall be provided at each of the intermediate landings. The uppermost and lower most landings shall be provided with one push button.
- 3.02.02 Calls initiated by the car or landing push buttons shall be registered and stored until answered, irrespective of the car being in motion or any landing door being open.
- 3.02.03 The car shall answer calls in one direction of travel, that is all "UP" landing calls shall be answered when the car travels in the upward direction and "DOWN" landing calls shall be answered when the car travels in the downward direction, except in the case of uppermost or lowermost calls which shall be answered as soon as they are reached irrespective of the direction of travel of the car.
- 3.03.00 Besides the automatic mode of operations described in Clauses 3.02.00 above, the elevators shall have provision for attendant operation also, transfer of operation between automatic control and attendant operation being achieved by a key operated switch in the car.
- 3.04.00 The operation of the elevators shall be through push button station located inside the lift car. Suitable interlock shall be provided so that the elevators shall not move unless the door are properly closed. The landing doors of any floor shall not open when the elevator is not on that floor. Push buttons shall be fixed in one car for holding the doors open for any length of time required.
- 3.05.00 The elevators under this section shall be treated as "Fire Lifts". "Fire Switch" in a glass front box shall be provided adjacent to the lifts at the entrance level, the function of which is to enable the fire authority to take over the complete control of the lifts, when required. When the switch is on, landing call points shall become inoperative and the lift shall be on the car control only. When the switch is off, the lift will return to normal working.

4.00.00 **PERFORMANCE REQUIREMENT**

Performance requirement for the elevators shall be guided by the Attachments/Annexure enclosed with this section.

5.00.00 **DESIGN AND CONSTRUCTION**

Design and constructional requirement of all the elevators and components thereof shall be in line with Indian Standards specified in clause 1.00.00 above as applicable unless specified otherwise.

**5.01.00 Load and Speed**

The elevator shall lift a pay load as indicated against rated load of the applicable Annexure attached to this section or its nearest as per manufacturer's present standard in addition to the weight of the car and its accessories and shall travel at a rated speed as indicated in the applicable Annexure.

**5.02.00 Travel and Landing**

Travel of the lift car, number and elevations of the landing levels shall be as indicated in Annexure attached to this section.

**5.03.00 Car**

**5.03.01 Size**

The dimensions of the lift car and car platform and door shall be as per IS-14665.

**5.03.02 Car Frame**

Lift car shall be carried in a complete frame of steel which shall be sufficiently rigid to withstand the operation of the safety gear without permanent deformation to the car frame.

At least four renewable guide shoes or guide shoes with renewable linings or set of roller guides shall be provided, two at the top and two at the bottom of the car frame.

**5.03.03 Car Enclosure**

Car shall be enclosed on all sides by means of car body and door. The sides of the car shall be lined with heavy gauge sheet steel panels properly braced and reinforced. The enclosure shall be flush on the inside and securely fastened to the platform. Car inside enclosure shall be of stainless steel plate of grade SS:304 of bright finish.

Car of the elevators specified herein shall be equipped with decorated Stainless Steel hand rails on three sides. Car shall be equipped with fan with grills and suitable lighting complete with decorative fittings. The light shall be left burning during the whole time the lift is available for use.

Necessary provisions shall be made for adequate ventilation of the car. Ventilation openings shall be provided in the enclosure walls as per requirement of IS-14665. To permit switching off of the power supply to the lift without switching off the fan and light a separate switch shall be provided for fan and light.

The enclosure of lift car shall withstand the maximum possible thrust applied normally at any point, excepting any vision panel, without permanent deformation. Glass shall not be used in the lift car except for the following purposes :

- a) As covers for certificate.
- b) For lighting fixtures.
- c) For appliances used in connection with the operation of the car.
- d) For vision panels and mirrors.

Suitable arrangement to secure isolating cushion between car and the steel car-frame shall be provided.

Telephone or paging facility shall be installed in the lift car. The Bidder shall provide suitable cabinets in the car to house hand sets. The Bidder shall also provide necessary wiring for telephone or paging connection from the car to a terminal box adjacent to the lift well.

The car panels shall be given final painting. The type and colour of the final painting shall be subject to the approval of the Owner/Consultant.

#### 5.03.04 Car Platform

It shall be constructed of structural steel shapes securely fastened together with one layer of wood flooring. Floor of the elevators shall be as specified in Annexure. The platform construction should be designed on the basis of rated loads evenly distributed.

Since, the car levelling devices will be used, substantial aprons of sufficient depth shall be fitted to the car floor to ensure that no space is permitted between the threshold and the landing while the car is being levelled to a floor.

#### 5.03.05 Car Roof

Car roof shall be covered with sheet metal. The construction of roof should be strong enough to be capable of supporting atleast two persons.

A three pin plug socket with switch of industrial type having adequate capacity for a hand lamp shall be fitted on top of the lift car for use by persons working thereon during maintenance.

#### 5.04.00 Car and Hoistway Doors

5.04.01 Type of door

Type of car and hoistway doors shall be as indicated in the Annexure and made of steel provided with necessary rubber buffers. Doors for fire lifts shall have fire resistance for minimum one hour. The final paints on car door and hoistway doors shall be same and shall match that of the car.

5.04.02 Door Hangers and Tracks

Hangers and tracks for car door and each hoistway door shall be furnished. Suitable material shall be used to minimise noise. Ball bearing, rollers or equal arrangement shall be provided to take upward thrust of the doors. Suitable devices shall be furnished for transmitting motion from one door panel to the other.

All required materials for landing entrance e.g. extruded aluminium or equivalent sills, strut angles, headers etc. shall be provided.

5.04.03 Door Operators

The door operation shall have power opening and power closing. Necessary electric type door operators shall be furnished. The car door and the hoistway door shall be mechanically connected and shall move simultaneously during opening and closing. The necessary door cushioning devices shall be furnished.

The car door and the hoistway door shall open automatically when the car stops at a landing. Should the electric power fail, the door operator shall be so designed that doors can be manually opened from within the car. Necessary door locking devices shall be furnished. Necessary switches shall be furnished in the elevator machine room to control the operation of the door.

5.05.00 **Car Self-leveling Device**

The elevator shall be equipped with automatic self-leveling devices, to bring the car to the floor landings. These self-leveling devices shall correct for overtravel and rope stretch.

5.06.00 **Car Operating Panel**

In the car, these shall be furnished, an operating panel containing push buttons, numbered to elevations of the landings served; two position key-operated switch, marked to indicate "With Attendant" and "Without Attendant"; an emergency stop switch; a buzzer; an emergency call button connected to a bell to be provided by the Contractor at the bottom most landing of each elevator to serve as an emergency signal and also in the control room with an indication; a non-stop button; push button, or switches for lighting and fan; up push button, down push button, one door open push button and other push buttons, switches, emergency light, telephone hand set etc. as required.

The emergency call button mentioned above shall have two sets of potential free contact and shall be suitably wired upto the control panel in the machine room for indication or annunciation at unit Control Room shall be provided.

When the key switch in the car operating panel is set at the attendant position, the attendant will have full control of the operation of the elevator. Any hoistway calls and other door close push button which are then registered will cause a buzzer to sound in the car operating panel and the appropriate indicator light to illuminate.

5.07.00 **Car Position Indicator in Car**

For the elevators, signal indication above the entrance in the car shall be provided by the appropriate numeral (which shall be the elevation of the respective floor) being illuminated when the car is passing the corresponding floor. The indication shall remain illuminated when the car is stopped at a floor. Up and down direction jewel lights shall also be provided.

5.08.00 **Push Button Station and Call-registered Tell-tale Lights at Hoistway**

5.08.01 The elevators as described in clause 3.00.00 above shall be equipped with a push button station consisting of a single up or down push button at terminal landings, and up and down push buttons at each intermediate landing including call registered lights (up or down call registered lights at each terminal landings and both up and down call-registered lights at all intermediate landings). These shall illuminate when the corresponding button is pressed to indicate that the call is registered and shall remain illuminated until the call is answered. An illuminated car position indicator similar to that specified for car in clause 5.07.00 shall be provided above the entrance of all the landings.

5.08.02 The word "Fire Lift" shall be conspicuously displayed in red paint on the lift landing doors of the elevators designated as fire lifts.

5.09.00 **Safety Shoe Device on Car Door**

Safety shoe device shall be furnished on car doors. Safety shoe shall extend the full height on the closing edges of the car doors. The arrangement shall be such that should the safety shoe touch a person or an object while the door is closing, the car and the hoistway door shall return to the open position. The doors shall remain open until the expiration of a pre-determined interval and then close automatically.

5.10.00 ~~Emergency Exit~~

~~Elevator car shall be provided with an emergency exit of adequate dimensions. The location of the emergency exit shall be at the top of the car.~~

5.11.00 **Terminal Buffers**

The terminal buffers shall be furnished for stopping the car and the counter-weight at the extreme ends of travel. All structural steel members required to install the buffer shall be supplied under this section.

**5.12.00 Load Plate**

A load plate giving the rated pay load of the elevator shall be fitted in the car in a conspicuous position. The rated load shall be given in kilograms and also in number of passengers.

**5.13.00 Counter-weights and Counter-weight Frames**

Counter-weight sections shall be mounted on structural metal frames so designed to retain the weights securely in its place.

Counter-weight frames shall be guided on each guide rail by upper and lower guiding members attached to the frame.

A substantial metal counter-weight guard of required length shall be provided at the bottom of the hoist-way.

**5.14.00 Guides for Car and Counter-weight**

Car and counter-weight guides shall be of rigid steel and shall be continuous throughout the entire length and shall be provided with adequate steel bracings and stiffeners. The necessary lubrication device for guide rail shall be provided.

**5.15.00 Limit Switches**

Normal terminal limit switches to slowdown and stop the car automatically, shall be provided at terminal landings and final limit switches shall be furnished to automatically cut-off the power and apply the brake, should the car travel beyond the terminal landings.

**5.16.00 Controller & Traction Machine**

5.16.01 The design ambient temperature for these equipment shall be taken as 50°C. The insulation of motor shall be class "F" and temperature rise shall be limited to Class "B".

5.16.02 Complete details of controller and traction machine shall be furnished by the Bidder.

5.16.03 The elevators being offered with Microprocessor based AC variable voltage and variable frequency type control, motor and generator shall be mounted on independent shafts coupled with proper coupling.

5.16.04 Number of starts per hour for which motor shall be capable, shall be selected by the Bidder for the given applications and in accordance with applicable code/standard.

- 5.16.05 Necessary brakes shall be provided in the traction machine.
- 5.16.06 Protective relays shall be furnished on the controller to protect against phase reversal, low voltage and phase failure. Overload and other protective relays shall also be furnished for traction motor. Single phasing preventor shall also be provided to protect motor while running at no-load.
- 5.17.00 **Lighting**
- Lighting shall be provided in machine room, lift well and lift cabin.
- Two (2) nos. 40 W Fluorescent tubes with fittings shall be provided at each of the machine room and the lift cabin whereas incandescent G.L.S. lamp shall be provided in the lift well. Emergency lighting shall be provided in all the places including Cabin. All necessary wires, conduits, junction boxes shall be supplied. In the lift cabin indirect illumination type fitting shall be provided.
- 5.18.00 **Grounding**
- Grounding of all enclosure of live parts shall be done as per applicable Electricity Rules with latest amendment. All structures of the lift shall also be grounded. Necessary material for grounding shall be supplied by the Contractor.
- 5.19.00 **Other Electrical Items**
- 5.19.01 Special care and precaution shall be taken regarding the handing of lift trailing cable loops between the points of suspension. A 1/4" sling rope should be used for tying up. Conductor and insulation of these trailing cables shall be flexible with suitable reinforcement provided.
- 5.19.02 All control cables shall have crimped type lugs and wire numbering ferrules at either ends.
- 5.19.03 For general technical requirements, Volume V of this specification shall be referred.
- 5.20.00 **Safety Gears**
- The elevator shall be provided with one or more safety devices capable of stopping and sustaining the lift car with full rated load in the car at governor tripping speed.
- When the safety gear is applied, decrease in the tension of the governor rope or motion of the car in the descending direction shall not release the safety gear.
- 5.21.00 **Overspeed Governor**
- The elevator shall be equipped with overspeed governor device which operates to apply the safety gear in the event of the speed of the car in the descending direction exceeding a predetermined limit.

5.22.00 **Brakes**

The machine shall be provided with direct current spring set, solenoid released, double shoe brakes of sufficient capacity to stop the car at any position with the design load. These brakes shall be designed in such a way to apply automatically in the event of power supply failure. The details of equipment offered shall be indicated in the offer.

5.23.00 **Rope**

Suitable traction steel hoist ropes of the sizes and number to ensure proper wearing qualities shall be supplied. As a minimum, the number of ropes shall comply with the factor of safety requirements of Indian Standard for lift/elevator. The full details of ropes, the maker's name, trade name, breaking strength, designed factor of safety of all ropes shall be submitted with the bid.

5.24.00 **Ringing of Stranded Lift**

During prolonged power failure, arrangement shall be provided, so that, after cutting out supply point manually through hand wheel the lift stranded between two floors may be brought to the nearer floor.

Alternative offer for bringing the stranded lift to the nearer floor by automatic winding arrangements may be given and price quoted separately.

5.25.00 **Lifting Attachments**

All equipment/component shall be equipped with suitable lifting attachments, e.g. lifting lugs, eye bolts etc. to facilitate erection and maintenance.

6.00.00 **INSPECTION AND TESTING**

6.01.00 The following specific test as applicable shall be carried out by the Contractor as minimum requirement for the elevators.

6.01.01 All materials used in manufacture of various components shall be of tested quality and shall conform to relevant standards/ specifications.

6.01.02 All welding shall be carried out as per welding procedures qualified as per ASME Section-IX or equivalent national / international standard. Welding procedures shall be forwarded for approval. Only qualified welders shall be employed for welding.

6.01.03 All NDT operators should be qualified as per ASNT-TC-IA.

6.01.04 Forged blanks grater than or equal to 40 mm thick and rounds grater than or equal to 50 mm dia shall be subjected to ultrasonic test to ensure free from internal defects.

- 6.01.05 All welds shall be subjected to dye-penetration test and visual examination.
- 6.01.06 All forged components shall be subjected to DPT/MPT after machining.
- 6.01.08 Buffer springs shall be subjected to load test as per relevant specifications. Material certificates for springs shall also be furnished.
- 6.01.09 Steel wire ropes shall be subjected to all the tests including material test as per relevant standard. Braking load test shall be carried out as per relevant national/international standards.
- 6.01.10 All components prior to assembly shall be checked for dimensions.
- 6.01.11 All rotating components shall be shop tested for dynamic balancing as per ISO-1940.
- 6.01.12 Car sling and car body in assembled condition shall be checked for position of all major components i.e. car sling inside depth, width, height and respective positions of all accessories within the same.
- 6.01.13 Induction Motor shall be subject to both type and routine tests in accordance with IS-325 and IS-4029. In addition, following tests shall also be carried out :
- a) 20% overspeed test for 2 minutes.
  - b) Vibration measurement.
  - c) Measurement of noise level as type test.
  - d) Degree of protection test on motor enclosure and terminal box as per IS-4691 as type test.
- 6.01.14 Following items shall be tested as per relevant standard :
- a) Trailing cable and copper conductors. PVC cables shall also be subjected to type, routine and acceptance tests.
  - b) Brake coil.
  - c) Relays contactors, instruments and controlling equipment.
- 6.01.15 The control panels, door operating panels, junction box & other metallic enclosures test shall conform to specific degree of protection.
- 6.01.16 Mechanical balance test and vibration levels of elevator and accessories shall be carried out.
- 6.01.17 Insulation, resistance test, high voltage withstand test of all wiring shall be carried out.
- 6.02.00 After installation of complete elevator, necessary trial run and performance tests shall be carried out by the Contractor in presence of Purchaser to

determine that equipment supplied is satisfactorily installed and commissioned.

The performance tests to be conducted shall interalia include but not limited to the following:

- a) Car operates smoothly for full length of travel.
- b) Car stops at each platform elevation under both loaded and unloaded conditions and alignment with floor level.
- c) Car travels at specified speed when loaded at specified capacity.
- d) Enclosure doors operate properly.
- e) Mechanical and electrical equipment function as specified.
- f) Input power at motor terminal at specified design capacity and speed
- g) Working of all safety interlocks and safety features including emergency braking in case of freefall of the car

All performance tests shall be conducted by the Contractor and the procedure for conducting such tests shall be approved by Owner.

**6.03.00 Permits & Inspection**

Regarding Permits and Inspection, Bidder shall obtain and pay for necessary Municipal or State inspections and permits as required including license fees for installation and inspection of elevator equipment and also make such tests as called for by the regulations of such authorities in the presence of the Purchaser representative. Bidder shall be responsible to obtain license for operating the elevator at site. Checking and inspection by the statutory authorities and obtaining license shall be Bidder responsibilities.

**7.00.00 DRAWINGS, DATA, AND INFORMATION**

7.01.00 In addition to the Proposal Data Sheets in Volume-IX of this specification duly filled up, Bidder shall submit the following drawings/data/information for the elevator along with this offer.

7.01.01 Layout drawing showing principal dimensions of the elevator car in plan and the elevator car and shaft in elevation.

7.01.02 Layout drawing showing the location of various equipment in the elevator machine room.

7.01.03 Complete general arrangement drawing of the elevators and its support structure showing all landing levels and enclosures.

7.01.04 Electrical Control Schematics.

- 7.01.05 Write-up, description and illustrative pamphlets on various components of the elevator and its control, interlock and safety devices.
- 7.01.06 Foundation details and loading.
- 7.01.07 Load on elevator columns.
- 7.01.08 Layout of conduits, conductors, cables etc.
- 7.01.09 Other drawings, data sheets and literature as necessary.
- 7.02.00 Drawing, Data, Information to be furnished by the successful Bidder after award of contract.
- 7.02.01 All drawings, data and information as asked for in Clause No. 7.01.00 in finalised form for review and approval of Owner/Consultant.
- 7.02.02 Detailed layout drawings including foundation and structural design data for elevator shaft and elevator machine room. The data shall include braking load on guides, reaction of buffers on lift pits, reaction on support point on machine room, hoistway etc.
- 7.02.03 Details of block outs, embedments, inserts on RCC Works.
- 7.02.04 For Mandatory Spares, Spares required for erection and commissioning, Recommended Spares, Special Tools and Tackle, fixtures etc., as required for regular operation and maintenance of the equipment offered and supply of first charge of lubricating oil, inhibitor oil and also adequate quantity of the consumables, ~~please refer Technical Specification Volume II A.~~
- 7.02.05 Complete Electrical Control, schematic wiring diagram of power and control room.
- 7.02.06 Write-up explaining the sequence of operation of control circuits and elevator components when an operation button is pressed.
- 7.02.07 Performance and characteristics curves for motors.
- 7.02.08 Drawings of control panels, operating panels, position indicators, in car and hoistways, push button station and call registered tell-tale lights at hoistway. These include Electrical Control Diagram and detailed circuit diagrams and physical arrangement/location diagrams of various electrical components in the Controller in the machine room, in the hoistway, in the car, at the landing etc.
- 7.02.09 Detail of pit floor, landing and landing entrance, machine room floor etc.
- 7.02.10 Other drawings and data as necessary.
- 7.02.11 Reports on shop tests and test certificates.

7.02.12 Material and performance test certificates.

ANNEXURE-II

PASSENGER ELEVATORS FOR  
~~STEAM GENERATOR, POWER HOUSE BUILDING & SERVICE BUILDING~~

|     |  |  |
|-----|--|--|
| 1.  | Type of service                                      | Passenger type.  |
| 2.  | Rated load on elevator                               | 1080 Kg (minimum)  |
| 3.  | Rated speed of lift                                  | 0.5 M/Sec.   |
| 4.  | Minimum number of floors to be served                | <del>Steam Generator- To be decided by Bidder and shall be subjected to Purchaser's approval.</del><br><br>Power House Building- All floors in the TG building upto deaerator floor.<br><br>Service Building- Various floor levels shall be finalized by APPDCL during detail engineering stage. |
| 5.  | Method of control                                    | ACVVVF control with automatic level adjustment.  |
| 6.  | Position of machine room                             | Directly above the lift shaft.   |
| 7.  | Car enclosure construction, design and finish of car | S.S. sheet fabricated smooth finish spray painted to approved shade.   |
| 8.  | Size of platform and car entrance                    | As per IS-14665  |
| 9.  | Car and landing door                                 | Horizontal Sliding door.   |
| 10. | Flooring   | MS chequered flooring. MS base & framework with shock absorber.  |
| 11. | Operation  | Automatic simplex collective with and without attendant with provision for locking control in "Auto" or "Attendant" position. Key type lock switch shall be provided.  |
| 12. | Signal   | Car position indicator in car and at all floors, telltale lights at all floors, battery operated alarm bell and emergency light with suitable battery, battery charger and controls. Remote alarm and Public address system to be provided.  |
| 13. | Method of operation of car and landing doors         | Power operated with automatic door opening and closing device.   |

|     |                                  |  |
|-----|----------------------------------|--|
| 14. | Lighting & fan                   | One cabin fan, two recessed fluorescent lamp fittings.   |
| 15. | Power Supply                     |  |
|     | a) Power                         | 415 Volts, 3 phase, 50 c/s, 3 wire system  |
|     | b) Lighting & fan inside the car | 240 volts, 1 phase, 50 c/s   |
| 16. | Other requirements               | <ol style="list-style-type: none"> <li>1. Plant Telephone Communication system shall be extended upto the elevator car through EPABX in M/C room..</li> <li>2. Suitable arrangement shall be provided to intimate unit control room during emergency in the form of audio-visual alarm.</li> <li>3. Automatic rescue device.</li> <li>4. If floor to floor distance between 2 floors is more than 10m, dummy landing should be provided in between these 2 floors. Dummy landing should have the connectivity with the staircase.</li> <li>5. Hall Lantern &amp; gong with scrolling indicator.</li> <li>6. Scrolling indicator in car.</li> <li>7. CFL lighting inside car</li> <li>8. Overload sensing device &amp; warning indicator.</li> <li>9. Announcement of floor level.</li> </ol> |

ANNEXURE-III

DEGREE OF PROTECTION  
FOR  
VARIOUS EQUIPMENT

| Sl. No. | Equipment                                       | Degree of Protection |
|---------|---|----------------------|
| 1       | A.C. Motor                                      | IP 54                |
| 2       | Controller                                      | IP 54                |
| 3       | Hall Buttons Fixture                            | IP 54                |
| 4       | Hall Position Indicator                         | IP 54                |
| 5       | Car Operating Panel                             | IP 54                |
| 6       | Car Position Indicator                          | IP 54                |
| 7       | Safety Operating Switch (car)                   | IP 54                |
| 8       | Junction/Inspection Box                         | IP 54                |
| 9       | Lighting Fixture (for shaft & M/C room)         |                      |
|         | a) Tube Light                                   | IP 21                |
|         | b) Bulk Head                                    | IP 21                |
| 10      | Brake   | IP 21                |
| 11      | Indoor Equipment (car light & fan junction box) | IP 54                |



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 1 OF 1**

## **SECTION C2-B GENERAL REQUIREMENT**

(General technical requirement, Special conditions for erection and commission, General conditions, engineering services)

## CONTENT

| <b>CLAUSE NO.</b> | <b>DESCRIPTION</b>  |
|-------------------|---|
| 1.00.00           | CODES AND STANDARDS                                       |
| 2.00.00           | RESPONSIBILITY FOR DESIGN                                 |
| 3.00.00           | NAME PLATES (RATING PLATES)                               |
| 4.00.00           | SAFETY AND SECURITY                                       |
| 5.00.00           | GUARDS  |
| 6.00.00           | LOCATION AND LAYOUT REQUIREMENTS                          |
| 7.00.00           | OPERATION, MAINTENANCE AND<br>AVAILABILITY CONSIDERATIONS |
| 8.00.00           | MATERIALS   |
| 9.00.00           | LUBRICATION   |
| 10.00.00          | LUBRICANTS & CONTROL FLUIDS                               |
| 11.00.00          | OPERATION AND MAINTENANCE                                 |
| 12.00.00          | PLANT LIFE AND MODE OF OPERATION                          |
| 13.00.00          | PACKAGING & MARKING                                       |
| 14.00.00          | PROTECTION  |
| 15.00.00          | ENVIRONMENT PROTECTION AND NOISE LEVEL REQUIREMENT        |
| 16.00.00          | INSPECTION AND TESTING                                    |
| 17.00.00          | TRAINING OF OWNER'S PERSONNEL                             |
| 18.00.00          | DEVIATIONS  |
|                   | <b>ATTACHMENTS</b>  |
| ANNEXURE-I        | LIST OF STANDARDS FOR REFERENCE                           |
| ANNEXURE-II       | CRITERIA FOR LAYOUT                                       |

**VOLUME : IIA**

**SECTION-IV**

**GENERAL TECHNICAL REQUIREMENTS**

**1.00.00 CODES AND STANDARDS**

1.01.00 Except where otherwise specified, the Plant shall comply with the appropriate Indian Standard or an agreed internationally accepted Standard Specification as listed in the annexure to this Section and mentioned in detailed specifications, each incorporating the latest revisions at the time of tendering. Where no internationally accepted standard is applicable, the Bidder shall give all particulars and details as necessary; to enable the Owner to identify all of the Plant in the same detail as would be possible had there been a Standard Specification.

1.02.00 Where the Bidder proposes alternative codes or standards he shall include in his tender one copy (in English) of each Standard Specification to which materials offered shall comply. In such case, the adopted alternative standard shall be equivalent or superior to the standards mentioned in the specification.

1.03.00 The plant will be designed in compliance with applicable National and International Codes and Standards such as ASME, ASTM, DIN, BS, IEC, IEEE, IS, etc. Wherever specified or required the Plant shall conform to various statutory regulations such as Indian Boiler Regulations, Indian Explosives Act, Indian Factories Act, Indian Electricity Act, Environmental Regulations, etc. Wherever required, approval for the plant supplied under the specification from statutory authorities shall be the responsibility of the Contractor.

1.04.00 In the event of any conflict between the codes and standards referred above, and the requirements of this specification, the requirements, which are more stringent, shall govern.

1.05.00 In case of any change of code, standards and regulations between the date of purchase order and the date the Contractor proceeds with manufacturing the Owner shall have the option to incorporate the changed requirements. It shall be the responsibility of the Contractor to advise Owner of the resulting effect.

1.06.00 Successful Bidder to furnish two (2) sets of latest of national/inter-national codes and standards to owner.

**2.00.00 RESPONSIBILITY FOR DESIGN**

2.01.00 The Contractor shall assume full responsibility for the design of the whole and every portion of the Plant, whether or not the design work was undertaken specifically in relation to the Contract and whether or not the Contractor was directly involved in the design work.

- 2.02.00 Notwithstanding the Owner's wish to receive the benefits of new, advanced and improved technologies, a prime requirement is that all the systems and components proposed shall have been already adequately developed and shall have demonstrated good reliability under similar, or more arduous conditions elsewhere, at least for continuous 2 years in two different power station.
- 2.03.00 The successful bidder shall have to carry out surge analysis, BFP transient analysis and other transient condition studies as may be necessary and as required by the Owner as per proven engineering practice.
- 2.04.00 The Bid shall include a detailed discussion on the development status of, and the reasons for any changes made in proposed systems or components for the Plant, as compared with similar items previously supplied in other installations cited by the bidder as reference plants.
- 2.05.00 The Bidder may also make alternate offers, provided such offers are superior in his opinion in which case adequate technical information, operating feed back, etc. are to be enclosed with the offer, to enable the Owner to assess the superiority and reliability of the alternatives offered. In case of each alternative offer, its implications on the performance, guaranteed efficiency, auxiliary power consumptions, etc. shall be clearly brought out to the Owner to make an overall assessment. In any case, the base offer shall necessarily be in line with the specifications i.e. Base offer shall be as per the technical specifications and the same will be considered for techno-commercial evaluation.

3.00.00 **NAME PLATES (RATING PLATES)**

- 3.01.00 Instruction plates, name plates or labels shall be permanently attached to each main and auxiliary item of plant in a conspicuous position. These plates shall be engraved with the identifying name, type and manufacturers serial number, together with the loading conditions under which the item of plant has been designed to operate.
- 3.02.00 Items such as valves, etc. which are subject to hand operation, shall be provided with nameplates so constructed as to remain clearly legible throughout the life of the plant giving due consideration to the difficult climatic conditions to be encountered. Nameplates shall be securely mounted where they will not be obscured in service by insulation, cladding, actuators or other equipment. Direction of flow is also to be engraved.
- 3.03.00 All trade nameplates and labels shall be in English language. All measurements shall be in M.K.S. Units.
- 3.04.00 The size and location of nameplates shall be subject to Approval of the Engineer.

4.00.00 **SAFETY AND SECURITY**

- 4.01.00 The design shall incorporate every reasonable precaution and provision for the safety of all personnel and for the safety and security of all persons and

- property. The design shall comply with all appropriate statutory regulations relating to safety. All structures and equipment shall be designed and constructed to withstand every foreseeable static and dynamic loading condition, including loading under earthquake conditions, with an adequate margin of safety.
- 4.02.00 Ready and safe access with clear head room shall be provided to all parts of the plant for operation, inspection, cleaning and maintenance.
- 4.03.00 Escape routes and clear ways shall be provided to allow speedy evacuation of the plant in the event of fire or explosion, and the plant layout shall allow for ease of access to all parts of the Works by rescue and fire fighting teams. The plant layout shall be designed to localise and minimise the effects of any fire or explosion. The recommendations of NFPA, OSHA, and TAC etc. as necessary shall be followed in all respects.
- 4.04.00 The use of corrosive, explosive, toxic or otherwise hazardous materials shall be kept to a minimum during construction and the design of the plant shall minimise the requirement for such materials during operation and maintenance. Where such materials must be used, all necessary precautions shall be taken in the design, manufacture and layout of equipment to minimise the resulting hazard, and all equipment necessary for the protection and first-aid treatment of personnel in the event of accidents shall be provided. Particular attention is drawn to avoid the use of materials containing asbestos in any form.
- 5.00.00 **GUARDS**
- 5.01.00 Effective guards and fences must be provided to prevent injury to operators through accident or malpractice.
- 5.02.00 Mesh guards which allow visual inspection of equipment with the guard in place are generally preferable. The guards shall be constructed of mesh attached to a rigid framework of mild steel rod, tube, or angle and the whole galvanised to prevent loss of strength by rusting or corrosion. The guards shall be designed to facilitate removal and replacement during maintenance.
- 5.03.00 All drive belts, couplings, gears, sharp metallic edges and chains must be safely guarded. Any lubricating nipple requiring attention during normal running must be positioned where they can be reached without moving the guards.
- 5.04.00 Guards for couplings and rotating shafts shall be in accordance with BS 5304-1975 or similar approved standard. All rotating shafts and parts of shafts must be covered.
- 5.05.00 Suitable fencing shall be provided to enclose all openings or doorways used for the hoisting and lowering of machinery etc. This fencing must be securely fixed but quickly detachable when required. A secure hand hold must be provided on each side of the opening or doorway.

6.00.00      **LOCATION AND LAYOUT REQUIREMENTS**

The majority of plant and equipment (excluding steam generator and some other auxiliaries) shall all be of indoor installation. A broad list of buildings housing such equipment is given elsewhere in this specification. Layout should facilitate access for operation-maintenance and inspection of any one or more equipment/components at a time without disturbing the operation or installation of rest of the plant. Further, Bidder should comply with the criteria given under the various equipment and system specifications as well as those stipulated in Annexure-II attached to this section.

Enclosed General Layout and other tender layout drawings show the location of major installations and auxiliary buildings. The Bidder shall try to retain these locations as far as practicable. The layout of equipment within the power house as shown in the tender drawings is indicative. The Bidder may, subject to Owner's approval alter the same to suit the space requirement of the equipment offered.

Bidder may give as an alternative his own preferred layout clearly indicating the advantages and other implications, if any. Such alternative will not be considered for evaluating the bid, but may be considered with the successful Bidder if Owner/Engineer finds the proposal more attractive in terms of techno-economic consideration.

While developing the layout of buildings the following criteria shall be given effect :

- a)      The minimum width of clear access corridors around equipment shall be 1.2 meter.
- b)      Each building shall have an identified vacant space for equipment unloading and maintenance and preferably a separate bay altogether in buildings housing heavy equipment. Provision for handling equipment by monorail hoist and/or overhead crane shall be made as specified.
- c)      The minimum clear height available between two consecutive floor slabs shall not be less than five (5) meters. A clear head room of 2.5m shall be maintained between the floor and any overhead piping/ cables or other obstruction. Adequate provision for natural ventilation and illumination shall be made as per good engineering practices.
- d)      There shall be at least two (2) nos. main access doors, one on either side of each building, of which one shall be minimum 3 meters wide with rolling shutters for equipment entry. For multistoried buildings, at least two (2) nos. regular staircases diagonally opposite to each other shall be provided connecting all the floors and roof. These minimum requirements shall be augmented as required depending on the floor area, statutory requirements and TAC recommendations.
- e)      All buildings shall have provision for toilet and associated effluent discharge system together with facility for drinking water. The criteria for ventilation, fire protection and illumination of building spaces specified

elsewhere in this specification shall be complied with.

- f) All rail/road crossings for pipe/cable racks shall be done with minimum 8 meters headroom from top of rail/road to bottom of rack. Similarly top cover over underground pipes/cables shall be minimum one (1) meter. For other detail refer to Annexure-II.
- g) Cubicle for operating personnel shall be located at safe place near the equipment.
- h) Interplant cable routing will be on overhead cable trays on pipe cum cable trestle or on cable trestle except where approved by purchaser/consultant. In exceptional case, small stretch of outdoor run of interplant cable routing may be taken through cable trench only with the Employer's prior approval.
- i) Concept of various mechanical and electrical equipment location and building dimensions (including column-row spacing) as shown in Plot Plan/Floor Plan drawing are to be adhered to. Any departure from this suggestive layout is primarily not recommended.

#### 7.00.00 **OPERATION, MAINTENANCE & AVAILABILITY CONSIDERATIONS**

7.01.00 Equipment/works offered shall be designed for high availability, high reliability, low maintenance and ease of operation & maintenance. The Bidder shall specifically state the design features incorporated to achieve high degree of reliability, availability, operability and ease of maintenance. He shall also furnish details of availability records in plants stated in his experience list.

7.02.00 Ample space for ease of operation and maintenance including equipment removal, tube bundle/cartridge/rotor pulling etc. shall be provided. All valves, gates, dampers and other devices shall be located and oriented in such a way that they are accessible from operating floor levels. Where this cannot be adhered to, platforms and walkways with access ladders shall be provided to facilitate operation and maintenance.

7.03.0 Motorised lifting devices, i.e. hoists, chain pulleys, jacks, etc. shall be provided for handling and carrying out maintenance of any equipment and/or part having weight in excess of 3000 Kg. Suitable beams, hooks etc. for this purpose shall be provided in the buildings.

No lifting arrangement is necessary for part having weight less than 500 Kg. Hoist shall be well protected by environment. Suitable painting and coating covering hoist at outdoor shall be provided.

Lifting devices like lifting tackles, slings, etc. to be connected to hook of the hoist/crane shall be provided by the Bidder for lifting the equipment, accessories covered under this specification.

7.04.00 All similar parts of the equipment shall be made to gauge and shall be interchangeable with and shall be made of same material and workmanship as the corresponding parts of the equipment. Where feasible common

components shall be employed in different pieces of equipment in order to optimize the spares inventory and utilization.

8.00.00 **MATERIALS**

8.01.00 In selecting materials of construction of equipment, the Contractor shall pay particular attention to the atmospheric conditions existing at the Site and the nature of material/fluid handled. Wherever deviations are taken in respect of materials specified, the reasons shall be spelt out clearly in the proposal.

All materials shall be new, and shall be of the quality most suited to the proposed application.

8.02.00 In as far as is possible; materials shall be in accordance with Indian or international standard specifications and shall be used in accordance with Indian or international codes of practice. Where such standards or codes of practice are not available sufficient information shall be provided to allow the Owner to assess the suitability of the material for the particular application.

All materials used shall have performed lengthy satisfactory service in similar or more arduous conditions to those proposed by the Contractor.

8.03.00 All parts which could deteriorate or corrode under the influence of the atmospheric, meteorological or soil conditions at the Site, or under the influence of the working conditions shall be suitably and effectively protected so that such deterioration or corrosion is a minimum over the life of the plant.

9.00.00 **LUBRICATION**

9.01.00 Provision shall be made for suitable efficient lubrication where necessary to ensure smooth operation free from undue wear.

9.02.00 Non ferrous capillary tubing shall be used throughout.

9.03.00 Gear boxes and oil baths shall be provided with filling and drain plugs, both of adequate size. An approved means of oil indication including level switches and temperature indication shall be provided.

9.04.00 All high speed gears shall be oil bath lubricated. Low speed gears shall be lubricated by means of soft grease. Removable and accessible drip pans shall be provided to collect lubricant which may drop from operating parts.

9.05.00 All lubrication points shall be conveniently situated for maintenance purposes. It must be possible to carry out lubrication from a gangway or landing and without the removal of guarding or having to insert the hand into it. Where accessibility to a bearing for oiling purposes would be difficult a method of remote lubrication shall be fitted.

9.06.00 The Contractor shall supply grease gun equipment suitable to service each type of nipple fitted.

10.00.00      **LUBRICANTS AND CONTROL FLUIDS**

10.01.00      The Contractor shall provide a detailed and comprehensive specification for all lubricating oils, greases and control fluids required for the entire plant. A sufficient supply of these shall be provided by the Contractor for initial commissioning, first fill and till COD of the unit.

10.02.00      The Contractor shall supply a detailed schedule giving the lubricant testing, cleaning and replacement procedures. All equipment and facilities necessary for the testing, cleaning and changing of lubricants and control fluids shall be provided. The Contractor shall endeavor to reduce the varieties and grades of required lubricants and control fluids to a minimum, matching them where possible to those already in use in the generating station in order to simplify procurement and minimise storage requirements. All lubricants and control fluids shall be of internationally recognised standards and shall be easily obtainable from a large number of Indian suppliers. Bidder shall also indicate the equivalent Indian Standard for the above for easy procurement in future.

10.03.00      No lubricant or control fluid shall have toxic or other harmful effects on personnel or on the environment.

11.00.00      **OPERATION AND MAINTENANCE**

11.01.00      The plant shall be designed and constructed so that operation and maintenance manpower requirements are minimised.

The design and layout shall facilitate inspection, cleaning, maintenance and repair. The importance of continuity of operation is second only to that of safety.

11.02.00      Spare parts for equipment shall be interchangeable with the original components and, so far as possible, be of common design and manufacture.

11.03.00      All similar standard components/parts of similar standard equipment provided shall be interchangeable with one another. Further identical equipments shall be provided for similar duties so that the same are interchangeable with one another in totality and component wise.

11.04.00      All heavy parts (500 Kg and above) must be provided with a convenient arrangement for slinging and handling during erection and overhaul. Any item of plant normally stripped or lifted during periods of maintenance and weighing one tonne or above, shall be clearly marked with its weight.

11.05.00      On completion of commissioning, a complete set of tools for the maintenance of the entire plant shall be provided by the Contractor. This shall include all necessary spanners, special wrenches, extraction equipment and any special tools reasonably required by the Engineer. Tools used during erection and commissioning shall not be accepted except with the specific approval of the Engineer.

11.06.00      All equipment and major valves should be provided with adequate maintenance approach and facility.

12.00.00 **PLANT LIFE AND MODE OF OPERATION**

The complete plant including all the equipment and systems individually and collectively shall be designed for continuous operation for an economic service life of thirty (30) years under the prevailing site conditions and for the type of duty intended.

The critical components of the Steam Generator, Turbine-Generator and Auxiliary equipment, the life of which is limited by time and temperature dependent mechanisms such as thermal stress, creep and low cycle fatigue, are to be designed considering expected (hot, warm and cold) start-up, shut-down and cyclic load variations.

The allowable stresses shall be reduced so that life expectancy to minimum 2,00,000 hours of operation can be achieved. The Bidder shall discuss this aspect in his technical proposal.

The unit would be operated on base load with cyclic load variation. The load variation is expected to be as per schedule depending on power demand.

The expected start-ups should be considered as minimum  
(Based on HPT metal temperature)

|   |   |              |
|---|---|--------------|
| Cold start-up ( >72 hrs. shutdown)                | : | 6 per year   |
| Warm start-up (between 10 to 72 hrs. of shutdown) | : | 40 per year  |
| Hot start-up (less than 10 hrs. shutdown)         | : | 160 per year |

13.00.00 **PACKAGING & MARKING**

All the equipment shall be suitably protected, coated, covered or boxed and crated to prevent damage or deterioration during transit, handling and storage at site till the time of erection. While packing all the materials, the limitations from the point of view of availability of railway wagon sizes in India should be taken account of. The details of various wagons normally available with Indian Railways for transportation of heavy equipment shall be considered by the Bidder. The Contractor shall be responsible for all loss or damage during transportation, handling and storage due to improper packing.

As per the information available, the dimensions of OD consignment for transportation of the equipment by rail (if any equipment to be handled through rail transportation) are as below :

|    |   |   |             |
|----|---|---|-------------|
| a) | Width of the Package<br>(from centre-line of rails<br>- 1.6 metres on both sides) | : | 3.2 Meters  |
| b) | Height of the package from rail top   | : | 4.47 Meters |

The above indicates the dimensions which can be normally transported on the

wagons without infringement of the "moving gauge". This is however not indicative of the consignment which can be carried out with infringement of "moving gauge" duly authorised and approved by the Indian Railways. There may be difference between the "moving gauge" and the "fixed structure gauge" and consignments infringing the "moving gauge" can be moved after investigation regarding possible infringement with the fixed structures. As the critical fixed structures in each route are different, consignments infringing moving dimensions have to be individually investigated to select a route and also determine the restrictions under which such movement is to be carried out. Such routes selected or other mode of transport envisaged is to be clearly brought out in the proposal wherever transport of over dimensional equipment is involved.

Bidder to consider unloading of material delivered through rail transportation, at near by railway station/ site unloading siding. The subsequent transportation up to project work place shall be considered by road only. All unloading and handling equipment both at railway station siding and at project site shall be arranged by the Bidder. Necessary arrangement to be organized with the railway authority for such purpose shall also be under the scope of services of the Bidder. Bidder may consider entire material delivered up to site through rail transportation only.

The identification marking indicating the name and address of the consignee shall be clearly marked in indelible ink on two opposite sides and top of each of the packages. In addition the Contractor shall include in the marking gross and net weight, outer dimension and cubic measurement. Each package shall be accompanied by a packing note (in weather proof paper) quoting specifically the name of the Contractor, the number and date of contract and names of the office placing the contract, nomenclature of contents and Bill of Material.

For imported equipment and material, suitable port facilities may be used in which case material may be transported from the port by tractor-trailer. Bidder may consider this aspect.

#### 14.00.00 **PROTECTION**

Equipment having antifriction or sleeve bearings shall be protected by weather-tight enclosures. Coated surfaces shall be protected against impact, abrasion, discoloration and other damages. Surfaces that are damaged shall be repainted.

Electrical equipment, controls and insulations shall be protected against moisture and water damages. All external gasket surfaces and flange faces, couplings, rotating equipment shafts, bearings and like items shall be thoroughly cleaned and coated with rust preventive compound as specified above and protected with suitable wood, metal or other substantial type covering to ensure their full protection. All exposed threaded parts shall be greased and protected with metallic or other substantial type protectors.

All piping, tubing and conduit connections on equipment and other equipment openings shall be closed with rough usage covers or plugs. Female threaded openings shall be closed with rough usage covers or forged steel plugs. The closures shall be taped to seal the interior of the equipment. Open ends of

piping, tubing and conduit shall be sealed and taped.

Returnable containers and special shipping devices shall be returned by the manufacturer's field representative at the Contractor's expense.

15.00.00 **ENVIRONMENT PROTECTION AND NOISE LEVEL REQUIREMENT**

15.01.00 **Environment Protection**

The plant shall be designed for installation and operation in harmony with the surrounding environment and all measures of pollution control shall be ensured by the Bidder to restrict pollution from the liquid effluent and stack emission within the limits as given below with due consideration of Environment (Protection) Rules 1986 as amended till date.

In case the Ministry of Environment & Forest stipulate any other conditions not specified hereunder while clearing the project shall be complied with the plant by the contractor.

15.01.01 For Liquid Effluent

- a) Provision laid down in schedule-I for Thermal Power Plants and also in Schedule-VI. General Standards for discharge of Environmental pollutants Part-A : Effects of Environmental (protection) Rules 1986, as amended till date.
- b) Any specific requirement of State Pollution Authorities over and above the above stipulation.

15.01.02 For Air Emission

- a) Suspended Particulate Matter i.e. dust burden at chimney outlet - Maximum 50 mg/Nm<sup>3</sup> (with worst coal and one field out at TMCR).
- b) NO<sub>x</sub> - 365 ppm Max. or 750 mg/Nm<sup>3</sup> (Equivalent NO<sub>2</sub>).
- c) SO<sub>2</sub> - Concentration based standard 2000 mg/Nm<sup>3</sup>. Load based standard 0.2 metric tonne /MWe/day (for first 500 MW and 0.1 metric tonne/MWe/day for rest of the capacity above 500 MW)

In absence of Indian Standard for emission from power plants as on date, for certain gaseous effluents, the internationally accepted World Bank Standard is to be followed. Indian Standard for emission of power plants are under formulation. Should this standard is published before finalisation of the contract, the bidder has to comply the more stringent of the above norm or the new Indian Standard.

The bidder shall include in his scope all necessary equipment and measuring instruments to comply with above requirements. Location and accessibility of the instruments shall be properly coordinated.

15.02.00 **Noise Level Requirement**

The plant will be designed, constructed and provided with suitable acoustic measures to ensure the noise level criteria as per the following stipulations.

- a) Maximum noise level shall not exceed 85 dB (A) when measured at 1.0M away from the noise emission source.
- b) Maximum noise level from its source within the premises shall not exceed 70 dB (A) as per Environment (Protection) Rules 1986, Schedule-III, 'Ambient Air Quality Standards' in respect of noise.
- c) Any statutory changes in stipulations regarding noise limitation that may occur in future according to State Pollution Control Board or Central pollution Control Board or Ministry of Environment & Forest regulation during tenure of the contract, the contractor shall comply with the requirement.

An exception will be made for the plant at startup operations and other big pressure reducing devices operating during emergency periods and for the safety valves.

16.00.00 **INSPECTION AND TESTING**

16.01.00 **Inspection and Tests during Manufacture**

16.01.01 The method and techniques to be used by the Contractor for the control of quality during manufacture of all plant and equipment shall be agreed with the Owner prior to the Award of Contract.

16.01.02 The Owner's general requirements with respect to quality control and the required shop tests are set out elsewhere in this specification.

16.01.03 Before any item of plant or equipment leaves its place of manufacture the Owner shall be given the option of witnessing inspections and tests for compliance with the specification and related standards.

16.01.04 Advance notice shall be given to the Owner as agreed in the Contract, prior to the stage of manufacture being reached, and the piece of plant must be held at this stage until the Owner has inspected the piece, or has advised in writing that inspection is waived. If having consulted the Owner and given reasonable notice in writing of the date on which the piece of plant will be available for inspection, the Owner does not attend the Contractor may proceed with manufacture having forwarded to the Owner duly certified copies of his own inspection and test results.

The Contractor shall forthwith forward to the engineer duly certified copies of the Test Certificates in six copies (one to the Purchaser and five to the Consulting Engineer) for approval. Distribution of six (6) copies of Test Certificates for approval will be two(2) copies to owner and four(4) copies to consultant. These four(4) copies will be further distributed by consultant after approval to owner, site and bidder. One copy will be retained with the

consultant for record purpose.

Further, nine (9) copies of Shop Test Certificates shall be bound with Instruction Manuals referred to elsewhere. Distribution of nine (9) copies of Shop Test Certificates for approval will be Two (2) copies to owner, Three (3) copies to site, Two (2) copies to consultant, Two (2) copies to owner's library / record.

16.01.05 Under no circumstances any repair or welding of castings be carried out without the consent of the Owner's Engineer. Proof of the effectiveness of each repair by radiographic and/or other non-destructive testing technique, shall be provided to the Engineer along with Defect Map.

16.01.06 All the individual and assembled rotating parts shall be statically and dynamically balanced in the works.

Where accurate alignment is necessary for component parts of machinery normally assembled on site, the Contractor shall allow for trial assembly prior to despatch from place of manufacture.

16.01.07 All materials used for the manufacture of equipment covered under this specification shall be of tested quality. Relevant test certificates shall be made available to the Purchaser. The certificates shall include tests for mechanical properties and chemical analysis of representative material or any other test as required by approved QAP/ Material specification.

16.01.08 All pressure parts connected to pumping main shall be subjected to hydraulic testing at a pressure of 150% of shut-off head for a period not less than one hour. Other parts shall be tested for one and half times the maximum operating pressure or as required by design code of that part, for a period not less than one hour.

16.01.09 All necessary non-destructive examinations shall be performed to meet the applicable code requirements.

16.01.10 All welding procedures adopted for performing welding work shall be qualified in accordance with the requirements of Section-IX of ASME code or IBR as applicable. All welded joints for pressure parts shall be tested by liquid penetrant examination according to the method outlined in ASME Boiler and Pressure Vessel code. Radiography, magnetic particle examination magnuflux and ultrasonic testing shall be employed wherever necessary/recommended by the applicable code. At least 10% of all major butt welding joints shall be radiographed.

16.01.11 Statutory payments in respect of IBR approvals including inspection for design and manufacturer of equipment shall be made by the Bidder. All payment for erection and testing at site (i.e. under IBR jurisdiction) shall also be made by the Bidder. In such case Contractor's scope shall also be extended to preparation of all necessary documents, co-ordination and follow-up with IBR authorities for above approval.

16.02.00 **Performance Tests at Site**

- 16.02.01 The full requirements for testing the system shall be agreed between the Owner and the Bidder prior to Award of Contract. The completely erected System shall be tested by the Contractor on site under normal operating conditions. The Contractor shall also ensure the correct performance of the System under abnormal conditions, i.e. the correct working of the various emergency and safety devices, interlocks, etc.
- 16.02.02 The Bidder shall provide complete details of his normal procedures for testing, for the quality of erection and for the performance of the erected plant. These tests shall include site pressure test on all erected pipe work to demonstrate the quality of the piping and the adequacy of joints made at site.
- 16.02.03 The Contractor shall furnish the quality procedures to be adopted for assuring quality from the receipt of material at site, during storage, erection, pre-commissioning to tests on completion and commissioning of the complete system/equipment.
- 16.03.00 For details of specific tests required on individual equipment refer to respective section of this specification.

**17.00.00 TRAINING OF OWNER'S PERSONNEL**

The Contractor shall extend all possible assistance and co-operation to the Purchaser regarding the transfer of technology and developing expertise in the area of engineering operation and maintenance of the Plant.

Number of man-days of training as mentioned below shall be included in his Tender.

**17.01.00 Training at Contractor's Premises**

The Contractor shall conduct training of sixty (60) engineers of the Owner on engineering, operation and maintenance of the Plant at the Contractor's or Associates or Sub-contractor's premises where adequate training facilities are available during the design and manufacturing stage of the Contractor.

The total man-months for training of engineers shall be maximum sixty (60), having following indicative break-up :

| Discipline                                 | No. of Engineers | No. of Man-month |
|--|------------------|------------------|
| Operation                                  | 20 heads         | 20               |
| Maintenance<br>Boiler, Turbine, Mechanical | 20 heads         | 20               |
| Electrical Maintenance                     | 8 heads          | 4                |
| Control & Instrumentation                  | 8 heads          | 4                |
| Maintenance Planning                       | 4 heads          | 2                |
|  | -----            | -----            |

60 heads  
-----

60  
-----

However, the details of the training programme will be discussed and finalised with the successful Bidder.

The training may also be arranged by the Contractor in any Plant where the equipment manufactured by the Contractor or his Associates is under installation, operation or testing to enable the trainees to become familiar with the equipment being furnished by the Contractor. All expenses inherently related to the training shall be borne by the Contractor and shall include but not limited to travel expenses (international and inland fares), lodging and per diem charges as well as medical insurance, instructors fee, programme and miscellaneous cost to be incurred during the training.

The training programme shall be adequate for the trainees to acquire the necessary expertise and competence in the area of engineering, operation and maintenance and as trainers for in-house technology transfer programme of the Purchaser.

The Contractor shall be responsible for the development of the Training Module and Programme Schedule which shall be submitted to the Purchaser for approval.

The components of the training modules shall include but not be limited to the training procedures/methodology, instructional materials such as audio visual materials, CDs and slides and manuals for each trainee.

Three (3) sets of the materials included in the training modules shall be handed over to the Purchaser upon completion of the training. An evaluation shall be jointly undertaken by the Contractor and the Purchaser's representative on the adequacy, appropriateness and relevance of the training and the programme effectiveness after the training. The training material shall be in English language only.

The content of the training programme shall include but not be limited to:

1. Coal fired thermal plant principles in management and practice for operators, technicians and maintenance personnel.
2. Plant operation and systems training for operators including simulator training as applicable.
3. Maintenance training programme covering electrical, mechanical and instrumentation and control.

Said training programme shall be submitted to the Purchaser for approval.

The timing of the training should be such that the participants will be conversant with sufficient know-how to participate in the pre-commissioning and commissioning tests of the Plant.

The Contractor shall provide qualified English speaking instructors and training

coordinator(s) during the tenure of the training programme.

17.02.00 **Operation and Maintenance Training at Site**

The Contractor shall provide a comprehensive training programme related to design application, plant management, operation and maintenance, including trouble shooting, of the Contractor's supplied system and equipment at the Site starting from Start of Commissioning and thereafter up to the Final Acceptance of the first Unit.

The following instructors shall be at the Site continuously during the training :

- a) One (1) for Steam Generator and Auxiliaries ;
- b) One (1) for Turbine Generator and Auxiliaries ;
- c) One (1) for Electrical Works ;
- d) One (1) for Instrumentation and Control (Boiler and Auxiliaries) ;
- e) One (1) for Instrumentation and Control (Turbine and Auxiliaries).

17.03.00 **On-the-Job Training**

During the period of pre-commissioning, commissioning and trial operation, the Purchaser shall provide operation and maintenance personnel to assist the Contractor in the operation and maintenance of his supply and work under the direction of the Contractor for the purpose of on-the-job training.

The Purchaser shall have the right to send to the Site his employees later intended to operate and maintain the equipment supplied under this Contract. The Contractor shall, without additional cost, use his site staff to instruct these employees on the operation and maintenance of the equipment. All instructions shall be in the English language.

17.04.00 For detail C&I training refer to Volume-VI, Section-9.

18.00.00 **DEVIATIONS**

The Bidder is required to submit with his proposal in the relevant schedules a detail list of any and all deviations taken by him clearly without any ambiguity. In the absence of such a list it will be understood and agreed that the Bidder's proposal is based on strict conformance to this specification and no post-contract negotiations would be allowed in this regard.

Unless otherwise specifically indicated in the deviation list, it will be construed and agreed that details indicated in documents & drawings furnished by the Bidder along with the offer is in-line with the specification requirement.

**ANNEXURE-I**

**LIST OF STANDARDS FOR REFERENCE**

- a) International Standards Organisation (ISO).
- b) International Electro-technical Commission (IEC).
- c) American Society of Mechanical Engineers (ASME).
- d) American National Standards Institute (ANSI).
- e) American Society for Testing and Materials (ASTM).
- f) American Institute of Steel Construction (AISC).
- g) American Welding Society (AWS).
- h) Architecture Institute of Japan (AIJ).
- i) National Fire Protection Association (NFPA).
- j) National Electrical Manufacturer's Association (NEMA).
- k) Japanese Electro-technical Committee (JEC).
- l) Institute of Electrical and Electronics Engineers (IEEE).
- m) Federal Occupational Safety and Health Regulations (OSHA).
- n) Instrument Society of America (ISA).
- o) National Electric Code (NEC).
- p) Heat Exchanger Institute (HEI).
- q) Tubular Exchanger Manufacturer's Association (TEMA).
- r) Hydraulic Institute (HIS).
- s) International Electro-Technical Commission (IEC) Publications.
- t) Power Test Code for Steam Turbines (PTC).
- u) Applicable German Standards (DIN).
- v) Applicable British Standards (BS).
- w) Applicable Japanese Standards (JIS).

- x) Electric Power Research Institute (EPRI).
- y) Standards of Manufacturer's Standardization Society (MSS).
- z) Bureau of Indian Standards Institution (BIS).
- aa) Indian Electricity Rules.
- bb) Indian Boiler Regulations (IBR).
- cc) Indian Explosives Act.
- dd) Indian Factories Act.
- ee) Tariff Advisory Committee (TAC) rules.
- ff) Emission regulation of Central Pollution Control Board (CPCB).
- gg) Pollution Control regulations of Dept. of Environment, Govt. of India
- hh) Central Board of Irrigation and Power (CBIP) Publications.
- ii) The Air Prevention and Control of Pollution Act.
- jj) The Environmental Protection Act
- kk) The Public Liability Insurance Act.
- ll) The Forest Conservation Act
- mm) The Wildlife protection Act.
- nn) The EIA Notification, 1994.
- oo) IS: 14665-Specification for Electric Traction Lift
- pp) Any other statutory Codes/Standards/Regulations

ANNEXURE-II

CRITERIA FOR LAYOUT

PLOT PLAN LAYOUT REQUIREMENTS

| ITEM   | SPECIFICATION REQUIREMENT   |
|--|---|
| A. Site conditions to be considered  |   |
| 1. Prevalent wind direction  | See wind-rose in plot plan.<br>Also refer Metrological Data.                    |
| B. Layout Requirements   |   |
| 1. Maximum permissible slope in  |   |
| a) Rail track  | 1 in 400  |
| b) Road  | 1 in 30   |
| c) Sides of unpaved embankment   | 1 in 2  |
| 2. Required road width   |   |
| a) Main roads  | Refer VII-A, B, C.  |
| b) Auxiliary interconnections  | Refer VII-A, B, C.  |
| c) Road to the power house unloading bay :   |   |
| • Only for entry to the unloading bay  | Yes   |
| • To pass through the unloading bay  | No  |
| 3. Required minimum horizontal distance between the nearest points of  |   |
| a) Plant boundary and the boundary of residential area   | (Local municipality/factory rule)   |
| b) Electrical transformer and any other building/facility  | As per the Tariff Advisory Committee/ LPA Rules                                 |
| c) Fire water supply installation and any building/facility subject to fire risk.  | As per the Tariff Advisory Committee/ LPA Rules                                 |
| d) Inflammable liquid (fuel oil, etc.) storage & handling installation and their fencing and other buildings/facilities. | Rules of the Indian Explosive (Indian Explosives Act) and Indian Petroleum Code |

| ITEM | SPECIFICATION REQUIREMENT  |
|------|--|
| 4.   | Required minimum vertical clearance  |
| a)   | Under pipes/cable racks at road crossings 8.0 Metres   |
| b)   | Soil coverage over underground pipes 1.0 Metre (minimum)   |
| 5.   | Railway Wagon clearance Rules of the Indian Railways   |
| 6.   | Minimum Clearance between any road edge and building/structure/ any fixed installation. 3 Metres       |
| 7.   | Required level, above the local developed grade level, of  |
| a)   | top of all roads 150 mm above FGL  |
| b)   | all outdoor paved areas 100 mm above FGL   |
| c)   | Temporary storage areas, workshops, offices, residence etc. required at the time of erection work. Yes |
| d)   | Green belt around power plant area As per environmental guidelines of MOEF, Govt. of India.            |

#### BUILDING/ EQUIPMENT LAYOUT REQUIREMENTS

|    |   |
|----|---|
| A. | Minimum clear space required at all working and walking areas for operating & maintenance personnel   |
| 1. | Horizontal, in all directions   |
| a) | Adjacent to any electrical equipment, electrical cables, running (rotating/reciprocating) equipment, safety valve or vent/drain pipe outlet, pipe/ equipment of surface temperature exceeding 60°C. 1200 mm |
| b) | Adjacent to any other plant facilities (including walls/structures) 1000 mm   |
| 2. | Vertical (head-room clearance)  |
| a) | Under any pipe/equipment surface of temperature exceeding 60°C and any electrical cables or other electrical items. 2.5 Metre   |
| b) | Under any other plant facilities (including structures, pipes etc.) 2.5 Metre   |

| ITEM  | SPECIFICATION REQUIREMENT   |
|---|---|
| 3. For all areas where any equipment (including trucks, trolleys and other material handling equipment) will move or maneuver.  | Minimum 500 mm clear in all direction from the outer edges of the equipment   |
| 4. Minimum clear hand space required for  |   |
| a) The application of thermal insulation  | 100 mm  |
| b) Welding work   | 150 mm  |
| c) Bolt tightening  | 150 mm  |
| B. Floors, platforms, staircase, ladders, walls, doors & windows  |   |
| 1. Statutory Requirement  | As per the regulations of Tariff Advisory Committee, Indian National Building Code, Indian Factories Act, Local Municipal Rules, etc. |
| 2. Operation & Maintenance Requirement  |   |
| a) Adequate floor space shall be kept to permit dismantling, temporary storing and in-situ maintenance of plant & equipment parts, satisfying the clear space requirements stated above. A separate unloading bay for such purpose is required. | Yes   |
| b) Floors or fixed/portable platforms with stairs/ladders shall be provided for easy approach to any plant item, including valves, instruments, etc. to be operated, observed and/or to be frequently (more than once a month) maintained.      | Yes   |
| 3. Plinth level of all buildings, above the finished grade level  | 500 mm  |
| 4. Minimum access opening required (with rolling shutter) for transportation, wherever entry of truck for material handling is envisaged  | 3.5M wide x 4M high or, more depending upon the equipment size to be handled.   |

| ITEM   | SPECIFICATION REQUIREMENT   |
|--|---|
| C. Other Maintenance Requirement   |   |
| 1. Generator stator handling<br>In case the Generator stator cannot be handled by the turbine house crane, all provisions for its overhauling, including the arrangement to slide the stator on the turbine house floor, the foundation work for stator jacking /lowering assembly, dismantling of building end walls/structures etc. shall be kept. | Yes   |
| 2. Maintenance of the internals/impellers of all important equipment, like boiler feed pumps, feed water heaters, Surface Condenser, fans of the boiler draft plant, Intake and circulating water pumps, cooling water pumps, coal mills, compressors, blowers, heat exchangers, fuel oil pumps, filters etc.  | Shall be possible without disconnecting or dismantling any piping/ducting.                          |
| 3. Overhauling and handling of the casings for the above items   | Shall be possible without disturbing/dismantling any piping/ducting not directly connected to them. |
| 4. Crane Approach<br><br>Wherever required the unobstructed approach of the crane hook/other hoisting equipment hook to various plant & equipment shall be possible.   | Yes   |
| D. Central Control Room<br><br>All electronic equipment other than those directly associated with control, operation or presentation of displays shall be mounted external to the control room in air conditioned control equipment room.  | Yes   |
| The bidder shall describe in his bid the proposed layout philosophy of the Central Control Room and Control Equipment Room and the arrangement of equipment best suited for the system offered by him and as per good ergonomically consideration.   |   |
| However, as a guide line, following features are given :   |   |
| a) False ceiling and false flooring shall be provided.   |   |
| b) Uniform height, colouring schemes for cabinets etc. shall be available.   |   |

| ITEM   | SPECIFICATION REQUIREMENT  |
|--|--|
| c) The total area of floor space covered by Control Consoles/Panels in the Control Room shall not exceed 15% of floor area.                      |  |
| d) No opening shall be provided from Boiler side.  |  |
| e) Two double leaf doors, suitably located for entering the Control room shall be provided with opening towards the turbine floor.               |  |
| f) Cable entry for the panels/conssoles shall be from bottom and suitable openings shall be provided.  |  |
| g) The Control Room lighting shall be designed to provide a glare free uniform illumination. The level of illumination shall be minimum 400 LUX. |  |
| h) Necessary Air Conditioning shall be provided for Central Control room, Control Equipment Room and SWAS room etc.                              |  |
| i) Basic amenities like toilet, Tiffin rooms, wash basins, rest rooms etc. shall be provided near the Control Room.                              |  |
| E. Toilet and drinking water facility  | Required in all buildings and on all floors wherever operating personnel are to be deployed. |



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 1 OF 2**

## **SECTION C2-B**

**FUNCTIONAL/PERFORMANCE / DEMONSTRATION GUARANTEE (AS APPLICABLE)**



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 2 OF 2**

**TRIAL OPERATION, COMMISSIONING, PERFORMANCE/ DEMONSTRATION  
GUARANTEE TESTS:**

**Demonstration / Functional guarantee tests of elevator shall be carried out at site as follows**

- A. Rated capacity of the elevator.
- B. Travel and hoist Speed of the elevator.
- C. Accurate positioning of the elevator.
- D. Over Load test as per IS.



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 1 OF 1**

**SECTION C2-B  
PAINTING SPECIFICATION**

**SECTION-XIII**  
**TECHNICAL SPECIFICATION**  
**FOR**  
**PROTECTIVE LINING AND PAINTING**

**C O N T E N T S**

| <u>CLAUSE NO</u> | <u>DESCRIPTION</u>  | <u>PAGE NO.</u> |
|------------------|---|-----------------|
| 1.00.00          | INTENT OF SPECIFICATION   | 1               |
| 2.00.00          | CODES & STANDARDS   | 1               |
| 3.00.00          | GENERAL REQUIREMENTS  | 2               |
| 4.00.00          | EQUIPMENT, MATERIAL AND SERVICES TO<br>BE FURNISHED BY THE BIDDER | 4               |
| 5.00.00          | COATING PROCEDURE AND APPLICATION                                 | 7               |
| 6.00.00          | TEST REQUIREMENTS   | 8               |
| 7.00.00          | INFORMATION / DATA REQUIRED                                       | 12              |

## SECTION-XIII

### TECHNICAL SPECIFICATION

#### FOR

### PROTECTIVE LINING AND PAINTING

#### 1.00.00 INTENT OF SPECIFICATION

1.01.00 This specification addresses the requirements of all labour, material, and appliances necessary with reference to preparations for lining / painting, application as well as finishing of all lining / painting for all mechanical and electrical equipment, piping and valves, structures etc. included under the scope of this Package.

1.02.00 The Bidder shall furnish and apply all lining, primers including wash primers if required, under-coats, finish coats and colour bands as described hereinafter or necessary to complete the work in all respects.

#### 2.00.00 CODES & STANDARDS

2.01.00 The Bidder shall follow relevant Indian and International Standards wherever applicable in cleaning of surface, selection of lining material / paints and their application. The entire work shall conform to the following standards / specifications (latest revision or as specified).

- a) SSPC SP 10 / NACE 2 / : Near White Blast Cleaning
- b) SSPC PA 2 : Measurement of dry film Coating Thickness with magnetic gauges.
- c) ASTM D 4541 : Method for pull off strength using portable Adhesion Tester.
- d) NACE RP 0274 – 2004 : High-Voltage Electrical Inspection of Pipeline Coatings
- e) NACE SP 0188 – 2006 : Discontinuity (Holiday) Testing of New Protective Coatings on Conductive Substrates

- f) NACE RP 0169 – 2002 : Control of External Corrosion on Underground or Submerged Metallic Piping Systems
- g) AWWA C 210 – 2007 : Liquid-Epoxy Coating Systems for the Interior and Exterior of Steel Water Pipelines
- h) IS 3589:2001 Annexure B : Steel Pipes for Water and Sewage Specification.
- i) AWWA C222-2000 : Polyurethane Coating for the Interior and Exterior of Steel Water Pipe and Fittings.
- j) IS 13213 : 2000 : Polyurethane Full Gloss Enamel (Two pack)

### **3.00.00 GENERAL REQUIREMENTS**

- 3.01.00 The steel surface preparation prior to actual commencement of coating shall conform to SSPC SP 10 / NACE 2 / Sa2½ (near white metal) with sand blasting.
- 3.02.00 The contractor shall submit a detailed written description in the form of a manual covering coating equipment, procedures, materials inspection test, and repair etc. to Owner/Consultant for approval.
- 3.03.00 The contractor shall also provide copies of test reports from NABL approved laboratory (like National Test House, Kolkata) in support of the paint/primer materials to be used shall conform to the specification requirement.
- 3.04.00 The contractor shall also provide certificates from paint/primer manufacturer mentioning the batch numbers, date of manufacture and shelf life etc. of the materials to be used. In addition to that Manufacturing Quality Plan (MQP) and Field Quality Plan (FQP) shall also be submitted prior to commencement of supply of material and field application.
- 3.05.00 Paint/coating application work at site shall be done either by paint manufacturer or by their authorized applicator. The authorized applicator shall have proper training & certification from manufacturer. Applicator shall possess all the necessary specialized equipment and manpower experienced in similar job.

- 3.06.00 Applied coating shall be tested for dry film thickness, holiday (electrical inspection for continuity) and adhesion as per relevant standard such as SSPC PA 2, NACE RP 0274 and ASTM D 4541.
- 3.07.00 If necessary, the material may be heated and applied by airless spray / plural component spray system.
- 3.08.00 Manufacturer's specific recommendation, if any, shall be followed during application of lining / paints.
- 3.09.00 In areas where there is danger of spotting automobiles or other finally finished equipment or building by wind borne particles from paint spraying, a Purchaser approved method shall be adopted.
- 3.10.00 The colour scheme of the entire Plant, covered under this specification shall be approved by the Purchaser in advance before application.
- 3.11.00 All indoor and outdoor piping, insulated as well as uninsulated will have approved colour bands painted on the pipes at conspicuous places throughout the system, as approved by Purchaser.
- 3.12.00 Inside surfaces of vessels / tanks shall be protected by anticorrosive paints or rubber lining as required / specified elsewhere in the specification. External surfaces of all vessels / tanks shall be protected by anti corrosive painting.
- 3.13.00 For vessels / tanks requiring lining and epoxy painting all inside surface shall be blast cleaned using non-siliceous abrasive after usual wire brushing.
- 3.14.00 Natural rubber lining shall be provided on the inside of vessels / tanks as required / specified elsewhere in the specification, in three layers resulting in a total thickness not less than 4.5 mm.
- 3.15.00 Surface hardness of rubber lining shall be 65 +/- 5 deg. A (shore).
- 3.16.00 After the lining is completed, the vessels / tanks shall not be subjected to any prolonged exposure to direct sunlight in course of its transportation, erection etc. They shall not be stored in direct sunlight. No further lining or burning shall be carried out on the vessel, after application of the lining.

3.17.00 All lining projecting outside of the vessel shall be protected adequately from mechanical damages during shipment, handling storage etc.

3.18.00 Suitable warnings, indicating the special care that must be taken with respect to these lined vessels shall be stenciled on their outside surface with the letters at least 12 mm high.

3.19.00 All insulated piping shall have aluminium sheet jacketing.

**4.00.00 EQUIPMENT, MATERIAL AND SERVICES TO BE FURNISHED BY THE BIDDER**

**4.01.00** After erection at site, the outside surfaces of all equipment having a shop coat shall be given further priming coat and finished coats of paint as detailed in following clauses. However, if the painting system is such that the shop coat and primer coat to be applied at site are not compatible, then shop coat has to be removed from the surface of equipment before application of primer coat with prior blasting.

All factory finished paints shall be touched up at site as required.

All uninsulated piping shall be finished with final paintings after use of proper wash primer and primer. Aluminium sheet jacketed piping need not be painted. Colour bands of Purchaser's approved shade shall however be applied on jacketed piping near walls or partitions, at all junctions, near valves and all other places as instructed by the Purchaser. All structures shall be painted with approved paint.

**4.02.00 Surface Preparation**

4.02.01 Unless mentioned otherwise, all rust and mill scale shall be removed by blasting to Sa 2-1/2 Swiss Standard before applying the primer.

4.02.02 Special care shall be taken to remove grease and oil by means of suitable solvents like Trichloroethylene or Carbon Tetrachloride.

4.02.03 The minimum degree of surface preparations for all equipment, piping, fittings, valves, structures etc. shall be "Near White" according to Steel Structure, Painting Council-SSPC-SP-10 before application of any primer/paint.

**4.03.00 Painting**

- 4.03.01 Specification for application of paints for external surfaces protection of vessels / tanks / equipment / piping / fittings / valves etc. to be installed indoor shall be as follows :
- a) Surface preparation shall be done either manually or by any other approved method.
  - b) Primer Coat shall consist of one coat (minimum DFT of 50 microns) of chlorinated rubber based zinc phosphate.
  - c) Intermediate Coat (or Under Coat) shall consist of one coat (minimum DFT of 50 microns) of chlorinated rubber based paint pigmented with Titanium Dioxide.
  - d) Top Coat shall consist of one coat (minimum DFT of 50 microns) of chlorinated rubber paint of approved shade and colour with glossy finish.
  - e) Total DFT of paint system shall not be less than 150 microns.
- 4.03.02 Specification for application of paints for external surfaces protection of vessels / tanks / equipment / piping / fittings / valves etc to be installed **outdoor** shall be as follows :
- a) Surface preparation shall be done by means of sand blasting, which shall conform to Sa 2-1/2 Swiss Standard.
  - b) Primer Coat shall consist of one coat (minimum DFT of 100 microns) of epoxy resin based zinc phosphate primer.
  - c) Intermediate Coat (or Under Coat) shall consist of one coat (minimum DFT of 100 microns) epoxy resin based paint pigmented with Titanium Dioxide.
  - d) Top Coat shall consist of one coat (minimum DFT of 75 microns) of epoxy paint of approved shade and colour with glossy finish. Additional one coat (minimum DFT of 25 microns) of Finish Coat of polyurethane shall be provided.
  - e) Total DFT of paint system shall not be less than 300 microns.
- ~~4.03.03 Specification for application of paints for external surfaces protection of steel pipes and fittings which are buried underground / laid inside a huge pipe & or submerged Under Water and laid under Pipe Trenches (in road/rail/pipe or trench crossings) shall be as follows :~~

~~External surface of the pipe, fittings, specialties etc. handling raw water/clarified water/filter water shall be painted with one coat of two part chemically cured polyurethane primer of min 50 micron dry film thickness followed by three or maximum four coats of two part solvent less polyurethane to build up coating of dry film thickness of 2000 micron including primer coat.~~

~~4.03.04 Specification for application of paints for **internal surface protection of large diameter pipes** (sizes above 600 mm NB and above) if any, shall be as follows :~~

- ~~a) All Internal surfaces of steel pipes, fittings, specialties etc. buried underground or located within pipe trenches shall be given epoxy coating to protect them from (except for drinking water service, where the compatible painting shall be so selected to meet relevant quality standards) corrosion.~~
- ~~b) Internal surface of the pipe should be coated with one coat of two part epoxy primer with not less than 50 micron DFT (dry film thickness) followed by two part polyamide cured solvent less epoxy.~~
- ~~c) The minimum dry film thickness (DFT) of internal lining shall be 600 micron.~~

~~4.03.05 Specification for application of paints for protection of **internal surfaces of DM Water Storage Tank(s)** shall be as follows :~~

- ~~a) Primer - One coat of epoxy primer containing high level of Zinc Phosphate anticorrosive pigment. Total Dry Film Thickness (DFT) of primer shall not be less than 125 microns.~~
- ~~b) Finish Paint - Three (3) coats Polyamine HB Epoxy Paint. Total Dry Film Thickness (DFT) of finish paint shall not be less than 125 microns per coat.~~
- ~~c) Total thickness of primer and paint should not be less than 500 microns.~~

4.03.06 All motors, local push button stations, cable racks, structures used for supports etc. are to be painted with acid proof paint.

4.03.07 The following surfaces shall not be painted - stainless steel, galvanized steel, aluminum, copper, brass, bronze and other nonferrous materials.

4.03.08 No painting or filler shall be applied until all repairs, hydrostatic tests and final shop inspection are completed.

4.03.09 All machined surfaces shall have two (2) coats of water repellent grease after thorough cleaning.

## **5.00.00 COATING PROCEDURE AND APPLICATION**

5.01.00 Surface Preparation :

Pipe shall be blast cleaned by sand. The cleanliness achieved prior to application shall be in accordance with the requirement of SSPC SP 10 / NACE 2 / Sa2½ of ISO 8501 (near white metal)

- a) The blast pattern or profile depth shall be 40 to 100 micron and shall be measured by dial micrometer.
- b) Before sand blasting is started or during blasting or coating, temperature of the pipe surface should be more than 3°C above dew point temperature. Blast cleaned surface should be primed within 4 hours and shall be protected from rainfall or surface moisture and shall not be allowed to flash rust. If the rust occurs, the surface again to be prepared by sand blasting or wire brushing.

5.02.00 Application of Epoxy Coating

- a) Coating shall be applied when
  - i) When the pipe surface temperature shall be atleast 3°C above dew point temperature.
  - ii) The temperature of mixed coating material and the pipe at the time of application shall not be lower than 10°C or greater that 50°C.
- b) Material preparation shall be in accordance with manufacturer's recommendations.
- c) Application of epoxy coating system :

The epoxy coating system shall be applied as per recommendation of the manufacturer and shall be applied by airless spray / plural component spray machine. For more than one coat, the second shall be applied with the time limits as recommended by the manufacturer.

5.03.00 Application of PU Coating

- a) PU coating shall be applied when the pipe surface temperature atleast 3°C above dew point temperature (when R.H is more than 85%).
- b) Material preparation and application shall be done as per manufacturer recommendation.

**6.00.00 TEST REQUIREMENTS :**

**6.01.00 Measurement of dry film thickness**

Measurement of dry film thickness of coating : Coating thickness shall be in the range of  $\pm 20\%$  and as per SSPC PA 2.

**6.01.01 Apparatus / Instrument:-**

The instrument used for dry film thickness may be Type 1 pull of gauges or Type 2 electronic gauges.

**6.01.02 Procedures:-**

- a) Number of measurements:  
For 100 square feet (9.29 square meters), five (5) spots per test area (each spot is 3.8 cm) in diameter. Three gauge readings per spot (average becomes the spot measurement).
- b) If the structure is less than 300 square feet, each 100 square feet should be measured.
- c) If the structure is between 300 and 1000 sq ft, select 3 random 100 square feet test areas and measure.
- d) For structure exceeding 1000 square feet, select 3 random 100 square feet testing areas for the first 1000 sq ft and select 1 random 100 square feet testing area for each additional 1000 square feet
- e) Coating thickness Tolerance: Individual reading taken to get a representative measurement for the spot are unrestricted (usually low or high readings are discarded). Spot measurements (the average of 3 gauge readings) must be within 80% of the minimum thickness and 120% of the maximum thickness. Area measurement must be within specified range.

**6.02.00 Electrical Inspection (Holiday) Test**

- 6.02.01 All the coated / lined pipes shall be tested with an approved high voltage holiday detector preferably equipped with an audio visual signaling device to indicate any faults, holes, breaks or conductive particles in the protective coating.
- 6.02.02 The applied output voltage of holiday detector shall have a spark discharge of thickness equal to at least twice the thickness of the coating to assure adequate inspection voltage and compensate for any variation in coating thickness. The electrode shall be passed over the coated surface at approximately half the spark discharge distance from the coated surface only one time at the rate of approximately 10 to 20m/min. The edge effect shall be ignored. Excessive voltage shall be avoided as it tends to induce holiday in the coated surface thereby giving erroneous readings.
- 6.02.03 While selecting test voltages, consideration should be given to the tolerance on coating thickness and voltage should be selected on the basis of maximum coating thickness likely to be encountered during testing of a particular pipe.  
The testing voltage shall be calculated by using following formula. (as per NACE 0274 : 2004)  
$$\text{Testing Voltage } V = 7900 \sqrt{T} \pm 10 \text{ percent where } T \text{ is the average coating thickness in mm.}$$
- 6.02.04 Any audio visual sound or spark leads to indicate pinhole, break or conductive particle.
- 6.03.00 Adhesion Pull off Test :**  
After holiday the coated surface is subjected to adhesion pull off test as per ASTM D 4541.
- 6.03.01 Apparatus / Instrument: Adhesion tester consists of three basic components:  
A hand wheel, a black column containing a dragging indicator pin and scale in the middle and a base containing three legs and a pulling "Jaw" at the bottom and also dollies.
- 6.03.02 Prepare the test surface :  
Once test area is selected, test area shall be free of grease, oil, dirt, water. The area should be flat surfaces and large enough to accommodate the specified number of replicate test.
- 6.03.03 Prepare Dolly (Test Pull Stub) :

The dolly is a round, two sided aluminium fixture. Both sides of the dolly looks same, however, one side sloped on top surface while flat on bottom surface. As the surface of the dolly is polished aluminium, roughen the same using a coarse sand paper.

6.03.04 Select an adhesive:

Use araldite, a 100% solid epoxy adhesive. This adhesive requires at least 24 hours at room temperature to cure.

6.03.05 Attach the dolly to the surface.

- a) Using a wooden stick, apply an even layer of adhesive to the entire contact surface area of the dolly.
- b) Carefully remove the excessive adhesive by using a cotton swab. Allow the adhesive to fully cure before performing the adhesion test.
- c) Attach the dolly to the coated surface and gently push downward to displace any excessive adhesive.
- d) Push the dolly inward against the surface, then apply tape across the head of the dolly.

6.03.06 Adhesion Test Procedure

- a) Attach the adhesion tester to the dolly by rotating the hand wheel counter clockwise to lower the jaw of the device.
- b) Slide the jaw completely under the head of the dolly. Position the three legs of the instruments so that they are sitting flat on the coated surface.
- c) Slide the dragging indicator pin on the black column to zero by pushing it downward.
- d) Firmly hold the base of the instrument in one hand and rotate the handwheel clockwise to raise the jaw of the device that is attached to the head of the dolly. The dragging indicator pin will move upward on the black column as the force is increased and will hold the reading. Apply the tension using a moderate speed. Continue to increase the tension on the head of the dolly until (a) the minimum PSI/MPa/Kg/cm<sup>2</sup> required by project specification is exceeded and the test is discontinued, (b) the maximum PSI/MPa/Kg/cm<sup>2</sup> of adhesion tester has been achieved and dolly is still attached, (c) The force applied by the adhesion tester causes the dolly to dislodge.

e) Read the scale and record the adhesion value.

#### **6.04.00 Coating Repair**

Defective Coating shall be repaired in accordance with the following subsections.

##### **6.04.01 Surface Preparation:**

Accessible areas of pipe requiring coating repairs shall be cleaned to remove debris and damaged coating using surface grinders or other means. The adjacent coating shall be feathered by sanding, grinding or other method. Accumulated debris shall be removed by blowing with contaminant free air or wiping with clean rags.

6.04.02 Areas not accessible for coating repair such as interior surfaces of small diameter pipe shall be reprocessed and recoated.

##### **6.04.03 Coating Application :**

The coating system shall be applied to the prepared areas in accordance with procedure.

##### **6.04.04 Repair Inspection :**

Repaired portion shall be electrically inspected using a holiday detector.

#### **6.05.00 Welded Field Joints**

##### **6.05.01 Preparation :**

The weld joints shall be cleaned so as to be free from mud, oil, grease, welding flux, weld spatter and other foreign contaminants. The cleaned metal surfaces of the weld joint shall then be blasted or abraded using rotary abrading pads. The adjacent liquid Epoxy / PU coating shall be feathered by abrading the coating surface for a distance of 25 mm.

##### **6.05.02 Electrical Inspection :**

After curing the coating system applied to the welding joints shall be holiday tested. Any holidays indicated by the detector shall be marked with chalk to identify the area of repair.

**7.00.00 INFORMATION/DATA REQUIRED**

The Bidder shall submit complete list of paints and primers proposed, giving detail information, such as, chemical composition, drying time etc. and also unit rates for application of each type of paint along with supply shall be furnished.



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**


**REV. 00**

**DATE: 02.05.2016**

**SHEET 1 OF 1**

**SECTION C2-B  
QUALITY ASSURANCE**

**ANNEXURE-III  
QUALITY ASSURANCE PLAN**

|    |   | MANUFACTURING QUALITY PLAN FOR=M/S vendor  | PROJECT: PACKAGE: ITEM: ELEVATOR BHEL REF. NO.:             | Q.P/FQP. NO & REV: DATE:1 PAGE: 1of 4 JOB NO:  |   |   |   |  |                                     |                                     |  |                                     |         |
|--|---|--|---|--|---|---|---|--|-------------------------------------|-------------------------------------|--|-------------------------------------|---------|
| 1  | 2   | 3  | 4   | 5  | 6   | 7   | 8   | 9  | 10                                  |                                     |  |                                     | 11      |
| Sr. No.  | COMPONENT & OPERATION   | CHARATERISTICS   | CLASS   | TYPE OF CHECK  | QUANTUM OF CHECK  | REFERENCE DOCUMENT  | ACCEPTANCE NORMS  | FORMATE OF RECORD  | AGENCY                              |                                     |  |                                     | REMARKS |
|  |   |  |   |  |   |   |   |  | D                                   | VE                                  | M  | B                                   |         |
| <b>A. Boughtout Items :</b>  |   |  |   |  |   |   |   |  |                                     |                                     |  |                                     |         |
| 1  | Raw materials, Round Hexagon & Structural. Type : EN-8/EN-8D to EN-9,B and En-24  | A: Chemical Composition<br>B: Mechanical Properties<br>C: Dimensional Checks   | Major<br>Major<br>Major                                     | Analysis<br>Hardness<br>Measurement  | Sample<br>Sample<br>100%  | IS/BS : 970<br>IS/BS : 970<br>DRG.  | IS/BS : 970<br>IS/BS : 970<br>DRG.  | O.S.L/ T.C<br>QA REG.<br>D.I.R/Q.C.R   |                                     | V<br>V<br>V                         | V<br>V<br>w                              | V<br>V<br>V                         |         |
| 2  | Raw material Rounds, En-8, EN-9, EN-24  | Crack Detection  | Major   | Ultrasonic testing   | 100%  | ASTM-388  | ASTM -388   | QA/FMT/03  |                                     | V                                   | W  | V                                   |         |
| 3  | Casting :<br>a. C.I. Graded Castings  | A: Chemical Composition<br>B: Mechanical Properties<br>C: Dimensional Checks<br>D: Blow Holes  | Major<br>Major<br>Major<br>Major                            | Analysis<br>Hardness on traction sheave<br>Measurement<br>Visual   | Sample<br>Sample<br>Sample<br>100%  | IS-vendor DRG<br>vendor-DRG IS : 210<br>vendor-DRG<br>—   | AS PER DRG.<br>vendor-DRG IS : 210<br>vendor-DRG<br>-   | S.T.C<br>S.T.C<br>QA/FMT/02<br>QA/REG  | √<br>√<br>-<br>-                    | V<br>V<br>-<br>W                    | V<br>V<br>W<br>-                         | V<br>V<br>-<br>-                    |         |
| 4  | Suppliers Item :<br>a. Manufactured Items<br>b. Moldings Rubber Items ( ABSORBER )<br>c. Springs (Buffer)<br>d. Guide Rail.<br>e. Wire rope | Dimensional Check<br>A: Dimensional Checks<br>B: Hardness<br>A: Dimensional Check<br>B: Spring Constant compression.<br>A.Chemical Test.<br>B. Dimension check.<br>A: Dimensional Check<br>B: Mechanical Properties. | Major<br>Major<br>Major<br>Major<br>Major<br>Major<br>Major | Measurement<br>Measurement<br>Compression Test<br>Measurement<br>Compression<br>Analysis<br>Measurement<br>Measurement of O.D/ Const.<br>Measurement | 100%<br>100%<br>Sample<br>100%<br>Sample<br>Sample<br>Sample<br>Correlate S.T.C | vendor/DRG.<br>vendor-DRG.<br>vendor-DRG.<br>vendor-DRG.<br>vendor-DRG.<br>vendor- DRG<br>vendor-DRG.<br>IS/2365 &<br>IS : 2266 | vendor/DRG.<br>vendor/DRG.<br>vendor-DRG.<br>vendor-DRG.<br>vendor-DRG.<br>vendor -DRG<br>vendor-DRG.<br>IS : 2365 &<br>IS : 2266 | D.I.R<br>QA/FMT/02<br>QA/FMT/02<br>QA/FMT/02<br>S.T.C<br>S. T.C<br>QA/FMT/02<br>QA/FMT/02<br>S.T.C | <br>-<br>-<br>-<br>√<br>√<br>-<br>√ | <br>-<br>-<br>-<br>V<br>V<br>-<br>V | <br>W<br>W<br>W<br>V<br>W<br>W<br>-<br>V | <br>-<br>-<br>-<br>V<br>V<br>-<br>V |         |
| *V= Verification as appropriat. *M= Manufacturer/Sub contractor.<br>*W=Witness , *VE= Manufacturer/ sub contractor Vendor.<br>*S.T.C= Supplier Test Certificate, *B =BHEL/Nominated inspection agency.<br>*O.S.L = Out Side Lab, *D.I.R=Daily inspection register.<br>*R.Q.C = Rvendoript Quality Control ( vendor) . *P =Perform.<br>*Q.C.R = Qua;ity Control Register ( vendor) . *T.C. = Test Certificate,<br>*D.I.R = Daily inspection register. * D = Documents.<br>*U.E.R. =Ultra Sonic Examination Record . |   |  | MANUFACTURER SEAL AND SIGN                                  | CONTRACTOR SIGN AND SEAL .   | NAME & SIGN OF APPROVING AUTHORITY & SEAL                                       |   |   |  |                                     |                                     |  |                                     |         |

| 1   | 2   | 3  | 4                                      | 5   | 6   | 7  | 8  | 9                             | 10     |                  |                  |                  | 11                         |
|---|---|--|--|---|---|--|--|-------------------------------|--------|------------------|------------------|------------------|----------------------------|
| Sr. No.   | COMPONENT & OPERATION   | CHARACTERISTICS  | CLASS                                  | TYPE OF CHECK                                       | QUANTUM OF CHECK                            | REFERENCE DOCUMENT   | ACCEPTANCE NORMS   | FORMATE OF RECORD             | AGENCY |                  |                  |                  | REMARKS                    |
|   |   |  |  |   |   |  |  |                               | D      | VE               | M                | B                |                            |
|   | f. Power & control (PVC)cable   | a- FRLS ,<br>b- Insulation resistance.   | Major<br>do                            | Electrical<br>do                                    | Sampling<br>do                              | IS - 694<br>do   | IS - 694<br>do   | S.T.C<br>do                   | √<br>√ | V<br>V           | V<br>V           | V<br>V           |                            |
| 5   | Raw material for motor.<br>(1) Enameled wire.<br><br>(2) Copper base (Flat) | a) Dimension Check<br>b) High voltage test<br><br>Chemical check                             | Major<br>Major<br>Major                | Measurement<br>Elect.<br>Analysis                   | Sample<br>One Sample<br>each roll<br>Sample | vendor -STD<br>IS:4800<br>Cu=min 99.5%   | vendor -STD<br>IS:4800<br>Cu=min 99.5%   | D.I.R<br>D.I.R<br>O.S.L / T.C |        | V<br>V<br>V      | W<br>W<br>V      | V<br>V<br>V      |                            |
| 6   | Finished Manufactured Components  | Plating thickness control  | Major                                  | Measurement   | Sample                                      | vendor-STD.  | vendor-STD.  | vendor-STD                    |        | V                | W                | V                |                            |
| <b>B. Inspection During mfg.</b>  |   |  |  |   |   |  |  |                               |        |                  |                  |                  |                            |
| 1   | Machine Shop :  | A: Dimensional Check<br>B: Crack detection Motor bodies<br>C: Surface check                  | Major<br>Major<br>Major                | Measurement<br>D.P. Test<br>Visual                  | 100%<br>100%<br>100%                        | vendor-DRG.<br>vendor-STD.<br>vendor-STD.  | vendor-DRG.<br>vendor-STD.<br>vendor-STD.  | QA/FMT/01<br>-<br>-           |        | -<br>-<br>-      | W<br>W<br>W      | -<br>-<br>-      |                            |
| 2   | Fabrication Shop :  | Dimensional Checks of critical items<br>Welding  | Major<br>minor                         | Measurement<br>Visual                               | 100%<br>Sampling                            | vendor-DRG.<br>do  | vendor-DRG.<br>do  | Q.C.R<br>.                    |        | -<br>.           | W<br>W           | -<br>.           | Welding by approved welder |
| <b>C. Assembly Inspection.</b>  |   |  |  |   |   |  |  |                               |        |                  |                  |                  |                            |
| 1   | Winding gear.   | A- Back lash of gears & Maching contact.<br>B- Vibration .<br>C- Noise level.<br>D- Visual . | Major<br>Major<br>Major<br>Oil leakage | Measurement<br>Measurement<br>Measurement<br>Visual | 100%<br>100%<br>100%<br>100%                | vendor<br>INSP NORMS<br>vendor<br>INSP NORMS<br>vendor<br>INSP NORMS<br>vendor<br>INSP NORMS | vendor<br>INSP NORMS<br>vendor<br>INSP NORMS<br>vendor<br>INSP NORMS<br>vendor<br>INSP NORMS | QA/FMT/11<br>do<br>do<br>do   |        | V<br>V<br>V<br>V | W<br>W<br>W<br>W | -<br>-<br>-<br>- |                            |
| *V= Verification as appropriat. *M= Manufacturer/Sub contractor.<br>*W=Witness , *VE= Manufacturer/ sub contractor Vendor.<br>*S.T.C= Supplier Test Certificate, *B =BHEL/Nominated inspection agency.<br>*O.S.L = Out Side Lab, *D.I.R=Daily inspection register.<br>*R.Q.C = Rvendoript Quality Control (vendor) . *P =Perform.<br>*Q.C.R = Qua;ity Control Register (vendor) . *T.C. = Test Certificate,<br>*D.I.R = Daily inspection register. *D = Documents.<br>*U.E.R. =Ultra Sonic Examination Record . |   |  | MANUFACTURER SEAL AND SIGN             |   | CONTRACTOR SIGN AND SEAL .                  |  | NAME & SIGN OF APPROVING AUTHORITY & SEAL /HPGCIL  |                               |        |                  |                  |                  |                            |

| 1   | 2                                | 3  | 4                                | 5  | 6  | 7   | 8   | 9   | 10     |                  |                  |                  | 11      |
|---|----------------------------------|--|----------------------------------|--|--|---|---|---|--------|------------------|------------------|------------------|---------|
| Sr. No.   | COMPONENT& OPERATION             | CHARATERISTICS   | CLASS                            | TYPE OF CHECK  | QUANTUM OF CHECK                           | REFERENCE DOCUMENT  | ACCEPTANCE NORMS  | FORMATE OF RECORD   | AGENCY |                  |                  |                  | REMARKS |
|   |                                  |  |                                  |  |  |   |   |   | D      | VE               | M                | B                |         |
| 2   | Motor Assembly :                 | A-Winding Insulation test.<br>B-Insulation Resistance<br>C-Motor testing for elect. Pmt.<br>D-Vibration measurement & noise lev                    | Major<br>Major<br>Major<br>Major | High Volt. Test<br>Measurement<br>Elect.<br>Measurement  | 100%<br>100%<br>100%<br>100%               | I S :325-96<br>1.5 KV for 5 SEC<br>> 10 mega ohms<br>IS : 325<br>vendor - Norms | I S :325-96<br>1.5 KV for 5 SEC.<br>> 10 mega ohms<br>IS : 325<br>vendor -Norms | D.I.R<br>QA/FMT/13<br>Test report<br>Test report<br>Test report |        | V<br>V<br>V<br>V | W<br>W<br>W<br>W | V<br>V<br>V<br>. |         |
| 3   | Speed Governor Assembly :        | Tripping speed<br>Easy Run test  | Major                            | Function Check   | 100%                                       | I S : 9878<br>LCH -112  | I S : 9878<br>LCH - 112   | T.C<br>IN Pant.   |        | V                | W                | V                |         |
| 4   | Controller Assembly / VVVF Unit. | 1. Visual Inspection<br>2. Electrical Checks (Routine Test).<br>3. Functional Checks<br>4. Pretreatment in seven tank for sheet & paint thickness. | Major<br>do<br>do<br>Major       | Visual<br>Electrical<br>Function<br>Measurement + Visual | 100%<br>100%<br>100%<br>Sampling           | vendor Norms<br>do<br>do<br>do  | vendor Norms<br>do<br>do<br>do  | T.C<br>do<br>do<br>vendor - FMT.                                |        | V<br>V<br>V<br>V | W<br>W<br>W<br>W | V<br>V<br>V<br>V |         |
| *V= Verification as appropriat. *M= Manufacturer/Sub contractor.<br>*W=Witness , *VE= Manufacturer/ sub contractor Vendor.<br>*S.T.C= Supplier Test Certificate, *B =BHEL/Nominated inspection agency.<br>*O.S.L = Out Side Lab, *D.I.R=Daily inspection register.<br>*R.Q.C = Rvendoript Quality Control (vendor) . *P =Perform.<br>*Q.C.R = Qua;ity Control Register (vendor) . *T.C. = Test Certificate,<br>*D.I.R = Daily inspection register. *D = Documents.<br>*U.E.R. =Ultra Sonic Examination Record . |                                  |  | MANUFACTURER SEAL AND SIGN       | CONTRACTOR SIGN AND SEAL.                                | NAME & SIGN OF APPROVING AUTHIRITY & SEAL. |   |   |   |        |                  |                  |                  |         |

| 1  | 2                     | 3                   | 4                          | 5                             | 6                         | 7                                    | 8   | 9                | 10     |    |   |   | 11      |
|--|-----------------------|---------------------|----------------------------|-------------------------------|---------------------------|--------------------------------------|---|------------------|--------|----|---|---|---------|
| Sr. No.  | COMPONENT & OPERATION | CHARACTERISTICS     | CLASS                      | TYPE OF CHECK                 | QUANTUM OF CHECK          | REFERENCE DOCUMENT                   | ACCEPTANCE NORMS                          | FORMAT OF RECORD | AGENCY |    |   |   | REMARKS |
|  |                       |                     |                            |                               |                           |                                      |   |                  | D      | VE | M | B |         |
| 5  | Mechanical assembly : | Cage assembly .     | Major                      | Measurement                   | 100%                      | Appd. L/o DRG.<br>vendor-INSP. Norms | Appd. L/o DRG.<br>vendor-INSP. Norms      | QA/FMT/15        |        | V  | W | V |         |
| 6  | Painting              | Parts & Components  | Major                      | Cross Hatch Test              | Sampling                  | vendor-INSP. Norms                   | vendor-INSP. Norms                        | QA / REG.        |        | V  | W | V |         |
|  |                       |                     | Major                      | Powder Coating Thickness Test | Sampling                  | vendor-INSP. Norms                   | vendor-INSP. Norms                        | QA / REG.        |        | V  | W | V |         |
| 6  | Electrical Assembly   | 1- Break assembly . | Minor                      | Function check                | Sampling                  | vendor- NORMS                        | vendor - NORMS                            | TC               |        | V  | W | V |         |
|  |                       |                     |                            |                               |                           |                                      |   |                  |        |    |   |   |         |
| *V= Verification as appropriate. *M= Manufacturer/Sub contractor.<br>*W=Witness , *VE= Manufacturer/ sub contractor Vendor.<br>*S.T.C= Supplier Test Certificate, *B =BHEL/Nominated inspection agency.<br>*O.S.L = Out Side Lab, *D.I.R=Daily inspection register.<br>*R.Q.C = Rvendoript Quality Control (vendor) . *P =Perform.<br>*Q.C.R = Qua;ity Control Register (vendor) . *T.C. = Test Certificate,<br>*D.I.R = Daily inspection register. *D = Documents.<br>*U.E.R. =Ultra Sonic Examination Record . |                       |                     | MANUFACTURER SEAL AND SIGN |                               | CONTRACTOR SIGN AND SEAL. |                                      | NAME & SIGN OF APPROVING AUTHORITY & SEAL |                  |        |    |   |   |         |



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 1 OF 1**

**SECTION C2-B  
REQUIREMENT OF SPARES, TOOLS & TACKLES**

## CONTENT

| <b>CLAUSE NO.</b> | <b>DESCRIPTION</b>   |
|-------------------|----------------------|
| 1.00.00           | TOOLS AND TACKLE     |
| 2.00.00           | SPARES               |
|                   | <b>ATTACHMENT</b>    |
| ANNEXURE-I        | MANDATORY SPARE LIST |

VOLUME : IIA

SECTION-VIII

REQUIREMENTS OF SPARES, TOOLS & TACKLE,  
LUBRICANTS/OIL/CONSUMABLES

1.00.00 **TOOLS & TACKLE**

The Contractor shall supply with the equipment one complete set of special tools and tackle as required for the erection, assembly, dismantling & maintenance of the equipment. These special tools will also include special material handling equipment, jigs & fixtures for maintenance and calibration/readjustment, checking & measurement aids etc. A list of such tools & tackle shall be submitted by the Bidder along with the offer. Detailed description of each tools/tackle, its function along with the equipment/part for which it is meant for and the price of each tools/tackle shall also be indicated in the offer. These tools & tackle shall be separately packed and sent to site before the first unit commissioning. The Bidder shall also ensure that these tools are not used for erection purpose.

2.00.00 **SPARES**

2.01.00 **General**

The Bidder shall indicate and include in his scope of supply all the necessary start-up, commissioning and recommended spares in addition to mandatory spares as specified elsewhere in the specification. The Owner reserves the right to buy any or all mandatory and recommended spares. The Contractor shall also state for each item of spares both mandatory and recommended, the normal expected service life.

2.01.01 All spares supplied under this contract shall be strictly interchangeable with the parts for which they are intended to replace. The spares shall be treated and packed for long storage under the climatic conditions prevailing at the site, e.g. small items shall be packed in sealed transparent plastic bags with dessicator packs as necessary.

2.01.02 Each spare part shall be clearly marked or labelled on the outside of the packing with the description. When more than one spare part is packed in a single case, a general description of the contents shall be shown on the outside and a detailed list enclosed. All cases, containers and other packages must be suitably marked and numbered for the purposes of identification.

2.01.03 All cases, containers or other packages are liable to be opened for examination as may be considered necessary by the Engineer.

2.01.04 All mandatory spares shall be delivered to site within one to three months prior to the scheduled date of the trial operation of the plant. However, they shall not be despatched before the despatch of the associated main equipment.

- 2.01.05 The Bidder shall also guarantee supply of spare parts, which will be made, based on manufacturer's drawings on special order from the Purchaser for 30 years after commissioning of the plant.
- 2.01.06 Warranty period for all kinds of spares shall be six thousand (6000) hours of operation, except normal wear or eighteen (18) months from the date of receipt at site, whichever is earlier. In case of failure or non-conformance to specifications, the Contractor shall replace them free of cost.
- 2.02.00 **Recommended Spares**
- 2.02.01 The Contractor shall provide a list of recommended spares giving unit prices and total prices for 2 years of normal operation of the plant for spares of indigenous origin, and for 5 years of normal operation for spares of non-indigenous origin. This list shall take into consideration the mandatory spares specified elsewhere in the specification and should be a separate list.
- 2.02.02 The price of recommended spares will not be used for the evaluation of bids. The price of these spares shall remain valid for a period as specified elsewhere in the specification from the date of Award of the Contract. Where the recommended spares are the same as mandatory spares, the prices shall be the same. The prices of any recommended spares, which are not common with mandatory spares, shall be subject to review by the Owner, and shall be finalised after mutual discussion.
- 2.03.00 **Start-up Commissioning Spares**
- 2.03.01 Start-up commissioning spares are those spares which may be required during the start-up and commissioning of the equipment/system. All spares used until the plant is handed over to the Owner shall come under this category. Said spares, properly marked, shall be supplied together with the main equipment and shall be used by the Contractor, if needed, during erection & commissioning stage. All such spares which remain unused till issuance of Taking Over Certificate by the Owner, along with an equipment-wise quantitative consumption report shall be returned to the Owner during time of handover. The list of commissioning spares to be brought by the Contractor to ensure smooth commissioning of the plant shall be subject to the Engineer's approval.
- 2.03.02 The Contractor shall submit a complete BBU list inclusive of recommended, mandatory, initial start-up and commissioning spares. Costs of the above spares, which are consumed before the handing-over of the plant, shall be deemed to have been included in the lump sum proposal price of the package, and the Contractor shall have no claim on this account to the Owner.
- 2.04.00 **Mandatory Spare Parts**
- 2.04.01 The Owner considers some of the spares are essential for running the equipment irrespective of whether they are included in the list of recommended spares by the Bidder as mentioned above.

Since the components involved can not be foreseen at the bidding stage, only

broad requirements of the Owner in this respect are outlined hereinafter. The bidder shall include his proposal, on the basis of this guideline, an item-wise list of all components and the quantity, unit prices & total price thereof, offered as mandatory spares for each and every equipment. This list shall be separate from the list of recommended spares and shall be used for bid evaluation purposes. Any clarification in this respect may be obtained by the Bidder at the pre-bidding stage.

2.04.02 The mandatory spares should be supplied to the Owner at least one month before the trial run. The despatch programme is subject to approval of the Owner/Consultant after award of contract.

2.04.03.1 Criteria for selection of Quantity of Mandatory Spares :

For Mandatory Spares refer Annexure-I.

2.04.04 Purchaser will have the option to procure any or all of the mandatory spares at his discretion.



|  |                                     |                 |
|--|-------------------------------------|-----------------|
| TITLE<br><b>TECHNICAL SPECIFICATION<br/>FOR<br/>ELEVATOR</b> | SPEC. NO. PE – TS –410 - 502 – A001 |                 |
|  | VOLUME                              | II B            |
|  | SECTION                             | C               |
|  | REV 0                               | DATE 02.05.2016 |
|  | SHEET                               | OF              |

**SECTION- C3**

**TECHNICAL SPECIFICATION  
(Electrical Portion)**



TITLE:  
**ELECTRICAL EQUIPMENT SPECIFICATION  
FOR  
ELEVATORS**  
  
**1X800 MW KOTHAGUDEM TPS**

SPECIFICATION NO.  
VOLUME NO. : **II-B**  
SECTION: **C**  
REV NO. : **00** DATE: 19/03/2015  
SHEET: 1 OF 1

### CONTENTS

| SECTION | TITLE  | NO OF SHEETS |
|---------|--|--------------|
| C       | SPECIFIC TECHNICAL REQUIREMENTS                        | 1            |
| C       | ELECTRICAL SCOPE BETWEEN BHEL & VENDOR                 | 1            |
| C       | ELECTRICAL LOAD DATA FORMAT                            | 1            |
| C       | DATASHEET-A  | 1            |
| C       | CABLE SCHEDULE FORMAT                                  | 1            |
| D       | QUALITY PLAN (FOR MOTORS BELOW 55 KW)                  | 2            |
| D       | QUALITY PLAN (FOR MOTORS ABOVE & 55 KW)                | 9            |
| D       | SECTION II: TECHNICAL SPECIFICATION FOR AC & DC MOTORS | 14           |
| D       | SECTION IV: TECHNICAL SPECIFICATION FOR CABLES         | 17           |



TECHNICAL SPECIFICATION FOR  
ELEVATORS  
(ELECTRICAL PORTION)

SPECIFICATION NO.  
VOLUME II B  
SECTION-C  
REV 0 DATE 19.03.2015  
PAGE 1 OF 2

SPECIFIC TECHNICAL REQUIREMENTS: ELECTRICAL

**1.0 EQUIPMENT & SERVICES TO BE PROVIDED BY BIDDER:**

- a) Services and equipment as per “Electrical Scope between BHEL and Vendor”.
- b) Any item/work either supply of equipment or erection material which have not been specifically mentioned but are necessary to complete the work for trouble free and efficient operation of the plant shall be deemed to be included within the scope of this specification. The same shall be provided by the bidder without any extra charge.
- c) Supply of mandatory spares as specified in the specifications of mechanical equipments.
- d) Electrical load requirement for Cranes.
- e) All equipment shall be suitable for the power supply fault levels and other climatic conditions mentioned in the enclosed project information.
- f) Bidder to furnish list of makes for each equipment at contract stage, which shall be subject to customer/BHEL approval without any commercial and delivery implications to BHEL
- g) Various drawings, data sheets as per required format, Quality plans, calculations, test reports, test certificates, operation and maintenance manuals etc shall be furnished as specified at contract stage. All documents shall be subject to customer/BHEL approval without any commercial implication to BHEL.
- h) Motor shall meet minimum requirement of motor specification.
- i) Vendor to clearly indicate equipment locations and local routing lengths in their cable listing furnished to BHEL.
- j) Cable BOQ worked out based on routing of cable listing provided by the vendor for “both end equipment in vendor’s scope” shall be binding to the vendor with +10 % margin to take care of slight variation in routing length & wastages.

**2.0 EQUIPMENT & SERVICES TO BE PROVIDED BY PURCHASER FOR ELECTRICAL & TERMINAL POINTS:**

Refer “Electrical Scope between BHEL and Vendor”.

**3.0 DOCUMENTS TO BE SUBMITTED ALONG WITH BID**

- 3.1 The electrical specification without any deviation from the technical/quality assurance requirements stipulated shall be deemed to be complied by the bidder in case bidder furnishes the overall compliance of package technical specification in the form of compliance certificate/No deviation certificate.
- 3.2 No technical submittal such as copies of data sheets, drawings, write-up, quality plans, type test certificates, technical literature, etc, is required during tender stage. Any such submission even if made, shall not be considered as part of offer.



TECHNICAL SPECIFICATION FOR  
ELEVATORS  
**(ELECTRICAL PORTION)**

SPECIFICATION NO.  
VOLUME II B  
SECTION-C  
REV 0                      DATE 19.03.2015  
PAGE 2 OF 2

**4.0 List of enclosures :**

- a) Electrical scope between BHEL & vendor (Annexure –I)
- b) Technical specification for motors.
- c) Datasheets & quality plan for motors.
- d) Electrical Load data format (Annexure –II)
- e) BHEL cable listing format (Annexure –III)
- f) Electrical mandatory spares (As per spec.)

NIDHI RAWAT  
( Sr. ENGR.)

SUBHASH SINGH  
(Sr. MGR)

## STANDARD ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR (FOR EPC PROJECTS)

PACKAGE: ELEVATORS

SCOPE OF VENDOR: SUPPLY , ERECTION &amp; COMMISSIONING OF VENDOR'S EQUIPMENT

PROJECT : 1X800 MW KOTHAGUDEM TPS

| <u>S. NO</u> | <u>DETAILS</u>   | <u>SCOPE SUPPLY</u>        | <u>SCOPE E&amp;C</u> | <u>REMARKS</u>  |
|--------------|--|----------------------------|----------------------|---|
| 1            | Isolating Switch   | Vendor                     | Vendor               | BHEL will provide two number 415 V(3ph, 3W) supply feeder only up to isolating switches for elevators. Any other voltage level (AC/DC) required will be derived by the vendor. Motor starter shall be part of elevator control panel. |
| 2            | Power cables, control cables, screened control cables and any special cables (if required) between equipment supplied by vendor.   | Vendor                     | Vendor               | Cable from supply feeder to isolating switch shall be in BHEL scope.  |
| 3            | Cabling material (cable trays, accessories, cable tray supporting system, conduits etc).   | Vendor                     | Vendor               |   |
| 4            | Equipment Earthing   | Vendor                     | Vendor               | All equipment metallic enclosures / frames, metal structure etc. shall be grounded at two points each to the nearest grounding points / risers provided by BHEL.  |
| 5            | Motors   | Vendor                     | Vendor               |   |
| 6            | Cable glands and lugs for equipment supplied by vendor   | Vendor                     | Vendor               | <ol style="list-style-type: none"> <li>1. Double compression Ni-Cr plated brass cable glands</li> <li>2. Solder less crimping type heavy duty tinned copper lugs for power &amp; control cables.</li> </ol>                           |
| 7            | <ol style="list-style-type: none"> <li>a) Input cable schedules (C &amp; I)</li> <li>b) Cable interconnection details for above</li> <li>c) Cable block diagram</li> </ol> | Vendor<br>Vendor<br>Vendor | -<br>-<br>-          | Cable listing for Control and Instrumentation Cable in enclosed excel format shall be submitted by vendor during detailed engineering stage.  |
| 8            | Equipment layout drawings  | Vendor                     | -                    |   |
| 9            | Electrical Equipment GA drawing  | Vendor                     | -                    | For necessary interface review.   |



TITLE

**LV MOTORS****DATA SHEET-A**

SPECIFICATION NO.

VOLUME II B

SECTION C

REV NO. 00 DATE 19.03.2015


SHEET 1 OF 1


- 1.0 Design ambient temperature : 50 °C
- 2.0 Maximum acceptable kW rating of LV motor : <175 KW
- 3.0 Installation (Indoors/ Outdoors) : As required
- 4.0 Degree Of Protection : IP55 - Outdoor  
IP54 – Indoor
- 5.0 Details of supply system
- a) Rated voltage (with variation) : 415V ± 10%
  - b) Rated frequency (with variation) : 50 Hz (Variation: +3% TO –5%)
  - c) Combined voltage & freq. variation : 10% (sum of absolute values)
  - d) System fault level at rated voltage : 25 kA for 1 sec
  - e) Short time rating for terminal box : 25 kA for 0.25 sec
  - f) LV System grounding : Solidly
- 6.0 Class of insulation : Class 'F', with temp rise limited to class B.
- 7.0 Minimum voltage for starting : 85% of rated voltage  
(As percentage of rated voltage)
- 8.0 Power cables data : Shall be given during Detailed engg.
- 9.0 Earth Conductor Size & Material : Shall be given during Detailed engg.
- 10.0 Space heater supply (30KW & ABOVE) : 240 V, 1Φ , 50 Hz
- 11.0 Rating up to which Single phase motor : Acceptable below 0.20 Kw
- 12.0 TYPE OF STARTER PROVIDED IN MCC : DOL
- 13.0 Locked rotor current
- a) Limit as percentage of FLC : 600%
  - b) Permissible tolerance, if any : ±20%
- 14.0 Additional tests : As per QP
- 15.0 Flame-proof motor
- a) Enclosure suitable (As per IS:2148) : As per requirement
  - b) Classification of Hazardous area : As per requirement  
(As per IS: 5572 part-I)
  - c) Degree of protection : IP65
- 16.0 Makes : AS PER ANNEXURE-I
- 17.0 Terminal box : Suitable to rotate at 90 degrees
- 18.0 Paint shade : Shade 631 of IS-5

All LT motors shall be controlled as follows:

- a) Up to 110kW: - Contactor operated.
- b) 110Kw to 175kW shall have ACB.



|  |                     | CUSTOMER :     |                      |                 |   | PROJECT                               |                  |         |        | SPECIFICATION : |   |   |                  |
|---|---------------------|----------------|----------------------|-----------------|---|---------------------------------------|------------------|---------|--------|-----------------|---|---|------------------|
|   |                     | TITLE          |                      |                 |   | TITLE                                 |                  |         |        | NUMBER :        |   |   |                  |
| QUALITY PLAN  |                     | BIDDER/ VENDOR |                      |                 |   | QUALITY PLAN                          |                  |         |        | SPECIFICATION   |   |   |                  |
| SHEET 1 OF 2  |                     | SYSTEM         |                      |                 |   | NUMBER PED-506-00-Q-006, REV-01       |                  |         |        | TITLE           |   |   |                  |
| SL. NO.   | COMPONENT/OPERATION | CAT.           | TYPE/METHOD OF CHECK | EXTENT OF CHECK | REFERENCE DOCUMENT                          | ACCEPTANCE NORM                       | FORMAT OF RECORD | SECTION | AGENCY | REMARKS         | P | W | V                |
| 1   | 2                   | 3              | 4                    | 5               | 6   | 7                                     | 8                | 9       | 10     | 11              |   |   |                  |
| 1.0   | ASSEMBLY            | MA             | VISUAL               | 100%            | MANUF'S SPEC                                | MANUF'S SPEC                          | -DO-             |         | 2      | -               |   |   |                  |
|   |                     | MA             | -DO-                 | -DO-            | MFG. DRG./ MFG. SPEC.                       | MFG. DRG./ MFG. SPEC.                 | -DO-             |         | 2      | -               |   |   |                  |
|   |                     | MA             | VISUAL               | 100%            | MFG.SPEC./ RELEVANT IS                      | MFG.SPEC./ RELEVANT IS                | -DO-             |         | 2      | -               |   |   |                  |
| 2.0   | PAINTING            | MA             | VISUAL               | SAMPLE          | MANUF'R'S SPEC/BHEL SPEC./RELEVANT STANDARD | BHEL SPEC. SAME AS COL.7              | LOG BOOK         |         | 2      | -               |   |   |                  |
| 3.0   | TESTS               | MA             | -DO-                 | 100%            | IS-325/ BHEL SPEC./ DATA SHEET              | SAME AS COL.7                         | TEST REPORT      |         | 2      | 1               |   |   | NOTE -1 & NOTE-3 |
|   |                     | MA             | MEASUREMENT & VISUAL | 100%            | APPROVED DRG/DATA SHEET                     | APPROVED DRG/DATA SHEET & RELEVANT IS | INSPN. REPORT    |         | 2      | 1               |   |   | NOTE -1 & NOTE-3 |
| BHEL  |                     | PARTICULARS    |                      |                 |   | BIDDER/VENDOR                         |                  |         |        |                 |   |   |                  |
|   |                     | NAME           |                      |                 |   |                                       |                  |         |        |                 |   |   |                  |
|   |                     | SIGNATURE      |                      |                 |   |                                       |                  |         |        |                 |   |   |                  |

|  |   | QUALITY PLAN          |                       | CUSTOMER :            |                    | PROJECT TITLE                                |                     | SPECIFICATION : |                    |                                     |  |
|---|---|-----------------------|-----------------------|-----------------------|--------------------|--|---------------------|-----------------|--------------------|-------------------------------------|--|
| SHEET 2 OF 2  |   | BIDDER/ VENDOR SYSTEM |                       | BIDDER/ VENDOR SYSTEM |                    | QUALITY PLAN NUMBER PED-506-00-Q-006, REV-01 |                     | SPECIFICATION : |                    |                                     |  |
| SL. NO.   | COMPONENT/OPERATION CHARACTERISTICS CHECK   | CAT.                  | TYPE/ METHOD OF CHECK | EXTENT OF CHECK       | REFERENCE DOCUMENT | ACCEPTANCE NORM                              | FORMAT OF RECORD    | SECTION AGENCY  | VOLUME III REMARKS |                                     |  |
| 1   | 2   | 3                     | 4                     | 5                     | 6                  | 7  | 8                   | 9               | 10                 | 11                                  |  |
|   |   | 3 NAMEPLATE DETAILS   | MA                    | VISUAL                | 100%               | IS-325 & DATA SHEET                          | IS-325 & DATA SHEET | INSPN. REPORT   | 2 1 -              |                                     |  |
|   | <p>NOTES:</p> <ol style="list-style-type: none"> <li>1 ROUTINE TESTS ON 100% MOTORS SHALL BE DONE BY THE VENDOR. HOWEVER, BHEL SHALL WITNESS ROUTINE TESTS ON RANDOM SAMPLES. THE SAMPLING PLAN SHALL BE MUTUALLY AGREED UPON WHERE EVER CUSTOMER IS INVOLVED IN INSPECTION. (1) SHALL MEAN BHEL AND CUSTOMERS BOTH TOGETHER.</li> <li>2 FOR EXHAUST/VENTILATION FAN MOTORS OF RATING UPTO 1.5KW , ONLY ROUTINE TEST CERTIFICATES SHALL BE FURNISHED FOR SCRUTINY.</li> <li>3</li> </ol> <p>Legends for Inspection agency</p> <ol style="list-style-type: none"> <li>1. BHEL/CUSTOMER</li> <li>2. VENDOR (MOTOR MANUFACTURER)</li> <li>3. SUB-VENDOR (RAW MATERIAL/COMPONENTS SUPPLIER)</li> </ol> <p>P. PERFORM<br/>W. WITNESS<br/>V. VERIFY</p> |                       |                       |                       |                    |  |                     |                 |                    |                                     |  |
| <b>BHEL</b>   |   | <b>PARTICULARS</b>    |                       | <b>BIDDER/VENDOR</b>  |                    |  |                     |                 |                    |                                     |  |
|   |   | <b>NAME</b>           |                       |                       |                    |  |                     |                 |                    |                                     |  |
|   |   | <b>SIGNATURE</b>      |                       |                       |                    |  |                     |                 |                    |                                     |  |
|   |   | <b>DATE</b>           |                       |                       |                    |  |                     |                 |                    |                                     |  |
|   |   |                       |                       |                       |                    |  |                     |                 |                    | <b>BIDDER/SVENDORS COMPANY SEAL</b> |  |

**VOLUME: V-A**

**SECTION-II**

**TECHNICAL SPECIFICATION  
FOR  
A.C. & D.C. MOTORS**

## CONTENT

| <b>CLAUSE NO.</b> | <b>DESCRIPTION</b>       |
|-------------------|--------------------------|
| 1.00.00           | SCOPE                    |
| 2.00.00           | CODES & STANDARDS        |
| 3.00.00           | SERVICE CONDITIONS       |
| 4.00.00           | TYPE AND RATING          |
| 5.00.00           | PERFORMANCE              |
| 6.00.00           | SPECIFIC REQUIREMENTS    |
| 7.00.00           | ACCESSORIES              |
| 8.00.00           | TESTS                    |
| 9.00.00           | DRAWINGS, DATA & MANUALS |

### **ATTACHMENT**

|            |             |
|------------|-------------|
| ANNEXURE-A | DESIGN DATA |
|------------|-------------|

**VOLUME: V-A**

**SECTION-II**

**TECHNICAL SPECIFICATION  
FOR  
A.C. & D.C. MOTORS**

1.00.00 **SCOPE**

1.01.00 This section covers the general requirements of the drive motors for power station auxiliary equipment.

1.02.00 Motors shall be furnished in accordance with both this general specification and the accompanying driven equipment specification.

1.03.00 In case of any discrepancy, the driven equipment specification shall govern.

2.00.00 **CODES & STANDARDS**

2.01.00 All motors shall conform to the latest applicable IS, IEC and CBIP Standards/Publications except when otherwise stated herein or in the driven equipment specification.

2.02.00 Major standards, which shall be followed, are listed below other applicable Indian Standards for any component part even if not covered in the listed standards shall also be followed:

- i) IS-325
- ii) IS-12615
- iii) IEC-60034

3.00.00 **SERVICE CONDITIONS**

3.01.00 The motors will be installed in hot, humid and tropical atmosphere highly polluted at places with coal dust and/or fly ash.

3.02.00 Unless otherwise noted, electrical equipment/system design shall be based on the service conditions and auxiliary power supply given in the annexure to this specification.

3.03.00 For motor installed outdoor and exposed to direct sunrays, the effect of solar heat shall be considered in the determination of the design ambient temperature.

4.00.00 **TYPE AND RATING**

4.01.00 **A.C. Motors**

4.01.01 Motors shall be general purpose, constant speed, squirrel cage, three/single phase, induction type.

- 4.01.02 All motors shall be rated for continuous duty. They shall also be suitable for long period of inactivity.
- 4.01.03 LT motor & HT motor name-plate rating at 50°C shall have at least 15% margin and 10% margin respectively over the input power requirement of the driven equipment at rated duty point unless stated otherwise in driven equipment specification.
- 4.01.04 The motor characteristics shall match the requirements of the driven equipment so that adequate starting, accelerating, pull up, break down and full load torques are available for the intended service.
- 4.01.05 Motors efficiency class shall be IE1, IE2 as per latest version of IEC-60034.
- 4.02.00 **D.C. Motors**
- 4.02.01 D.C. motor provided for emergency service shall be shunt/compound wound type.
- 4.02.02 Motor shall be sized for operation with fixed resistance starter for maximum reliability.
- Starter panel complete with all accessories shall be included in the scope of supply.
- 5.00.00 **PERFORMANCE**
- 5.01.00 **Running Requirements**
- 5.01.01 Motor shall run continuously at rated output over the entire range of voltage and frequency variations as given in the annexure.
- 5.01.02 The motor shall be capable of operating satisfactorily at full load for 5 minutes without injurious heating with 75% rated voltage at motor terminals.
- 5.01.03 The motor shall be designed to withstand momentary overload of 60% of full load torque for 15 second without any damage.
- 5.02.00 **Starting Requirements**
- Motor shall be designed for direct online starting at full voltage. Breakaway starting current as percentage of full load current for various motor rating shall not exceed the given below-
- |                     |   |   |
|---------------------|---|---|
| Motors up to 1500kW | - | 600% subject to IS tolerance of plus 20%.   |
| Motors above 1500kW | - | 450% not subject to any positive tolerance. |
- 5.02.01 The motor shall be capable of withstanding the stresses imposed if started at 110% rated voltage.

- 5.02.02 Motor shall start with rated load and accelerate to full speed with 80% rated voltage at motor terminals except mill motor. Mill motor shall start with rated load and accelerate to full speed at 85% of the rated voltage at the motor terminals.
- 5.02.03 a) Two hot starts in succession with motor initially at normal running temperature.  
b) Pump motor subject to reverse rotation shall be designed to withstand the stresses encountered when starting with shaft rotating at 125% rated speed in reverse direction.
- 5.02.04 The motors shall be designed to withstand 120% of rated speed for 2 minutes without any mechanical damage.
- 5.03.00 **Stress During Bus Transfer**
- 5.03.01 The motor may be subjected to sudden application of 150% rated voltage during bus transfer, due to the phase difference between the incoming voltage and motor residual voltage.
- 5.03.02 The motor shall be designed to withstand any torsional and/or high current stresses, which may result, without experiencing any deterioration in the normal life and performance characteristics.
- 5.04.00 **Locked Rotor Withstand Time**
- 5.04.01 The locked rotor withstand time under hot condition at 110% rated voltage shall be more than motor starting time by at least 3 seconds for motors up to 20 seconds starting time and by 5 seconds for motor with more than 20 seconds starting time.
- 5.04.02 Starting time mentioned above is at minimum permissible voltage of 80% rated voltage.
- 5.04.03 Hot thermal withstand curve shall have a margin of at least 10% over the full load current of the motor to permit relay setting utilising motor rated capacity.
- 6.00.00 **SPECIFIC REQUIREMENTS**
- 6.01.00 **Enclosure**
- 6.01.01 All motor enclosures for outdoor, semi-outdoor & indoor application shall conform to the degree of protection IP-55 unless otherwise specified. Motor for outdoor or semi-outdoor service shall be of weather-proof construction with canopy.
- 6.01.02 For hazardous area approved type of increased safety enclosure shall be furnished.
- 6.02.00 **Cooling**
- 6.02.01 The motor shall be self ventilated type, either totally enclosed fan cooled IC 411(TEFC), totally enclosed tube ventilated IC 511(TETV) or closed air circuit air- cooled IC 611(CACA).

- 6.02.02 For large capacity motors not available with above type of cooling may be accepted with IC 81W or IC 91W, closed air circuit water cooled (CACW) subject to the approval of the owner.
- 6.03.00 **Winding and Insulation**
- 6.03.01 All insulated winding shall be of copper.
- 6.03.02 All motors shall have class F insulation but limited to class B temperature rise.
- 6.03.03 Windings shall be impregnated to make them non-hygroscopic and oil resistant.
- 6.04.00 **Tropical Protection**
- 6.04.01 All motors shall have fungus protection involving special treatment of insulation and metal against fungus, insects and corrosion.
- 6.04.02 All fittings and hardwares shall be corrosion resistant.
- 6.05.00 **Bearings**
- 6.05.01 Motor shall be provided with antifriction bearings, unless sleeve bearings are required by the motor application. Bearings shall be rated for minimum service life of 40,000Hrs.
- 6.05.02 Vertical shaft motors shall be provided with thrust and guide bearings. Thrust bearing of tilting pad type is preferred.
- 6.05.03 Bearings shall be provided with seals to prevent leakage of lubricant or entrance of foreign matters like dirt, water etc. into the bearing area.
- 6.05.04 Sleeve bearings shall be split type, ring oiled, with permanently aligned, close running shaft sleeves.
- 6.05.05 Grease lubricated bearings shall be pre-lubricated and shall have provisions for in-service positive lubrication with drains to guard against over lubrication. LT motors 15kW and above shall be provided with external greasing arrangement.
- 6.05.06 Oiled bearing shall have an integral self cooled oil reservoir with oil ring inspection ports, oil sight glass with oil level marked for standstill and running conditions and oil fill and drain plugs.
- 6.05.07 Forced lubricated or water cooled bearing shall not be used without prior approval of Owner.
- 6.05.08 Lubricant shall not deteriorate under all service conditions. The lubricant shall be limited to normally available types with IOC equivalent.
- 6.05.09 Bearings shall be insulated as required to prevent shaft current and resultant bearing damage.
- 6.06.00 **Noise & Vibration**

- 6.06.01 All HT motors shall be provided with vibration pads for mounting of vibration detectors. Vibration monitoring devices shall be provided on DE and NDE side in x&y direction with remote DCS monitoring, alarm and tripping.
- 6.06.02 The maximum double amplitude vibrations for HT motors upto 1500 rpm shall be 25 microns and 15 microns upto 3000 rpm. For 415V motors, maximum double amplitude vibrations upto 1500 rpm shall be 40 microns and 15 microns upto 3000 rpm.
- 6.06.03 The noise level shall not exceed 85db (A) at 1.5 meters from the motor.
- 6.07.00 **Motor Terminal Box**
- 6.07.01 Motor terminal box shall be detachable type and located in accordance with Indian Standards clearing the motor base- plate/ foundation
- 6.07.02 Terminal box shall be capable of being turned 360 Deg. in steps of 180 Deg. for HT motors and 90 Deg. for LT motors unless otherwise approved.
- 6.07.03 The terminal box shall be split type with removable cover with access to connections and shall have the same degree of protection as motor.
- 6.07.04 The terminal box shall have sufficient space inside for termination/connection of XLPE insulated armoured aluminium cables.
- 6.07.05 Terminals shall be stud or lead wire type, substantially constructed and thoroughly insulated from the frame.
- 6.07.06 The terminals shall be clearly identified by phase markings, with corresponding direction of rotation marked on the non-driving end of the motor.
- 6.07.07 The terminal box shall be capable of withstanding maximum system fault current for a duration of 0.25 sec.
- 6.07.08 For 11000V and 3300V motor, the terminal box shall be phase-segregated type. The neutral leads shall be brought out in a separate terminal box (not necessarily phase segregated type) with shorting links for star connection.
- 6.07.09 Motor terminal box shall be furnished with suitable cable lugs and double compression brass glands to match with cable used.
- 6.07.10 The gland plate for single core cable shall be non-magnetic type.
- 6.07.11 Minimum clearances to be provided between phase to phase and phase to earth shall be as under-

| Voltage Rating of Motor | Minimum Ph-Ph & Ph-Earth clearance |
|-------------------------|------------------------------------|
| 0.415 kV                | : 25 mm                            |
| 3.3 kV                  | : 65 mm                            |
| 11.0 kV                 | : 140 mm                           |

**Note:** In case it is not possible to maintain these clearances, the live parts shall be totally insulated from earth and other Phases. Adequate clearances shall be provided for cable connections.

6.08.00 **Grounding**

6.08.01 The frame of each motor shall be provided with two separate and distinct grounding pads complete with tapped hole, GI bolts and washer.

6.08.02 The grounding connection shall be suitable for accommodation of ground conductors as follows:

| Rating |        | Conductor Size |                      |
|--------|--------|----------------|----------------------|
| Above  | Up to  |                |                      |
| -----  | 5.5 kW | :              | 8 SWG GI Wires.      |
| 5.5 kW | 22 kW  | :              | 25mm X 4mm GS Flat.  |
| 23 kW  | 55 kW  | :              | 40mm X 6mm GS Flat.  |
| 56kW   | 174kW  | :              | 50mm X 8mm GS Flat.  |
| 175kW  | ABOVE  | :              | 75mm X 10mm GS Flat. |

6.08.03 The cable terminal box shall have a separate grounding pad.

6.09.00 **Minimum Cable Size for LT & HT Motors shall as be as follows-**

a) For 415V, 3-Ph, LT Motors-

| Rating |         | Cable Size |                     |
|--------|---------|------------|---------------------|
| Above  | Up to   |            |                     |
| -----  | 5.5 kW  | :          | 1R X 3C X 6 Sq.mm   |
| 5.5 kW | 11 kW   | :          | 1R X 3C X 10 Sq.mm  |
| 11 kW  | 22 kW   | :          | 1R X 3C X 35 Sq.mm  |
| 22 kW  | 37.5 kW | :          | 1R X 3C X 70 Sq.mm. |
| 37.5kW | 55 kW   | :          | 1R X 3C X 150 Sq.mm |
| 55 kW  | 75 kW   | :          | 1R X 3C X 300 Sq.mm |
| 75 kW  | 110kW   | :          | 2R X 3C X 150 Sq.mm |
| 110 kW | 175kW   | :          | 2R X 3C X 300 Sq.mm |

b) For 3.3kV & 11kV, 3-Ph, HT Motors-

| Rating |       | Cable Size |  |
|--------|-------|------------|--|
| Above  | Up to |            |  |

|         |           |   |                       |
|---------|-----------|---|-----------------------|
| 175 kW  | 1000 kW   | : | 1R X 3C X 240 Sq.mm   |
| 1000 kW | 2000 kW   | : | 2R X 3C X 240 Sq.mm   |
| 2000 kW | 4500 kW   | : | 2R X 3C X 300 Sq.mm   |
| 4501 kW | 10,000 kW | : | 9R X 1C X 1000 Sq.mm. |

**Note:** During detail engineering if higher cable size is required same shall be provided.

6.10.00 **Rating Plate**

In addition to the minimum information required by IS, the following information shall be shown on motor rating plate :

- a) Temperature rise in Deg.C under rated condition and method of measurement.
- b) Degree of protection.
- c) Bearing identification no. and recommended lubricant.
- d) Location of insulated bearings.

7.00.00 **ACCESSORIES**

7.01.00 **General**

Accessories shall be furnished, as listed below, or if otherwise required by driven equipment specification or application.

7.02.00 **Space Heater**

7.02.01 Motor of rating 30 kW and above shall be provided with space heaters, suitably located for easy removal or replacement.

7.02.02 The space heater shall be rated 240 V, 1 Phase, 50Hz and sized to maintain the motor internal temperature above dew point when the motor is idle.

7.02.03 Minimum Cable Size for space heater shall be as listed-

- i) For LT motors: 2.5 sq.mm, 2-Core copper cable complying with IS-1554(Part-1).
- ii) For HT motors: 6 sq.mm, 2 Core aluminium cable complying with IS-1554(Part-1).

7.03.00 **Temperature Detectors**

7.03.01 All 11000V and 3300V motors shall be provided with twelve (12) nos. simplex type winding temperature detectors, four (4) nos. per phase.

- 7.03.02 11000V and 3300V motor bearing shall be provided with duplex type temperature detectors.
- 7.03.03 The temperature detector mentioned above shall be resistance type, 3 wire, platinum wound, 100 Ohms at 0°C.
- 7.03.04 Leads of all simplex type motor winding RTDS and motor bearing RTDS shall be wired up to respective switchgear metering & protection compartment. From which one set of RTDS will be connected to numerical protection relay and another set shall be kept free for DDCMIS connectivity.
- 7.03.05 0.5 sq.mm annealed tinned copper conductor complying with IS-1554(Part-1). shall be used for RTD/BTD wiring.
- 7.04.00 **Indicator/Switch**
- 7.04.01 Dial type local indicator with alarm contacts shall be provided for the following:
- a) 11000 V and 3300V motor bearing temperature.
  - b) Hot and cold air temperature of the closed air circuit for CACA and CACW motor.
- 7.04.02 Flow switches shall be provided for monitoring cooling water flow of CACW motor and oil flow of forced lubrication bearing, if used. CACW motor shall be provided with water leakage detector with remote alarm and tripping.
- 7.04.03 Alarm switch contact rating shall be minimum 2.0 A at 220V D.C. and 10A at 240V A.C.
- 7.05.00 **Current Transformer for Differential Protection**
- 7.05.01 Motor 1000 kW and above shall be provided with three differential current transformers mounted over the neutral leads within the enclosure.
- 7.05.02 The arrangement shall be such as to permit easy access for C.T. testing and replacement. Current transformer characteristics shall match Owner's requirements to be intimated later.
- 7.06.00 **Accessory Terminal Box**
- 7.06.01 All accessory equipment such as space heater, temperature detector, current transformers etc., shall be wired to and terminated in terminal boxes, separate from and independent of motor (power) terminal box.
- 7.06.02 Accessory terminal box shall be complete with double compression brass glands and pressure type terminals to suit owner's cable connections.
- 7.07.00 **Drain Plug**
- Motor shall have drain plugs so located that they will drain the water, resulting from the condensation or other causes from all pockets of the motor casing.

7.08.00 **Lifting Provisions**

Motor weighing 25 Kg. or more shall be provided with eyebolt or other adequate provision of lifting.

7.09.00 **Dowel Pins**

The motor shall be designed to permit easy access for drilling holes through motor feet or mounting flange for installation of dowel pins after assembling the motor and driven equipment.

7.10.00 **Painting**

For paint shade finish, refer Section-X of Volume: II-A : Lead Specification.

8.00.00 **TESTS**

Routine and Type Tests are to be conducted in presence of customer's representative as per IS:325 and in addition, any special test called for in the driven equipment specification shall be performed and required copies of test certificates are to be furnished for approval. In addition, following tests shall have to be carried out on the motors in presence of OWNER's representative on 3.3kV/11kV motors.

- a. Impulse test by 1.2 / 50 micro sec. On sample coil of Stator winding insulation as type test as per IEC-60034, part -15 test voltages as under :

| Voltage rating of motor | Impulse Test Voltage |
|-------------------------|----------------------|
| 3.3 kV                  | 18 kV peak           |
| 11 kV                   | 49 kV peak           |

- b. Tan delta, charging current and dielectric loss measurements on each phase of motor stator winding as routine test.
- c. Polarization Index Test as per IS: 7816 as routine test
- d. Test for suitability of IPW- 55(Weather proof) as per IS 4691 as type test. Type test certificate for first numeral shall be acceptable in lieu to test, provided the test motor is identical to motor being supplied. Second numeral test shall be carried out on one motor of each type and rating.
- e. Fault Withstand Test for main terminal box as type test. Type test certificate shall be acceptable, if the test is conducted on exactly identical terminal box.
- f. Test for noise level as routine test.
- g. Test for vibration as routine test.

- h. Tan delta measurement on coils.
- i. Surge withstand test for inter turn insulation.
- j. Test to diagnose rotor bar failure during manufacture.
- k. Over speed test as routine test.
- l. Temperature rise test.

Temperature rise under normal condition above ambient temperature shall be limited to-

| Specified Design Ambient temperature | Thermometer Method | Resistance Method |
|--------------------------------------|--------------------|-------------------|
| 50 deg.C                             | 60 deg.C           | 70 deg.C          |
| 45 deg.C                             | 65 deg.C           | 75 deg.C          |
| 40 deg.C                             | 70 deg.C           | 80 deg.C          |

Tests indicated at (h), (i), (j) shall be carried out during manufacture of the coils and shall be furnished for verification.

9.00.00 **DRAWINGS, DATA & MANUALS**

9.01.00 Drawings, Data & Manuals shall be submitted in triplicate with the bid and in quantities and procedures as specified in General Conditions of Contract and/or elsewhere in the specification for approval and subsequent distribution after the issue of 'Letter of Intent'.

9.02.00 **To be Submitted with the bid**

- a) List of the motors
- b) Individual motor data sheet as per format of the proposal data sheets.
- c) Scheme & write-up on forced lubrication system, if any
- d) Type test report

9.03.00 **To be submitted for Owner / Purchaser's Approval and Distribution**

All relevant drawings and data pertaining to the equipment like GTP, GA drawing, foundation plan, QAP, etc. shall be submitted by the Bidder for approval of Owner/Owner's consultant. Also refer clause no. 1.19.02(u) of Section-I of Volume – V-A: Technical Specifications for Electrical Equipment & Accessories.

**ANNEXURE-A**

**DESIGN DATA**

1.0 AUXILIARY POWER SUPPLY

| Supply          | Description   | Consumer   |
|-----------------|---|--|
| H.V. Supply     | 11000 V, 3Ø, 3W, 50 Hz,<br>Non-effectively earthed<br><br>Fault level 44 kA symm.<br>for 1 sec. | Motors 1500 kW & above   |
| M.V. Supply     | 3300 V, 3Ø, 3W, 50 Hz,<br>Non-effectively earthed<br><br>Fault level 40 kA symm.<br>for 1 sec.  | Motors 175 kW and<br>Up to less than 1500 kW.  |
| L.V. Supply (i) | 415V, 3Ø, 3W, 50 Hz<br>effectively earthed<br><br>Fault level 50 kA symm.<br>for 1 sec.         | Motors above 0.2kW<br>and below 175kW.   |
| (ii)            | 240V AC/415V AC<br><br>240V, 1Ø, 2W, 50 Hz<br>effectively earthed                               | Motors upto 0.2kW.<br><br>Lighting, Space heat-<br>ing , A.C supply for Contr-<br>ol & protective devices. |
| D.C. Supply     | 220V, 2W, unearthed<br><br>Fault level 25* kA.<br>for 1 sec.                                    | D.C. alarm, control<br>& protective devices  |

\* Indicative only, the actual value will be decided by the Bidder, after substantiating the same by calculation.

Note-

- 415V or 3.3 kV may be adopted by the bidder for the drives in the range of 160-210 kW.
- 3.3 kV AC supply for CHP conveyor motors of rating above 160 kW is to be used.
- The voltage rating of the drives indicated above is for basic guideline. Minor variations can be accepted on case to case basis based on techno-economic considerations of the various sub-systems.
- Voltage rating for special purpose motors viz, VFD and screw compressors, shall be as per manufacturer's standard. All the motors ratings on Stacker/ reclaimer shall be 415V ac supply only.

2.0 RANGE OF VARIATION

A.C. Supply :

Voltage :  $\pm 10\%$   
Frequency :  $+3\%$  to  $-5\%$   
Combined Volt + frequency : 10% (absolute sum)

During starting of large motor, the voltage may drop to 80% of the rated voltage for a period of 60 seconds. All electrical equipment while running shall successfully ride over such period without affecting system performance.

D.C. Supply :

Voltage : 187 to 242 Volt

**SECTION-IV**

**TECHNICAL SPECIFICATION  
FOR  
CABLES**

**1.00.00 SCOPE OF SUPPLY**

1.01.00 Power and Control Cables shall cover the requirement of entire Plant including the switchyard.

Other cables including special cables, if any, which may be necessary as per proven engineering practice for satisfactory and trouble free operation of the entire cable system of the plant shall also be within the scope of supply. These shall include all such cables for electrical integral with mechanical equipment systems and subsystems.

1.02.00 Cable shall be furnished in accordance with this specification and the following annexures :

- a) 11kV & 3.3 kV Power cables : Annexure - A
- b) 1100V Power Cables : Annexure – B
- c) Control Cables : Annexure – C
- d) Fire Survival Cables : Annexure – D
- e) Flexible Trailing cable : Annexure – E

1.03.00 All relevant drawings, data and instruction manuals

**2.00.00 CODES & STANDARDS**

2.01.00 All cable and materials shall be designed, manufactured and tested in accordance with the latest applicable Indian Standards (IS) and IEC except where modified and/or supplemented by this specification.

2.02.00 Cable and material conforming to any other standard which ensures equal or better quality, may be accepted. In such case, copies of the English version of the standard adopted shall be submitted along with the bid.

2.03.00 The electrical installation shall meet the requirements of Indian Electricity Rules as amended upto date and relevant IS Code of Practice. In addition, other rules and regulations applicable to the work shall be followed.

**3.00.00 DESIGN CRITERIA**

3.01.00 Cables will be generally laid on ladder type trays or drawn through rigid PVC/GI /HDPE pipe/conduits. Cable tunnels shall be avoided as far as possible, except at locations where overhead trays are not possible, with prior approval of the Owner.

- 3.02.00 For continuous operation at specified rating, maximum conductor temperature shall be limited to the permissible value as per relevant standard and/or this specification which one is more stringent.
- 3.03.00 The insulation and sheath materials shall be resistant to oil, acid and alkali and shall be tough enough to withstand mechanical stresses during handling.
- 3.04.00 Armouring shall be single round wire of galvanized steel for multicore cables and aluminum for single core cable for power and control cables. For fire survival control cable, the armouring over inner sheath shall consist of single layer of wire / round galvanized steel wire as per IS 3975 amended upto date. For Fire survival power cable, Single core cables to be used in A.C. system, the armouring over inner sheath shall consist of single layer of round copper wire, for multi-core cables to be used in A.C. system and single core cables in D.C. System, the armouring over inner sheath shall consist of single layer of round galvanized steel wire.
- 3.05.00 The outer sheath shall have flame retardant low smoke halogen evolution (FRLSH) characteristics or fire survival characteristics as applicable and shall meet the requirements of additional tests specified for the purpose.
- 3.06.00 Core identification for multicore cable shall be provided by colour coding.
- 3.07.00 HT cables shall be manufactured by triple extrusion dry cured (CCV) process using pressurized nitrogen.

4.00.00 **SPECIFIC REQUIREMENTS**

4.01.00 **General Description**

All Cables shall be furnished in strict compliance with ratings and requirements and sizes as given in Annexures to this Specification.

4.02.00 **Drum Length and Tolerance**

The cables shall be supplied in non-returnable packing steel drum for 11 kV & 3.3 kV power cables, wooden drums for 1100V power and control cables, each containing minimum 500 meters length of larger sizes of cable unless specifically asked for. For smaller sizes of cables, each drum shall contain 1000 meters length of cable. Allowable tolerance on individual drum length is  $\pm 5\%$ .

4.03.00 **Non-Standard Length**

Non-standard lengths upto 5% of the total ordered quantity may be accepted. However the Contractor will be required to obtain approval before packing the Cables on drums. Non-standard lengths shall not be less than 100 metres in any case.

4.04.00 **Cable identification**

Cable identification shall be provided by embossing on every meter on the outer sheath the following :

- a) TSGENCO
- b) Manufacturer's name or trade mark
- c) Voltage grade
- d) Year of manufacture
- e) Type of insulation, e.g. XLPE/PVC/HR85/IE2 etc.
- f) No. of core and size of cables.
- g) Type of improved fire performance, e.g. FR/FRLSH/FS
- h) IS number

4.05.00 **Packing**

4.05.01 Cables shall be supplied in non returnable drums. The drums shall be of heavy construction. All wooden parts shall be manufactured from seasoned wood. All ferrous parts used shall be treated with suitable rust preventive finish or coating to avoid rusting during transit or storage. Wooden cable drum shall be treated by immersing in copper-nitrate solution.

4.05.02 Cable shall be wound and packed on drums in such a manner that it will be properly sealed and firmly secured to the drum. The ends of each length shall be sealed before shipment.

4.05.03 The cable drums should carry the following details in printed form:

- a) TSGENCO
- b) Manufacturer's name or trade make
- c) Type of cable & voltage grade
- d) Year of manufacture
- e) Type of insulation e.g. XLPE/HRPVC/IE2
- f) No. of core and size of cables
- g) Cable code e.g. FRLSH/FS
- h) Length of cable on drum
- i) No. of length on drum, if more than one
- j) Direction of rotation, by arrow
- k) Approx. gross mass.

- l) IS/IEC number and ISI mark

4.06.00 **Joints and Terminations**

Materials of construction for a joint/termination shall perfectly match with the dielectric chemical and physical characteristics of the associated cables. The material and design concepts shall incorporate a high degree of operating compatibility between the cable and joints. The protective outer covering (jacket) used on the joints/terminations shall have the same qualities as that of the cable outer sheath in terms of ambient/operating temperature withstand capability and resistance to hazardous environments and corrosive elements. Straight through joints and terminations for HT cables shall be heat shrinkable type.

4.07.00 **Selection Criteria**

- 4.07.01 a) HT and LT power cables shall be selected on the basis of current carrying capacity, short circuit rating and permissible voltage drop.
- b) While sizing power cables, following aspects shall be reckoned:
- i) Ground/Ambient Air temperature
  - ii) Depth of Laying.
  - iii) Power Cables touching each other.
- c) Cables, for circuit breaker controlled feeders, shall withstand the short circuit current for the fault clearing time 0.16 Sec. for outgoing feeder, 0.5 Sec. for Tie feeder and 1.0 Sec. for Incomer.
- d) HT cables shall be sized based on the following considerations:
- Rated current of the equipment and ground/ambient temperature.
  - Touching/spacing of cable.
  - Laying on multi-tier racks, trench
  - Depth of laying.
- The voltage drop of the cable , during motor starting condition , shall be limited to 15% and during full load running condition shall be limited to 3 % rated voltage. For BFP motor, the voltage drop during motor starting condition shall be limited to 20% and for Mill motor shall be limited to 10%. Other outgoing feeder / transformer feeder shall be limited to 3% rated voltage.
- Short circuits withstand capability
- e) For fuse/MCCB/Breaker protected circuits the conductor size shall depend upon full load current subject to voltage drop limited to 3% during running of all feeders and 15% during starting for motor feeders. In addition, transformer regulation shall also be considered for loads fed from 415V PMCC. Incase of other out going line feeder voltage drop shall be limited to 3%.

- f) For loads fed from local panels, the total running voltage drop in cable from 415V PMCC to local panel and from local panel to individual motor shall be limited to 3% at full load motor current while the same during starting shall be limited to 15%.
- g) As per national electric code (NEC) current rating capacity of motor feeder/cables should be 125% of full load current.
- h) For welding receptacle, 3% running drop shall only be considered.
- The minimum sizes of L.T cable to be chosen are as below:  
AL - 16 mm<sup>2</sup> (3 core) & 16mm<sup>2</sup> (2 core) Cu - 2.5 mm<sup>2</sup>
- 4.07.02 Apart from above, consideration shall also be given to limit the cable to some standard sizes instead of using too many types.
- 4.07.03 The standard cable sizes, amp capacities, derating factors. as given in IS/IEC will be generally followed.
- 4.07.04 a) For breaker protected circuits minimum size of the cable shall be as follows:
- |                    |   |                   |
|--------------------|---|-------------------|
| 1100V Power Cable  | : | 240 Sq mm XLPE AL |
| 3300V Power Cable  | : | 185 Sq mm XLPE AL |
| 11000V Power Cable | : | 240 Sq mm XLPE AL |
- b) For motor circuits the selection of size will be made ensuring that the cable shall withstand a short circuit fault directly following a second hot start.
- 4.07.05 For fuse/MCCB protected circuit, the conductor size will depend on full load current subject to voltage drop not exceeding 3%. For practical purposes, the minimum size chosen is as below :
- |              |   |            |
|--------------|---|------------|
| a) Aluminium | : | 6 Sq mm.   |
| b) Copper    | : | 2.5 Sq mm. |
- 4.07.06 All control cables shall be 2.5 Sq mm copper cable.
- 4.07.07 Multicore control cables will generally have spare conductor (s) in accordance with the following chart :

| Conductors required | Cables |
|---------------------|--------|
| 1 or 2              | 1-3/C  |
| 3 or 4              | 1-5/C  |
| 5 or 6              | 1-7/C  |
| 7 or 8              | 1-9/C  |

- |  |          |                             |
|--|----------|-----------------------------|
|  | 9 or 10  | 1-12/C                      |
|  | Above 10 | Two or more of above cables |
- 4.07.08 Separate cables for each type of following services/functions as applicable shall be used for each feeder. Same multicore cable using different services shall not be acceptable.
- a) Power.
  - b) Control, interlock and indication.
  - c) Metering and measuring.
  - d) Alarm and annunciation.
  - e) C.T. Cables.
  - f) V.T. Cables.
- 4.08.00 **Cable Identification**
- Cable identification shall be provided by embossing on the outer sheath the following :
- a) Manufacturer's name or trade mark
  - b) Manufacturer's name or trade mark
  - c) Voltage grade
  - d) Year of manufacture
  - e) Type of insulation, e.g. XLPE, HRPVC & IE2 etc.
  - f) No. of core & size of cables
  - g) Type of outer sheath e.g. FRLSH, FS etc.
- 4.09.00 Selected sizes of power and control cables are given in Annexure-G.
- 4.10.00 Fire Survival Cables shall be used for important auxiliaries / area as recommended in Standard Technical Specification by CEA for the following services. The fire survival time of these cables shall not be less than 3 hours at 750 deg. C.
- i. DC emergency lube oil pump
  - ii. DC hydrogen seal pump
  - iii. Turbine lube oil pump/barring gear
  - iv. DC emergency lighting for main building and service building
  - v. DC cables for battery to charger & DC distribution boards

- vi. Jacking oil pump
- vii. Emergency turbine trip in control room
- viii. Boiler Turbine : Generator inter trip which include the interconnection between
  - Boiler master fuel trip and turbine trip relays
  - Generator trip relays & turbine trip relays
  - Generator trip relays & generator breaker
  - Generator trip relays & field breaker
  - Generator trip relays & unit auxiliary transformer breaker
  - Incomer cables for DG board, emergency board, DC lighting board etc.

5.00.00 **TESTS**

5.01.00 **Shop Tests**

The Cables shall be subject to shop tests in accordance relevant IS/IEC standards to prove the design and general qualities of the Cables as below:

- 5.01.01 Routine tests on each drum of cables.
- 5.01.02 Acceptance Tests on 1 drum out of every 10 drums chosen at random for acceptance of the lot for every size.
- 5.01.03 Type test on each type and size of cable, inclusive of measurement of armour DC resistance of power cables on one drum out of every 10 drums of cable.

5.02.00 **Additional Tests**

Following additional acceptance tests shall also be performed on each type of cables having outer sheath with improved fire performance (category C1, Type FR/ Category C2, Type FRLSH)

- 5.02.01 Oxygen index test (both C1 & C2)

The Oxygen index shall not be less than 29.
- 5.02.02 Temperature Index Test (both C1 & C2)

The measured value of temperature index shall be 21 at a temperature of 250°C for FRLS cables and 350°C for FS cables
- 5.02.03 Flame Retardance test on single cable and on bunched cables (both C1 & C2)

After the test, there should be no visible damages on the test specimen within 300mm from its upper end.

After burning has ceased, the cables should be wiped clean and the charred or affected portion should not have reached a height exceeding 2.5 meter above the bottom edge of the burner, measured at the front and rear of the cable assembly. 3 Hours fire rating test shall be carried out for FS cable as per IEC-331

5.02.04 Halogen acid gas evolution test (for Category C2)

The level of HCL evolved shall not exceed 20 per cent by weight. HCL evolved shall not be exceed 2% for FS cable.

5.02.05 Smoke density test (for Category C2)

The cables shall meet the requirements of light transmission of minimum 40% after the test. Minimum transmission shall be 80% for FS cable.

5.02.06 Test for specific optical density of smoke

The cables shall meet the requirements of IS/IEC.

5.02.07 Test for rodent & termite repulsion property

The test shall be carried out to note the presence of rodent and termite repelling chemical in PVC compound. Normal procedure is that a few chippings of the PVC compound are slowly ignited in a porcelain dish or crucible in a muffle furnace at about 600°C. The resulting ignited ash is boiled with a little ammonium acetate solution (10%). A drop of aqueous sodium sulphide solution is placed on a thick filter paper and it is allowed to soak. The spot is touched with a drop of above extract. A black spot indicates the presence of anti-termite & rodent compound.

Flammability test shall be carried on finished cables as per following standards-

- a) Swedish Chimney test – SS: 424-14-75
- b) IEEE std.383 – 1974 latest
- c) IEC std. 332-1, 332-3 and IEC 331

6.00.00 **DRAWINGS, DATA & MANUALS**

6.01.00 Drawings, Data and Manuals shall be submitted with the bid and for approval/reference and subsequent distribution after the issue of Letter of Intent in quantities and procedures as specified in General condition of contract and/or

6.02.00 **To be submitted with the Bid**

- a) Manufacturer's catalogues giving cable construction details and characteristics.

- b) Cable current ratings for different types of installation, inclusive of derating factors for ambient temperature, grouping etc.
- c) Write-up on Manufacturer's recommended method of splicing, jointing, termination etc. of the cables.
- d) Type test reports on 11 KV & 3.3 KV Power, LT FRLSH Power & control, FS power and control cables.
- e) Filled-up proposal particulars.

6.03.00 To be submitted for Owner/Purchaser's Approval and Distribution

All relevant drawings and data pertaining to the equipment like GTP, QAP, etc. shall be submitted by the Bidder for the approval of Owner/Owner's consultant. Also refer clause no. 1.19.02(u) of Section-I of Volume – V-A: Technical Specifications for Electrical Equipment & Accessories.

**ANNEXURE-A**

**RATINGS AND REQUIREMENTS  
HV POWER CABLES (11 KV & 3.3 KV)**

- 1.0 11000/11000V & 3300/3300V grade 90<sup>0</sup>C continuous rating under normal condition and 250<sup>0</sup>C rating under short circuit condition heavy duty XLPE power cable suitable for use in 11000V/3300V non-effectively earthed system conforming to following requirement and in line with IS-7098, IS-8130, IS-5831 & IS-3975, manufactured by Triple Extrusion Dry Cure (CCV) process using pressurized Nitrogen.
- 1.1 Conductor : Stranded and compacted aluminium conductor of grade H2 & class 2 for all sizes, generally conforming to IS: 8130.
- 1.2 Conductor Screen : Extruded semi-conducting compound.
- 1.3 Insulation : Extruded cross linked polyethylene (XLPE) conforming to IS: 7098 (Part-2)
- 1.4 Insulation Screen : Extruded semi-conducting compound with a layer of non-magnetic metallic tape. For single core armoured cables, the armouring shall constitute the metallic part of screening. The semi-conducting tape shall be easily strippable.
- 1.5 Core Identification : By coloured strips applied on (For three core cables) cores.
- 1.6 Inner Sheath : Extruded HRPVC/FRLS compound conforming to type ST2 of IS: 5831 for three core cables. Single core cables shall have inner sheath. Filler material shall also be of type ST2 PVC.
- 1.7 Armour : Galvanised single round steel wire armour for twin and multicore cables.  
  
Non-magnetic hard drawn aluminum single round wire conforming to H4 of IS-8130 latest for single core cables
- 1.8 Overall Sheath : Extruded FRLSH HRPVC compound conforming to type ST2 of IS: 5831.
- 1.9 Drum : Steel Drum

**ANNEXURE-B**

**RATINGS AND REQUIREMENTS  
LV POWER CABLES [1.1KV (XLPE TYPE)]**

- 1.0 1100 V grade, 90°C continuous rating under normal condition and 250°C under short circuit condition rating, XLPE heavy duty, power cable conforming to following requirement and in line with IS 7098 Part-I. IS 8130 & IS 5831 and IS 3975.
- 1.1 Conductor : Stranded and compacted plain aluminium of grade H2 and class 2 stranded, high conductivity annealed plain copper for cable sizes upto 2.5 mm<sup>2</sup> conforming to IS:8130.
- 1.2 Insulation : Extruded cross-linked polyethylene (XLPE) conforming to IS: 7098 (Part-1)
- 1.3 Core Identification : By color coding
- 1.4 Inner Sheath : Extruded HRPVC FRLS compound conforming to type ST2 of IS: 5831 for multicore cable. Single core cables shall have no inner sheath. Filler shall be of same material as of inner sheath i.e. ST2
- 1.5 Armour : Galvanized single round steel wire armour for twin and multicore cables.  
Non-magnetic hard drawn aluminum single round wire conforming to H4 of IS-8130 latest for single core cables
- 1.6 Overall Sheath : Extruded FRLSH HRPVC compound conforming to type ST2 of IS: 5831.
- 1.7 Drum : Conforming to IS-10418 (Wooden drum)

**ANNEXURE-C**

**RATINGS AND REQUIREMENTS  
CONTROL CABLES**

- 1.0 1100 V grade 85°C continuous rating under normal condition and 160°C under short circuit condition rating HRPVC Control cable (YWY) conforming to following requirement and in line with IS:1554, IS:8130, IS:5831 and IS:3975.
- 1.1 Conductor : Stranded, non-compacted & circular, high conductivity annealed plain copper, generally conforming to IS: 8130.
- 1.2 Insulation : Extruded HRPVC type-C compound conforming to IS: 5831. The minimum volume resistivity of insulation shall be  $3.5 \times 10^{14}$  ohm-cm at 27°C and  $3.5 \times 10^{11}$  OHM-CM at 85°C.
- 1.3 Core Identification : By color coding and numbering at interval of 100mm or less
- 1.4 Inner sheath : Extruded HRPVC compound conforming to type ST2 FRLS of IS: 5831 for multicore cables. Single core cables shall have no inner sheath. Filler shall be of same material as of inner sheath i.e. ST2.
- 1.5 Armour : Galvanised single round steel wire for twin and multicore cables.
- 1.6 Overall sheath : Extruded FRLSH HRPVC compound conforming to type ST2 of IS: 5831.
- 1.7 Drum : Conforming to IS: 10418 (Wooden drum)

**ANNEXURE-D**

**RATINGS AND REQUIREMENTS  
(1.1KV GRADE COPPER CONDUCTOR FS POWER CABLES)**

1100 V, copper conductor, heat resisting insulation, extruded inner sheath of low smoke and very low halogen content fire resisting material, single layer of copper wire armour for single core/ single layer of round galvanised steel wire for multicore, outer sheath of low smoke and very low halogen content fire resistant material, suitable for minimum temperature of 750 deg.C for 3 hours. The cables shall be in compliance with IEC-60331, Part 11.

**RATINGS AND REQUIREMENTS  
(1.1KV GRADE COPPER CONDUCTOR FS CONTROL CABLES)**

1100 V, copper conductor, heat resisting insulation, extruded inner sheath of low smoke and very low halogen content fire resisting material, single layer of copper wire armour for single core/ single layer of round galvanised steel wire for multicore, outer sheath of low smoke and very low halogen content fire resistant material, suitable for minimum temperature of 750 deg.C for 3 hours. The cables shall be in compliance with IEC-60331, Part 11.

**ANNEXURE-E**

**RATINGS AND REQUIREMENTS  
FLEXIBLE TRAILING CABLES**

- i) 3300 V Unearthed Grade
- Flexible trailing cable, annealed plain copper conductor, Class-5 of IS-8130, insulated with EPR, conductor and insulation shielded with EPR, cores screened with ATC wire braiding, cores laid up, HD CSP inner sheathed, proof cotton taped and FRLS HD CSP sheathed overall, conforming to IS:9968. Alternatively PCP sheathing may be acceptable.
- ii) 1100 V Grade
- 1100 V Grade trailing cable shall be plain copper of Class-5 of IS-8130, heat resistant elastomeric compound based on EPR insulation, inner sheath of heat resistant elastomeric compound PCP sheath, nylon cord reinforcement and heat resistant, oil resistant and flame retardant heavy duty elastomeric compound FRLS CSP outer sheath.

**ANNEXURE-F**

**CABLE SIZES**

Following sizes are given as a general guideline. Standard sizes as per IEC/IS shall be adopted.

| Sl. No. | Cable Size                  | Conductor | Insulation  |
|---------|-----------------------------|-----------|-------------|
| 1.0     | <b>H. T. CABLES (11kV)</b>  |           |             |
| 1.1     | 1 core 1000 sq.mm           | AL        | XLPE (FRLS) |
| 1.1     | 1 core 630 Sq.mm            | AL        | XLPE (FRLS) |
| 1.2     | 3 core 400 Sq.mm            | AL        | XLPE (FRLS) |
| 1.3     | 3 core 240 Sq.mm            | AL        | XLPE (FRLS) |
| 1.4     | 1 core 70 Sq.mm             | AL        | XLPE (FRLS) |
| 1.0     | <b>H. T. CABLES (3.3kV)</b> |           |             |
| 1.1     | 1 core 630 Sq.mm            | AL        | XLPE (FRLS) |
| 1.2     | 3 core 300 Sq.mm            | AL        | XLPE (FRLS) |
| 1.3     | 3 core 240 Sq.mm            | AL        | XLPE (FRLS) |
| 1.4     | 3 core 185 Sq.mm            | AL        | XLPE (FRLS) |
| 1.5     | 1 core 70 Sq.mm             | AL        | XLPE (FRLS) |
| 2.0     | <b>L. T. POWER CABLES</b>   |           |             |
| 2.1     | 3 core 2.5 Sq.mm            | CU        | XLPE (FRLS) |
| 2.2     | 2 core 16 Sq.mm             | AL        | XLPE (FRLS) |
| 2.3     | 3 core 16 Sq.mm             | AL        | XLPE (FRLS) |
| 2.4     | 4 core 16 Sq.mm             | AL        | XLPE (FRLS) |
| 2.5     | 2 core 35 Sq.mm             | AL        | XLPE (FRLS) |
| 2.6     | 3 core 35 Sq.mm             | AL        | XLPE (FRLS) |
| 2.7     | 4 core 35 Sq.mm             | AL        | XLPE (FRLS) |
| 2.8     | 3 core 70 Sq.mm             | AL        | XLPE (FRLS) |

| Sl. No.    | Cable Size             | Conductor | Insulation   |
|------------|------------------------|-----------|--------------|
| 2.9        | 3.1/2 core 70 Sq.mm    | AL        | XLPE (FRLS)  |
| 2.10       | 3 core 95 Sq.mm        | AL        | XLPE (FRLS)  |
| 2.11       | 3.1/2 core 95 Sq.mm    | AL        | XLPE (FRLS)  |
| 2.12       | 3 core 185 Sq.mm       | AL        | XLPE (FRLS)  |
| 2.13       | 3.1/2 core 185 Sq.mm   | AL        | XLPE (FRLS)  |
| 2.14       | 3 core 240 Sq.mm       | AL        | XLPE (FRLS)  |
| 2.15       | 3.1/2 core 240 Sq.mm   | AL        | XLPE (FRLS)  |
| 2.16       | 3 core 300 Sq.mm       | AL        | XLPE (FRLS)  |
| 2.17       | 3.1/2 core 300 Sq.mm   | AL        | XLPE (FRLS)  |
| 2.18       | 1 core 630 Sq.mm       | AL        | XLPE (FRLS)  |
| <b>3.0</b> | <b>CONTROL CABLE</b>   |           |              |
| 3.1        | 2 core 2.5 Sq.mm       | CU        | HRPVC (FRLS) |
| 3.2        | 3 core 2.5 Sq.mm       | CU        | HRPVC (FRLS) |
| 3.3        | 5 core 2.5 Sq.mm       | CU        | HRPVC (FRLS) |
| 3.4        | 7 core 2.5 Sq.mm       | CU        | HRPVC (FRLS) |
| 3.5        | 9 core 2.5 Sq.mm       | CU        | HRPVC (FRLS) |
| 3.6        | 12 core 2.5 Sq.mm      | CU        | HRPVC (FRLS) |
| 3.7        | 20 core 2.5 Sq.mm      | CU        | HRPVC (FRLS) |
| <b>4.0</b> | <b>FS POWER CABLES</b> |           |              |
| 4.1        | 3 core 2.5 Sq.mm       | CU        | EPR          |
| 4.2        | 2 core 16 Sq.mm        | CU        | EPR          |
| 4.3        | 3 core 16 Sq.mm        | CU        | EPR          |
| 4.4        | 4 core 16 Sq.mm        | CU        | EPR          |
| 4.5        | 2 core 35 Sq.mm        | CU        | EPR          |

| Sl. No. | Cable Size              | Conductor | Insulation |
|---------|-------------------------|-----------|------------|
| 4.6     | 3 core 35 Sq.mm         | CU        | EPR        |
| 4.7     | 4 core 35 Sq.mm         | CU        | EPR        |
| 4.8     | 3 core 95 Sq.mm         | CU        | EPR        |
| 4.9     | 3.1/2 core 95 Sq.mm     | CU        | EPR        |
| 5.0     | <b>FS CONTROL CABLE</b> |           |            |
| 5.1     | 2 core 2.5 Sq.mm        | CU        | EPR        |
| 5.2     | 3 core 2.5 Sq.mm        | CU        | EPR        |
| 5.3     | 5 core 2.5 Sq.mm        | CU        | EPR        |
| 5.4     | 7 core 2.5 Sq.mm        | CU        | EPR        |
| 5.5     | 9 core 2.5 Sq.mm        | CU        | EPR        |
| 5.6     | 12 core 2.5 Sq.mm       | CU        | EPR        |



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**


**REV. 00**

**DATE: 02.05.2016**

**SHEET 1 OF 1**

**SECTION- D**

**STANDARD TECHNICAL SPECIFICATION**

|   |   |                              |      |
|---|---|------------------------------|------|
|  | TITLE   | SPEC. NO. PE-TS-410-502-A001 |      |
|   | <b>TECHNICAL SPECIFICATION of VVVF drive for<br/>Elevator</b> | VOLUME II - B                |      |
|   |   | SECTION - C                  |      |
|   | DATE 02.05.2016   | SUB SECTION                  |      |
|   | SHEET   | 1                            | OF 5 |

## 1.0 General

- a) This part of the specification describes the general requirements for the Variable Voltage Variable frequency Drives, herein referred to as AC Drives, for use with standard IEC design AC squirrel cage induction motors. The nominal values, the standard documents and the drive's minimum performance are defined in this part. **To avoid any mismatch between the motor and its control equipment, the AC Drive shall be capable of auto adjustment by automatic measurement of the motor parameters with/without motor rotation.**

- b) Inverter construction and related devices:

Construction shall be divided in 3 broad sections. Section one converts AC Supply into DC supply. Section 2 Converts and controls DC supply into AC Supply with regulation. Section 3 shall be used for braking action of the motor and Dynamic Braking Unit (DBU) can be inbuilt or external depending upon the drive capacity. VVVF can be used in open loop (without external speed feed back) like in Travel motions or close loop (With external speed feed back) like in Hoist motions. Like all other electronic / electric devices VVVF drives are also protected by MCB / MCCB / Fuses. VVVF drives are sensitive to temperature and hence drive internal as well as external cooling fans are provided.

- c) Programming of VVVF Drives.

VVVF drives shall be programmable and for that purpose detachable digital Operator display unit shall be supplied along with the VVVF having required buttons for setting the user constant, functions etc. The VVVF drive is to be fine tuned by matching the motor parameters and setting the parameters on full load.

- d) VVVF drives shall be connected with power supply and these drives generate their own low voltage control supply. Potential free contacts shall be connected to this control supply and few programmable control terminals. Starting / stopping / set speeds operations of VVVF drive shall be achieved by above control connection.
- e) VVVF shall give smooth control over acceleration and deceleration making the motion jerk free and using Variable voltage variable frequency limits the inrush current to the squirrel cage motors. VVVF provides controlled torque to the motor due to which elevator operations are jerk free.

### 1.1 Experience

The Frequency Converter Manufacturer shall have adequate experience in frequency converter manufacturing and have adequate business volume in order to provide credibility in his commitments and a capability of long term support.

### 1.2 Local support

The Supplier shall have a permanent representative office with a trained and skilled support staff, in the country where the goods are delivered, in order to prove his commitment for local support and to provide a channel for communication.



|   |                              |             |
|---|------------------------------|-------------|
| <b>TITLE</b><br><b>TECHNICAL SPECIFICATION of VVVF drive for Elevator</b> | SPEC. NO. PE-TS-410-502-A001 |             |
|   | VOLUME II - B                |             |
|   | SECTION - C                  |             |
|   | DATE 02.05.2016              | SUB SECTION |
|   | SHEET                        | 2 OF 5      |

The engineers employed by the Supplier's regional office shall be certified by the Manufacturer and provide start-up service including physical inspection of the drive, connected wiring and final adjustments, to ensure that the AC Drive meets the required performance.

The Supplier shall be able to give basic drives training to the Customer's engineers, preferably on the site. The training shall, as a minimum, include system concepts and basic troubleshooting.

## 2.0 Basic requirements for the AC Drives

### 2.1 General requirements

The AC Drive shall comply with National (country of origin) and International standards and the recommendations for electrical industrial control devices (IEC, EN, UL, NFC, and VDE).

The AC Drive shall be of the most modern design, yet user friendly and be simple to install commission and maintain. The AC Drive shall be able to start and control the speed of a standard squirrel cage induction AC motor. The AC Drives shall be: CE marked, conforming to European Low Voltage (73/23/CEE and 93/68/CEE) and EMC (89/336/CEE) Directives, UL/CSA marked according to UL 508C.

The AC Drives have to be built to comply with the IEC standards.

The AC Drive shall be a digitally controlled drive, using, at least, the Pulse Width Modulation (PWM) with flux vector control open loop (for travel) and closed loop (for hoist). It shall have diodes / thyristors in rectifier and IGBT's in the inverter section in their entire power range, and it shall have the following minimum specifications.

|                                       |  |
|---------------------------------------|--|
| Rated Input Voltages                  | 380V to 480V (-10% to +10% variation), three-phase                   |
| Rated Input Frequency                 | 50Hz +5 % to - 5%  |
| Output Voltage                        | 0 – Input voltage, three-phase                                       |
| Output Frequency Range                | 0 to 400 Hz  |
| Acceleration / Deceleration Time      | 0.01 – 999s, adjustable, linear, with S, with U or customised shapes |
| Overload capability (Constant Torque) | 150% of nominal current for 1min.                                    |
| Operating ambient Temperature         | -10°C up to 50°C (shall be de-rated suitably if not rated at 50°C)   |
| Storage ambient Temperature           | -25°C up to 70 °C  |



|   |                              |             |
|---|------------------------------|-------------|
| <b>TITLE</b><br><b>TECHNICAL SPECIFICATION of VVVF drive for Elevator</b> | SPEC. NO. PE-TS-410-502-A001 |             |
|   | VOLUME II - B                |             |
|   | SECTION - C                  |             |
|   | DATE 02.05.2016              | SUB SECTION |
|   | SHEET                        | 3 OF 5      |

|                            |   |
|----------------------------|---|
| Maximum operating altitude | 1000 m without de-rating, 1000...3000 (shall be de-rated suitably)  |
| Max. Relative Humidity     | 95 %, without condensation and dripping water.  |
| Main Protections           | Over current, short circuit between phase, short circuit between phase and ground, input phase loss, output phase loss, motor overload, over speed, over voltage, under voltage, drive over temperature |

The AC Drive shall be able to give a 100 % output current continuously in the above specified conditions. In order to ensure that the drive can provide the required output current in the specified ambient conditions, the Manufacturer shall inform the required de-rating, if the ambient temperature given in the project-specific specification is higher than rated ambient of the drive or if the installation altitude is more than 1000 m above the sea level. The de-rating factor shall be specified so that neither the lifetime of the AC Drive nor the unit's performance, overload capability included, nor the reliability of the AC Drive shall suffer.

**Suitable encoder shall be provided for main hoist motion.**

### 3.0 User interface

#### 3.1 General

The user interface shall be identical throughout the power range and type to avoid confusion amongst the users and need for training in several different units.

#### 3.2 Inputs and outputs

A. At least, the following standard Inputs and Outputs shall be provided, to be used in interface with the control system:

|                 |   |   |
|-----------------|---|---|
| Analogue Inputs | : | 1 x Programmable differential voltage input $\pm 10V$ ,<br>1 x Programmable current input 0(4) - 20mA<br>1 x Programmable voltage input 0 – 10V |
| Analogue Output | : | 1 x Programmable analogue outputs 0(4) - 20mA or 0 – 10V  |
| Logic inputs    | : | 6 x Programmable logic Inputs isolated from the mains   |
| Relay Outputs   | : | 2 x Programmable Digital outputs with a changeover dry contact  |

All the control terminals shall be clearly marked.

B. At least, it shall be possible to assigned the following functions to the I/Os:



TITLE

**TECHNICAL SPECIFICATION of VVVF drive for  
Elevator**

SPEC. NO. PE-TS-410-502-A001

VOLUME II - B

SECTION - C

DATE 02.05.2016

SUB SECTION

SHEET

4 OF 5


| <b>Analogue input</b>  | <b>Analogue outputs</b>  |
|--|--|
| Speed reference<br>Summing reference   | Motor current<br>Motor frequency<br>Motor torque<br>Motor power  |
| <b>Logic input</b>   | <b>Relay or logic outputs (open collector)</b>   |
| Forward<br>Reverse<br>Jog<br>Preset speeds<br>Reference switching<br>Ramp switching<br>Parameter sets selection<br>Fast stop<br>Freewheel stop<br>+ speed<br>- speed<br>External fault | Ready<br>Drive running<br>High speed attained<br>Drive fault<br>Frequency threshold attained<br>Motor thermal state attained<br>Torque or current limitation attained<br>Brake control |

### 3.4 Programming terminal

- A. The AC drive shall have a keypad /display for programming and controlling purposes. An IP54 or IP65 remote mounting shall be possible at a distance of 10m.
- B. Password protection shall be provided to avoid unauthorized tampering with the set parameters.
- C. The programming terminal shall be able to display the commercial reference of the AC drive and of the options, the software version, the serial number
- D. Direct keypad entry shall be provided to observe the following actual parameters. Any one of the following parameters or actual values shall be selected to be always displayed:
- i) Input Voltage
  - ii) Input Frequency
  - iii) Output Frequency
  - iv) Output Power
  - v) Output Current
  - vi) Motor Speed

The following parameters shall always be displayed during normal operation:-

- i) Drive Status

|   |   |                              |             |
|---|---|------------------------------|-------------|
|  | TITLE   | SPEC. NO. PE-TS-410-502-A001 |             |
|   | <b>TECHNICAL SPECIFICATION of VVVF drive for<br/>Elevator</b> | VOLUME II - B                |             |
|   |   | SECTION - C                  |             |
|   |   | DATE 02.05.2016              | SUB SECTION |
|   |   | SHEET                        | 5 OF 5      |

- The following drive control functions at least shall be available from the keypad:-
- i) Run
  - ii) Stop
  - iii) Local / Remote selection.
  - iv) Forward/Reverse (if function enabled)
  - v) Accelerate
  - vi) Decelerate
  - vii) Parameter setting

### 3.5 Application programming

The AC Drive shall be designed for both simple and the most complicated applications, yet it shall be user friendly. It shall be possible to reset the parameter settings back to the original factory settings through the keypad.

### 3.6 PC Tools

The AC Drive Supplier shall have Windows based PC software available for monitoring and controlling the AC Drives, and the software shall be offered as an option. The software shall be supplied with the necessary hardware and a provision for connecting a PC with the AC Drives. It shall be possible to set and modify parameters, control the drive, read actual values and make trend analysis using the software.

## 4.0 Software features

### A. Restart

In the event of a fault trip due to over voltage, over current or loss of analogue signal, the AC DRIVE shall be programmable to attempt an automatic restart. For safety reasons, the maximum number of attempts shall be within a selectable time. If the fault does not clear after the attempts, the drive shall lock out.

### B. Brake logic control

The AC Drive shall have a built-in function to control a mechanical brake in order to move the load in a smooth and safe way. The brake logic control shall be adapted to the different movements: hoisting, travel, orientation.

## 5. Preferred makes:

Schneider Electric, L&T-YASKAWA, Siemens, ABB, Allen Bradley (Rockwell Automation).



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 1 OF 1**

**SECTION- E**  
**ANNEXURES**



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 1 OF 2**

**ANNEXURE-I  
LIST OF MAKES**

| <b>SR. NO.</b> | <b>ITEM</b>     | <b>SUPPLIERS</b>                             | <b>PLACE</b> | <b>REMARKS</b> |
|----------------|-----------------|--|--------------|----------------|
| 1.             | WIRE ROPES      | USHA MARTIN                                  | RANCHI       |                |
|                |                 | BHARAT WIRE ROPE                             | MUMBAI.      |                |
| 2.             | TRAILING CABLE  | GEBAU & GRILLER- AUSTRIA                     |              |                |
|                |                 | DAETWYLER (THELMA) CABLES- SWITZERLAND       | SWITZERLAND  |                |
|                |                 | LAPP   | GERMANY      |                |
|                |                 | UNIVERSAL                                    | -            |                |
|                |                 | INCABSTEP                                    | -            |                |
| 3.             | BUFFER SPRINGS  | INDUSTRIAL STEEL SPRING                      | -            |                |
|                |                 | ALL INDIA STEEL SPRING MANUFACTURING COMPANY | -            |                |
|                |                 | KOLKATA SHAW COMPANY                         | KOLKATA      |                |
|                |                 | SUPER INDIA SPRINGS                          | KOLKATA      |                |
|                |                 | MESCO SPRING.                                | MUMBAI.      |                |
| 4.             | GEAR INTERNALS  | PREMIUM ENERGY TRANSMISSION LTD,             | PUNE         |                |
|                |                 | SICOR S.P.A-                                 | ITLY         |                |
|                |                 | OEM  |              |                |
| 5.             | DRIVER MOTOR    | Seimens-                                     | MUMBAI       |                |
|                |                 | ABB  | FARIDABAD    |                |
|                |                 | BHARAT BIJILI                                | -            |                |
|                |                 | CGL  | -            |                |
|                |                 | KIRLOSKER                                    | -            |                |
| 6.             | STAINLESS STEEL | OEM  | -            |                |
|                |                 | SAIL,  | -            |                |
|                |                 | MINOX METAL,                                 | -            |                |
| 7.             | CR SHEET        | JINDAL                                       | -            |                |
|                |                 | ESSAR STEELS,                                | -            |                |
| 8.             | CABLES          | BHUSHAN STEELS                               | -            |                |
|                |                 | DELTON,                                      | -            |                |
|                |                 | NICCO  | -            |                |
|                |                 | UNIVERASL,                                   | -            |                |
|                |                 | FINOLEX,                                     | -            |                |
|                |                 | CCI  | -            |                |
|                |                 | MACROTHREM,                                  | -            |                |
|                |                 | VARSHA CABLES                                | -            |                |
|                |                 | KEI.   | -            |                |
|                |                 | PARAMOUNT                                    | -            |                |
| 9.             | RELAYS          | POLYCAB.                                     | -            |                |
|                |                 | SIEMENS                                      | -            |                |
|                |                 | SCHNEIDER TELEMECHANIQUE                     | -            |                |
|                |                 | SALZER,                                      | -            |                |



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 2 OF 2**

| <b>SR. NO.</b> | <b>ITEM</b>            | <b>SUPPLIERS</b>         | <b>PLACE</b> | <b>REMARKS</b> |
|----------------|------------------------|--------------------------|--------------|----------------|
|                |                        | SCHNIDER ELECTRIC.       | -            |                |
| <b>10.</b>     | CONTACTORS             | SIEMENS                  | -            |                |
|                |                        | L&T                      | -            |                |
|                |                        | GE                       | -            |                |
|                |                        | SCHNEIDER TELEMCHANIQUE. | -            |                |
| <b>11.</b>     | TRANSFORMERS           | SHARP ELECTRONICS        | -            |                |
|                |                        | MELCON CONTROLS          | CHENNAI      |                |
|                |                        | LOGITECH                 | -            |                |
|                |                        | GUNHAWA ELECTRIC CO LTD. | -            |                |
| <b>12.</b>     | INVERTOR (V3F)         | YASKAWA-                 | GERMANY      |                |
|                |                        | TOSHIBA                  | JAPAN.       |                |
| <b>13.</b>     | T GUIDES               | SAVERA                   | CHINA        |                |
|                |                        | D.D HITECH               | -            |                |
| <b>14.</b>     | CAR DOOR OPERATOR      | Wittur GMBH              | AUSTRIA      |                |
|                |                        | FERMATOR                 | -            |                |
|                |                        | OEM                      | -            |                |
| <b>15.</b>     | INFRA-RED DOOR CURTAIN | MEMCO                    | UK           |                |
|                |                        | WECO                     | -            |                |
|                |                        | TLJONES                  | -            |                |
| <b>16.</b>     | BATTERY (LEAD ACID)    | EXIDE.                   |              |                |
|                |                        | HBL POWER SYSTEM-        | HYDERABAD    |                |
|                |                        | AMAR RAJA                | TIRUPATI     |                |
|                |                        | AMCO SAFT INDIA LTD      | BANGALORE.   |                |

**NOTE:**

1. THE SUB VENDOR LIST ABOVE IS INDICATIVE ONLY AND IS SUBJECT TO BHEL AND CUSTOMER APPROVAL DURING DETAILED ENGINEERING STAGE WITHOUT ANY COMMERCIAL & DELIVERY IMPLICATION TO BHEL.

BIDDER TO PROPOSE SUB VENDOR WITHIN 4 WEEKS OF PLACEMENT OF LOI. THEREAFTER NO REQUEST FOR ADDITIONAL SUB-VENDOR SHALL BE ENTERTAINED.

2. IN CASE OF ASSEMBLED IMPORTED ELEVATOR, MAKES OF BOI SHALL BE SUBJECT TO BHEL/ CUSTOMER APPROVAL DURING DETAIL ENGINEERING STAGE WITHOUT ANY COMMERCIAL IMPLICATION AT CONTRACT STAGE.

3. DEALERS ARE NOT ACCEPTABLE FOR ANY ITEM OF THE PACKAGE. BIDDER SHALL PROCURE ALL ITEMS INCLUDING PLATES, STRUCTURAL ETC. FROM APPROVED SUB VENDOR ONLY.



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 1 OF 3**

**ANNEXURE-II**  
**MANDATORY SPARES**



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 2 OF 3**

**ANNEXURE-II**  
**List of Mandatory Spares for elevator.**

Capacity and type of elevator for TG building and Service building are same. Hence one set of spares common for TG building, and service building elevator shall be provided.

| <b>Sl. No.</b> | <b>DESCRIPTION</b>                                 | <b>Qty. for Two Unit</b>                                     | <b>Remark</b>        |
|----------------|--|--|----------------------|
| <b>1.1</b>     | <b>Control panel.</b>                              |  |                      |
| 1.1.1          | Copper Contactors                                  | 10 Nos. of each type/rating & size for each type of Elevator | <b>As applicable</b> |
| 1.1.2          | Carbon Contacts                                    | 10 Nos. of each type & size for each type of Elevator        |                      |
| 1.1.3          | Compression Spring                                 | 10 Nos. of each type & size for each type of Elevator        |                      |
| 1.1.4          | Interlocking switch                                | 10 Nos. of each type for each type of Elevator               |                      |
| 1.1.5          | Contactors   | 1 No. of each type for each type of Elevator                 |                      |
| 1.1.6          | Coils for contactors                               | 2 Nos. of each type for each type of Elevator                |                      |
| 1.1.7          | Relays   | 2 Nos. of each type & model for each type of Elevator        |                      |
| 1.1.8          | Relay Coils  | 10 Nos. of each type & model for each type of Elevator       |                      |
| 1.1.9          | Resistors  | 100% of total quantity In one elevator of each type          |                      |
| 1.1.10         | Capacitors   | 100% of total quantity In one elevator of each type          |                      |
| 1.1.11         | Suppressor Unit                                    | 100% of total quantity In one elevator of each type          |                      |
| 1.1.12         | Control Rectifier                                  | 1 No. of each type for each type of Elevator                 |                      |
| 1.1.13         | Impulse module                                     | 100% each type for each type of Elevator                     |                      |
| 1.1.14         | Electronic Control Card                            | 1 No. each Card for each type of Elevator                    |                      |
| <b>1.2</b>     | <b>Lift car.</b>                                   |  |                      |
| 1.2.1          | Fixed contact assembly                             | 6 Nos. each type & rating for each type of Elevator          |                      |
| 1.2.2          | Moving contact assembly                            | 6 Nos. each type & rating for each type of Elevator          |                      |
| 1.2.3          | Operating Lever                                    | 4 Nos. each type for each type of Elevator                   |                      |
| 1.2.4          | Roller & Type                                      | 5 Nos. each type for each type of Elevator                   |                      |
| 1.2.5          | Dry reed switch                                    | 1 No. each type for each type of Elevator                    |                      |
| 1.2.6          | Cam arrangement                                    | 1 No. each type for each type of Elevator                    |                      |
| 1.2.7          | Roller assembly                                    | 2 Nos. for each type of Elevator                             |                      |
| 1.2.8          | Set of Over Travel Limit Switch                    | 2 Sets for each type of Elevator                             |                      |
| <b>1.3</b>     | <b>Entrances</b>                                   |  |                      |
| 1.3.1          | Fixed contact assembly                             | 10 Nos. each type for each type of Elevator                  |                      |
| 1.3.2          | Moving contact assembly                            | 10 Nos. each type for each type of Elevator                  |                      |
| 1.3.3          | Lock arm assembly                                  | 10 Nos. each type for each type of Elevator                  |                      |
| 1.3.4          | Roller type  | 6 Nos. for each type of Elevator                             |                      |
| 1.3.5          | Landing push button station C/W push & cover plate | 10 Nos. each type for each type of Elevator                  |                      |
| <b>1.4</b>     | <b>Miscellaneous</b>                               |  |                      |
| 1.4.1          | Push button to suit car and landing push stations  | 12 Nos. each type for each type of Elevator                  |                      |
| 1.4.2          | indicator units to suit car and landing indicators | 12 Nos. each type for each type of Elevator                  |                      |
| 1.4.3          | Emergency battery unit                             | 2 Nos. for each type of Elevator                             |                      |
| <b>1.5</b>     | <b>Winding Unit</b>                                |  |                      |



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 3 OF 3**

|       |                                      |  |  |
|-------|--------------------------------------|--|--|
| 1.5.1 | Set of Brake shoe lining with rivets | 6 Sets each type for each type of Elevator   |  |
| 1.5.2 | Brake Coil                           | 2 Nos. for each type of Elevator   |  |
| 1.5.3 | Hoist Motors                         | 1 No. each type and rating for each type of Elevator                                 |  |
| 1.5.4 | Set of Bearings for all motors       | 1 Sets for each type of Elevator   |  |
| 1.5.5 | Micro switches                       | 2 Nos. each type for each type of Elevator   |  |
| 1.5.6 | Solenoids                            | 2 Nos. each type for each type of Elevator   |  |
| 1.5.7 | Trailing Cable                       | One set of full length of each size/type of cables as used for each type of Elevator |  |



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 1 OF 2**

**ANNEXURE-III**

# **LIST OF TOOLS AND TACKLES**



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 2 OF 2**

**ANNEXURE-III**

**List of Tools & tackles for elevator.**

| <b>Sl. No.</b> | <b>DESCRIPTION</b>                               | <b>Qty.</b> | <b>Remarks</b> |
|----------------|--|-------------|----------------|
| 1              | Spanner of all sizes required for maintenance    | 1 No.       |                |
| 2              | Adjustable Spanner                               | 1 No.       |                |
| 3              | Allen Key set all sizes required for maintenance | 1 No.       |                |
| 4              | Screw driver set                                 | 1 Set       |                |
| 5              | Cutting plier                                    | 1 No.       |                |
| 6              | Grease gun                                       | 1 No.       |                |
| 7              | Nose plier                                       | 1 No.       |                |
| 8              | Grip plier                                       | 1 No.       |                |
| 9              | Hook spanner                                     | 1 No.       |                |
| 10             | Box spanner                                      | 1 No.       |                |
| 11             | Oil can  | 1 No.       |                |
| 12             | Measurement Taps                                 | 1 No.       |                |
| 13             | Paint brush 1/4,1/2,3/4 inch                     | 1 No.       |                |
| 14             | Line tester                                      | 1 No.       |                |
| 15             | Multimeter                                       | 1 No.       |                |
| 16             | Soldering iron                                   | 1 No.       |                |
| 17             | Torch Light                                      | 1 No.       |                |
| 18             | Knife cutter                                     | 1 No.       |                |
| 19             | Steel rule                                       | 1 No.       |                |
| 20             | Wire Striper                                     | 1 No.       |                |
| 21             | Tube Spanner Combination                         | 1 No.       |                |
| 22             | Hammer 1/2 Kg                                    | 1 No.       |                |
| 23             | Dial rench                                       | 1 No.       |                |
| 24             | Other tools if any (Please specify)              |             |                |



**TITLE:**  
**TECHNICAL SPECIFICATION  
FOR  
ELEVATOR**

**SPEC. NO. PE-TS-410-502-A001**

**VOLUME IIB**

**SECTION C**

**SUB-SECTION**

**REV. 00**

**DATE: 02.05.2016**

**SHEET 1 OF 1**

## **ANNEXURE-IV**

### **Drawing document submission schedule**

| <b>S.NO.</b> | <b>Description</b>                          | <b>Schedule</b>                                    |
|--------------|---|--|
| 1            | First submission of dwg/<br>docs as per MDL | Within two (2) weeks from placement of LOI.        |
| 2            | Every repeat submission                     | Within one (1) week.                               |
| 3            | Response time by BHEL                       | Within three (3) weeks after receiving of drawing. |
|              |   |  |

#### **Note:**

- 1.0 The above are the minimum quantity of drawings/documents required. The exact requirement shall be informed to the successful bidder during detail engineering stage for which no commercial implication shall be entertained by BHEL.
- 2.0 Bidder to note that BHEL reserves the right for drawing/document submission through web based Document Management System. Bidder would be provided access to the DMS for drawing/document approval and adequate training for the same. Detailed methodology would be finalized during the kick-off meeting. Bidder to ensure following at their end.
  - Internet explorer version – Minimum Internet Explorer 7.
  - Internet speed – 2 mbps (Minimum preferred).
  - Pop ups from our external DMS IP (124.124.36.198) should not be blocked.
  - Vendor's internal proxy setting should not block DMS application's link (<http://124.124.36.198/wrenchwebaccess/login.aspx>).

ANNEXURE-1

DISTRIBUTION SCHEDULE

| S. No | Description                                   | TSGENCO           |                    |                                |                |               |                |               |                 | M/S DCPL, KOLKATA |     |      | Equipment Vendor | Remarks |
|-------|---|-------------------|--------------------|--------------------------------|----------------|---------------|----------------|---------------|-----------------|-------------------|-----|------|------------------|---------|
|       |   | Director Projects | Director Technical | CE/Civil Thermal Projects Hyd. | CE/ TPC-I, Hyd | CE/ O&M/ KTPS | SE/ Civil KTPS | SE/E&M / KTPS | DE Constr. KTPS | Kolkata           | HYD | KTPS |                  |         |
| A     | <b>Letter Of Intent or Contract Documents</b> | 1                 | 1                  | 1                              | S              | 1             | 2              | 2             | 1               | 1                 | 1   | 1    | 2                |         |
| B     | <b>Vendor Drawings</b>                        |                   |                    |                                |                |               |                |               |                 |                   |     |      |                  |         |
| 1.    | Preliminary                                   | 1                 | 1                  | 1                              | 2              | 1             | 1              | 2             | 2               | 12                | 1   | -    | S                |         |
| 2.    | Return preliminary with comments              | -                 | -                  | 1                              | 2              | 1             | 1              | 1             | 1               | S                 | 1   | -    | 1                |         |
| 3.    | Final and any revision thereof                |                   |                    |                                |                |               |                |               |                 |                   |     |      |                  |         |
|       | a. Civil                                      | 1                 | 1                  | 6+1T                           | 1              | 1             | 6+1T           | 1             | -               | 2+1T              | 1   | 1    | S                |         |
|       | b. E&M  | 1                 | 1                  | 1                              | 6+1T           | 1             | 1              | 6+1T          | 1               | 2+1T              | 1   | 1    | S                |         |
| C.    | <b>Design Drawings</b>                        |                   |                    |                                |                |               |                |               |                 |                   |     |      |                  |         |
| 1.    | Preliminary                                   |                   |                    |                                |                |               |                |               |                 |                   |     |      |                  |         |
|       | a. Civil                                      | 1                 | 1                  | 2                              | 1              | 1             | 2              | 1             | 1               | 4                 | 1   | 1    | S                |         |
|       | b. E&M  | 1                 | 1                  | 1                              | 2              | 1             | 1              | 2             | 1               | 4                 | 1   | 1    | S                |         |
| 2.    | Released for construction                     |                   |                    |                                |                |               |                |               |                 |                   |     |      |                  |         |
|       | a. Civil                                      | 1                 | 1                  | 2                              | 1              | 1             | 6              | 1             | 1               | 1                 | 1   | 2    | S                |         |
|       | b. E&M  | 1                 | 1                  | 1                              | 1              | 2             | 1              | 6             | 1               | 1                 | 1   | 2    | S                |         |
| 3.    | Return marked 'As built'                      |                   |                    |                                |                |               |                |               |                 |                   |     |      |                  |         |
|       | a. Civil                                      | -                 | -                  | 1                              | -              | -             | 1              | -             | -               | 1                 | 1   | S    | 1                |         |
|       | b. E&M  | -                 | -                  | -                              | 1              | -             | -              | 1             | 1               | 1                 | 1   | S    | 1                |         |
| 4.    | As built drawings                             |                   |                    |                                |                |               |                |               |                 |                   |     |      |                  |         |
|       | a. Civil                                      | -                 | -                  | 1+1T                           | -              | 2+1T          | 5+1T           | -             | 1               | 1+1T              | -   | 1    | S                |         |
|       | b. E&M  | -                 | -                  | 1                              | 2+1T           | 2+1T          | -              | 5+1T          | 1+1T            | 1+1T              | -   | 1    | S                |         |

| S. No | Description                         | TSGENCO           |                    |                                |                |               |                |               |                 | M/S DCPL, KOLKATA |     |      | Equipment Vendor | Remarks |
|-------|-------------------------------------|-------------------|--------------------|--------------------------------|----------------|---------------|----------------|---------------|-----------------|-------------------|-----|------|------------------|---------|
|       |                                     | Director Projects | Director Technical | CE/Civil Thermal Projects Hyd. | CE/ TPC-I, Hyd | CE/ O&M/ KTPS | SE/ Civil KTPS | SE/E&M / KTPS | DE Constr. KTPS | Kolkata           | HYD | KTPS |                  |         |
| D     | Progress Report Monthly             |                   |                    |                                |                |               |                |               |                 |                   |     |      |                  |         |
| 1.    | Equipment vendor                    | 1                 | 1                  | 1                              | 2              | 1             | 1              | 2             | 1               | 1                 | 1   | 1    | S                |         |
| 2.    | M/s DCPL, Kolkata                   | 1                 | 1                  | 2                              | 2              | 1             | 1              | 2             | 1               | S                 | 1   | 1    | Nil              |         |
| E     | Test & Inspection Reports           |                   |                    |                                |                |               |                |               |                 |                   |     |      |                  |         |
| 1.    | Equipment manufacturer              |                   |                    |                                |                |               |                |               |                 |                   |     |      |                  |         |
|       | a. Civil                            | 1                 | 1                  | 1                              | 2              | 1             | 1              | 1             | -               | 11                | 1   | 1    | S                |         |
| s     | b. E&M                              | 1                 | 1                  | -                              | 2              | 1             | -              | 1             | 1               | 11                | 1   | 1    | S                |         |
| 2.    | M/s DCPL, Kolkata                   | 1                 | 1                  | -                              | 2              | 1             | -              | 1             | 1               | S                 | -   | 1    | -                |         |
| F     | Instruction Manuals/Data Books      |                   |                    |                                |                |               |                |               |                 |                   |     |      |                  |         |
| 1.    | Equipment manufacturer              |                   |                    |                                |                |               |                |               |                 |                   |     |      |                  |         |
|       | a. Civil                            | 1                 | 1                  | 1+1T                           | 1              | 1             | 6+1T           | 1             | 1               | 2+1T              | 1   | 1    | S                |         |
|       | b. E&M                              | 1                 | 1                  | -                              | 3+1T           | 1             | -              | 6+1T          | 2               | 3+1T              | 1   | 1    | S                |         |
| 2.    | M/s DCPL, Kolkata                   | 1                 | 1                  | -                              | 10+1T          | 1             | -              | 15+1T         | -               | S                 | 1   | 1    | Nil              |         |
| G     | M/s DCPL, Kolkata Criteria          | 1                 | 1                  | 1                              | 8+1T           | 1             | 1              | 2             | 1               | 1                 | 1   | 1    | S                |         |
| H     | Design Calculations                 | 1                 | 1                  | 1                              | 8+1T           | 1             | 1              | 2             | 1               | 1                 | 1   | 1    | S                |         |
| I     | Final consulting Engineering Report | 1                 | 1                  | 1                              | 10             | 1             | 1              | 2             | 1               | S                 | 1   | 1    | Nil              |         |


S – Source, T – Transparency & Soft Copy on CD,

TSGENCO : Telangana State Power Generation Corporation Limited

Director, Projects, Hyd : Director/ Projects, TSGENCO, Vidut Soudha, Hyderabad – 500 082

**DEVELOPMENT CONSULTANTS**  
(e-PCT-TS-K-02-2014-15-Vol. IIA-6 Annx.docx)

V.IIA/S-6 Anx-1: 2

|   |   |                                      |                  |
|---|---|--------------------------------------|------------------|
|  | <b>TITLE</b><br><br><b>TECHNICAL SPECIFICATION</b><br><br><b>FOR</b><br><br><b>ELEVATOR</b> | SPEC. NO. PE – TS – 410 - 502 – A001 |                  |
|   |   | VOLUME III                           |                  |
|   |   | S. No.                               |                  |
|   |   | REV 0                                | DATE: 02.05.2016 |
|   |   | SHEET 1                              | OF 1             |

**ANNEXURE-V**

**MDL FOR ELEVATOR**

| S.NO. | BHEL DOC No        | TITLE   | PURPOSE |
|-------|--------------------|---|---------|
| 1     | PE-V0-410-502-A101 | TDS OF TG HALL ELEVATOR   | A       |
| 2     | PE-V0-410-502-A102 | TDS OF SERVICE BUILDING ELEVATOR  | A       |
| 3     | PE-V0-410-502-A001 | GA, M/C ROOM LAYOUT, SCOPE & BOM OF PASSENGER ELEVATOR (TG HALL)          | A       |
| 4     | PE-V0-410-502-A002 | GA, M/C ROOM LAYOUT, SCOPE & BOM OF PASSENGER ELEVATOR (SERVICE BUILDING) | A       |
| 5     | PE-V0-410-502-A003 | MQP FOR ELEVATOR (Common for TG hall and Service building)                | A       |
| 6     | PE-V0-410-502-A004 | O&M MANUAL FOR ELEVATOR (Common for TG hall and Service building)         | I       |

**FOR INFORMATION**

(Required to be submitted to BHEL for information/ review)

|   |                    |  |   |
|---|--------------------|--|---|
| 1 | PE-V0-410-502-A005 | WIRING DIAGRAM & POWER DISTRIBUTION SCHEMATIC          | I |
| 2 | PE-V0-410-502-A006 | MOTO & ROPE SIZING CALCULATION                         | I |
| 3 | PE-V0-410-502-A007 | COUNTER WT AND CAR & CWT GUIDE RAIL FORCES CALCULATION | I |

A= APPROVAL

I= INFORMATION

## ANNEXURE-VI

### Check List for Operation & Maintenance Manual

Project name :  
 Project number :  
 Package Name :  
 PO reference :  
 Document number :  
 Revision number :

| Sl.no. & Sections | Description   | Tick ( √ )if included in Manual |    |                | Remarks |
|-------------------|---|---------------------------------|----|----------------|---------|
|                   |   | Yes                             | No | Not Applicable |         |
| <b>1.</b>         | <b>Cover page</b>   |                                 |    |                |         |
| <b>1.1</b>        | Project Name  |                                 |    |                |         |
| <b>1.2</b>        | Customer/consultant Name  |                                 |    |                |         |
| <b>1.3</b>        | Name of Package   |                                 |    |                |         |
| <b>1.4</b>        | Supplier details with phone, FAX ,email address , Emergency Contact number  |                                 |    |                |         |
| <b>1.5</b>        | Name and sign of prepared by , checked by & approved by   |                                 |    |                |         |
| <b>1.6</b>        | Revision history with approval Details  |                                 |    |                |         |
| <b>2.0</b>        | <b>Index</b>  |                                 |    |                |         |
| <b>2.1</b>        | showing the sections & related page nos<br>All the pages should be numbered section wise  |                                 |    |                |         |
| <b>3.0</b>        | <b>Description of Plant/System</b>  |                                 |    |                |         |
| <b>3.1</b>        | Description /write up of operating principle of system equipment/ associated sub-systems & accessories/controls system , operating conditions, performance parameters under normal , start up and special cases |                                 |    |                |         |
| <b>3.2</b>        | Equipment list and basic parameter with Tag numbers   |                                 |    |                |         |
| <b>3.3</b>        | Data sheets approved by Customer/for information and catalogues provided by original manufacturer   |                                 |    |                |         |
| <b>3.4</b>        | Associated other packages and Interface /terminal points  |                                 |    |                |         |
| <b>3.5</b>        | P&ID & Process Diagrams   |                                 |    |                |         |
| <b>3.6</b>        | GA Layout drawings, As-built drawings , Actual photograph of items/system (Drawings of A2 & bigger sizes are to be attached in the last)  |                                 |    |                |         |
| <b>3.7</b>        | Single line/wiring diagrams   |                                 |    |                |         |
| <b>3.8</b>        | Control philosophy /control write-ups   |                                 |    |                |         |

|             |   |  |  |  |  |
|-------------|---|--|--|--|--|
| <b>4.0</b>  | <b>Commissioning Activities (if not covered in separate document i.e. erection manual, commissioning manual)</b>  |  |  |  |  |
| <b>4.1</b>  | Pre-Commissioning Checks  |  |  |  |  |
| <b>4.2</b>  | handling of items at site   |  |  |  |  |
| <b>4.3</b>  | Storage at site   |  |  |  |  |
| <b>4.4</b>  | Unpacking & Installation procedure  |  |  |  |  |
| <b>5.0</b>  | <b>Operation Guidelines for plant personal/user/operator</b>  |  |  |  |  |
| <b>5.1</b>  | Interlock & Protection logic along with the limiting values of protection settings for the equipment along with brief philosophy behind the logic, drawings etc. to be provided.  |  |  |  |  |
| <b>5.2</b>  | Start up, normal operation and shut down procedure for equipments along with the associated systems in step by step mode. Valve sequence chart, step list, interlocks etc. with Equipment isolating procedures to be mentioned. |  |  |  |  |
| <b>5.3</b>  | Do's & Don't of the equipments.   |  |  |  |  |
| <b>5.4</b>  | Safety precautions to be taken during normal operation. Safety symbols, Emergency instructions on total power failure condition/lubrication failure/any other condition   |  |  |  |  |
| <b>5.5</b>  | Parameters to be monitored with normal values and limiting values   |  |  |  |  |
| <b>5.6</b>  | Trouble shooting with causes and remedial measures  |  |  |  |  |
| <b>5.7</b>  | Routine operational checks, recommended logs & records  |  |  |  |  |
| <b>5.8</b>  | Changeover schedule if more than one auxiliary for the same purpose is given  |  |  |  |  |
| <b>5.9</b>  | Painting requirement and schedule   |  |  |  |  |
| <b>5.10</b> | Inspection, repair , Testing and calibration procedures   |  |  |  |  |
| <b>6.0</b>  | <b>Maintenance guidelines for plant personal</b>  |  |  |  |  |
| <b>6.1</b>  | List of Special Tools and Tackles required for Overhaul/Trouble shooting including special testing equipment required for calibration etc.  |  |  |  |  |
| <b>6.2</b>  | Stepwise dismantling and re-assembly procedure clearly specifying the tools to be used, checks to be made, records to be maintained, clearances etc. to be mentioned. Tolerances for fitment of various components to be given. |  |  |  |  |
| <b>6.3</b>  | Preventive Maintenance & Overhauling schedules linked with running hours/calendar period along with checks to be given  |  |  |  |  |

|             |  |  |  |  |  |
|-------------|--|--|--|--|--|
| <b>6.4</b>  | Long term maintenance schedules especially for structural, foundations etc.  |  |  |  |  |
| <b>6.5</b>  | Consumable list along with the estimated quantity required during commissioning, normal running and during maintenance like Preventive Maintenances and Overhaul. Storage/handling requirement of consumables/self-life. |  |  |  |  |
| <b>6.6</b>  | List of lubricants with their Indian equivalent, Lubrication Schedule, Quantity required for each equipment for complete replacement is to be given  |  |  |  |  |
| <b>6.7</b>  | List of vendors & Sub-vendors with their latest addresses, service centres ,Telephone Nos., Fax Nos., Mobile Nos., e-mail IDs etc.   |  |  |  |  |
| <b>6.8</b>  | List of mandatory and recommended spare parts list   |  |  |  |  |
| <b>6.9</b>  | Tentative Lead time required for ordering of spares from the equipment supplier  |  |  |  |  |
| <b>6.10</b> | Guarantee and warranty clauses   |  |  |  |  |
| <b>7.0</b>  | <b>Statutory and other specific requirements considerations.</b>   |  |  |  |  |
| <b>8.0</b>  | <b>List of reference documents</b>   |  |  |  |  |
| <b>9.0</b>  | <b>Binding as per requirement</b>  |  |  |  |  |

# SITE STORAGE AND PRESERVATION GUIDELINES

## FOR

### MECHNANICAL BOPs

(Doc No: PE-DC-SSG-A001 REV.00)



**PROJECT ENGINEERING MANAGEMENT, POWER SECTOR**  
**BHARAT HEAVY ELECTRICALS LIMITED-NOIDA**

## **CONTENT**

- 1 SCOPE OF THE DOCUMENT
- 2 PURPOSE OF STORAGE & PRESERVATION
- 3 MEASURES TO BE TAKEN FOR STORAGE AND PRESERVATION
  - a) GENERAL STORAGE REQUIREMENTS
  - b) GENERAL PRESERVATION REQUIREMENTS
  - c) GENERAL INSPECTION REQUIREMENTS
- 4 TYPE OF STORAGE FOR VARIOUS EQUIPMENT
5. CONCLUSION
6. STACKING ARRANGEMENT FOR PLATES AND STRUCTURAL STEEL

## **1. SCOPE OF THE DOCUMENT**

This guideline is prepared in intent to provide proper site storage and preservation of the Mechanical, Electrical and C & I items / equipment supplied under various bought out packages/items. This storage procedure shall be followed at different power plant sites by concerned agency for storage and preservation from the date of equipment received at site until the same are erected and handed over to the customer.

## **2. PURPOSE OF STORAGE & PRESERVATION**

Many of the items may be required to be kept in stores for long period. It shall therefore be essential that proper methods of storage and preservation be applied so that items do not deteriorate, loose some of their properties and become unusable due to atmospheric conditions and biological elements.

## **3. MEASURES TO BE TAKEN FOR STORAGE, HANDLING & PRESERVATION**

### **a) GENERAL STORAGE REQUIREMENTS**

1. To the extent feasible, materials should be stored near the point of erection. The storage areas should have adequate unloading and handling facilities with adequate passage space for movement of material handling equipment such as cranes, fork lift trucks, etc. The storage of materials shall be properly planned to minimise time loss during retrieval of items required for erection.
2. The outdoor storage areas as well as semi-closed stores shall be provided with adequate drainage facilities to prevent water logging. Adequacy of these facilities shall be checked prior to monsoon.
3. The storage sheds shall be built in conformity with fire safety requirements. The stores shall be provided with adequate lights and fire extinguishers. 'No smoking' signs shall be placed at strategic locations. Safety precautions shall be strictly enforced.
4. Adequate lighting facility shall be provided in storage areas and storage sheds and security personnel positioned to ensure enforcement of security measures to prevent theft and loss of materials.
5. Adequate number of competent stores personnel and security staff shall be deployed to efficiently store and maintain the equipment / material.
7. The equipment shall be stored in an orderly manner, preserving their identification slips, tags and instruction booklets, etc., required during erection. The storage of materials shall be equipment-wise. Loose parts shall be stored in sheds on racks,

preserving the identification marks and tags in good condition. The group codes shall be displayed on the racks

6. At no time shall any materials be stored directly on ground. All materials shall be stored minimum 200 mm above the ground preferably on wooden sleepers

**b) GENERAL PRESERVATION REQUIREMENTS**

1. All special measures to prevent corrosion shall be taken like keeping material in dry condition, avoiding the equipment coming in contact with corrosive fluid like water, acid etc.
2. Materials which carry protective coating shall not be wrapped in paper, cloth, etc., as these are liable to absorb and retain moisture. The material shall be inspected and in case of signs of wear or damages to protective coating, that portion shall be cleaned with approved solution and coated with an approved protective paint. Complete record of all such observations and protective measures taken shall be maintained.
3. Generally equipment supplied at site are properly greased or rust protective oil is applied on machined/ fabricated components. However periodic inspection shall be carried out to ensure that protection offered is intact.
4. While handling the equipment, no dragging on the ground is permitted. Avoid using wire rope for lifting coated components. Use polyester slings (if possible) otherwise protective material (e.g. clothes, wood block etc.) should be used while handling the components with rope / slings
5. For Equipment supplied with finished paint, touch paint shall be done in case any surface paint gets peeled off during handling. Otherwise such surfaces shall necessarily be wrapped with polythene to avoid any corrosion. Further for equipment wherein finish coat is to be applied at site, site to ensure that equipment is received with primer coat applied.
6. It shall be ensured by periodic inspection that plastic inserts are intact in tapped holes, wherever applicable.
7. Pipes shall be blown with air periodically and it shall be ensured that there is no obstruction.
8. Silica gel or approved equivalent moisture absorbing material in small cotton bags shall be placed and tied at various points on the equipment, wherever necessary.
9. Heavy rotating parts in assembled conditions shall be periodically rotated to prevent corrosion/jamming due to prolonged storage.

10. All the electrical equipment such as motors, generators, etc. shall be tested for insulation resistance at least once in three months and a record of such measured insulation values shall be maintained.
11. Following preservatives/preservation methods can be used depending upon type of equipment
  - a. Rust preventive fluid (RPF)
  - b. Rust protective paints
  - c. Tarpaulin covers, in case of outdoor storage
  - d. De-oxy aluminate for weld-ments

**c) GENERAL INSPECTION REQUIREMENTS**

1. Period inspection of materials with specific reference to –
  - Ingress of moisture and corrosion damages.
  - Damage to protective coating.
  - Open ends in pipes, vessels and equipment -
    - In case any open ends are noticed, same shall be capped.
2. Any damages to equipment / materials.
  - In case of any damages, these shall be promptly notified and in all cases, the repairs / rectification shall be carried out.
  - Any items found damaged or not suitable as per project requirements shall be removed from site. If required to store temporarily, they shall be clearly marked and stored separately to prevent any inadvertent use.

#### 4. TYPE OF STORAGE FOR VARIOUS EQUIPMENT

The types of storage are broadly classified under the following heads:

i **Closed storage with dry and dust free atmosphere. (C )**

The closed shed can be constructed by using cold-rolled / tubular components for structure and corrugated asbestos sheets / galvanised iron sheets for roofing. Brick walls / asbestos sheets can be used to cover all the sides. The floor of the shed can be finished with plain cement concrete suitably glazed. The shed shall be provided with proper ventilation and illumination.



ii **Semi-closed storage. (S)**

The semi closed shed can be constructed by using cold-rolled / tubular components for structure and corrugated / asbestos sheets for roofing. The floor shall be brick paved. If required a small portion of sides can be covered to protect components from rainwater splashing onto the components.





iii Open storage (O )

The open yard shall be levelled, well consolidated to achieve raised ground with the provision of feeder roads for crane approach along with access roads running all sides. One part of the open yard shall be stone pitched, levelled and consolidated with raised ground suitable for storing / stacking heavier and critical components with due space to handle them by cranes etc . Adequate number of sleepers, concrete block etc. to be provided to make raised platforms to stack critical materials.

A separate yard to be identified as “scrap yard” slightly away from main open yard to store wooden/steel scraps, which are to be disposed off. This is required to avoid mix up with regular components as well as to avoid fire hazard.

Some of the components, which are having both machined & un-machined surfaces and are bulky, shall be stored in open storage area on a raised ground and suitably covered with water proof / fire retardant tarpaulin.



The equipment listed below shall be stored and inspected as per requirement mentioned in the table below.

| Sl. No.  | Description of the equipment        | Type of Storage | Check for  | Remarks         |
|--|-------------------------------------|-----------------|--|-----------------|
| <b>Raw material /mechanical items like pipes, plates, structure sections etc.)</b> |                                     |                 |  |                 |
| 1.   | Steel pipes ( lined/unlined)        | S               | Damage , paint, corrosion, rubber lining peeling | Provide end cap |
| 2.   | MS Plates                           | S               | Damage, paint, corrosion                         |                 |
| 3.   | SS Plates                           | S               | Damage   |                 |
| 4.   | Non-metallic pipes                  | S               | Damage, cracks                                   | Provide end cap |
| 5.   | Stainless steel pipes               | S               | Damage ,   | Provide end cap |
| 6.   | MS sections, beams                  | S               | Damage, paint, corrosion                         |                 |
| 7.   | Cable trays                         | S               | Damage, condition of preservations               |                 |
| 8.   | Insulation sheets                   | S               | Damage   |                 |
| 9.   | Insulation                          | C               | Damage, packing                                  |                 |
| 10.  | Hangers Rods                        | S               | Damage, paint, packing                           |                 |
| 11.  | Tubes                               | S               | Damage, paint , packing                          | Provide end cap |
| 12.  | Hume pipes                          | O               | Damage   |                 |
| 13.  | Castings                            | O               | Damage, paint, corrosion                         |                 |
| <b>Fabricated mechanical items (pressure vessels, tanks etc.)</b>                  |                                     |                 |  |                 |
| 14.  | Pressure vessels (unlined)          | O               | Damage, paint, corrosion,                        | Covered nozzles |
| 15.  | Atmospheric storage tanks (unlined) | O               | Damage, paint, corrosion                         | Covered nozzles |

| Sl. No.   | Description of the equipment         | Type of Storage | Check for                               | Remarks         |
|---|--------------------------------------|-----------------|---|-----------------|
| 16.   | Pressure vessels (lined)             | S               | Damage, paint, corrosion, rubber lining |                 |
| 17.   | Atmospheric storage tanks(lined)     | S               | Damage, paint, corrosion, rubber lining |                 |
| 18.   | Support structures                   | O               | Damage , paint, corrosion               |                 |
| 19.   | Flanges                              | C               | Damage , paint, corrosion               |                 |
| 20.   | Fabricated pipes                     | S               | Damage , paint, corrosion               | Provide end cap |
| 21.   | Vessels internals                    | C               | Damage , paint, corrosion ,packing      |                 |
| 22.   | Grills                               | S               | Damage , paint, corrosion               |                 |
| 23.   | Angles                               | S               | Damage , paint, corrosion               |                 |
| 24.   | Bridge mechanism/clarifier mechanism | O               | Damage , paint, corrosion               |                 |
| 25.   | Cranes, rails                        | S               | Damage , paint, corrosion               |                 |
| 26.   | Stair cases                          | O               | Damage , paint, corrosion               |                 |
| 27.   | Ladders/handrails                    | O               | Damage , paint, corrosion               |                 |
| 28.   | Fabricated ducts                     | S               | Damage , paint, corrosion               |                 |
| 29.   | Isolation Gates                      | O               | Damage , paint, corrosion               |                 |
| 30.   | Fabricated boxes/panels              | S               | Damage , paint, corrosion               |                 |
| <b>Mechanical components like valves, fittings, cables glands, spares etc.)</b> |                                      |                 |   |                 |
| 31.   | Valves                               | S               | Damage , packing                        |                 |

| Sl. No.   | Description of the equipment         | Type of Storage | Check for                   | Remarks         |
|---|--------------------------------------|-----------------|-----------------------------|-----------------|
| 32.   | Fittings                             | S               | Damage , packing            | Provide end cap |
| 33.   | Cable glands                         | C               | Damage , packing            |                 |
| 34.   | Tools & tackles                      | C               | Damage , packing            |                 |
| 35.   | Nut , bolts, washers,                | C               | Damage , packing            |                 |
| 36.   | Gasket & Packings                    | C               | Damage , packing            |                 |
| 37.   | Copper tubes                         | C               | Damage , packing, corrosion | Provide end cap |
| 38.   | SS tubing                            | C               | Damage , packing            | Provide end cap |
| <b>Rotating assemblies (pumps, blowers, stirrers, fans, compressors etc.)</b> |                                      |                 |                             |                 |
| 39.   | Pumps                                | S               | Damage , packing, corrosion | Shaft rotation  |
| 40.   | Blowers/Compressors                  | S               | Damage , packing, corrosion | Shaft rotation  |
| 41.   | Agitators/stirrers/radial launders   | C               | Damage , packing, corrosion | Shaft rotation  |
| 42.   | Rollers for chlorine tonner mounting | C               | Damage , packing, corrosion |                 |
| 43.   | Centrifuge                           | S               | Damage , packing,           |                 |
| 44.   | Gear box                             | C               | Damage , packing, corrosion |                 |
| 45.   | Bearings                             | C               | Damage , packing, corrosion |                 |
| 46.   | Fans                                 | S               | Damage , packing, corrosion |                 |
| 47.   | Dosing skids                         | S               | Damage , packing, corrosion |                 |
| 48.   | Pump assemblies                      | S               | Damage , packing, corrosion |                 |
| 49.   | Air washers( INTERNALS)              | S               | Damage , packing            |                 |
| 50.   | Air conditioners ( split)            | C               | Damage , packing            |                 |

| Sl. No.  | Description of the equipment                     | Type of Storage                              | Check for                            | Remarks            |
|--|--|--|--------------------------------------|--------------------|
| 51.  | Elevators( CONTAINERIZED)                        | O  | Damage , packing, corrosion          |                    |
| 52.  | Chillers/VA machines                             | S  | Damage , packing                     |                    |
| 53.  | Air handling Unit/Package unit                   | S  | Damage , packing                     |                    |
| 54.  | Chlorinators & Evaporators                       | C  | Damage , packing                     |                    |
| 55.  | Ejectors   | C  | Damage , packing                     |                    |
| 56.  | Electrolyser                                     | C  | Damage , packing                     |                    |
| <b>Miscellaneous items like chain pulley blocks, hoists etc.</b>                               |  |  |                                      |                    |
| 57.  | Chain pulley blocks                              | S  | Damage, Packing                      |                    |
| 58.  | Electric hoists                                  | S  | Damage, Packing                      |                    |
| 59.  | Fire extinguishers                               | C  | Damage, expiry date                  |                    |
| 60.  | Fork Lift Truck                                  | S  | Damage, Packing                      |                    |
| 61.  | Hydraulic Mobile Crane                           | O  | Damage, Packing                      |                    |
| 62.  | Mobile Pick Up & Carry Crane                     | O  | Damage, Packing                      |                    |
| 63.  | Motor boats                                      | O  | Damage, Packing                      |                    |
| 64.  | Safety showers                                   | S  | Damage, Packing                      |                    |
| 65.  | Diffusers/dampers                                | S  | Damage, Packing                      |                    |
| <b>Chemicals and consumables ( acid, alkali, paints, oils, reagents and special chemicals)</b> |  |  |                                      |                    |
| 66.  | Hydro Chloric Acid (HCl)                         | Store in canes/<br>storage tank in dyke area | Date of production/<br>leakage/fumes | hazardous chemical |
| 67.  | Sulphuric acid (H <sub>2</sub> SO <sub>4</sub> ) | Store in canes/<br>storage tank in dyke area | Date of production/<br>leakage/fumes | hazardous chemical |

| Sl. No. | Description of the equipment     | Type of Storage                                 | Check for  | Remarks  |
|---------|----------------------------------|---|--|--|
| 68.     | Sodium hydroxide (NaOH)          | Store in canes/<br>storage tank in<br>dyke area | Date of production/<br>leakage/ fumes/<br>breather | hazardous<br>chemical<br>,breather to be<br>checked for air<br>ingress                                   |
| 69.     | Sodium hypo chlorite             | To be stored<br>under shed                      | Date of production/<br>leakage/ fumes              | hazardous<br>chemical ,self-life<br>normally 15-30<br>days after which<br>strength of<br>chemical decays |
| 70.     | Ammonia                          | S   | Date of production/<br>leakage/ fumes              | Store in closed<br>storage tanks,<br>hazardous<br>chemical   |
| 71.     | CW treatment chemicals           | S   | Date of production ,<br>Self-life                  | Store in closed<br>canes   |
| 72.     | RO/UF cleaning chemicals         | S   | Date of production ,<br>Self-life                  | Store in closed<br>canes   |
| 73.     | Lime                             | C   | Damage to packing ,<br>seepage                     | Prevent moisture,<br>rain  |
| 74.     | Alum bricks                      | C   | Damage to packing                                  | Prevent moisture,<br>rain  |
| 75.     | Poly electrolyte                 | S   |  | Store in closed<br>storage tanks   |
| 76.     | Laboratory chemicals(<br>powder) | C   | Damage, Packing self-<br>life                      |  |
| 77.     | Laboratory chemicals(<br>liquid) | C   | Damage, Packing self-<br>life                      |  |
| 78.     | Lubrication oils                 | C   | Leakage  |  |
| 79.     | Paints                           | S   | Leakage ,air tightness                             |  |
| 80.     | Sand                             | O   | Damage of packing                                  | No hooks   |
| 81.     | Salt (NaCl)                      | C   | Damage of packing,<br>water ingress                | Prevent moisture,<br>rain  |
| 82.     | Anthracite                       | S   | Damage of packing                                  |  |
| 83.     | Activated carbon                 | S   | Damage of packing                                  |  |

| Sl. No.   | Description of the equipment         | Type of Storage   | Check for         | Remarks                       |
|---|--------------------------------------|---|-------------------|-------------------------------|
| 84.   | Thermal insulation                   | S   | Damage of packing |                               |
| 85.   | Cement                               | C   | Damage of packing | Prevent moisture, rain        |
| 86.   | Gravels                              | O   | Damage of packing |                               |
| 87.   | ION exchange resins                  | C   | Damage , packing  | Refer manufacturer guidelines |
| 88.   | RO membranes                         | C   | Damage , packing  | Refer manufacturer guidelines |
| 89.   | UF membranes                         | C   | Damage , packing  | Refer manufacturer guidelines |
| 90.   | Cleaning chemicals                   | C   | Damage , packing  | Refer manufacturer guidelines |
| 91.   | Chemicals for analysers/calibration  | C   | Damage , packing  | Refer manufacturer guidelines |
| <b>Electrical and C &amp; I items (motors, cables etc.)</b> |                                      |   |                   |                               |
| 92.   | Motors                               | C   | Damage , packing  |                               |
| 93.   | Cable drums                          | O   | Damage            |                               |
| 94.   | Control Panel /control desk, UPS ,JB | S   | Damage, Packing   |                               |
| 95.   | Instruments( gauges/analysers)       | C   | Damage            |                               |
| <b>Special items</b>  |                                      | As per Manufacturer's item, like Hydrogen cylinders, Ozonator, Analyser, Chlorine dioxide generators etc. |                   |                               |

## **5. CONCLUSION**

Concerned storage agency at site should make sure that loss in equipment performance and wear & tear are minimised through proper storage and preservation. The above are broad guidelines and cover major equipment / materials. However specific storage practices shall be followed as per manufacturer recommendation. All the necessary measures even in addition to the ones mentioned above, if found necessary, should be taken to achieve the objective.

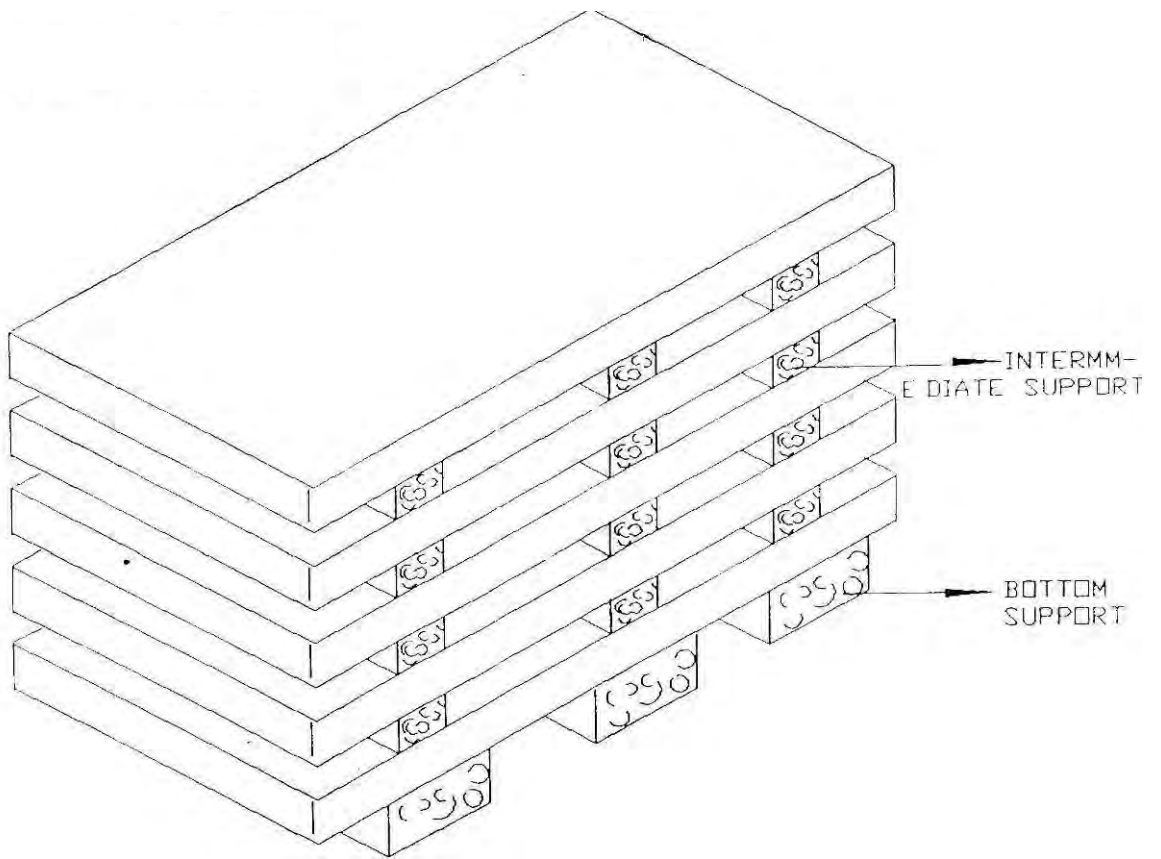


Figure - 1 - PLATE STACKING ARRANGEMENT

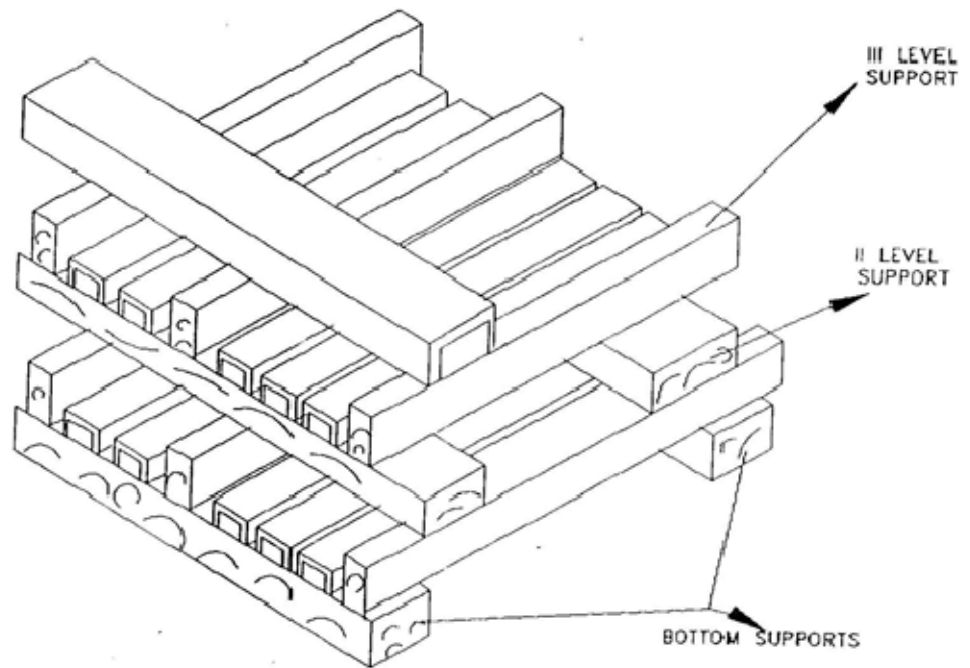


Figure - 2 - STRUCTURAL STEEL STACKING ARRANGEMENT

**CIVIL INPUT DETAILS.**

**Project:** 1 X 800 MW KOTHAGUDEM STPP.

**Job No.** 410


**PACKAGE:** ELEVATORS

Details of Elevator shaft well dimension as per IS: 14665 (all parts) is tabulated below.


| Building / Location | No. of elevator | Capacity of elevator (KG) | Type of elevator (Conventional / panoramic) | Type of service (Passenger Elevator / Passenger cum goods elevator / Goods cum passenger elevator) | Elevator shaft dimension (inside clear space over plaster) as per IS :14665 ( C X D) mm |      | Elevator shaft construction with  | Remarks   |
|---------------------|-----------------|---------------------------|---|--|---|------|---|---|
|                     |                 |                           |   |  | C   | D    |   |   |
| TG Building.        | 1 No.           | 1088                      | Conventional                                | Passenger Elevator   | 2500 (ENTRANCE)   | 2100 | Clay Brick or concrete with plastered and white washed shaft walls from inside. | As per manufacturer's recommendation, fly ash brick not to be used. |
| Service Building    | 1 No.           | 1088                      | Conventional                                | Passenger Elevator   | 2500 (ENTRANCE)   | 2100 |   |   |

**Note:**

1. Min height above M/c Room slab till M/c Room ceiling (below secondary roof beams) shall be 4.00 m.
2. Please note that Lift Well/Shaft dimensions furnished are as per IS 14665, Part-I. Further bidder to note that TOC of pit for all elevators shall be (-)1.6 m. RCC pedestals for buffers for car and counter weight(in pit) & traction machine (in machine room) and cutouts & pockets in machine room shall be furnished after finalization of order.
3. Shaft construction shall be done with RCC or clay bricks (230 mm thk) only, which shall be confirmed during contract stage.

|   |   |                                  |     |                 |
|---|---|----------------------------------|-----|-----------------|
|  | TITLE   | SPEC. PE – TS – 410 - 502 – A001 |     |                 |
|   | <b>TECHNICAL SPECIFICATION<br/>FOR<br/>ELEVATOR</b> | VOLUME                           | III |                 |
|   |   | SECTION                          |     |                 |
|   |   | REV                              | 0   | DATE 02.05.2016 |
|   |   | SHEET                            | 1   | OF 1            |

## Volume – III

|   |   |                                  |                 |
|---|---|----------------------------------|-----------------|
|  | <b>TITLE</b><br><br><b>TECHNICAL SPECIFICATION<br/>FOR<br/>ELEVATOR</b> | SPEC. PE – TS – 410 - 502 – A001 |                 |
|   |   | VOLUME III                       |                 |
|   |   | SECTION                          |                 |
|   |   | REV 0                            | DATE 02.05.2016 |
|   |   | SHEET OF                         |                 |

### Index

|   |   |
|---|---|
| 1 | List of documents to be submitted with bid.               |
| 2 | Compliance cum confirmation certificate                   |
| 3 | Pre Bid Clarification Schedule                            |
| 4 | Schedule of Technical Deviation /No Deviation Certificate |
| 5 | Electrical load list.                                     |

|   |       |                                  |     |                  |
|---|-------|----------------------------------|-----|------------------|
|  | TITLE | SPEC. PE – TS – 410 - 502 – A001 |     |                  |
|   |       | VOLUME                           | III |                  |
|   |       | SECTION                          |     |                  |
|   |       | REV                              | 0   | DATE: 02.05.2016 |
|   |       | SHEET                            | 1   | OF 1             |

**BIDDER HAS TO SUBMIT ONLY FOLLOWING DOCUMENTS ALONG WITH THE OFFER, FOR TECHNICAL EVALUATION OF THE BID:-**

- 1) Schedule of Technical Deviation ( if any)  
OR  
'NO DEVIATION CERTIFICATE' – Clearly mentioning that bidder has considered 'No - Deviation' from the technical specification provided by BHEL.
- 2) Signed and stamped copy of "Compliance cum confirmation certificate".
- 3) Unpriced format, duly mentioned '**Quoted**' against each Sl.no/ clause no.
- 4) Duly Signed and stamped copy of :
  - a) "Specific-Electrical Equipment Specification for elevator.
  - b) "Electrical Scope between BHEL and Vendor" sheet.
  - c) Compliance to /duly filled "Electrical Load Data" sheet.
  - d)
- 5) Signed and stamped copy of Supply price percentage break-up (enclosed with section- C1)

**Note 1:- Any other standard document/ details furnished by the bidder i.e. Data sheet / GA Drawing/ QAP etc. shall not be taken in to consideration for evaluation.**

**Note 2:- Bidder to note that if the bidder does not submit the documents mentioned in Sl. No. 1.0 to 4.0 along with their offer then their offer is liable to be rejected.**



TITLE:  
**TECHNICAL SPECIFICATION  
FOR ELEVATOR  
COMPLIANCE CUM CONFIRMATION  
CERTIFICATE**

SPEC. NO.: PE-TS-410-502-A001

VOLUME: III

S.No. A1

SECTION:

REV. NO. 0 DATE 02.05.2016

SHEET 1 OF 2

### **COMPLIANCE CUM CONFIRMATION CERTIFICATE**

The bidder shall confirm compliance with following by signing/ stamping this compliance certificates (every sheet) and furnishes same with the offer.

- a) The scope of supply, technical details, construction features, design parameters etc. shall be as per technical specification & there are no exclusions, other than those resolved as per 'Schedule of Deviations', with regard to same.
- b) There are no other deviations w.r.t. specifications other than those furnished in the 'Schedule of Deviations'. Any other deviation, stated or implied, taken elsewhere in the offer stands withdrawn unless specifically brought out in the 'Schedule of Deviations'
- c) Bidder shall submit QP in the event of order based on the guidelines given in the specification & QP enclosed therein. QP will be subject to BHEL/ CUSTOMER approval & customer hold points for inspection / testing shall be marked in the QP at the contract stage. Inspection/ testing shall be witnessed as per same apart from review of various test certificates / Inspection records etc. This is within the contracted price with extra implications to BHEL after award of the contract.
- d) All drawings / data-sheets / calculations etc. submitted along with the offer shall be considered for reference only, same shall be subject to BHEL/ CUSTOMER approval in the event of order.
- e) The offered materials shall be either equivalent or superior to those specified in the specification & shall meet the specified / intended duty requirements. In case the material specified in the specifications is not compatible for intended duty requirements then same shall be resolved by the bidder with BHEL during the pre-bid discussions, otherwise BHEL/ Customer's decision shall be binding on the bidder whenever the deficiency is pointed out.

For components where materials are not specified, same shall be suitable for intended duty, all materials shall be subject to approval in the event of order.

- f) The commissioning spares shall be supplied on 'As Required Basis' & prices for same included in the base price itself. Prices for special tools & tackles, if any, shall also be included in the base price.
- g) All sub vendors shall be subject to BHEL/ CUSTOMER approval in the event of order.
- h) Guarantee for plant /equipment shall be as per relevant clause of GCC /SCC /Other Commercial Terms & Conditions.
- i) In the event of order, all the material required for completing the job at site shall be supplied by the bidder within the ordered price even if the same are additional to approved billing break up, approved drawing or approved Bill of quantities. This clause will apply in case during site commissioning additional requirements emerges due to customer and / or consultant's comments. No extra claims shall be put on this account.
- j) Schedule of drawings submissions, comment incorporations & approval shall be as stipulated in the specifications. The successful bidder shall depute his design personnel to BHEL's/ Customer's/ Consultant's office for across the table resolution of issues and to get documents approved in the stipulated time.



TITLE:  
**TECHNICAL SPECIFICATION  
FOR ELEVATOR  
COMPLIANCE CUM CONFIRMATION  
CERTIFICATE**

SPEC. NO.: PE-TS-410-502-A001

VOLUME: III

S.No. A1

SECTION:

REV. NO. 0      DATE 02.05.2016

SHEET 2 OF 2

- k) As built drawings shall be submitted as and when required during the project execution.
- l) That the bidder has not tempered with this compliance cum confirmation certificate and if at any stage any tempering in the signed copy of this document is noticed then same shall be treated as breach of contract and suitable actions shall be taken against the bidder.



**DEVIATION SHEET (COST OF WITHDRAWAL)****PROJECT:- 1X800 MW KOTHAGUDEM STPP.****PACKAGE:- ELEVATOR****TENDER ENQUIRY REFERENCE:-****NAME OF VENDOR:-**

| SL NO | VOULME/ SECTION | PAGE NO. | CLAUSE NO. | TECHNICAL SPECIFICATION/ TENDER DOCUMENT | COMPLETE DESCRIPTION OF DEVIATION | COST OF WITHDRAWAL OF DEVIATION | REFERENCE OF PRICE SCHEDULE ON WHICH COST OF WITHDRAWAL OF DEVIATION IS APPLICABLE | NATURE OF COST OF WITHDRAWAL OF DEVIATION (POSITIVE/ NEGATIVE) | REASON FOR QUOTING DEVIATION |
|-------|-----------------|----------|------------|--|-----------------------------------|---------------------------------|--|--|------------------------------|
|-------|-----------------|----------|------------|--|-----------------------------------|---------------------------------|--|--|------------------------------|

**TECHNICAL DEVIATIONS**

|  |  |  |  |  |  |  |  |  |  |
|--|--|--|--|--|--|--|--|--|--|
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |

**COMMERCIAL DEVIATIONS**

|  |  |  |  |  |  |  |  |  |  |
|--|--|--|--|--|--|--|--|--|--|
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |
|  |  |  |  |  |  |  |  |  |  |

**PARTICULARS OF BIDDERS/ AUTHORISED REPRESENTATIVE**

| NAME | DESIGNATIONS | SIGN & DATE |
|------|--------------|-------------|
|------|--------------|-------------|

**NOTES:**

- For self manufactured items of bidder, cost of withdrawal of deviation will be applicable on the basic price (i.e. excluding taxes, duties & freight) only.
- For directly dispatchable items, cost of withdrawal of deviation will be applicable on the basic price including taxes, duties & freight.
- All the bidders have to list out all their Technical & Commercial Deviations (if any) in detail in the above format.
- Any deviation not mentioned above and shown separately or found hidden in offer, will not be taken cognizance of.
- Bidder shall submit duly filled unpriced copy of above format indicating "quoted" in "cost of withdrawal of deviation" column of the schedule above along with their Techno-commercial offer, wherever applicable.
- Bidder shall furnish price copy of above format along with price bid.
- The final decision of acceptance/ rejection of the deviations quoted by the bidder shall be at discretion of the Purchaser.
- Bidders to note that any deviation (technical/commercial) not listed in above and asked after Part-I opening shall not be considered.
- For deviations w.r.t. Payment terms, Liquidated damages, Firm prices and submission of E1/ E2 forms before claiming 10% payment, if a bidder chooses not to give any cost of withdrawal of deviation loading as per Annexure-VIII of GCC, Rev-06 will apply. For any other deviation mentioned in un-priced copy of this format submitted with Part-I bid but not mentioned in priced copy of this format submitted with Priced bid, the cost of withdrawal of deviation shall be taken as NIL.
- Any deviation mentioned in priced copy of this format, but not mentioned in the un-priced copy, shall not be accepted.
- All techno-commercial terms and conditions of NIT shall be deemed to have been accepted by the bidder, other than those listed in unpriced copy of this format.
- Cost of withdrawal is to be given separately for each deviation. In no event bidder should club cost of withdrawal of more than one deviation else cost of withdrawal of such deviations which have been clubbed together shall be considered as NIL.
- In case nature of cost of withdrawal (positive/negative) is not specified it shall be assumed as positive.
- In case of discrepancy in the nature of impact (positive/ negative), positive will be considered for evaluation and negative for ordering.

| LOAD TITLE | RATING (KW) |                         | UNIT (U)/STN (S) | Nos.    |         | VOLTAGE CODE* | FEEDER CODE** | EMER. LOAD (Y) | CONT.(C)/INTT.(I) | STARTING TIME >5 SEC (Y) | LOCATION | BOARD NO. | CABLE     |     | BLOCK CABLE DRG. No. | CONTROL CODE | REMARKS | LOAD No. |
|------------|-------------|-------------------------|------------------|---------|---------|---------------|---------------|----------------|-------------------|--------------------------|----------|-----------|-----------|-----|----------------------|--------------|---------|----------|
|            | NAME PLATE  | MAX. CONT. DEMAND (MCR) |                  | RUNNING | STANDBY |               |               |                |                   |                          |          |           | SIZE CODE | NOs |                      |              |         |          |
| 1          | 2           | 3                       | 4                | 5       | 6       | 7             | 8             | 9              | 10                | 11                       | 12       | 13        | 14        | 15  | 16                   | 17           | 18      | 19       |

**TG HALL ELEVATOR**

|   |  |      |   |   |   |   |   |   |   |  |                               |  |  |  |  |  |  |  |
|---|--|------|---|---|---|---|---|---|---|--|-------------------------------|--|--|--|--|--|--|--|
| ELEVATOR MOTOR  |  | 16.5 | S | 1 | 0 | D | S | - | C |  | TG HALL Elevator Machine room |  |  |  |  |  |  |  |
| 2 T A/C FOR TG HALL M/C ROOM AND LIGHTING FOR ELEVATOR M/C ROOM & SHAFT AND MAINTENANCE AND INSTALLATION REQUIREMENT. |  | 7    | S | 1 | 0 | D | S | - | C |  | TG HALL Elevator Machine room |  |  |  |  |  |  |  |

**SERVICE BUILDING ELEVATOR**

|  |  |      |   |   |   |   |   |   |   |  |  |  |  |  |  |  |  |  |
|--|--|------|---|---|---|---|---|---|---|--|--|--|--|--|--|--|--|--|
| ELEVATOR MOTOR   |  | 16.5 | S | 1 | 0 | D | S | - | C |  | Service Building Elevator Machine room |  |  |  |  |  |  |  |
| 2 T A/C FOR SERVICE BUILDING ELEVATOR M/C ROOM AND LIGHTING FOR ELEVATOR M/C ROOM & SHAFT AND MAINTENANCE AND INSTALLATION REQUIREMENT |  | 7    | S | 1 | 0 | D | S | - | C |  | Service Building Elevator Machine room |  |  |  |  |  |  |  |

**Note:**

- 1) No other single phase or 3 phase supply shall be provided for elevator erection / operation etc.
- 2) Only two (3 phase) supply feeders per elevator shall be provided one feeder shall be dedicated to elevator motor and other 3 phase supply feeder shall be provided by BHEL for air conditioner, machine room and shaft lighting and maintenance / installation requirement. Bidder to consider CT in their scope for stepping down the voltage as per their requirement.


*Bidder to note: Feeder of indicated rating shall be provided by BHEL. If motor rating is lesser than the provided feeder rating, bidder shall provide protection against over current*

**NOTES:** 1. COLUMN 1 TO 12 & 18 SHALL BE FILLED BY THE REQUISITIONER (ORIGINATING AGENCY); REMAINING COLUMNS ARE TO BE FILLED UP BY PEM (ELECTRICAL)  
2. ABBREVIATIONS : \* VOLTAGE CODE (7):- (ac) A=11 KV, B=6.6 KV, C=3.3 KV, D=415 V, E=240 V (1 PH), F=110 V (DC): G=220 V, H=110 V, J=48 V, K=+24V, L=-24 V  
: \*\* FEEDER CODE (8):- U=UNIDIRECTIONAL STARTER, B=BI-DIRECTIONAL STARTER, S=SUPPLY FEEDER, D=SUPPLY FEEDER (CONTACTER CONTROLLED)



**LOAD DATA (ELECTRICAL)**

|                  |                          |                    |                   |                   |  |
|------------------|--------------------------|--------------------|-------------------|-------------------|--|
| JOB NO.          | 410                      | ORIGINATING AGENCY |                   | PEM (ELECTRICAL)  |  |
| PROJECT TITLE    | 1X800 MW KOTHAGUDEM TPP. | NAME               | DATA FILLED UP ON |                   |  |
| SYSTEM / S       | ELEVATOR                 | SIGN.              | DATA ENTERED ON   |                   |  |
| DEPTT. / SECTION | MAUX / M                 | SHEET 1 OF 1       | REV. 00           | DE'S SIGN. & DATE |  |

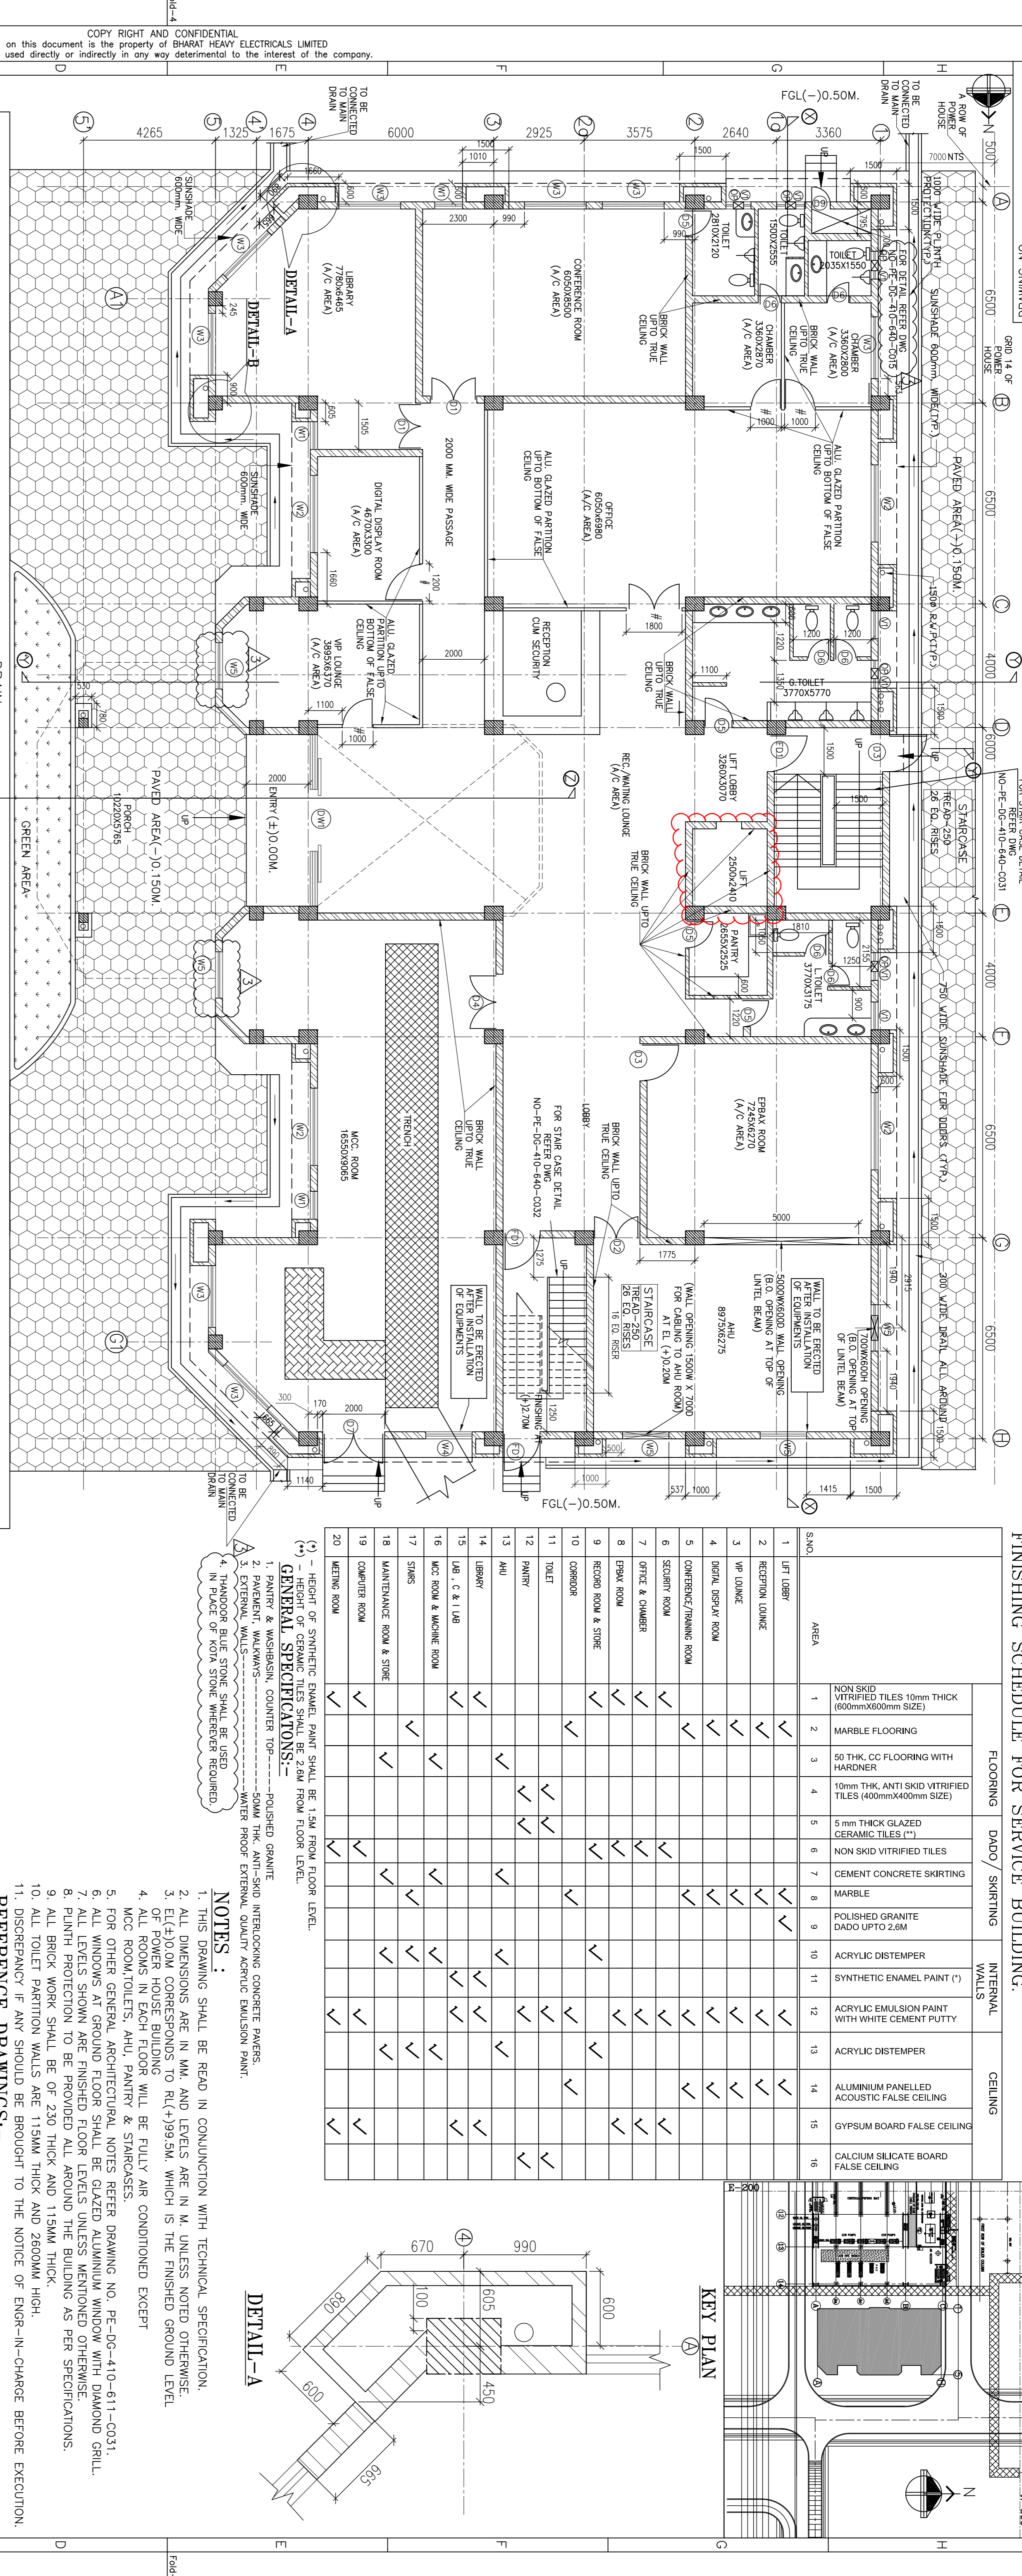

| S.NO. | AREA                     | 1  | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 |
|-------|--------------------------|--|---|---|---|---|---|---|---|---|----|----|----|----|----|----|----|
| 1     | LIFT LOBBY               | NON SKID VITRIFIED TILES 10mm THICK (600mmx600mm SIZE)         | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 2     | RECEPTION LOUNGE         | MARBLE FLOORING  | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 3     | VP LOUNGE                | 50 THK. CC FLOORING WITH HARDNER                               | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 4     | DIGITAL DISPLAY ROOM     | 10mm THK. ANTI SKID VITRIFIED CERAMIC TILES (400mmx400mm SIZE) | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 5     | CONFERENCE/TRAINING ROOM | 5 mm THICK GLAZED CERAMIC TILES (")                            | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 6     | SECURITY ROOM            | NON SKID VITRIFIED TILES                                       | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 7     | OFFICE & CHAMBER         | CEMENT CONCRETE SKIRTING                                       | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 8     | BRAX ROOM                | MARBLE   | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 9     | RECORD ROOM & STORE      | POLISHED GRANITE DADO UP TO 2.6M                               | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 10    | CORRIDOR                 | ACRYLIC DISTEMPER  | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 11    | TOILET                   | SYNTHETIC ENAMEL PAINT (")                                     | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 12    | PANTRY                   | ACRYLIC EMULSION PAINT WITH WHITE CEMENT PUTTY                 | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 13    | AHU                      | ACRYLIC DISTEMPER  | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 14    | LIBRARY                  | MARBLE   | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 15    | LAB. C & I LAB           | POLISHED GRANITE   | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 16    | MCC ROOM & MACHINE ROOM  | ACRYLIC EMULSION PAINT WITH WHITE CEMENT PUTTY                 | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 17    | STAIRS                   | ACRYLIC DISTEMPER  | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 18    | MAINTENANCE ROOM & STORE | ALUMINIUM PANALLED ACOUSTIC FALSE CEILING                      | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 19    | COMPUTER ROOM            | GYPSUM BOARD FALSE CEILING                                     | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |
| 20    | WATERING ROOM            | CALCIUM SILICATE BOARD FALSE CEILING                           | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  | ✓  |

**GENERAL SPECIFICATIONS:-**

- PAINTS & WASHBASIN, COUNTER TOP-----POLISHED GRANITE
- PANTRY, WALKWAYS-----50MM THK. ANTI-SKID INTERLOCKING CONCRETE PAVERS.
- EXTERNAL WALLS-----WATER PROOF EXTERNAL QUALITY ACRYLIC EMULSION PAINT.
- THANNOOR BLUE STONE SHALL BE USED IN PLACE OF KOTA STONE WHEREVER REQUIRED.

**NOTES:**

- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH TECHNICAL SPECIFICATION.
- ALL DIMENSIONS ARE IN MM. AND LEVELS ARE IN M. UNLESS NOTED OTHERWISE.
- EL(+0.00) CORRESPONDS TO RL(+99.5M. WHICH IS THE FINISHED GROUND LEVEL OF POWER HOUSE BUILDING.
- ALL ROOMS IN EACH FLOOR WILL BE FULLY AIR CONDITIONED EXCEPT MCC ROOM, TOILETS, AHU, PANTRY & STAIRCASES.
- FOR OTHER GENERAL ARCHITECTURAL NOTES REFER DRAWING NO. PE-DG-410-611-C031.
- ALL WINDOWS AT GROUND FLOOR SHALL BE GLAZED ALUMINIUM WINDOW WITH DIAMOND GRILL.
- ALL LEVELS SHOWN ARE FINISHED FLOOR LEVELS UNLESS MENTIONED OTHERWISE.
- PLUMB PROTECTION TO BE PROVIDED ALL AROUND THE BUILDING AS PER SPECIFICATIONS.
- ALL BRICK WORK SHALL BE OF 230 THK THICK AND 115MM THICK.
- ALL TOILET PARTITION WALLS ARE 115MM THICK AND 2600MM HIGH.
- DISCREPANCY IF ANY SHOULD BE BROUGHT TO THE NOTICE OF ENGR-IN-CHARGE BEFORE EXECUTION.

**REFERENCE DRAWINGS:-**

1. PLOT PLAN-----PE-DG-410-100-M001
2. ARCH. PLAN AT EL.+4.25M-----PE-DG-410-640-C002
3. ARCH. PLAN AT EL.+8.50M-----PE-DG-410-640-C003
4. ARCH. PLAN AT EL.+12.75M-----PE-DG-410-640-C004
5. ARCH. PLAN AT EL.+17.00M-----PE-DG-410-640-C005
6. ARCH. PLAN AT EL.+21.25M-----PE-DG-410-640-C006
7. ARCH. WEST ELEVATION-----PE-DG-410-640-C007
8. ARCH. EAST ELEVATION-----PE-DG-410-640-C009
9. ARCH. NORTH ELEVATION-----PE-DG-410-640-C011
10. ARCH. SOUTH ELEVATION-----PE-DG-410-640-C012
11. DETAIL OF STAIR CASE 1-----PE-DG-410-640-C031
12. DETAIL OF STAIR CASE 2-----PE-DG-410-640-C032
13. ARCH SERVICE BLDG SECTION X-X-----PE-DG-410-640-C008
14. ARCH SERVICE BLDG SECTION Y-Y-----PE-DG-410-640-C010
15. SERVICE BLDG. WINDOWS DETAILS-----PE-DG-410-640-C013
16. SERVICE BLDG. DOOR & PARTITIONS DETAILS-----PE-DG-410-640-C014
17. SERVICE BLDG. TOILET DETAILS-----PE-DG-410-640-C015

**RELEASED FOR CONSTRUCTION**

(DESIGN IS APPROVED IN ACCORDANCE WITH THE TRANSMITTAL NO. 13406/0CH-5/0610 DATED 28.09.2015)

BHEL-PROJECT ENGINEERING MANAGEMENT(CIVIL)

THIS DRAWING MARKED (✓) IS RELEASED FOR

COMMENTS/ APPROVAL

PLANNING/ INFORMATION

CONSTRUCTION

STAMP ALL PREVIOUS REVISION AS SUPERSEDED

ISSUED BY: ANIL KHANDELWAL

SIGNATURE: \_\_\_\_\_

DATE: 21 October 2015

**LEGEND**

PLASTER  
 THK. THICKNESS  
 TYP. TYPE  
 BL. BLOCK  
 FL. FLOOR FINISH LEVEL  
 RWP. RAW WATER PIPE

PLASTER  
 THK. THICKNESS  
 TYP. TYPE  
 BL. BLOCK  
 FL. FLOOR FINISH LEVEL  
 RWP. RAW WATER PIPE

**DETAIL - A**

7.0 M WIDE ROAD (N/S)

600  
 230  
 900  
 600

**DETAIL - B**

900  
 230  
 900  
 600

**DOORS AND WINDOWS SCHEDULE**

| S.NO. | TYPE | SIZE      | SILL/VAL. | INTEL/VEL. | REMARKS  |
|-------|------|-----------|-----------|------------|--|
| 1.    | D1   | 1500X2300 | ---       | 2500       | DOUBLE SHUTTER ALUMINIUM GLAZED DOOR WITH 6MM THK TOUGHENED FLOAT GLASS          |
| 2.    | D2   | 1500X2300 | ---       | 2500       | DOUBLE SHUTTER ALUMINIUM GLAZED DOOR WITH 6MM THK TOUGHENED FLOAT GLASS          |
| 3.    | D3   | 1200X2300 | ---       | 2500       | SINGLE SHUTTER ALUMINIUM GLAZED DOOR WITH 6MM THK TOUGHENED FLOAT GLASS          |
| 4.    | D4   | 1800X2300 | ---       | 2500       | DOUBLE SHUTTER HOLLOW METAL FLUSH DOOR   |
| 5.    | D5   | 900X2500  | ---       | 2500       | SINGLE SHUTTER WOODEN PANEL DOOR WITH HARD WOOD FRAME                            |
| 6.    | D6   | 750X2500  | ---       | 2500       | SINGLE SHUTTER SOLID CORE PVC DOOR   |
| 7.    | D7   | 2000X3000 | ---       | 3000       | DOUBLE SHUTTER HOLLOW METAL FLUSH DOOR WITH 2100 OPENABLE & 900 HIGH TRANSOM     |
| 8.    | D8   | 1200X2300 | ---       | 2500       | SINGLE SHUTTER HOLLOW METAL FLUSH DOOR   |
| 9.    | D9   | 600X2300  | ---       | 2500       | SINGLE SHUTTER ALUMINIUM GLAZED DOOR WITH 6MM THK TOUGHENED FLOAT GLASS          |
| 10.   | D10  | 1000X2300 | ---       | 2500       | SINGLE SHUTTER ALUMINIUM GLAZED DOOR WITH 6MM THK TOUGHENED FLOAT GLASS          |
| 11.   | D11  | 1200X2300 | ---       | 2500       | SINGLE SHUTTER FIRE RATED DOOR   |
| 12.   | D12  | 5500X2700 | ---       | 2700       | SENSOR OPERATED ALUMINIUM GLAZED SLIDING DOOR WITH 6MM THK TOUGHENED FLOAT GLASS |
| 13.   | D13  | 5500X2700 | ---       | 2700       | SENSOR OPERATED ALUMINIUM GLAZED SLIDING DOOR WITH 6MM THK TOUGHENED FLOAT GLASS |
| 14.   | D14  | 5000X2400 | ---       | 2700       | ANODIZED ALUMINIUM FRAME FIXED GLAZED WITH 6MM THK TOUGHENED FLOAT GLASS         |

**REVISIONS**

| REV. | DATE                       | BY   | CHKD       | APPD | REV. | DATE                       | BY   | CHKD       | APPD |
|------|----------------------------|------|------------|------|------|----------------------------|------|------------|------|
| 1.   | 21.10.15                   | USHA | P.G.       | S.B. | 1.   | 14.9.15                    | USHA | P.G.       | S.B. |
| 2.   | 28.09.2015                 | AS   | AS         | AS   | 2.   | 22.07.2015                 | AS   | AS         | AS   |
| 3.   | 13.06/0CH-4/02/28          | DATE | 18/05/2015 |      | 2.   | 13.06/0CH-4/02/28          | DATE | 18/05/2015 |      |
| 4.   | RELEASED FOR CONSTRUCTION. |      |            |      | 3.   | RELEASED FOR CONSTRUCTION. |      |            |      |

**PROJECT INFORMATION**

PROJECT: KOTHA GUDDEM THERMAL POWER STATION  
 STAGE-VII, UNIT # 12 (1X800 MW)

CONSULTANT: TELANGANA STATE POWER GENERATION CORPORATION LTD.  
 HYDERABAD

DEVELOPMENT CONSULTANTS PVT. LTD.  
 CONSULTING ENGINEERS  
 KOLHATA WEMBA CHEMUN NEW DELHI

CLIENT: BHARAT HEAVY ELECTRICALS LTD.  
 POWER SECTOR  
 PROJECT ENGINEERING MANAGEMENT  
 NEW DELHI

DESIGNER: RAJENDRA  
 CHECKER: PARUL  
 APPROVER: SANJU  
 DATE: 08.04.2015  
 DATE: 08.04.2015  
 DATE: 08.04.2015

