



FIRST ANGLE PROJECTION (ALL DIMENSIONS ARE IN MM)

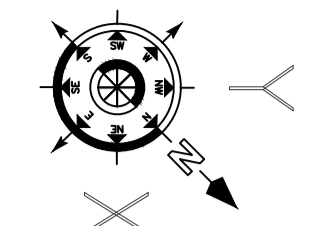

X=-37.5M, Y=-387M

X=37.5M, Y=538M

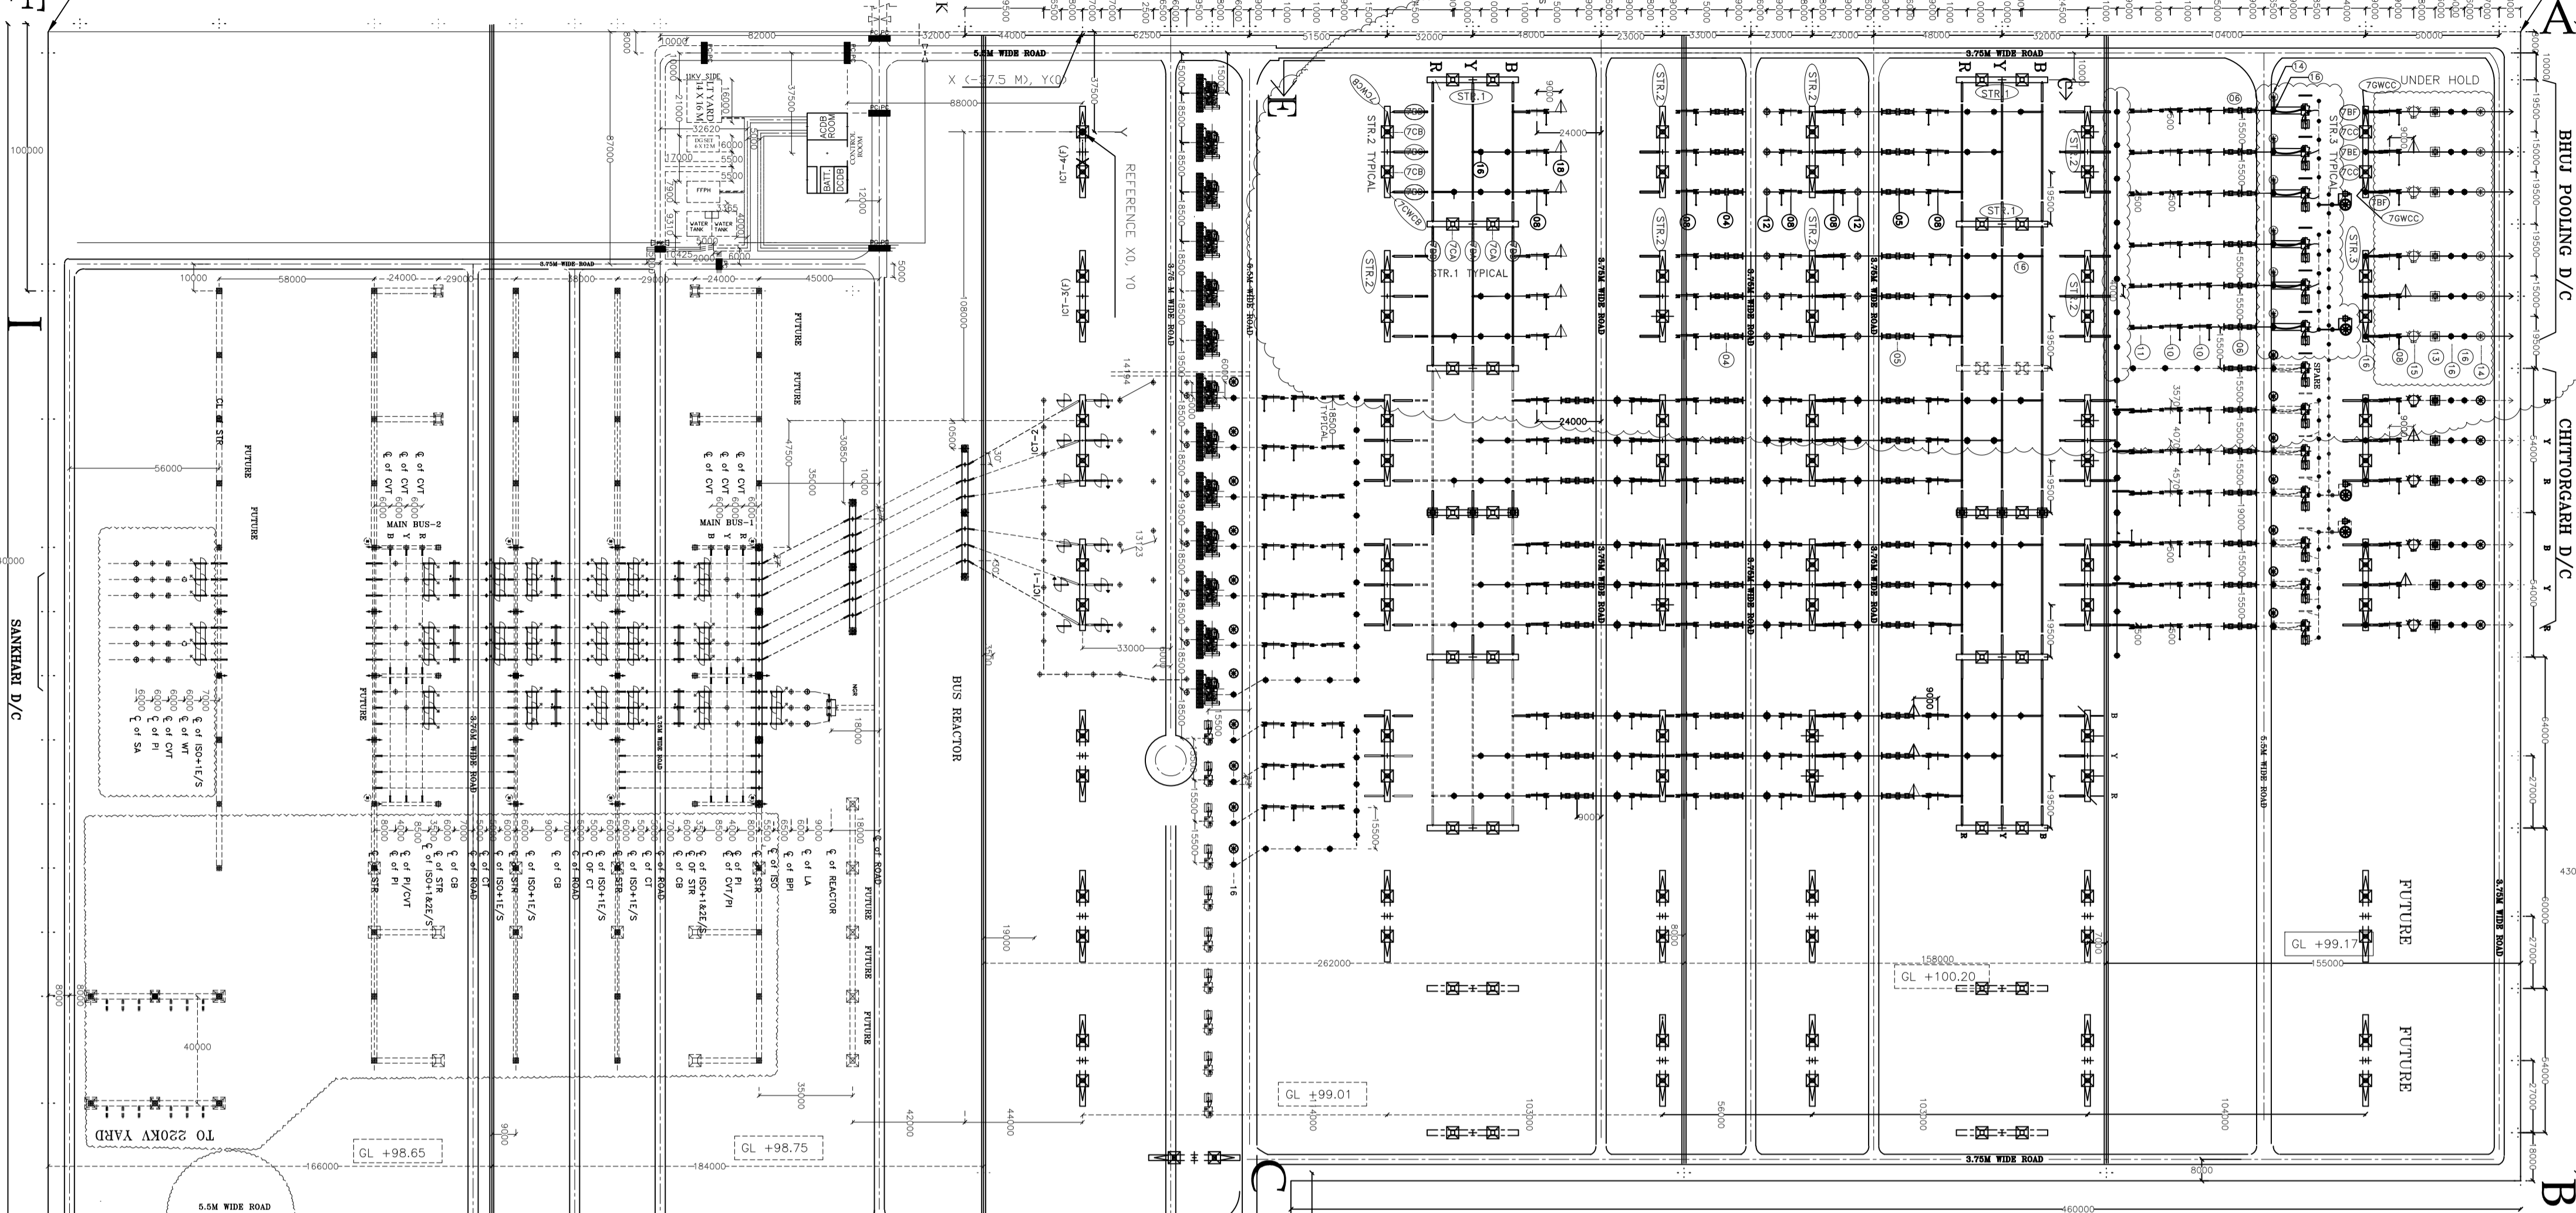

BILL OF QTY. FOR 765kV MAIN EQUIPMENTS. (50KA FOR 1 SEC)

ITEM CODE	DESCRIPTION	RATING	QTY. (PART-1)	SYMBOL	SCOPE OF SUPPLY
1	500 MVA, (3- ϕ) AUTOTRANSFORMER	765/400/33kV	-		PGCIL
2	110MVAR LINE REACTOR (1- ϕ) WITH NER500 (2m)	765kV	6		PGCIL
3	110MVAR BUS REACTOR (1- ϕ)	765kV	-		PGCIL
4	SF6 CIRCUIT BREAKER WITH CR, WITH CSS (3- ϕ)	3150A	2		PGCIL
5	SF6 CIRCUIT BREAKER WITH CR, WITHOUT CSS (3- ϕ)	3150A	2		PGCIL
6	SF6 CIRCUIT BREAKER WITHOUT CR, WITH CSS (3- ϕ)	3150A	2		PGCIL
7	SF6 CIRCUIT BREAKER WITHOUT CR, WITHOUT CSS (1- ϕ)	3150A	-		PGCIL
8	ISOLATOR WITH ONE E/SV (3- ϕ) VERTICAL, KNEE TYPE	3150A	12		BHEL
9	ISOLATOR WITH TWO E/SV (3- ϕ) VERTICAL, KNEE TYPE	3150A	-		BHEL
10	ISOLATOR WITH ONE E/SV (1- ϕ) VERTICAL, KNEE TYPE	2000A	12		BHEL
11	ISOLATOR WITHOUT E/SV (1- ϕ) VERTICAL, KNEE TYPE	2000A	6		BHEL
12	CURRENT TRANSFORMER (1- ϕ) WITH LEGS, EXTENDED CURRENT RATING	3000A	12		BHEL
13	CVT (1- ϕ)	8800V	6		BHEL
14	SURGE ARRESTER (1- ϕ)	624 kV	12		BHEL
15	WAVE TRAP (1- ϕ) PEDESTAL TYPE	1m, 3150A	04		BHEL
16	765kV POST INSULATOR (FOR SWITCHYARD)	624 kV	44		BHEL
17	765kV POST INSULATOR (FOR WAVE TRAP)	624 kV	12		BHEL
18	765kV GUY WIRE (FOR SWITCHYARD)		08		BHEL

L1 Lattice Structure for Towers & Beams

Standard Structures for 765kV		
a	7CA Column	Nos. 8
b	7BA	Nos. 4
c	7BB	Nos. 8
d	7CB Column	Nos. 16
e	7BC	Nos. 8
f	7BD	Nos. 16
g	7CWCB	Nos. 16
h	7CC Column	Nos. 4
i	7BE	Nos. 2
j	7BF	Nos. 4
k	7CWCC	Nos. 4


- NOTE -**
- LEVELS (BGL) FOR SWITCHYARD ARE AS PER POWER GRID DRAWING NO. C/ENGL/WR2/BANAS/STELL-01 REV-01
 - DEAD END TOWER ERECTION AND OUTGOING STRINGING OF LINE CONDUCTOR & SHIELD WIRE ARE NOT IN BHEL SCOPE BUT CONNECTION OF EQUIPMENT TOWARDS LINE SIDE SHALL BE DONE BY BHEL. SUPPLY OF TENSION INSULATOR STRING ON LINE SIDE OF TAKE OFF GANTY IS IN BHEL SCOPE OF WORK INCLUDING TENSION CLAMP FOR EARTHING.
 - SUPPLY ERECTION, TESTING, COMMISSIONING AND EARTHING OF 765kV REACTOR & TRANSFORMER INCLUDING (OLTC & TERMINAL CONNECTOR OF TRAF) & (NCR, 125KV LA, 33KV NCT & TRFM) CONNECTOR OF REACTOR, FORMATION OF HV, LV, TERTIARY, NEUTRAL & AUXILIARY BUSES ALONG WITH BR & ITS STRUCTURE AND ASSOCIATED CIVIL WORKS IS NOT COVERED IN SCOPE OF WORK AS PER 'S' SECTION PROJECT.
 - INTER EQUIPMENT DIMENSION ARE PLANNED SO AS TO ACHIEVE REQUIRED PHYSICAL AND ELECTRICAL CLEARANCE, HOWEVER IF ELECTRICAL CLEARANCE ARE NOT AVAILABLE SITE AND MODIFICATIONS ARE REQUIRED TO ACHIEVE IT, THE REQUIRED MODIFICATION WILL BE DONE BY BHEL WITHOUT ANY EXTRA COST IMPLICATION TO OWNER.
 - FIRE RESISTANT WALL BETWEEN 765kV TRANSFORMER UNITS AND 765kV REACTORS UNITS ARE NOT IN BHEL SCOPE.
 - ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE SPECIFIED.
 - LOCATION OF WT SHOWN IS INDICATIVE ONLY. EXACT LOCATION SHALL BE FINALIZED DURING ERECTION COMMISSIONING STAGE BASED ON LINE PARAMETERS FOUNDATION FOR WAVE TRAP SHALL BE CONDUCTED FOR ALL THREE PHASES IN 765kV AREA.
 - 765kV REACTOR AREA SHALL BE FINALIZED AFTER RECEIVING PROJECT SPECIFIC REACTOR AREA LAYOUT FROM POWERGRID. HENCE THE SAME SHALL BE UPDATED ON SWITCHYARD LAYOUT DRAWING ACCORDINGLY & REACTOR INTERCONNECTIONS SHOWN ON THIS LAYOUT ARE TENTATIVE.
 - SETS OF BRM, CTR, COT, JUNCTION BOX & SWITCHYARD PANEL ROOM (SPR) LOCATION SHALL BE SHOWN IN CABLE TRENCH LAYOUT DRAWING.
 - PHASE SEQUENCE IS INDICATIVE & IT SHALL BE VERIFIED AT SITE DURING EXECUTION, ALONG WITH TRANSFORMER LINE.
 - PUNTH HEIGHT OF FOUNDATION WILL BE 300MM FROM FINISHED GROUND LEVEL (F.G.L.).
 - CONSTRUCTION OF 765kV BULK BUS UP TO 765kV REACTOR ARE NOT IN BHEL SCOPE.
 - PUNTH LEVEL WILL BE F.G.L. +300MM, HOWEVER TO MEET BEAM AT SAME HEIGHT, RESPECTIVE PUNTH LEVEL WILL BE RAISED AS REQUIRED.

CONDUCTOR & STRINGING DETAILS -765kV

SL.NO.	DESCRIPTION	LEVEL FROM PUNTH	SUB-CONDUCTOR	TENSION INSULATOR STRING/PHASE
1.	MAIN BUS-1 & II	(AT 27M HEIGHT)	QUAD AAC BULL CONDUCTOR WITH 450MM SUB-CONDUCTOR SPACING	DOUBLE TENSION 210 kN DISC INSULATOR (2444 Nos.)
2.	JACKBUS	(AT 39M HEIGHT)	QUAD AAC BULL CONDUCTOR WITH 450MM SUB-CONDUCTOR SPACING	DOUBLE TENSION 210 kN DISC INSULATOR (2444 Nos.)
3.	DROPPERS/AMPERING	-	QUAD AAC BULL CONDUCTOR WITH 450MM SUB-CONDUCTOR SPACING	SINGLE STRING-210kN DISC INSULATOR (1444 Nos.)
4.	EQUIPMENT INTERCONNECTION	(AT 14M HEIGHT)	4.5" IPS AL TUBE (120mm OD)/QUAD AAC BULL CONDUCTOR WITH 450MM SPACING	-
5.	EARTHWIRE	(AT 45M HEIGHT)	7/3.66mm GI WIRE (10.98mm DIA)	-
6.	INTERCONNECTION BETWEEN 765/400kV TRAF TO 400kV SUB-STATION	-	QUAD BULB/BERSHIMS ACSR CONDUCTOR WITH 450MM SUB-CONDUCTOR SPACING/4.5" IPS AL TUBE	-
7.	EQUIPMENT INTERCONNECTION NEAR 765/400kV ICT AREA FOR HIGH BREAKHIGH LA	(AT 12M HEIGHT)	QUAD BULB/BERSHIMS ACSR CONDUCTOR WITH 450MM SUB-CONDUCTOR SPACING/4.5" IPS AL TUBE	-

CONDUCTOR & STRINGING DETAILS -400kV

SL.NO.	DESCRIPTION	LEVEL FROM PUNTH	SUB-CONDUCTOR	TENSION INSULATOR STRING/PHASE
1.	MAIN BUS-1 & II	(AT 15M HEIGHT)	QUAD AAC BULL CONDUCTOR WITH 450MM SUB-CONDUCTOR SPACING	DOUBLE TENSION 120 kN DISC INSULATOR (2425 Nos.)
2.	JACKBUS	(AT 22M HEIGHT)	QUAD BERSHIMS ACSR CONDUCTOR WITH 450MM SUB-CONDUCTOR SPACING	DOUBLE TENSION 120 kN DISC INSULATOR (2425 Nos.)
3.	DROPPERS/AMPERING	-	QUAD BERSHIMS ACSR CONDUCTOR WITH 450MM SUB-CONDUCTOR SPACING	SINGLE STRING-120kN DISC INSULATOR (1425 Nos.)
4.	EQUIPMENT INTERCONNECTION	(AT 8M HEIGHT)	4.5" IPS AL TUBE /QUAD ACSR BERSHIMS CONDUCTOR WITH 450MM SPACING	-
5.	EARTHWIRE	(AT 29.5M HEIGHT)	7/3.66mm GI WIRE (10.98mm DIA)	-
6.	BUS CVT, CVT & LA IN LINE BAYS	-	7MM BERSHIMS ACSR CONDUCTOR WITH 450MM SUB-CONDUCTOR SPACING	-

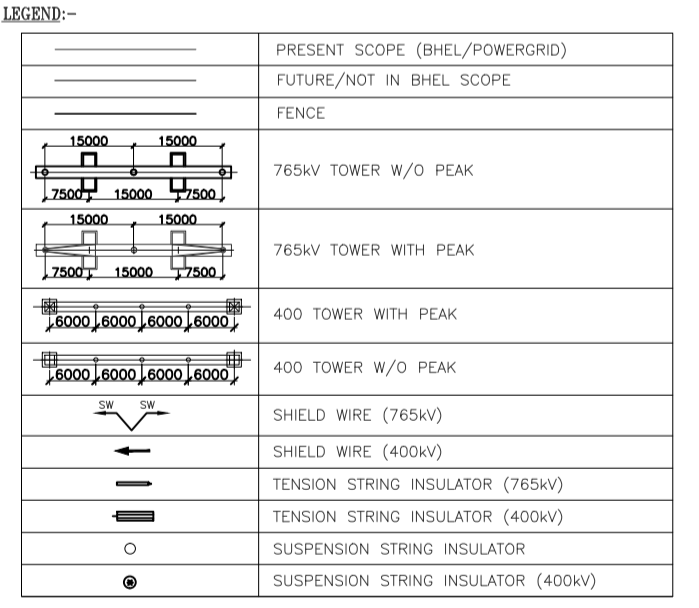

SYSTEM PARAMETERS (765kV)-

SL.NO.	DESCRIPTION OF PARAMETER	765kV SYSTEM	400kV SYSTEM	220kV SYSTEM	36kV SYSTEM
1.	HIGHEST SYSTEM VOLTAGE	800kV	420kV	245kV	36kV
2.	NORMAL SYSTEM VOLTAGE	765kV	400kV	220kV	33kV
3.	RATED FREQUENCY	50Hz	50Hz	50 Hz	50Hz
4.	NO. OF PHASES	3	3	3	3
RATED INSULATION LEVELS					
5.	(i) FULL WAVE LIGHTNING IMPULSE WITHSTAND VOLTAGE (1.2/50microsec.)	±2100kV	±1550kV	±1050kV	±170kV
	(ii) SWITCHING IMPULSE WITHSTAND VOLTAGE (250/250microsec.) DRY & WET	±1550kV	±1050kV	---	---
	(iii) ONE MINUTE POWER FREQUENCY DRY WITHSTAND VOLTAGE (rms)	830kV	630kV	460kV	70kV
6.	DISCRIMINATION EXTINCTION VOLTAGE	508kV	320kV	156 kV	---
7.	MAX. MAINT. INTERFERENCE VOLTAGE LEVEL AT 508kV (rms) FOR 765 kV & AT 120 kV (rms) FOR 400kV	2500 micro volts	1500 micro volts	1000 micro volts	---
8.	RATED SHORT CIRCUIT CURRENT FOR 1 SEC. DURATION	50KA	63KA	40KA	25KA
9.	SYSTEM NEUTRAL EARTHING	EFFECT. EARTHED	EFFECT. EARTHED	EFFECT. EARTHED	EFFECT. EARTHED

REV.	DATE	ALTERED CHECKED APPROVED	REV.	DATE	ALTERED CHECKED APPROVED	REV.	DATE	ALTERED CHECKED APPROVED	REV.	DATE	ALTERED CHECKED APPROVED	REV.	DATE	ALTERED CHECKED APPROVED
ZONE			ZONE			ZONE			ZONE			ZONE		

ADDITIONAL INFORMATION
W.D.No.

STATUS OF DRAWING

DISTRIBUTION OF PRINTS

POWER GRID CORPORATION OF INDIA LTD
NAME OF CUSTOMER
POWER GRID CORPORATION OF INDIA LTD
NAME OF PROJECT : SUBSTATION PACKAGE-SS01 FOR CONSTRUCTION OF 765/400/220KV BHUJ S/S & EXT. OF 765KV BANASKANTHA S/S UNDER GREEN ENERGY CORRIDOR ISTS PART- C (PART-1)
NOA NO.- CC-CS/483-WR2/SS-2803/11/CB/NOA-142/5507 & 5508 DT. 01.09.15

NO.	NAME	SCALE	DATE
1	JK		27.04.16
2	SK		
3	RS		

BHARAT HEAVY ELECTRICALS LTD.
TRANSMISSION PROJECTS DIVISION

DESIGNER:

SCALE: 1:1

CARD CODE: NTS

LAYOUT PLAN FOR 765 KV BANASKANTHA EXTENSION SUBSTATION

DRAWING NO. TB-385-510-022

SHEET No. 01

PRINT SIZE A0