
	TITLE :	SPECIFICATION NO.
	GENERAL TECHNICAL REQUIREMENTS	
	FOR	VOLUME NO. : II-B
	LV MOTORS	SECTION : D
		REV NO. : 00 DATE : 18.12.14
		SHEET : 3 OF 4
<p>4.4. Motors shall not be provided with any electric or pneumatic operated external fan for cooling the motors.</p> <p>4.5. Frames shall be designed to avoid collection of moisture and all enclosures shall be provided with facility for drainage at the lowest point.</p> <p>4.6. In case Class 'F' insulation is provided for LV motors, temperature rise shall be limited to the limits applicable to Class 'B' insulation. In case of continuous operation at extreme voltage limits the temperature limits specified in table-1 of IS:325 shall not exceed by more than 10°C.</p> <p>4.7. Terminals and Terminal Boxes</p> <p>4.7.1 Terminals, terminal leads, terminal boxes, windings tails and associated equipment shall be suitable for connection to a supply system having a short circuit level, specified in the Data Sheet-A.</p> <p>Unless otherwise stated in Data Sheet-A, motors of rating 110 kW and above will be controlled by circuit breaker and below 110 kW by switch fuse-contactor. The terminal box of motors shall be designed for the fault current mentioned in data sheet "A".</p> <p>4.7.2 Unless otherwise specified or approved, phase terminal boxes of horizontal motors shall be positioned on the left hand side of the motor when viewed from the non-driving end.</p> <p>4.7.3 Connections shall be such that when the supply leads R, Y & B are connected to motor terminals A B & C or U, V & W respectively, motor shall rotate in an anticlockwise direction when viewed from the non-driving end. Where such motors require clockwise rotation, the supply leads R, Y, B will be connected to motor terminals A, C, B or V W & V respectively.</p> <p>4.7.4 Permanently attached diagram and instruction plate made preferably of stainless steel shall be mounted inside terminal box cover giving the connection diagram for the desired direction of rotation and reverse rotation.</p> <p>4.7.5 Motor terminals and terminal leads shall be fully insulated with no bar live parts. Adequate space shall be available inside the terminal box so that no difficulty is encountered for terminating the cable specified in Data Sheet-A.</p> <p>4.7.6 Degree of protection for terminal boxes shall be IP 55 as per IS 4691.</p> <p>4.7.7 Separate terminal boxes shall be provided for space heaters.. If this is not possible in case of LV motors, the space heater terminals shall be adequately segregated from the main terminals in the main terminal box. Detachable gland plates with double compression brass glands shall be provided in terminal boxes.</p> <p>4.7.8. Phase terminal boxes shall be suitable for 360 degree of rotation in steps of 90 degree for LV motors.</p> <p>4.7.9 Cable glands and cable lugs as per cable sizes specified in Data Sheet-A shall be included. Cable lugs shall be of tinned Copper, crimping type.</p> <p>4.8 Two separate earthing terminals suitable for connecting G.I. or MS strip grounding conductor of size given in Data Sheet-A shall be provided on opposite sides of motor frame. Each terminal box shall have a grounding terminal.</p> <p>4.9 General</p> <p>4.9.1 Motors provided for similar drives shall be interchangeable.</p>		

	TITLE :	SPECIFICATION NO.
	GENERAL TECHNICAL REQUIREMENTS	
	FOR	VOLUME NO. : II-B
	LV MOTORS	SECTION : D
		REV NO. : 00 DATE : 18.12.14
	SHEET : 4 OF 4	

- 4.9.2 Suitable foundation bolts are to be supplied alongwith the motors.
- 4.9.3 Motors shall be provided with eye bolts, or other means to facilitate safe lifting if the weight is 20Kgs. and above.
- 4.9.4 Necessary fitments and accessories shall be provided on motors in accordance with the latest Indian Electricity rules 1956.
- 4.9.5 All motors rated above 30 kW shall be provided with space heaters to maintain the motor internal air temperature above the dew point. Unless otherwise specified, space heaters shall be suitable for a supply of 240V AC, single phase, 50 Hz.
- 4.9.6 Name plate with all particulars as per IS: 325 shall be provided
- 4.9.7 Unless otherwise specified, the colour of finish shall be grey to Shade No. 631 and 632 as per IS:5 for motors installed indoor and outdoor respectively. The paint shall be epoxy based and shall be suitable for withstanding specified site conditions.
- 5.0 INSPECTION AND TESTING**
- 5.1 All materials, components and equipments covered under this specification shall be procured, manufactured, as per the BHEL standard quality plan No. PED-506-00-Q-006/0 and PED-506-00-Q-007/2 enclosed with this specification and which shall be complied.
- 5.2 LV motors of type-tested design shall be provided. Valid type test reports not more than 5 year shall be furnished. In the absence of these, type tests shall have to be conducted by manufacturer without any commercial implication to purchaser.
- 5.3 All motors shall be subjected to routine tests as per IS: 325 and as per BHEL standard quality plan.
- 5.4 Motors shall also be subjected to additional tests, if any, as mentioned in Data Sheet A.
- 6.0 DRAWINGS TO BE SUBMITTED AFTER AWARD OF CONTRACT**
- a) OGA drawing showing the position of terminal boxes, earthing connections etc.
- b) Arrangement drawing of terminal boxes.
- c) Characteristic curves:
(To be given for motor above 55 kW unless otherwise specified in Data Sheet).
- i) Current vs. time at rated voltage and minimum starting voltage.
- ii) Speed vs. time at rated voltage and minimum starting voltage.
- iii) Torque vs. speed at rated voltage and minimum voltage.
For the motors with solid coupling the above curves i), ii), iii) to be furnished for the motors coupled with driven equipment. In case motor is coupled with mechanical equipment by fluid coupling, the above curves shall be furnished with and without coupling.
- iv) Thermal withstand curve under hot and cold conditions at rated voltage and max. permissible voltage.

ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR

PACKAGE: VENTILATION SYSTEM

SCOPE OF VENDOR: SUPPLY, ERECTION & COMMISSIONING OF VENDOR'S EQUIPMENT

PROJECT: 4X270 MW BHADRADRI TPS

S.NO	DETAILS	SCOPE SUPPLY	SCOPE E&C	REMARKS
1	415V MCC	BHEL	BHEL	240 V AC (supply feeder)/415 V AC (3 PHASE 4 WIRE) supply shall be provided by BHEL based on load data provided by vendor at contract stage for all equipment supplied by vendor as part of contract. Any other voltage level (AC/DC) required will be derived by the vendor.
2	Local Push Button Station (for motors)	BHEL	BHEL	Located near the motor.
3	Power cables, control cables and screened control cables for a) both end equipment in BHEL's scope b) both end equipment in vendor's scope c) one end equipment in vendor's scope	BHEL BHEL BHEL	BHEL Vendor BHEL	1. For 3.b) & c): Sizes of cables required shall be informed by vendor at contract stage (based on inputs provided by BHEL) in the form of cable listing. Finalisation of cable sizes shall be done by BHEL. Vendor shall provide lugs & glands accordingly. 2. Termination at BHEL equipment terminals by BHEL. 3. Termination at Vendor equipment terminals by Vendor.
4	Junction box for control & instrumentation cable	Vendor	Vendor	Number of Junction Boxes shall be sufficient and positioned in the field to minimize local cabling (max 10-12 mtrs) and trunk cable.
5	Any special type of cable like compensating, co-axial, prefab, MICC, optical fibre etc.	Vendor	Vendor	Refer C&I portion of specification for scope of fibre Optical cables if used between PLC/ microprocessor & DCS.
6	Cable trays, accessories & cable trays supporting system 100/ 50 mm cable trays/ Conduits/ Galvanised steel cable troughs for local cabling	BHEL Vendor	BHEL Vendor	Local cabling from nearby main route cable tray (BHEL scope) to equipment terminal (vendor's scope) shall be through 100/ 50 mm. cable trays/ conduits/ Galvanised steel cable troughs, as per approved layout drawing during contract stage.
7	Cable glands ,lugs and bimetallic strip for equipment supplied by Vendor	Vendor	Vendor	1. Double compression Ni-Cr plated brass cable glands 2. Solder less crimping type heavy duty tinned copper lugs for power and control cables.
8	Conduit and conduit accessories for cabling between equipment supplied by vendor	Vendor	Vendor	Conduits shall be medium duty, hot dip galvanised cold rolled mild steel rigid conduit as per IS: 9537.
9	Lighting	BHEL	BHEL	
10	Equipment grounding (including electronic earthing) &	BHEL	BHEL	Refer note no. 4 for electronic earthing

ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR

PACKAGE: VENTILATION SYSTEM

SCOPE OF VENDOR: SUPPLY, ERECTION & COMMISSIONING OF VENDOR'S EQUIPMENT

PROJECT: 4X270 MW BHADRADRI TPS

S.NO	DETAILS	SCOPE SUPPLY	SCOPE E&C	REMARKS
	lightning protection			
11	Below grade grounding	BHEL	BHEL	
12	LT Motors with base plate and foundation hardware	Vendor	Vendor	Makes shall be subject to customer/ BHEL approval at contract stage.
13	Mandatory spares	Vendor	-	Vendor to quote as per specification.
14	Recommended O & M spares	Vendor	-	As specified elsewhere in specification
15	Any other equipment/ material/ service required for completeness of system based on system offered by the vendor (to ensure trouble free and efficient operation of the system).	Vendor	Vendor	
16	a) Input cable schedules (Control & Screened Control Cables) b) Cable interconnection details for above c) Cable block diagram	Vendor Vendor Vendor	- - -	Cable listing for Control and Instrumentation Cable and electronic earthing cable in enclosed excel format shall be submitted by vendor during detailed engineering stage.
17	Electrical Equipment & cable tray layout drawings	Vendor	-	For ensuring cabling requirements are met, vendor shall furnish Electrical equipment layout & cable tray layout drawings (both in print form as well as in AUTOCAD) of the complete plant (including electrical area) indicating location and identification of all equipment requiring cabling, and shall incorporate cable trays routing details marked on the drawing as per PEM interface comments. Cabling arrangement of the same (wherever overhead cable trays, trenches, cable ducts, conduits etc.) shall be decided during contract stage. Electrical equipment layout & cable tray layout drawing shall be subjected to BHEL/ customer approval without any commercial implications to BHEL.
18	Electrical Equipment GA drawing	Vendor	-	For necessary interface review.

NOTES:

1. Make of all electrical equipment/ items supplied shall be reputed make & shall be subject to approval of BHEL/customer after award of contract.
2. All QPs shall be subject to approval of BHEL/customer after award of contract without any commercial implication.

ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR

PACKAGE: VENTILATION SYSTEM

SCOPE OF VENDOR: SUPPLY, ERECTION & COMMISSIONING OF VENDOR'S EQUIPMENT

PROJECT: 4X270 MW BHADRADRI TPS


3. In case the requirement of Junction Box arises on account of Power Cable size mis-match due to vendor engineering at later stage, vendor shall supply the Junction Box for suitable termination.
4. Vendor shall indicate location of Electronic Earth pit in their Civil assignment drawing.



Arvind



SA Khan



Pritam Khatun



TITLE

LV MOTORS**DATA SHEET-A****4 X 270 MW BHADRADRI TPS**

SPECIFICATION NO.

VOLUME II B

SECTION D

REV NO. DATE 18.12.14

SHEET 1 OF 2

- 1.0 Design ambient temperature : 50 °C
- 2.0 Maximum acceptable kW rating of LV motor : 160KW *
- 3.0 Installation (Indoors/ Outdoors) : As required
- 4.0 Details of supply system
- a) Rated voltage (with variation) : 415V ± 10%
- b) Rated frequency (with variation) : 50 Hz + 3 % to - 5%
- c) Combined voltage & freq. variation : 10% (sum of absolute values)
- d) System fault level at rated voltage : 50 kA for 1 sec
- e) Short time rating for terminal boxes
- o 110 kW and above (Breaker : 50 KA for 0.20 sec..
Controlled)
 - o Below 110 kW (Contactor : 50 KA protected by HRC fuse
Controlled)
- f) LV System grounding : Solidly
- 5.0 Class of insulation : Class 'F', with temp rise limited to class B.
- 6.0 Minimum voltage for starting : (a) 85% below 110KW
(As percentage of rated voltage) (b) 80% from 110KW to 160KW
(c) 85% above 160KW to 1000KW
(d) 80% from 1001 KW to 4000KW
(e) 75% > 4000KW
- 7.0 Power cables data : Shall be given during detailed engg.
- 8.0 Earth Conductor Size & Material : As per attached Datasheet of Earthing.
- 9.0 Space heater supply : 240 V, 1 ϕ , 50 Hz (for motors above 30 Kw)
- 10.0 Rating up to which Single phase motor : Acceptable below 0.20 kW
- 11.0 Locked rotor current
- a) Limit as percentage of FLC : As per IS 12615*
- 12.0 Flame-proof motor
- a) Enclosure suitable (As per IS: 2148) : As per requirement
- b) Classification of Hazardous area : As per requirement
(As per IS: 5572 part-I)
- 13.0 Makes : BHEL/ Customer approval
- 14.0 Paint shade : Shall be given during detailed engg
- 15.0 Degree Of protection for motor/ terminal box : IP 54/ IP 55



TITLE

LV MOTORS**DATA SHEET-A****4 X 270 MW BHADRADRI TPS**

SPECIFICATION NO.

VOLUME II B

SECTION D

REV NO. DATE 18.12.14

SHEET 1 OF 2

* Continuous duty LT motors up to 160 KW Output rating (at 50 deg.C ambient temperature), shall be High efficiency (IE2) as per IEC: 60034-30/ IS:12615

16.0 TESTING**16.1 Type Tests**

For LT Motors above 55kW, type test reports for type tests as per IS: 325/ IS: 12615 conducted on equipment similar to those proposed to be supplied and carried out within last five years from the date of bid opening shall be submitted. However, if such reports are not available, one motor of each type shall be subjected to type tests for free of cost.

16.2 Routine Tests

All motors shall be subjected to routine tests as per IS: 325/ IS: 12615 in the presence of customer or customer representative.

	TITLE	SPECIFICATION NO.
	MOTOR DATA SHEET - C	VOLUME II B
		SECTION D
		REV NO. 00 DATE
		SHEET 1 OF 2

S. No.	Description	Data to be filled by successful bidder
A.	General	
1	Manufacturer & country of origin	
2	Motor type	
3	Type of starting	
4	Name of the equipment driven by motor & Quantity	
5	Maximum Power requirement of driven equipment	
6	Rated speed of Driven Equipment	
7	Design ambient temperature	
B.	Design and Performance Data	
1	Frame size & type designation	
2	Type of duty	
3	Rated Voltage	
4	Permissible variation for	
5	a) Voltage	
6	b) Frequency	
7	c) Combined voltage & frequency	
8	Rated output at design ambient temp (by resistance method)	
9	Synchronous speed & Rated slip	
10	Minimum permissible starting voltage	
11	Starting time in sec with mechanism coupled	
12	a) At rated voltage	
13	b) At min starting voltage	
14	Locked rotor current as percentage of FLC (including IS tolerance)	
15	Torque	
	a) Starting	
	b) Maximum	
16	Permissible temp rise at rated output over ambient temp & method	
17	Noise level at 1.0 m (dB)	
18	Amplitude of vibration	
19	Efficiency & P.F. at rated voltage & frequency	
	a) At 100% load	
	c) At 75% load	

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			



 Arvind SA Khan Pritam Kishore

	TITLE	SPECIFICATION NO.
	MOTOR DATA SHEET - C	VOLUME II B
		SECTION D
		REV NO.00 DATE
		SHEET 2 OF 2

S. No.	Description	Data to be filled by successful bidder
	c) At starting	
C.	Constructional Features	
1	Method of connection of motor driven equipment	
2	Applicable Standard	
3	DOP of Enclosure	
4	Method of cooling	
5	Class of insulation	
6	Main terminal box	
	a) Type	
	b) Power Cable details (Conductor, size, armour/unarmour)	
	c) Cable Gland & lugs details (Size, type & material)	
	d) Permissible Fault level (kArms & duration in sec)	
7	Space heater details (Voltage & watts)	
8	Flame proof motor details (if applicable)	
	a) Enclosure	
	b) suitability for hazardous area	
	i Zone	O / I / II
	ii Group	IIA / IIB / IIC
9	No. of Stator winding	
10	Winding connection	
11	Kind of rotor winding	
12	Kind of bearings	
13	Direction of rotation when viewed from NDE	
14	Paint Shade & type	
15	Net weight of motor	
16	Outline mounting drawing No (To be enclosed as annexure)	
D.	Characteristic curves/ drawings (To be enclosed for motors of rating $\geq 55KW$)	
	a) Torque speed characteristic	
	b) Thermal withstand characteristic	
	c) Current vs time	
	d) Speed vs time	

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			

 Arvind
 SA Khan
 Pritam Kishore

CUSTOMER :		PROJECT		SPECIFICATION :		
BIDDER/ VENDOR SYSTEM		TITLE		NUMBER :		
CAT.		QUALITY PLAN		TITLE		
SHEET 1 OF 9		NUMBER PED-506-00-Q-007, REV-03		SECTION		
COMPONENT/OPERATION		REFERENCE		AGENCY		
CHARACTERISTIC CHECK		ACCEPTANCE NORM		VOLUME III		
TYPE/ METHOD OF CHECK		DOCUMENT		REMARKS		
EXTENT OF CHECK		FORMAT OF RECORD		P W I V		
CAT.		7		10		
3		8		11		
1	2	4	5	6	9	
1.0	RAW MATERIAL & BOUGHT OUT CONTROL					
1.1	SHEET STEEL, PLATES, SECTION, EYEBOLTS	MA	VISUAL	100%	LOG BOOK	3 - -
		MA	MEASUREMENT	SAMPLE	-DO-	3 - -
		MA	MECH. TEST	-DO-	INSPEC. REPORT	3 - 2
1.2	HARDWARES	MA	VISUAL	100%	-DO-	3 - -
		MA	VISUAL	SAMPLES	SUPPLIERS TC & LOG	3 - 2
1.3	CASTING	MA	VISUAL	100%	LOG BOOK	3 - 2
		MA	CHEM & MECH TEST	1/HEAT NO.	SUPPLIERS TC	3 - 2
		MA	MEASUREMENT	100%	LOG BOOK	3 - 2
1.4	PAINT & VARNISH	MA	VISUAL	100% CONTINUOUS	LOG BOOK	3 - 2
		MA	VISUAL	100% CONTINUOUS	LOG BOOK	3 - 2
BHEL		PARTICULARS		BIDDER/VENDOR		
		NAME				
		SIGNATURE				
		DATE				
						BIDDER/VENDORS COMPANY SEAL

 Anind
 SA Khan
 Pritesh Katoor

QUALITY PLAN		CUSTOMER :				PROJECT TITLE				SPECIFICATION :				
SHEET 4 OF 9		BIDDER / VENDOR SYSTEM				QUALITY PLAN NUMBER PED-506-Q-007, REV-03				SPECIFICATION TITLE				
SL. NO.	COMPONENT/OPERATION	CHARACTERISTIC CHECK	CAT.	TYPE/METHOD OF CHECK	EXTENT OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD	AGENCY	SECTION	W	V	VOLUME III REMARKS	
1	2	3	4	5	6	7	8	9		10			11	
1.10	BEARINGS	3.DIMENSIONS 1.MAKE & TYPE 2.DIMENSIONS	MA	MEASUREMENT VISUAL MEASUREMENT	-DO- 100% SAMPLE	-DO- MANFR'S DRG./ APPROVED DATASHEET BHEL DATA SHEET	-DO- MANFR'S DRG./ APPROVED DATASHEET BHEL DATA SHEET BEARING MANUF'S CATALOGUES	Log Book -DO- -DO-	3	-	2			
1.11	SLIP RING (WHEREVER APPLICABLE)	3.SURFACE FINISH 1.SURFACE COND. 2.DIMENSIONS	MA	VISUAL VISUAL MEASUREMENT	100% 100% SAMPLE	-	FREE FROM VISUAL DEFECTS -DO-	-DO- -DO-	3	-	2			
1.12	OIL SEALS & GASKETS	3.DIMENSIONS 1.MATERIAL OF GASKET 2.SURFACE COND.	MA	MEASUREMENT ELECT.TEST -DO- VISUAL VISUAL MEASUREMENT	-DO- 100% 100% 100% SAMPLE	MANUF'S DRG MANUF'S SPEC./ BHEL SPEC. -DO- MANUF'S DRG/SPECS -	MANUF'S DRG MANUF'S SPEC./ BHEL SPEC. -DO- MANUF'S DRG/SPECS FREE FROM VISUAL DEFECTS MANUF'S DRG	-DO- -DO- -DO- -DO- -DO-	3	-	2			
BHEL														
PARTICULARS										BIDDER/VENDOR				
NAME														
SIGNATURE														
DATE														
BIDDER'S/VENDORS COMPANY SEAL														


 Anind SA Khan Poojan Kabra

SHEET 5 OF 9		QUALITY PLAN		CUSTOMER :			PROJECT			SPECIFICATION :		
COMPONENT/OPERATION		CHARACTERISTIC CHECK		BIDDER/ VENDOR			TITLE			NUMBER :		
SHEET 5 OF 9		QUALITY PLAN		SYSTEM			QUALITY PLAN			TITLE		
CAT.		EXTENT OF CHECK		TYPE/ METHOD OF CHECK			REFERENCE DOCUMENT			AGENCY		
3		4		5			6			7		
8		9			10			11				
P		W			V			REMARKS				
1	2	3	4	5	6	7	8	9	10	11		
2.0	IN PROCESS		MA	VISUAL	100%	-DO-	GOOD FINISH	LOG BOOK	3/2	2	-	
2.1	STATOR FRAME WELDING (IN CASE OF FABRICATED STATOR)	1.WORKMANSHIP & CLEANNESS	MA	MEASUREMENT	-DO-	MANUF'S DRG	MANUF'S DRG	-DO-	2	-	-	
2.2	MACHINING	1.FINISH	MA	VISUAL	100%	-DO-	GOOD FINISH	LOG BOOK	2	-	-	
		2.DIMENSIONS	MA	MEASUREMENT	-DO-	MANUF'S DRG	MANUF'S DRG	-DO-	2	-	-	
		3.SHAFT SURFACE FLOWS	MA	PT	-DO-	RELEVANT SPEC./ ASTM-E165	MANUF'S DRG	-DO-	2	-	1	
2.3	PAINTING	1.SURFACE PREPARATION	MA	VISUAL	100%	MANFRS SPEC./BHEL SPEC./ RELEVANT STAND	BHEL SPEC./ SAME AS COL.7	LOG BOOK	2	-	-	
		2.PAINT THICKNESS (BOTH PRIMER & FINISH COAT)	MA	MEASUREMENT BY ELCOMETER	SAMPLE	-DO-	-DO-	-DO-	2	-	-	
		3.SHADE	MA	VISUAL	-DO-	-DO-	-DO-	Log Book	2	-	-	
		4.ADHESION	MA	CROSS CUTTING & TAPE TEST	-DO-	-DO-	-DO-	Log Book	2	-	-	
BHEL												
PARTICULARS				BIDDER/VENDOR								
NAME												
SIGNATURE												
DATE												
BIDDER/S/VENDORS COMPANY SEAL												

 Arvind
 SA Khan
 Pritesh Katoor

CUSTOMER :		PROJECT		SPECIFICATION :						
BHEL		TITLE		NUMBER :						
BIDDER/ VENDOR		QUALITY PLAN		SPECIFICATION :						
SYSTEM		NUMBER PED-506-00-Q-007, REV-03		TITLE						
CAT.		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV & MV)		SECTION						
CHARACTERISTIC CHECK		REFERENCE DOCUMENT		AGENCY						
SHEET 7 OF 9		ACCEPTANCE NORM		VOLUME III						
COMPONENT/OPERATION		EXTENT OF CHECK		REMARKS						
2		5		P W V						
3		6		10						
4		7		11						
5		8		9						
6		9		10						
7		10		11						
1	2	3	4	5	6	7	8	9	10	11
2.7	COMPLETE STATOR ASSEMBLY	4.DURATION 1.COMPACTNESS & CLEANLINESS	MA	-DO-	-DO-	-DO-	-DO-	Log Book	2	- 1
2.8	BRAZING/COMPRESSION JOINT	1.COMPLETENESS 2.SOUNDNESS	CR	-DO-	100%	-DO-	-DO-	Log Book	2	- -
2.9	COMPLETE ROTOR ASSEMBLY	3.HV 1.RESIDUAL UNBALANCE 2.SOUNDNESS OF DIE CASTING	CR	MALLET TEST & UT	-DO-	-DO-	-DO-	Log Book	2	- -
2.10	ASSEMBLY	1.ALIGNMENT 2.WORKMANSHIP 3.AXIAL PLAY 4.DIMENSIONS 5.CORRECTNESS, COMPLETENESS TERMINATIONS/ MARKING/ COLOUR CODE 6. RTD, BTD & SPACE HEATER MOUNTING.	MA	ELECT. TEST	-DO-	-DO-	-DO-	Log Book	2	1
			CR	DYN. BALANCE	-DO-	MFG SPEC./ ISO 1940	MFG. DWG.	Log Book	2	1
			CR	ELECT. (GROWLER TEST)	-DO-	MFG. SPEC.	MFG. SPEC.	Log Book	2	1
			MA	MEAS.	-DO-	-DO-	-DO-	Log Book	2	- -
			MA	VISUAL	-DO-	-DO-	-DO-	Log Book	2	- -
			MA	MEAS.	-DO-	-DO-	-DO-	Log Book	2	- 1
			MA	-DO-	-DO-	MFG.DRG./ MFG SPEC.	MFG. DRG/ RELEVANT IS	Log Book	2	- -
			MA	VISUAL	100%	MFG SPEC. RELEVANT IS	MFG SPEC. RELEVANT IS	Log Book	2	- -
			MA	VISUAL	100%	MFG SPEC. RELEVANT IS	MFG SPEC. RELEVANT IS	Log Book	2	1
BHEL										
BIDDER/VENDOR										
PARTICULARS										
NAME										
SIGNATURE										
DATE										
BIDDERS/VENDORS COMPANY SEAL										

Arvind SA Khan Pawan Kabra

QUALITY PLAN		CUSTOMER :				PROJECT				SPECIFICATION :			
SHEET 8 OF 9		BIDDER / VENDOR SYSTEM				TITLE				NUMBER :			
COMPONENT/OPERATION		CAT.				ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV & MV)				TITLE			
CHARACTERISTIC CHECK		TYPE/METHOD OF CHECK				REFERENCE DOCUMENT				ACCEPTANCE NORM			
3		EXTENT OF CHECK				FORMAT OF RECORD				REMARKS			
2		4				5				6			
1		7				8				9			
1		10				11				11			
P		W				V				I			
3.0	TESTS	MA	ELECT. TEST	1/TYPE/SIZE	IS-325/ BHEL SPEC./ DATA SHEET	TEST REPORT	IS-325/ BHEL SPEC./ DATA SHEET	1*	1	* NOTE - 1			
	1. TYPE TESTS INCLUDING SPECIAL TESTS AS PER BHEL SPEC.	MA	-DO-	100%	-DO-	-DO-	-DO-	1 ^{\$}	1	^{\$} NOTE - 2			
	2. ROUTINE TESTS INCLUDING SPECIAL TEST AS PER BHEL SPEC.	MA	-DO-	100%	IS-12075 & IS-12065	-DO-	IS-12075 & IS-12065	1 ^{\$}	1	^{\$} NOTE - 2			
	3. VIBRATION & NOISE LEVEL	MA	MEASUREMENT & VISUAL	100%	APPROVED DRG/DATA SHEET	INSPC. REPORT	APPROVED DRG/DATA SHEET & RELEVANT IS	1	-				
	4. OVERALL DIMENSIONS AND ORIENTATION	MA	ELECT. & MECH. TEST	1/TYPE/ SIZE	RELEVANT IS	TC	BHEL SPEC. AND DATA SHEET	-	1	TC FROM AN INDEPENDENT LABORATORY, REFER NOTE-3			
	5. DEGREE OF PROTECTION	MA	-DO-	100%	-DO-	-DO-	-DO-	1 ^{\$}	1	^{\$} NOTE - 2			
	6. MEASUREMENT OF RESISTANCE OF RTD & BTD	MA	-DO-	100%	-DO-	-DO-	-DO-	1 ^{\$}	1	^{\$} NOTE - 2			
	7. MEASUREMENT OF RESISTANCE, IR OF SPACE HEATER	MA	VISUAL	100%	IS-325 & DATA SHEET	INSPC. REPORT	IS-325 & DATA SHEET	1 ^{\$}	1	^{\$} NOTE - 2			
	8. NAMEPLATE DETAILS	MA	EXPLOSION FLAME PROOF TEST	1/TYPE	IS-3682 IS-8239 IS-8240	TC	IS-3682 IS-8239 IS-8240	-	1	TC FROM AN INDEPENDENT LABORATORY, REFER NOTE-3			
	9. EXPLOSION FLAME PROOFNESS (IF SPECIFIED)	MA	VISUAL & MEASUREMENT BY ELKOMETER	SAMPLE	BHEL SPEC. & DATA SHEET	TC	BHEL SPEC. & DATA SHEET	1 ^{\$}	1	SAMPLING PLAN TO BE DECIDED BY INSPECTION AGENCY ^{\$} NOTE - 2			
	10. PAINT SHADE, THICKNESS & FINISH	MA											

Arvind SA Khan Poojan Kataria

BIDDER'S/VENDORS COMPANY SEAL

SL. NO.	COMPONENT/OPERATION	QUALITY PLAN		CUSTOMER :			PROJECT TITLE			SPECIFICATION : NUMBER :		
		SHEET 9 OF 9		BIDDER/ VENDOR :			QUALITY PLAN NUMBER PED-506-Q-007, REV-03			SPECIFICATION : TITLE		
1	2	3	4	5	6	7	8	9	10	11	SECTION AGENCY	
											CHARACTERISTIC CHECK	CAT.

NOTES:

- 1 DEPENDING UPON THE SIZE AND CRITICALLY, WITNESSING BY BHEL SHALL BE DECIDED.
- 2 ROUTINE TESTS ON 100% MOTORS SHALL BE DONE BY THE VENDOR. HOWEVER, BHEL SHALL WITNESS ROUTINE TESTS ON RANDOM SAMPLES. THE SAMPLING PLAN SHALL BE MUTUALLY AGREED UPON.
- 3 IN CASE TEST CERTIFICATES FOR THESE TESTS ON SIMILAR TYPE, SIZE AND DESIGN OF MOTOR FROM INDEPENDENT LABORATORY ARE AVAILABLE, THESE TEST MAY NOT BE REPEATED.
- 4 WHEREVER CUSTOMER IS INVOLVED IN INSPECTION, AGENCY (1) SHALL MEAN BHEL AND CUSTOMERS BOTH TOGETHER.

Legends for Inspection agency

1. BHEL/CUSTOMER
2. VENDOR (MOTOR MANUFACTURER)
3. SUB-VENDOR (RAW MATERIAL/COMPONENTS SUPPLIER)

P. PERFORM
W. WITNESS
V. VERIFY

BHEL		BIDDER/VENDOR	
PARTICULARS	NAME	SIGNATURE	DATE
			BIDDER'S/VENDORS COMPANY SEAL

 Anind
 SA Khan
 Pritesh Khatke

CUSTOMER :		PROJECT		SPECIFICATION :							
TITLE		TITLE		NUMBER :							
QUALITY PLAN		QUALITY PLAN		SPECIFICATION							
BIDDER/ VENDOR		NUMBER PED-506-00-Q-006, REV-01		TITLE							
SYSTEM		ITEM AC ELECT. MOTORS BELOW 55KW (LV)		SECTION							
CAT.		REFERENCE DOCUMENT		AGENCY							
SHEET 1 OF 2		EXTENT OF CHECK		P W V							
COMPONENT/OPERATION CHECK		TYPE/METHOD OF CHECK		REMARKS							
1	2	3	4	5	6	7	8	9	10	11	
1.0	ASSEMBLY	1.WORKMANSHIP 2.DIMENSIONS 3.CORRECTNESS COMPLETENESS TERMINATIONS/ MARKING/COLOUR CODE	MA	VISUAL -DO- VISUAL	100% -DO- 100%	MANUF'S SPEC MFG. DRG./ MFG. SPEC. MFG.SPEC./ RELEVANT IS	MANUF'S SPEC MFG. DRG./ MFG. SPEC. MFG.SPEC. RELEVANT IS	-DO- -DO- -DO-	2 - 2 - 2 -	- - -	
2.0	PAINTING	1.SHADE	MA	VISUAL	SAMPLE	MANUF'R'S SPEC/BHEL SPEC./RELEVANT STANDARD	BHEL SPEC. SAME AS COL.7	LOG BOOK	2 -	-	
3.0	TESTS	1.ROUTINE TEST INCLUDING SPECIAL TEST AS PER BHEL SPEC. 2.OVERALL DIMENSIONS & ORIENTATION	MA	-DO-	100%	IS-325/ BHEL SPEC./ DATA SHEET	SAME AS COL.7	TEST REPORT	2 1	NOTE -1 & NOTE-3	
			MA	MEASUREMENT & VISUAL	100%	APPROVED DRG/DATA SHEET	APPROVED DRG/DATA SHEET & RELEVANT IS	INSPN. REPORT	2 1	NOTE -1 & NOTE-3	
BHEL		PARTICULARS		BIDDER/VENDOR							
		NAME									
		SIGNATURE									

 Arvind
 SA Khan
 Paveen Kabir

SL. NO.	QUALITY PLAN	CUSTOMER :				PROJECT TITLE			SPECIFICATION :		
		BIDDER/ VENDOR SYSTEM	TYPE/ METHOD OF CHECK	EXTENT OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD	SECTION AGENCY	NUMBER :	SPECIFICATION :	
1	2	3	4	5	6	7	8	9	10	TITLE :	
	<p>QUALITY PLAN</p> <p>SHEET 2 OF 2</p> <p>COMPONENT/OPERATION CHARACTERISTICS CHECK</p> <p>3.NAMEPLATE DETAILS</p>	MA	VISUAL	100%	IS-325 & DATA SHEET	IS-325 & DATA SHEET	IS-325 & DATA SHEET	INSPN. REPORT	2 1 -	VOLUME III	
	<p>NOTES:</p> <p>1 ROUTINE TESTS ON 100% MOTORS SHALL BE DONE BY THE VENDOR. HOWEVER, BHEL SHALL WITNESS ROUTINE TESTS ON RANDOM SAMPLES. THE SAMPLING PLAN SHALL BE MUTUALLY AGREED UPON</p> <p>2 WHERE EVER CUSTOMER IS INVOLVED IN INSPECTION, (1) SHALL MEAN BHEL AND CUSTOMERS BOTH TOGETHER.</p> <p>3 FOR EXHAUST/VENTILATION FAN MOTORS OF RATING UPTO 1.5KW , ONLY ROUTINE TEST CERTIFICATES SHALL BE FURNISHED FOR SCRUTINY.</p> <p><u>Legends for inspection agency</u></p> <p>1. BHEL/CUSTOMER</p> <p>2. VENDOR (MOTOR MANUFACTURER)</p> <p>3. SUB-VENDOR (RAW MATERIAL/COMPONENTS SUPPLIER)</p> <p>P. PERFORM</p> <p>W. WITNESS</p> <p>V. VERIFY</p>										
	BHEL	PARTICULARS		BIDDER/VENDOR		BIDDER/VENDOR		BIDDER/VENDOR			
		NAME		SIGNATURE		DATE		BIDDER'S/VENDORS COMPANY SEAL			

Arvind SA Khan Pawan Kishor

Explanatory notes for filling up cable list for routing through WinPath, the cable routing program (developed by Corporate R&D) being used in PEM.

1. For the purpose of clarity, it may please be noted that the information given in regard to the cables to be routed through WinPath as per the system elaborated below is called "Cable List", while the term "Cable Schedule" applies to the cable list with routing information added after routing has been carried out.
2. The cable list shall be entered as an MS Excel file in the format as per enclosed template EXT_CAB_SCH_FORMAT.XLS. No blank lines, special characters, header, footer, lines, etc. shall be introduced in the file. No changes shall be made in the title line (first line) of the template.
3. The field properties shall be as under:
 - a. UNITCABLENO: A/N, up to sixteen (16) characters; each cable shall have its own unique, unduplicated cable number. In case this rule is violated, the cable cannot be taken up for routing.
 - b. FROM: A/N, up to sixty (60) characters; the "From" end equipment/ device description and location to be specified here. Information in excess of 60 characters will be truncated after 60 characters.
 - c. TO: A/N, up to sixty (60) characters; the "To" end equipment/ device description and location to be specified here. Information in excess of 60 characters will be truncated after 60 characters.
 - d. PURPOSE: A/N, up to sixty (60) characters; the purpose (i.e. power cable/ indication/ measurement, etc.) to be specified here. Information in excess of 60 characters will be truncated after 60 characters.
 - e. REMARKS: A/N, up to forty (40) characters; Any information pertinent to routing to be specified here (e.g., cable number of the cable redundant to the cable number being entered). Information in excess of 40 characters will be truncated after 40 characters.
 - f. CABLESIZE: A/N, 7 characters exactly as per the codes indicated below shall be specified here. The program cannot route cables described in any other way/ format.
 - g. PATHCABLENO: Field reserved for utilization by the program. User shall not enter any information here.
4. One list shall be prepared for each system/ equipment (i.e., separate and unique cable lists shall be prepared for each system).
5. The cables shall be described as per the scheme listed below:

A	NN	A	NNN
Cable	No. of cores	Cable code	Cable size
Voltage	(e.g. 01,03,3H, 07)	(See C below)	(e.g. 035,185,2.5, 0.5)
Code (see B below)			

(A) SYSTEM VOLTAGE CODES:
 (ac) A = 11KV, B = 6.6KV, C = 3.3KV, D = 415V, E = 240V, F = 110V
 (dc) G = 220V, H = 110V, J = 48V, K = +24V, L = -24V

(B) CABLE VOLTAGE CODES:
 A = 11KV (Power cables)

Explanatory notes for filling up cable list for routing through WinPath, the cable routing program (developed by Corporate R&D) being used in PEM.

- B = 6.6KV (Power cables)
- C = 3.3KV (Power cables)
- D = 1.1KV (LV & DC system power & control cables)
- E = 0.6KV (0.5 sq. mm. Control cables)

(C) CABLE CODES

PVC Copper

- A = Armoured FRLS
- B = Armoured Non-FRLS
- C = unarmoured FRLS
- D = Unarmoured Non-FRLS

PVC Aluminium

- E = Armoured FRLS
- F = Armoured Non-FRLS
- G = unarmoured FRLS
- H = Unarmoured Non-FRLS

XLPE Copper

- J = Armoured FRLS
- K = Armoured Non-FRLS
- L = unarmoured FRLS
- M = Unarmoured Non-FRLS

XLPE Aluminium

- N = Armoured FRLS
- P = Armoured Non-FRLS
- Q = unarmoured FRLS
- R = Unarmoured Non-FRLS

- S = FIRE SURVIVAL CABLES
- T = TOUGH RUBBER SHEATH
- U = OVERALL SCREENED
- V = PAIRED OVERALL SCREENED
- W = PAIRED INDIVIDUAL SCREENED
- Y = COMPENSATING CABLES
- I = PRE-FABRICATED CABLES
- Z = JELLY FILLED CABLES



4X270 MW BHADRADRI TPS
C & I PORTION SPECIFICATION
VENTILATION SYSTEM

SPECIFICATION No: PE-TS-411-554-A001

VOLUME II B

SECTION C3

REV. 00

DATE: MARCH 2015

SECTION-C3
C&I SPECIFICATION



Technical specification for
VENTILATION SYSTEM

4 X 270 MW BHADRADRI TPS

SPEC NO.: PE-TS-411-145-I

VOLUME

SECTION

REV. NO. 00

DATE : 19.03.2015

SHEET 1 OF 2

C&I TECHNICAL SPECIFICATION FOR VENTILATION SYSTEM



Technical specification for
VENTILATION SYSTEM
4 X 270 MW BHADRADRI TPS

SPEC NO.: PE-TS-411-145-I

VOLUME

SECTION

REV. NO.

00

DATE : 19.03.2015

SHEET

2

OF

2

Table of Contents

Section-C

Sht. No.

1.1 Specific technical requirement 3

Section D

1.1	PLC Configuration	8
1.2	Actuator specification and Datasheet	10
1.3	Drive Control philosophy	21
1.4	UPS Scheme	27
1.5	Instrumentation Datasheet & Check list	29
1.6	LCP & Junction Boxes Specification and Quality plan	66
1.7	PC Specification	93
1.8	Furniture specification	96
1.9	Cable BOQ	98
1.10	KKS Philosophy	100
1.11	List of Deliverables	105



Technical specification for
VENTILATION SYSTEM
 4 X 270 MW BHADRADRI TPS

SPEC NO.: PE-TS-411-145-I

VOLUME

SECTION **C**

REV. NO. 00

DATE : 19.03.2015

SHEET 1 OF 1

SPECIFIC TECHNICAL REQUIREMENT



**SPECIFIC TECHNICAL REQUIREMENT FOR
VENTILATION SYSTEM
4X270 MW BHADRADRI TPS**

SPECIFICATION NO.

VOLUME **II-B**

SECTION : **C**

REV. NO. 00

DATE: 19.03.2015

SHEET 1

OF 4

1. **Complete** Control & Instrumentation for Ventilation System is in bidder scope of supply. Items not specifically mentioned however required for the completeness of the system shall be supplied by bidder.
2. A common PLC based control system cum Annunciation panel with solid state annunciation windows along with product integrated microprocessor panel for the chilling unit shall be provided for Air Conditioning and Ventilation system by the AC system vendor.
3. The Ventilation system shall be controlled from the common AC system PLC panel. Vendor to furnish the list of drives/motors/fans/pumps etc., Input/output lists to be hooked up to the PLC panel and other necessary inputs so that necessary provision and hardware requirement can be ensured at PLC panel by the AC system vendor for designing and fabrication of its panel.
4. Bidder to include Field instrumentation along with necessary fittings, accessories and valve manifold etc. and Field Junction Box (JB's), in his scope of supply. Each instrument/ equipment shall have a unique KKS Tag no. Field instrument specification and Data Sheet are given elsewhere in this specification. Bidder to provide local control panel wherever required.
5. All fields cabling for instruments/motor/pump/blower to JB is in bidder's scope and details are given elsewhere in the specification. The field I/O s should be grouped together in JB's suitably and a common trunk cable shall be taken to the panel. Cable between JB to PLC shall be provided by BHEL as free issue as per 'Electrical scope split sheet' in Electrical portion of the specification whereas cable schedule, cable interconnection details and wiring diagram for the same shall be in bidders' scope.
6. Cable schedule, cable interconnection details and wiring diagram where one end equipment and/or both end equipments are in bidder scope shall be provided by the bidder.
7. Instrument installation drawings are to be provided by bidder. All instrument fitting and erection hardware/racks as per instrument installation diagram shall be in bidder's scope.
8. All manual valves at pump discharge shall be provided with Open and Close Limit Switches.
9. PLC control system as defined in the enclosed specification and Data Sheets shall be in bidder scope. The PLC system shall comprise of (i) PLC based local panel (ii) UPS Power supply (iii) Operator interface in the form of CRT, keyboard and OWS along with required furniture.



**SPECIFIC TECHNICAL REQUIREMENT FOR
VENTILATION SYSTEM
4X270 MW BHADRADRI TPS**

SPECIFICATION NO.

VOLUME **II-B**

SECTION : **C**

REV. NO. 00

DATE: 19.03.2015

SHEET 2

OF 4

10. PLC shall have the facility to synchronize its time with BHEL plant master clock system using IRIG-B signals. Necessary Hardware (IRIG-B port) for same at PLC end to be provided by bidder. The cable connecting PLC and plant master clock system shall be in BHEL scope.
11. PLC shall be connected to DCS through serial link with OPC Compliant for monitoring/Control. For details, please refer PLC Configuration Diagram.
12. All furniture (tables, chairs etc.) required for PLC operator HMI shall be in bidder's scope. Chairs shall be capable of being adjusted for height and position of backrest. The chairs shall be mounted on five castors, shall swivel and shall have arm rests'. One table and chair shall be provided for each operator station and separate table for each printer.
13. The requirements given below are to be read in conjunction with detailed Technical specification enclosed.
14. For instrument and control cable scope of supply, refer 'Electrical scope split sheet' in Electrical portion of the specification.
15. Bidder shall provide at least 20% or minimum two numbers, whichever are higher, spare channels as hot on rail spares in each configured I / O modules. In addition to this 10% or minimum one number, whichever is higher, extra assigned complete spare I / O modules mounted on rails in sub racks as hot on rail spare for each category of installed I / O modules shall also be provided. Spare modules shall be distributed over each controller group. Spare channel and modules shall be fully wired up to termination cabinets.
16. Every panel-mounted instrument, requiring power supply, shall be provided with a pair of easily replaceable glass cartridge fuses of suitable rating. Every instrument shall be provided with a grounding terminal and shall be suitably connected to the panel grounding bus.
17. Supplied system shall provide critical group alarms for both AC and ventilation system to be hardwired to plant DCS.
18. Provision for input fire signal from fire alarm system to be ensured in the PLC panel for opening/ closing of the motor operated fire dampers.
19. Provision for separate Terminal block/wiring diagram for power and control blocks of control panel to be ensured.
20. Provision for earthing of the panel to be provided by vendor.



**SPECIFIC TECHNICAL REQUIREMENT FOR
VENTILATION SYSTEM
4X270 MW BHADRADRI TPS**

SPECIFICATION NO.

VOLUME **II-B**

SECTION : **C**

REV. NO. 00

DATE: 19.03.2015

SHEET 3

OF 4

21. Vendor to submit GA drawing of control panel indicating layout of instruments, construction details, wiring diagram, class of protection for enclosure, paint type, paint color, thickness and material of enclosure sheet, control scheme during detailed engineering.
22. Layout & space requirement of panel to be specified during detailed engineering.
23. All bidirectional drives (Motor Operated Valves, MOVs) are integral starter type. Typical Hook Up diagram of all types of drives is attached for use(subject to Customer approval).
24. Bidder shall provide Cable Schedule in BHEL excel format provided in Electrical portion of the specification. Also, Cable Interconnections details for Complete System shall be in Bidders' scope.
25. 415 V AC/ 240 V AC (3 Phase, 3 Wire) supply shall be provided by BHEL at a single point as per 'Electrical scope split sheet' in Electrical portion of the specification. Further distribution to various instruments/Equipment shall be in Bidder's scope. Bidder to include the necessary power distribution board in his scope. Any power supply other than the above, if required for any instrument/equipment has to be derived from the above supply & all the necessary hardware for the same shall be in Bidder's scope.
26. Bidder to provide all control panels, system cabinets, termination & relay cabinets complete with all accessories, wiring and all mounting and erection hardware including junction boxes, canopies, structural steel as required. All instruments/drives shall be terminated on Junction Boxes/Panel in Bidder scope of supply. 20% Spare terminals shall be provided on Junction Boxes.
27. Bidder to delegate/depute their person/experts as per owner/consultant requirements.
28. The make of all the items shall be from approved sub-vendor list.
29. The design, manufacture, inspection, testing, site calibration and installation of all C&I equipment and systems covered under this specification shall conform to the latest editions of applicable codes and standards eg. ANSI, ASME, IEEE, ISO, IEC, IGCI, AWS, NFPA, AISC, IGS, SAMA, UBC, UL, NESC, NEMA, ISA, DIN, VDE, IS etc.



**SPECIFIC TECHNICAL REQUIREMENT FOR
VENTILATION SYSTEM
4X270 MW BHADRADRI TPS**

SPECIFICATION NO.

VOLUME **II-B**

SECTION : **C**

REV. NO. 00

DATE: 19.03.2015

SHEET 4

OF 4

30. Bidder shall provide the signal exchange, to Plant DCS in BHEL prescribed format to be furnished during detailed engineering.

NOTES:

1. All equipment items shall be of latest design with proven on track record from reputed experienced manufacturers of specified type and range of equipment. The make/model of various instruments/items/systems and instrument sub-vendor shall be subject to approval of BHEL/Customer during detailed engineering stage.
2. The above given scope is indicative & minimum. Any item/ equipment not indicated above however required for the completeness of the system is to be supplied by bidder without any technical, commercial and delivery implication to BHEL.
3. Documents of C&I System shall be submitted to end user/owner for approval during detail engineering. Changes, if any, shall be accommodated by the bidder without any price/time implication.



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.: **PE-TS-411-145-I**

VOLUME

SECTION

REV. NO. 00


DATE : 19.03.2015

SHEET OF

PLC CONFIGURATION

NOTES:

- 1) TABLE TOP OWS/EWS SHALL BE 24" OR AVAILABLE INDUSTRY STANDARD.
- 2) PLC SYSTEM SHALL HAVE REDUNDANCY IN PROCESSOR, POWER SUPPLY AND COMMUNICATION SYSTEM.
- 3) UPS POWER SUPPLY SHALL BE USED FOR PLC PANEL(S), OWS/EWS AND NETWORK COMPONENTS.
- 4) POWER SUPPLY ARRANGEMENT FOR PLC SYSTEM SHALL BE AS SHOWN ON SHEET 2 OF 2.
- 5) PLC PANEL SHALL HAVE PROVISION TO ACCEPT TIME SYNC. SIGNAL (NTP/IRIG-B) FROM MASTER CLOCK SYSTEM (BHEL SUPPLY).
- 6) PLC PANEL SHALL HAVE PROVISION FOR DATA EXCHANGE (OPC) WITH PLANT DCS.
- 7) NECESSARY PATCH CORD/CONVERTERS, LIU AT BOTH PLC AND DCS END SHALL BE IN BHEL-EDN SCOPE.

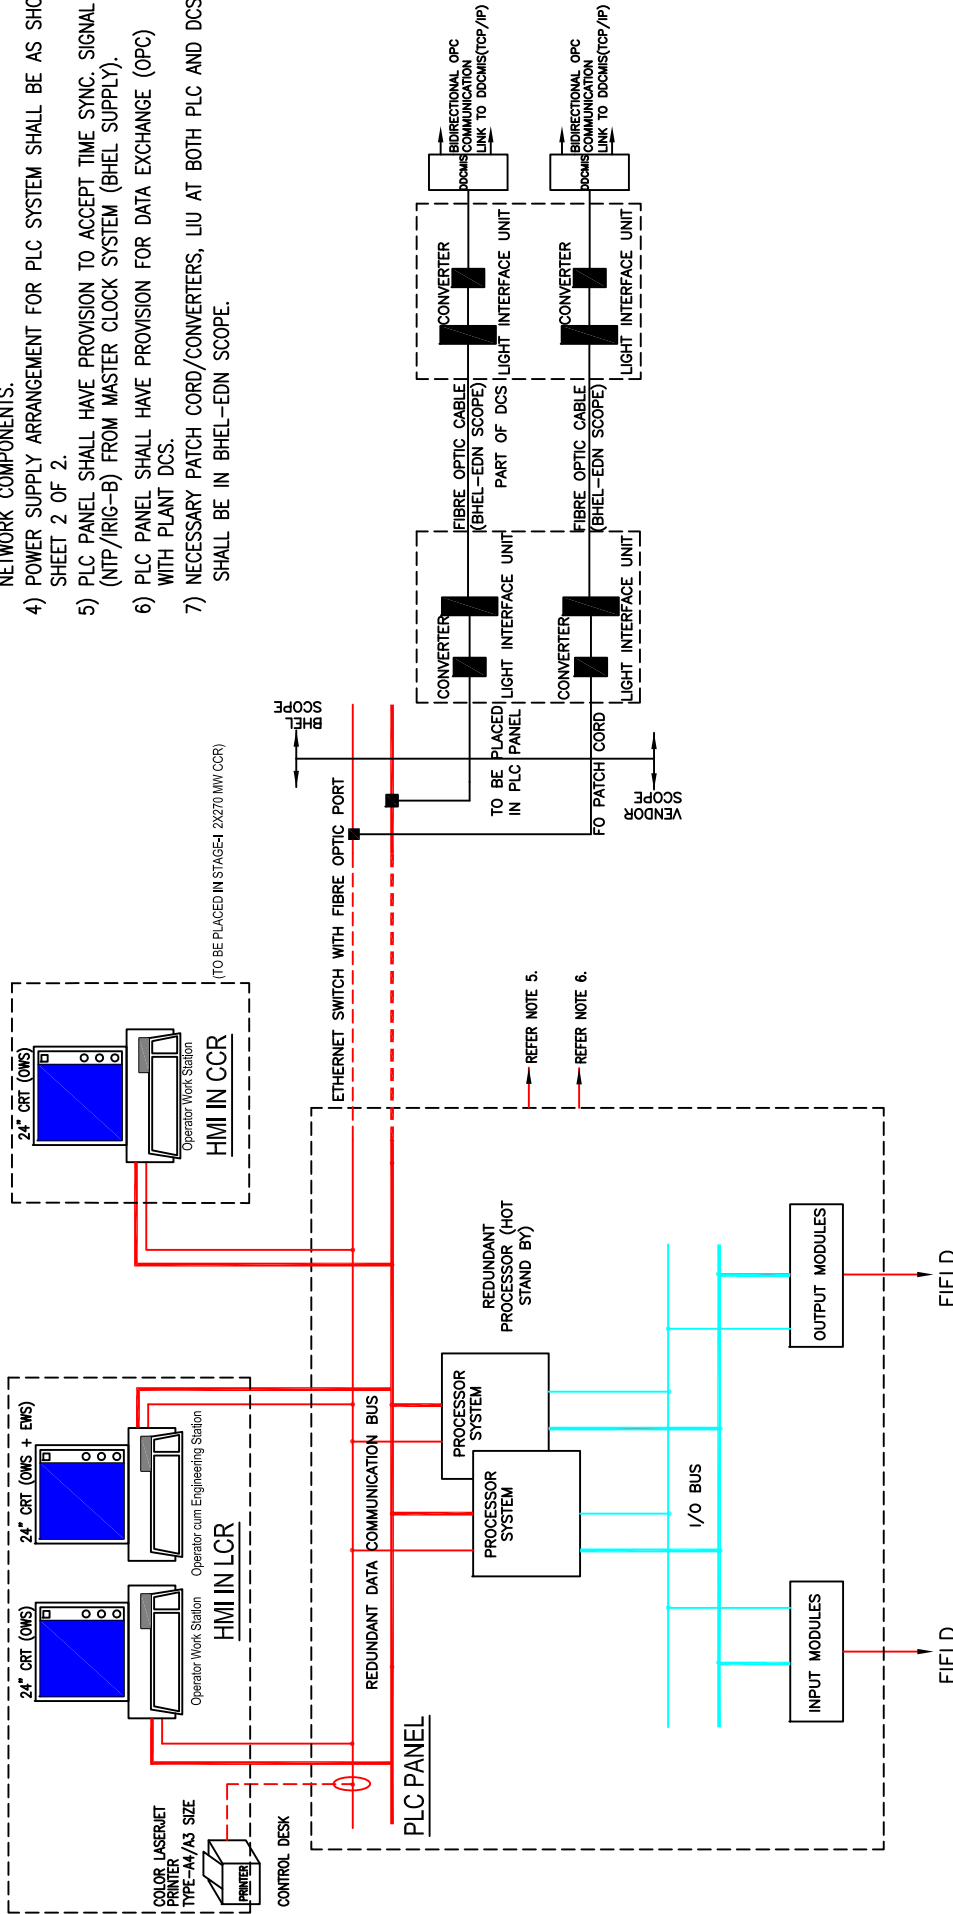

LEGEND: -

- PROGRAMMABLE LOGIC CONTROLLER
- DISTRIBUTED CONTROL SYSTEM
- UNINTERRUPTED POWER SUPPLY
- OPERATOR WORK STATION/ ENGINEERING WORK STATION
- HUMAN MACHINE INTERFACE
- NETWORK TIME PROTOCOL
- OLE PROCESS CONTROL
- MOULDED CASE CIRCUIT BREAKER
- MINIATURE CIRCUIT BREAKER
- LOCAL CONTROL ROOM
- COMMON CONTROL ROOM

PROJECT:

4X270 MW BHADRADRI TPS

DRG.NO. PE-DM-411-145-1900

TITLE:

PLC CONFIGURATION
AC/VENTILATION

DATE 21.03.2015

REV.NO. 00

SHT 19 Page of 9 dr.106



Arvind SA Khan Pawan Kataria



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.: **PE-TS-411-145-I**

VOLUME

SECTION

REV. NO. 00

DATE : 19.03.2015

SHEET OF

ACTUATOR SPECIFICATION

VOLUME: V-A

SECTION-III

**TECHNICAL SPECIFICATION
FOR
ELECTRIC MOTOR ACTUATORS**

1.00.00 SCOPE

1.01.00 This Section covers the general requirements of Electric Motor Actuators for valves/dampers.

1.02.00 All electric motor actuators shall be furnished in accordance with this general specification and the accompanying driven equipment specification. All the electrical actuators shall be INTEGRAL type only.

2.00.00 STANDARDS

2.01.00 All electrical equipment shall conform to the latest applicable IS, ANSI and NEMA Standards, except when stated otherwise herein or in driven equipment specification.

2.02.00 Major standards, which shall be followed, are listed below. Other applicable Indian Standards for any component part even if not covered in the listed standards shall also be followed

i) IS -9334

ii) IS-325

3.00.00 SERVICE CONDITIONS

3.01.00 The actuator shall be suitable for operation in hot, humid and tropical atmosphere, highly polluted at places with coal dust and/or fly ash.

3.02.00 Unless otherwise noted, electrical equipment/system design shall be based on the service conditions and auxiliary power supply given in the general specification.

3.03.00 For actuator motor installed outdoor and exposed to direct sun rays, the effect of solar heat shall be considered in the determination of the design ambient temperature.

4.00.00 RATING

4.01.00 For isolating service, the actuator shall be rated for three successive open-close operation of the valve/damper or 15 minutes, whichever is longer.

4.02.00 For regulating service, the actuator shall be suitably time-rated for the duty cycle involved with necessary number of starts per hour, but in no case less than 150 starts per hour.

5.00.00 **PERFORMANCE**

The actuator shall meet the following performance requirements:

- 5.01.00 Open and close the valve completely and make leak-tight valve closure without jamming.
- 5.02.00 Attain full speed operation before valve load is encountered and imparts an unseating blow to start the valve in motion (hammer blow effect).
- 5.03.00 Operate the valve stem at standard stem speed and shall function against design differential pressure across the valve seat.
- 5.04.00 The motor reduction gearing shall be sufficient to lock the shaft when the motor is de-energised and prevent drift from torque switch spring pressure.
- 5.05.00 The entire mechanism shall withstand shock resulting from closing with improper setting of limit switches or from lodging of foreign matter under the valve seat.

6.00.00 **SPECIFIC REQUIREMENT**

6.01.00 **Construction**

- 6.01.01 The actuator shall essentially comprise the drive motor, torque/ limit switches, gear train, clutch, hand wheel, position indicator/ transmitter, in-built thermostat for over load protection, space heater and internal wiring.
- 6.01.02 The actuator enclosure shall be totally enclosed, dust tight, weather-proof suitable for outdoor use without necessity of any canopy. Degree of protection of enclosure for motor actuator shall be IP-65.
- 6.01.03 All electrical equipment, accessories and wiring shall be provided with tropical finish to prevent fungus growth.
- 6.01.04 The actuator shall be designed for mounting in any position without any lubricant leakage or operating difficulty.

6.02.00 **Motor**

- 6.02.01 The drive motor shall be three phase, squirrel cage, induction machine with minimum class B insulation and IPW-55 enclosure, designed for high torque and reversing service. Canopy shall be provided for outdoor service.
- 6.02.02 The motor shall be designed for full voltage direct on-line start, with starting current limited to 6 times full-load current.
- 6.02.03 The motor shall be capable of starting at 85 percent of rated voltage and running at 80 percent of rated voltage at rated torque and 85 percent rated voltage at 33 percent excess rated torque for a period of 5 minutes each.
- 6.02.04 Motor leads shall be terminated in the limit switch compartment.
- 6.02.05 Motor actuators for valves/dampers shall be with integral starter with 3phase/3wire, 415V AC and operable from remote.

- 6.02.06 Earthing terminals shall be provided on either side of the motor.
- 6.03.00 **Limit Switches**
- Each actuator shall be provided with following limit switches: -
- 6.03.01 2 torque limit switches, one for each direction of travel, self-locking, adjustable torque type.
- 6.03.02 4 end-of-travel limit switches, two for each direction of travel.
- 6.03.03 2 position limit switches, one for each direction of travel, each adjustable at any position from fully open to fully closed positions of the valve/damper.
- 6.03.04 Each limit switch shall have 2 NO + 2 NC potential free contacts. Contact rating shall be 5A at 240V A.C. or 0.5A at 220V D.C.
- 6.04.00 **Hand Wheel**
- Each actuator shall be provided with a hand wheel for emergency manual operation. The hand wheel shall de-energize automatically when the motor is energized.
- 6.05.00 **Position Indicator/Transmitter**
- The actuator shall have:
- 6.05.01 One (1) built-in local position indicator for 0-100% travel.
- 6.05.02 One (1) position transmitter, 4-20 mA current signal as position feedback, for remote indicator.
- 6.06.00 **Space Heater**
- A space heater shall be included in the limit switch compartment suitable for 240V, 1 phase, 50 Hz supply.
- 6.07.00 **Wiring**
- All electrical devices shall be wired up to and terminated in a terminal box. All wiring shall be done with 1100 V grade fire resistance PVC insulated stranded copper conductor of not less than 2.5 Sq.mm cross section. All wiring shall be identified at both ends with ferrules. All the electrical actuators shall have uniform wiring.
- 6.08.00 **Terminal Box**
- The terminal box shall be weather proof, with removable front cover and cable glands for cable connection. The terminal shall be suitable for connection of 2.5 Sq.mm copper conductor.
- 7.00.00 **ACCESSORIES**

As required for the driven equipment, the actuator shall be furnished with starting equipment mounted on the actuator. This shall include:

- 7.01.00 One (1) triple pole MCCB
- 7.02.00 One (1) reversing starter with mechanically interlocked contactors, 3 thermal overload relays, 2 NO + 2 NC auxiliary contacts for each contactor.
- 7.03.00 One (1) remote-local selector switch.
- 7.04.00 CLOSE-STOP-OPEN oil tight push buttons with indication lights.
- 7.05.00 415/240 V control transformer with primary & secondary fuses.

8.00.00 **TEST**

The actuator and all components there of shall be subject to tests as per relevant Standards. In addition, if any special test is called for in equipment specification, the same shall be performed.

9.00.00 **DRAWINGS, DATA & MANUALS**

- 9.01.00 Drawings, Data & Manuals shall be submitted in triplicate with the bid and in quantities and procedures as specified in General Conditions of Contract and/or elsewhere in the specification for approval and subsequent distribution after the issue of 'Letter of Intent'.

9.02.00 **To be submitted with Bid**

Data sheet for each type of actuator shall be furnished along with internal wiring diagram, suggested control schematic and torque limit switch contact development and manufacturer's catalogues. Drawings, Data & Manuals shall be submitted in triplicate with the bid and in quantities and procedures as specified in General Conditions of Contract and/or elsewhere in the specification for approval and subsequent distribution after the issue of 'Letter of Intent'.

9.03.00 **To be submitted for Owner / Purchaser's Approval and Distribution**

All relevant drawings and data pertaining to the equipment like GTP, GA drawing, foundation plan, BOM, control & schematics, QAP, etc. shall be submitted by the Bidder for approval of Owner/Owner's consultant. Also refer clause no. 1.19.02(u) of Section-I of Volume – V-A : Technical Specifications for Electrical Equipment & Accessories.

ANNEXURE-A

DESIGN DATA

1.0 AUXILIARY POWER SUPPLY

S	upply	Description	Consumer
	L.V. Supply (i)	415V, 3Ø, 3W, 50 Hz Effectively earthed Fault level 50 kA symm. for 1 sec.	u Motors above 0.2kW pto less than 175kW.
	(ii)	240V AC/415V AC 240V, 1Ø, 2W, 50 Hz effectively earthed	Motors upto 0.2kW. Lighting, Space heat- ing , A.C supply for Contr- l & protective devices.
	D.C. Supply	220V, 2W, unearthed Fault level 25* kA. for 1 sec.	& D.C. alarm, control protective devices

* Indicative only, the actual value will be decided by the Bidder, after substantiating the same by calculation.

2.0 RANGE OF VARIATION

A.C. Supply :

V	oltage	:	± 10%
	Frequency	:	+3% to -5%.
	Combined Volt + frequency	:	10% (absolute sum)

During starting of large motor, the voltage may drop to 80% of the rated voltage for a period of 60 seconds. All electrical equipment while running shall successfully ride over such period without affecting system performance.

D.C. Supply :

Voltage	:	187 to 242
---------	---	------------



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.: **PE-TS-411-145-I**

VOLUME


SECTION

REV. NO. 00

DATE : 19.03.2015

SHEET OF


Actuator Data Sheet


	SPECIFICATION FOR MOTORISED VALVE ACTUATOR		SPECIFICATION NO.: PE-SS-411-145-1007	
	VOLUME			
	SECTION			
	REV. NO.	00	DATE:	14.11.14
	SHEET	1	OF	3

Data Sheet A & B

DATA SHEET-A (TO BE FILLED BY PURCHASER)	DATA SHEET-B (TO BE FILLED-UP BY BIDDER)
---	---


350

GENERAL*	* PROJECT	4X270 MW BHADRADRI TPS		
	OFFER REFERENCE			
	* TAG NO. SERVICE			
	* DUTY	<input checked="" type="checkbox"/> ON / OFF REQUIRED)	<input checked="" type="checkbox"/> INCHING (AS	
	* LINE SIZE (inlet/outlet): MATERIAL			
	* VALVE TYPE	<input type="checkbox"/> GLOBE <input type="checkbox"/> GATE <input type="checkbox"/> REG. GLOBE <input type="checkbox"/> BUTTERFLY		
	* OPENING / CLOSING TIME			
	* WORKING PRESSURE			
	AMBIENT CONDITION	SHALL BE SUITABLE FOR CONTINUOUS OPERATION UNDER AN AMBIENT TEMP. OF 0-55 DEG C AND RELATIVE HUMIDITY OF 0-95%		
	VALVE SEAT TEST PRESS	BIDDER TO SPECIFY		
	REQUIRED VALVE TORQUE	BIDDER TO SPECIFY		
	ACTUATOR RATED TORQUE	BIDDER TO SPECIFY		
CONSTRUCTION AND SIZING	MECHANICAL POSITION INDICATOR	TO BE PROVIDED FOR 0-100% TRAVEL		
	BEARINGS	DOUBLE SHIELDED, GREASE LUBRICATED ANTI-FRICTION.		
	GEAR TRAIN FOR LIMIT SWITCH/TORQUE SWITCH OPERATION	METAL (NOT FIBRE GEARS). SELF-LOCKING TO PREVENT DRIFT UNDER TORQUE SWITCH SPRING PRESSURE WHEN MOTOR IS DE-ENERGIZED.		
	SIZING	OPEN/CLOSE AT RATED SPEED AGAINST DESIGNED DIFFERENTIAL PRESSURE AT 85% OF RATED VOLTAGE. FOR ISOLATING SERVICE THREE SUCCESSIVE OPEN-CLOSE OPERATIONS OR 15 MINS. WHICHEVER IS HIGHER. FOR INCHING(REGULATING) SERVICE 150 STARTS/HR MINIMUM		
HANDWHEEL	* REQUIRED	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO		
	* ORIENTATION	<input type="checkbox"/> TOP MOUNTED <input type="checkbox"/> SIDE MOUNTED		
	TO DISENGAGE AUTOMATICALLY DURING MOTOR OPERATION.			
ELECTRIC ACTUATOR	ACTUATOR MAKE/MODEL	BIDDER TO SPECIFY		
	MOTOR MAKE / MODEL / TYPE / RATING (KW)	BIDDER TO SPECIFY		
	MOTOR TYPE	SQUIRREL CAGE INDUCTION MOTOR, STARTING CURRENT LIMITED TO SIX TIMES THE RATED CURRENT.		
	ACTUATOR APPLICABLE WIRING DIAGRAM	<input checked="" type="checkbox"/> ENCLOSED (BIDDER TO CONFIRM) A: <input checked="" type="checkbox"/> DRG. NO. 3-V-MISC-24227 R00 B: <input type="checkbox"/> DRG. NO. 3-V-MISC-24550 R00 C: <input type="checkbox"/> DRG. NO. 3-V-MISC-24283 R00 D: <input type="checkbox"/> DRG. NO. 4-V-MISC-90271 R11		
	COLOUR SHADE	<input checked="" type="checkbox"/> BLUE (RAL 5012) ENAMEL <input type="checkbox"/>		
	SHAFT RPM	BIDDER TO SPECIFY		
	OLR SET VALUE	BIDDER TO SPECIFY		
	STARTING / FULL LOAD CURRENT	BIDDER TO SPECIFY		
	NO. OF REV FOR FULL TRAVEL	BIDDER TO SPECIFY		
	@ PWR SUPP TO MTR / STARTER	415V, 3PH, AC		
	@ CONTROL VOLTAGE REQUIREMENT	TO BE DERIVED INTERNALLY		
	@ ENCLOSURE CLASS OF MOTOR	<input type="checkbox"/> IP 65 <input checked="" type="checkbox"/> IP 67 <input type="checkbox"/> FLAME PROOF <input type="checkbox"/> IP 55, TOTALLY ENCL, SELF VENTILATED.		
	@ INSULATION CLASS	<input type="checkbox"/> CLASS-B <input checked="" type="checkbox"/> CLASS-F (TEMP. RISE LIMITED TO CLASS B)		
	@ WINDING TEMP PROTECTION	 PHASE)		

	SPECIFICATION FOR MOTORISED VALVE ACTUATOR	SPECIFICATION NO.: PE-SS-411-145-1007	
		VOLUME	
		SECTION	
		REV. NO. 00	DATE: 14.11.14
		SHEET 2	OF 3
Data Sheet A & B			
DATA SHEET-A (TO BE FILLED BY PURCHASER)		DATA SHEET-B (TO BE FILLED-UP BY BIDDER)	

350

	SINGLE PHASE / WRONG PHASE SEQUENCE PROTECTION	REQUIRED	
INTEGRAL STARTER	INTEGRAL STARTER	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	TYPE OF SWITCHING DEVICE	<input checked="" type="checkbox"/> CONTACTORS <input type="checkbox"/> THYRISTORS	
	TYPE	<input checked="" type="checkbox"/> CONVENTIONAL <input type="checkbox"/> SMART (NON-INTRUSIVE)	
	STEP DOWN CONT. TRANSFORMER	<input checked="" type="checkbox"/> REQUIRED	
	OPEN / CLOSE PB	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	STOP PB	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	INDICATING LAMPS	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	LOCAL REMOTE S/S	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	STATUS CONTACTS FOR MONITORING	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	INTEGRAL STARTER DISTURBED SIGNAL	REQUIRED (O/L RELAY OPERATED, CONT./POWER SUPPLY FAILED, S/S IN LOCAL, TORQUE SWITCH OPTD. MID WAY)	
INTERPOSING RELAY (Applicable for integral Starter)	INTERPOSING RELAYS	REQUIRED	
	INTERPOSING RELAY (QUANTITY)	<input type="checkbox"/> 2 NOS. <input checked="" type="checkbox"/> 3 NOS.	
	DRIVING VOLTAGE	<input checked="" type="checkbox"/> 20.5 – 24V DC <input type="checkbox"/> _____ V DC	
	DRIVING CURRENT	<input checked="" type="checkbox"/> 125mA MAX <input type="checkbox"/> _____ mA MAX	
	LOAD RESISTANCE	<input checked="" type="checkbox"/> > 192 ohms - <25 k ohms <input type="checkbox"/> > _____ ohms - < _____ ohms	
TORQUE SWITCH	MFR & MODEL NO.	BIDDER TO SPECIFY	
	OPEN / CLOSE	<input checked="" type="checkbox"/> 1 No. <input type="checkbox"/> 2Nos. / <input checked="" type="checkbox"/> 1 No. <input type="checkbox"/> 2Nos	
	CONTACT TYPE	2 NO + 2 NC	
	RATING	5A 240V AC AND 0.5A 220V DC	
	CALIBRATED KNOBS(OPEN&CLOSE TS)	REQUIRED FOR SETTING DESIRED TORQUE	
	ACCURACY	+3% OF SET VALUE	
LIMIT SWITCH	MFR & MODEL NO.	BIDDER TO SPECIFY	
	OPEN : INT : CLOSE	<input checked="" type="checkbox"/> 1 No. <input type="checkbox"/> 2 Nos. 2 Nos. (ADJ.) <input checked="" type="checkbox"/> 1 No. <input type="checkbox"/> 2Nos.	
	CONTACT TYPE	2 NO + 2 NC	
	RATING (AC / DC)	5A 240V AC AND 0.5A 220V DC	


	SPECIFICATION FOR MOTORISED VALVE ACTUATOR		SPECIFICATION NO.: PE-SS-411-145-1007	
			VOLUME	
			SECTION	
	REV. NO.	00	DATE:	14.11.14
	SHEET	3	OF	3
Data Sheet A & B				
DATA SHEET-A (TO BE FILLED BY PURCHASER)			DATA SHEET-B (TO BE FILLED-UP BY BIDDER)	

350

POSITION TRANSMITTER	POSITION TRANSMITTER (For inching duty)	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED		
	MFR & MODEL NO.	BIDDER TO SPECIFY		
	TYPE	<input checked="" type="checkbox"/> ELECTRONIC (2 WIRE) R/I CONVERTER <input type="checkbox"/> ELECTRONIC (2 WIRE) CONTACTLESS		
	SUPPLY	<input checked="" type="checkbox"/> 24V DC <input type="checkbox"/>		
	OUTPUT	<input checked="" type="checkbox"/> 4-20mA		
	ACCURACY	± 1% FS		
SPACE HEATER	@SPACE HEATER	REQUIRED		
	@ POWER SUPPLY			
	@ RATING	415v, 3PH, AC FOR RATING > 0.2KW; SINGLE PHASE FOR RATING < 0.2KW		
TERMINAL BOX	MOTOR TERMINAL BOX	REQUIRED		
	ACTUATOR TERMINAL BOX	REQUIRED		
	ENCL CLASS MTR T.B. / ACTUATOR T.B.	@ <input checked="" type="checkbox"/> IP 67 @ <input type="checkbox"/>	<input checked="" type="checkbox"/> IP67 <input type="checkbox"/>	
	@ EARTHING TERMINAL	REQUIRED		
	PLUG & SOCKET(9 PIN) (FOR COMM, LS/TS FEED BACK, PoT)	<input type="checkbox"/> REQUIRED <input checked="" type="checkbox"/> NOT REQUIRED <input type="checkbox"/> <input type="checkbox"/> 2 NOS. <input type="checkbox"/>		
CABLE GLANDS	@ POWER CABLE GLAND	SIZE:--DURING DETAIL ENGINEERING		
	@ SPACE HEATER CABLE GLAND	SIZE: 2C x 2.5 sq. mm		
	OTHER CONTROL CABLE GLANDS-1	INSTRUMENT CABLE SIZE FOR ON/OFF DUTY VALVES SHALL BE 8PX0.5 SQMM - ONE CABLE GLAND OF OD SIZE 20 MM. INSTRUMENT CABLE SIZE FOR INCHING DUTY TYPE VALVES SHALL HAVE TWO NO. CABLES (ONE NO. 8PX0.5 SQMM AND 2ND 2PX0.5 SQMM) - TWO NO. GLANDS OF OD SIZES 20 MM & 15 MM.		
	OTHER CONTROL CABLE GLANDS-2			
WEIGHT	TOTAL WEIGHT (ACTUATOR + ACCESSORIES)	BIDDER TO SPECIFY	_____ Kg.	
NOTES: 1. SCOPE: DESIGN, MANUFACTURE, INSPECTION, TESTING AND DELIVERY TO SITE OF ELECTRIC ACTUATOR FOR INCHING OR OPEN / CLOSE DUTY. 2. CODES & STANDARDS: DESIGN AND MATERIALS USED SHALL COMPLY WITH THE RELEVANT LATEST NATIONAL AND INTERNATION STANDARD. AS A MINIMUM, THE FOLLOWING STANDARDS SHALL BE COMPLIED WITH: IS-9334, IS-2147, IS-2148, IS-325, IS-2959, IS-4691 AND IS-4722 3. TEMPERATURE RISE SHALL BE RESTRICTED TO 70 DEG. C FOR AMBIENT TEMPERATURE OF 50 DEG C. 4. CABLE GLANDS OF DOUBLE COMPRESSION TYPE, BRASS MATERIAL SHALL BE PROVIDED. 5. THE TORQUE SWITCHES SHALL BE PROVIDED WITH MECHANICAL LATCHING DEVICE TO PREVENT OPERATION WHEN UNSEATING FROM THE END POSITIONS. THE LATCHING DEVICE SHALL UNLATCH AS SOON AS THE VALVE LEAVES THE END POSITION. IF SUCH PROVISION IS NOT POSSIBLE, THE TORQUE SWITCHES SHALL BE BYPASSED BY END-POSITION LIMIT SWITCHES WHICH OPENS ON VALVE LEAVING END POSITION.THESE LIMIT SWITCHES ARE ADDITIONAL TO THE NUMBER OF LIMIT SWITCHES SPECIFIED ELSEWHERE. 6. THE MOTOR SHALL OPERATE SATISFACTORILY UNDER THE +/- 10% SUPPLY VOLTAGE VARIATION AT RATED FREQUENCY, -5% TO +3% VARIATION IN FREQUENCY AT RATED SUPPLY VOLTAGE, SIMULTANEOUS VARIATION IN VOLTAGE & FREQUENCY THE SUM OF ABSOLUTE PERCENTAGE NOT EXCEEDING 10%. 7. THE MOTOR SHALL BE SUITABLE FOR DIRECT ON LINE STARTING.				
NOTES* = TO BE FILLED BY MPL (LEAD AGENCY), @= TO BE FILLED BY ES				





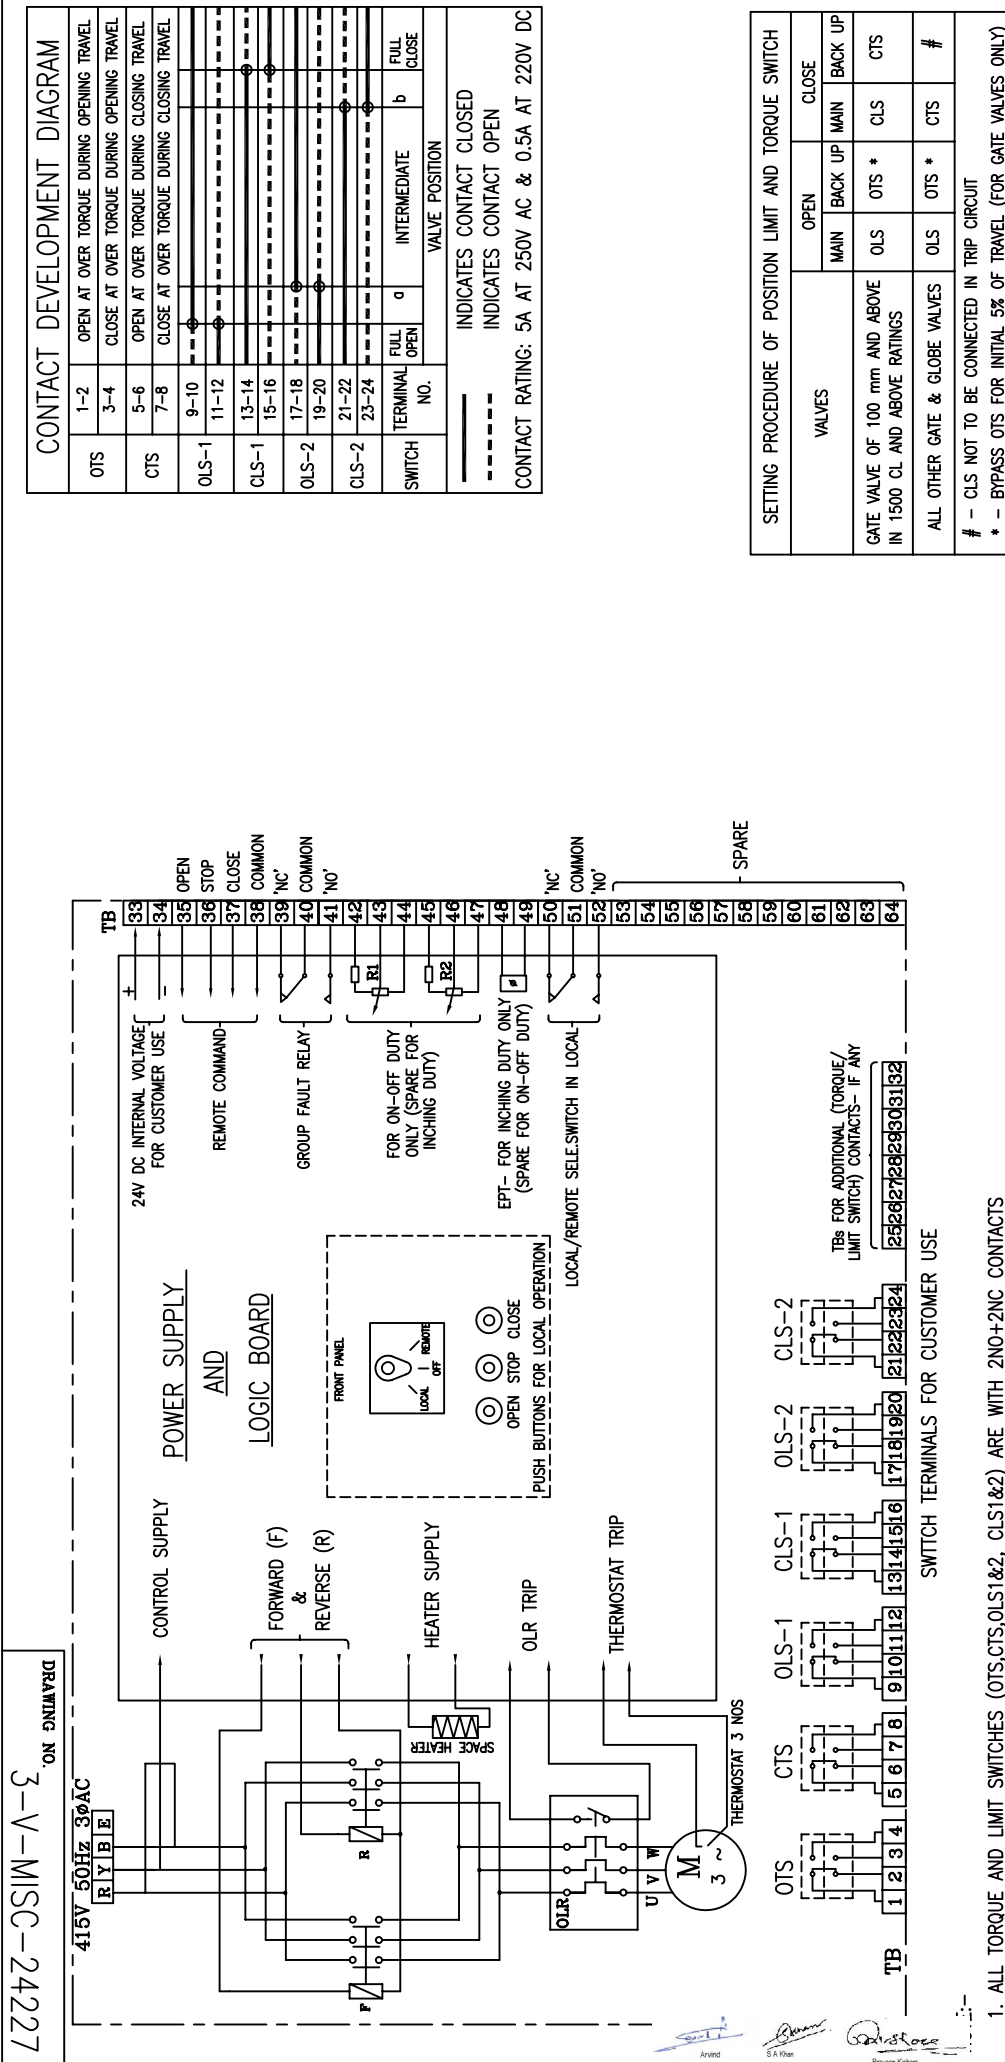

CONTACT DEVELOPMENT DIAGRAM

OTS	1-2	OPEN AT OVER TORQUE DURING OPENING TRAVEL
CTS <th>3-4</th> <th>CLOSE AT OVER TORQUE DURING OPENING TRAVEL</th>	3-4	CLOSE AT OVER TORQUE DURING OPENING TRAVEL
	5-6	OPEN AT OVER TORQUE DURING CLOSING TRAVEL
	7-8	CLOSE AT OVER TORQUE DURING CLOSING TRAVEL
OLS-1	9-10	
	11-12	
CLS-1	13-14	
	15-16	
OLS-2	17-18	
	19-20	
CLS-2	21-22	
	23-24	

TERMINAL NO. FULL OPEN o INTERMEDIATE b FULL CLOSE

INDICATES CONTACT CLOSED
 INDICATES CONTACT OPEN

CONTACT RATING: 5A AT 250V AC & 0.5A AT 220V DC

SETTING PROCEDURE OF POSITION LIMIT AND TORQUE SWITCH

VALVES	OPEN			CLOSE		
	MAIN	BACK UP	MAIN	BACK UP	MAIN	BACK UP
GATE VALVE OF 100 mm AND ABOVE IN 1500 CL AND ABOVE RATINGS	OLS	OTS *	CLS	CLS	CTS	CTS
ALL OTHER GATE & GLOBE VALVES	OLS	OTS *	CTS	CTS	CTS	#

- CLS NOT TO BE CONNECTED IN TRIP CIRCUIT
 * - BYPASS OTS FOR INITIAL 5% OF TRAVEL (FOR GATE VALVES ONLY)

TYPE OF PRODUCT ELECTRICAL VALVE ACTUATORS (AC) WITH INTEGRAL STARTERS
 OR NAME OF CUSTOMER/PROJECT
 (DRAWN FOR INTERMEDIATE POSITION OF VALVES)

BHARAT HEAVY ELECTRICALS LTD.,
 UNIT: HIGH PRESSURE BOILER PLANT,
 TIRUCHIRAPPALLI-620014.

365-121

DEPT	VL	SCALE	WEIGHT (KG)	REFERENCE INFORMATION	DATE	NO. OF VAR
					07.10.04	
					07.10.04	
					07.10.04	

CARD CODE U 01

WIRING DIAGRAM (TERMINAL PLAN)
 FOR ACTUATOR WITH INTEGRAL STARTER

DRAWING NO. 3-V-MISC-24227

Page no. 20 of 106

CAUTION: The information on this document is the property of BHARAT HEAVY ELECTRICALS LTD. It must not be used directly or indirectly in any way detrimental to the interest of the company.

REV	DATE	ALTERED
		CHD & APPD

SWITCH TERMINALS FOR CUSTOMER USE

TB	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	

25228272828909182
 21222324

1. ALL TORQUE AND LIMIT SWITCHES (OTS,CTS,OLS1&2, CLS1&2) ARE WITH 2NO+2NC CONTACTS '1NO+1NC' IS TERMINATED IN TBS 1-24, REMAINING CONTACTS ARE FOR INTERNAL USE.
 ANY SPARE CONTACTS WHICH ARE NOT USED INTERNALLY ARE TO BE TERMINATED IN TBS 25-32

2. CTS - TORQUE SWITCHES FOR CW ROTATION (CLOSE)

3. OTS - TORQUE SWITCHES FOR CCW ROTATION (OPEN)

4. OLS-1, OLS-2 - LIMITSWITCHES FOR POSITION OPEN

5. CLS-1, CLS-2 - LIMITSWITCHES FOR POSITION CLOSE

6. EPT - ELECTRONIC POSITION TRANSMITTER
 (Contactless , FOR INCHING DUTY)

7. R1-R2-POTENTIOMETER 2 x 100 OHMS (FOR ON-OFF DUTY)

8. FOR COMMANDS & EPT EITHER INTERNALLY GENERATED 24 VDC OR EXTERNAL SUPPLY OF 24VDC CAN BE USED

9. M - MOTOR 3Φ 415V 50 Hz AC SUPPLY



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.: PE-TS-411-145-I

VOLUME

SECTION


REV. NO. 00

DATE : 19.03.2015

SHEET OF


Drive Control Philosophy

PLC INTERFACE FOR BIDIRECTIONAL DRIVE(WITH INTEGRAL STARTER)

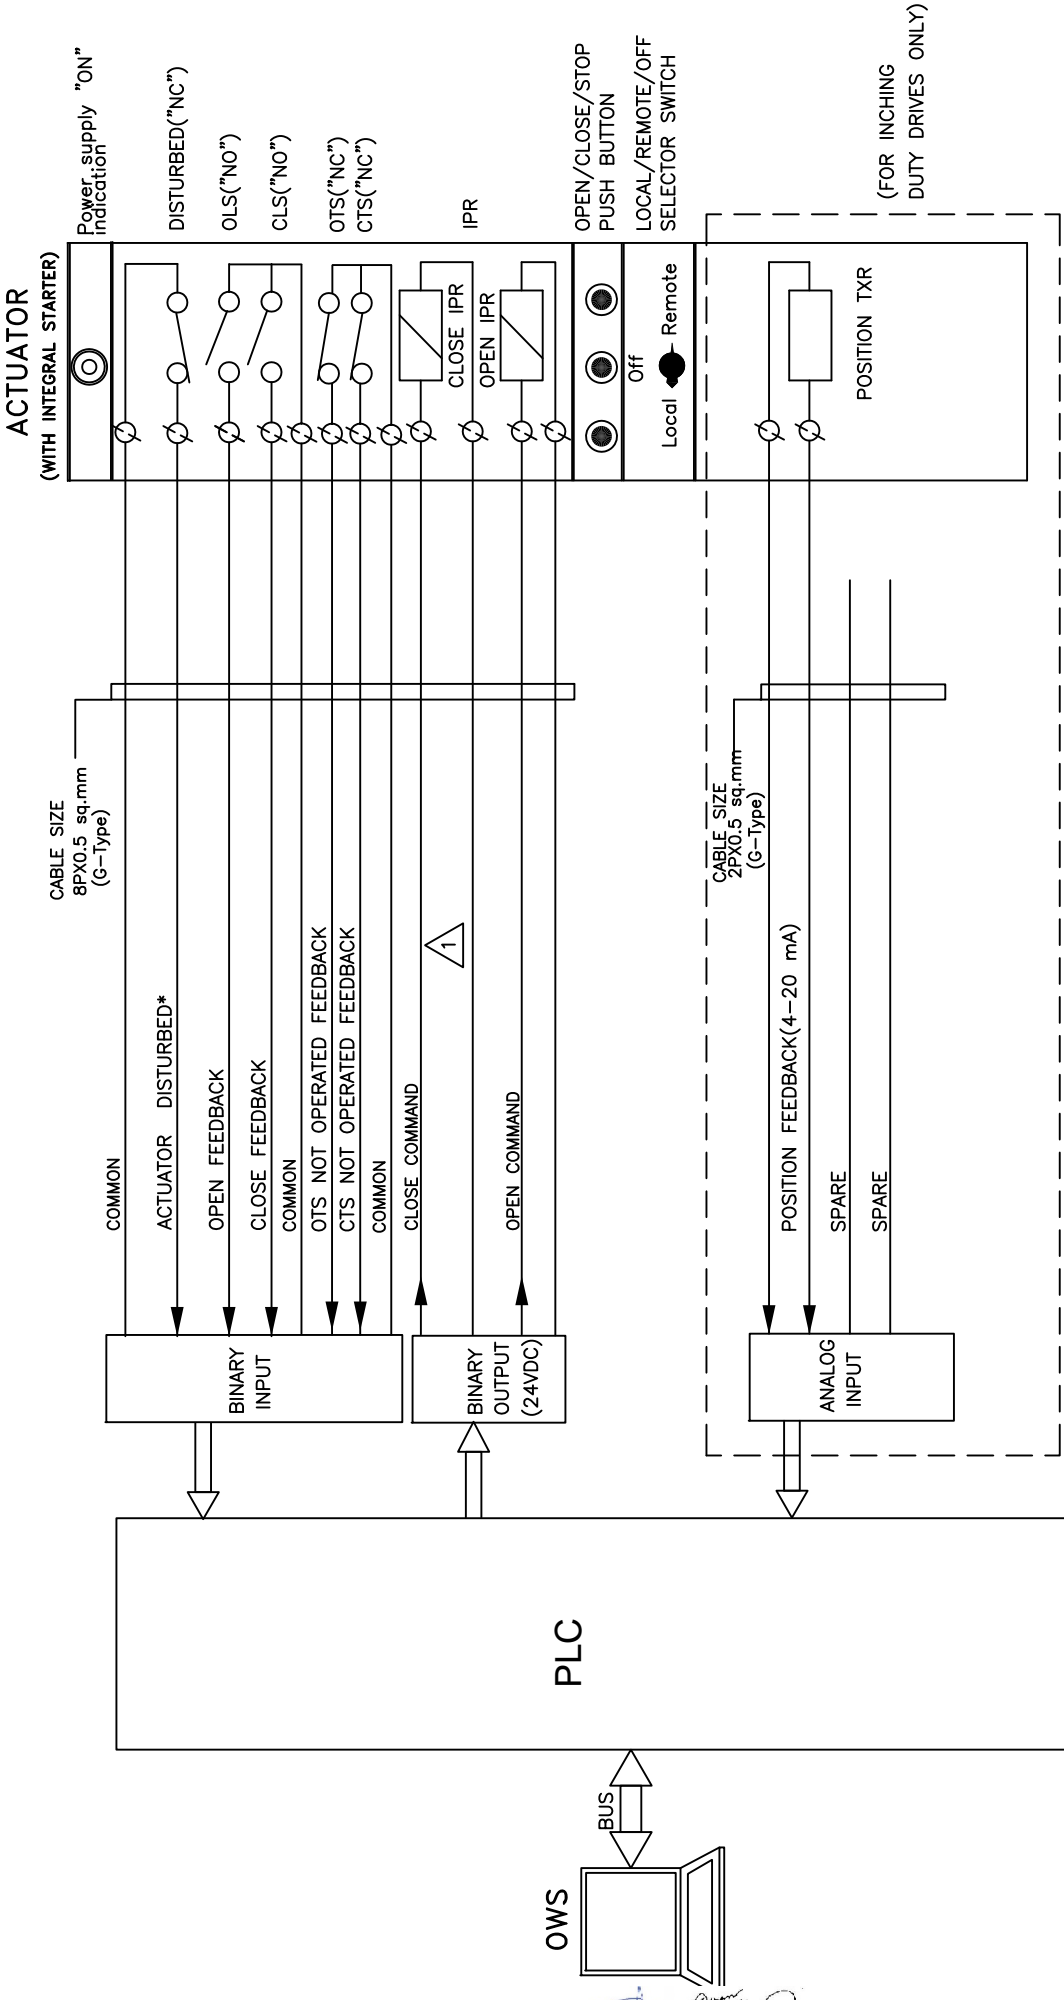

NOTE:

- * DISTURBED= Loss of Power supply (1 Phase/3 Phase)/
- Loss of control supply/ Motor thermostat trip/
- Thermal over load/
- Local/Off/Remote Sel. switch in local or off mode/
- Stop PB optd.



Arvind
S.A Khan
Pavleen Katar

	PROJECT: 4 X 270 MW BHADRADRI TPS	DRG.NO. PE-DM-411-145-1002
	TITLE PLC INTERFACE FOR BIDIRECTIONAL DRIVE	DATE 06.02.2015
		REV.NO. 01
		SHT 7 Page 06 of 22 of 106