PLC INTERFACE FOR UNIDIRECTIONAL LT DRIVE

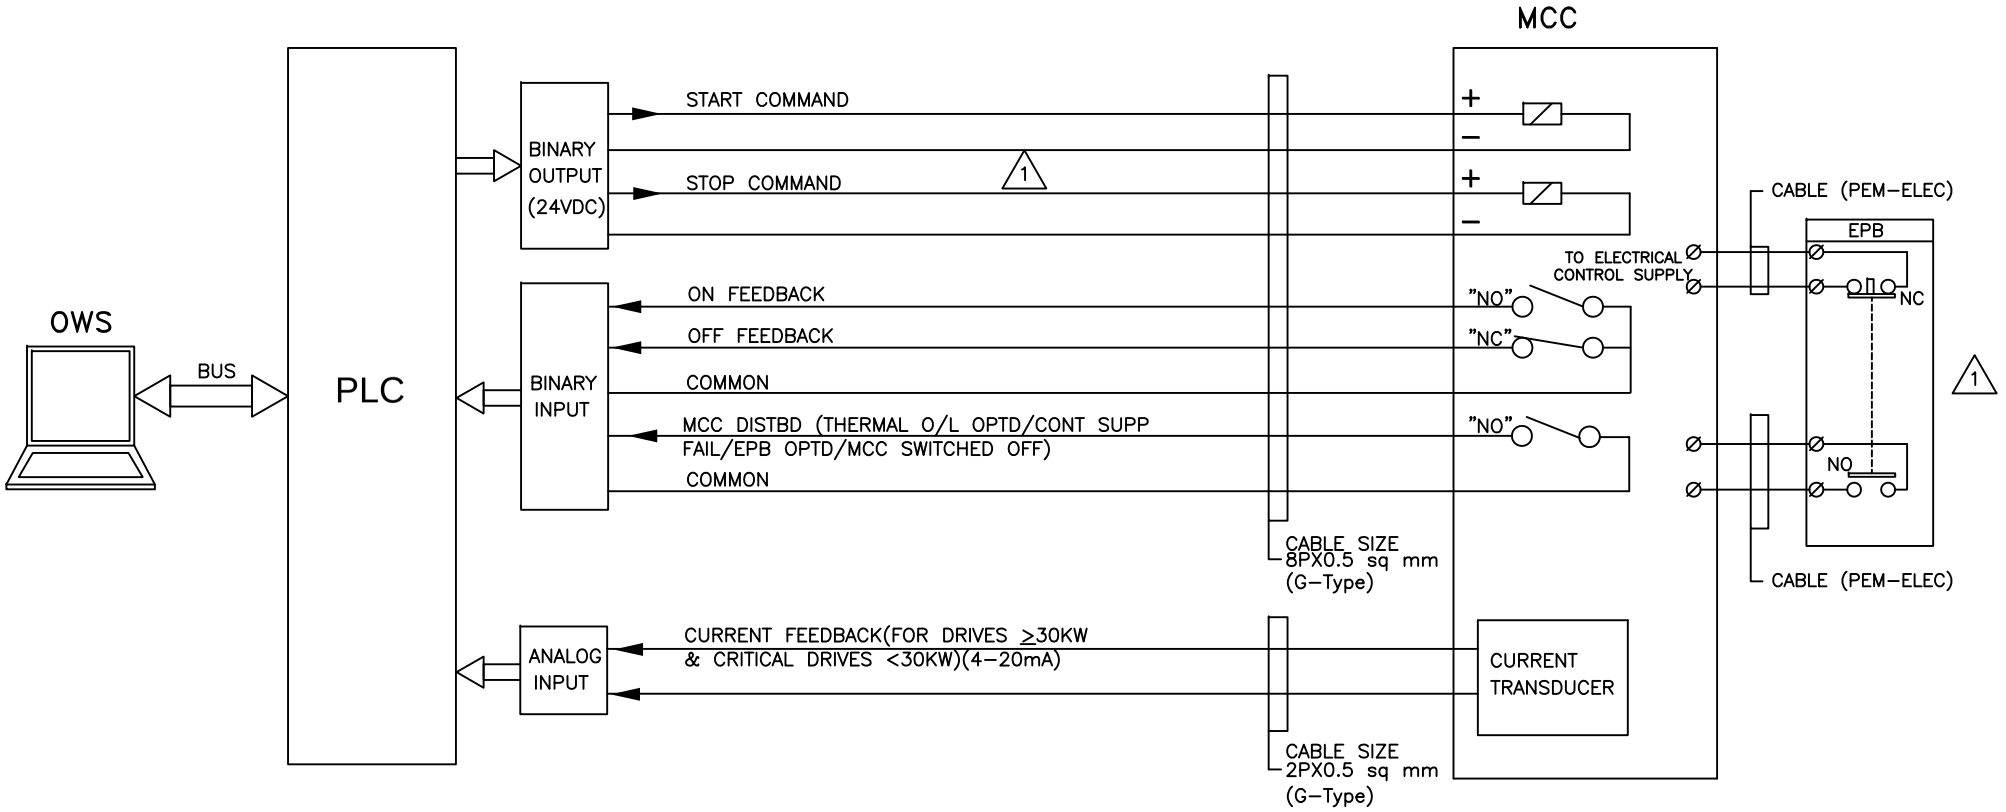

BHEL	PROJECT: 4 X 270 MW BHADRADRI TPS	DRG.NO.	PE-DM-411-145-I002
		DATE	06.02.2015
	TITLE PLC INTERFACE FOR UNIDIRECTIONAL LT DRIVE	REV.NO.	01
		SHT	8 OF 11

PLC INTERFACE FOR SOLENOID DRIVE
(24V DC / 240V AC UPS)

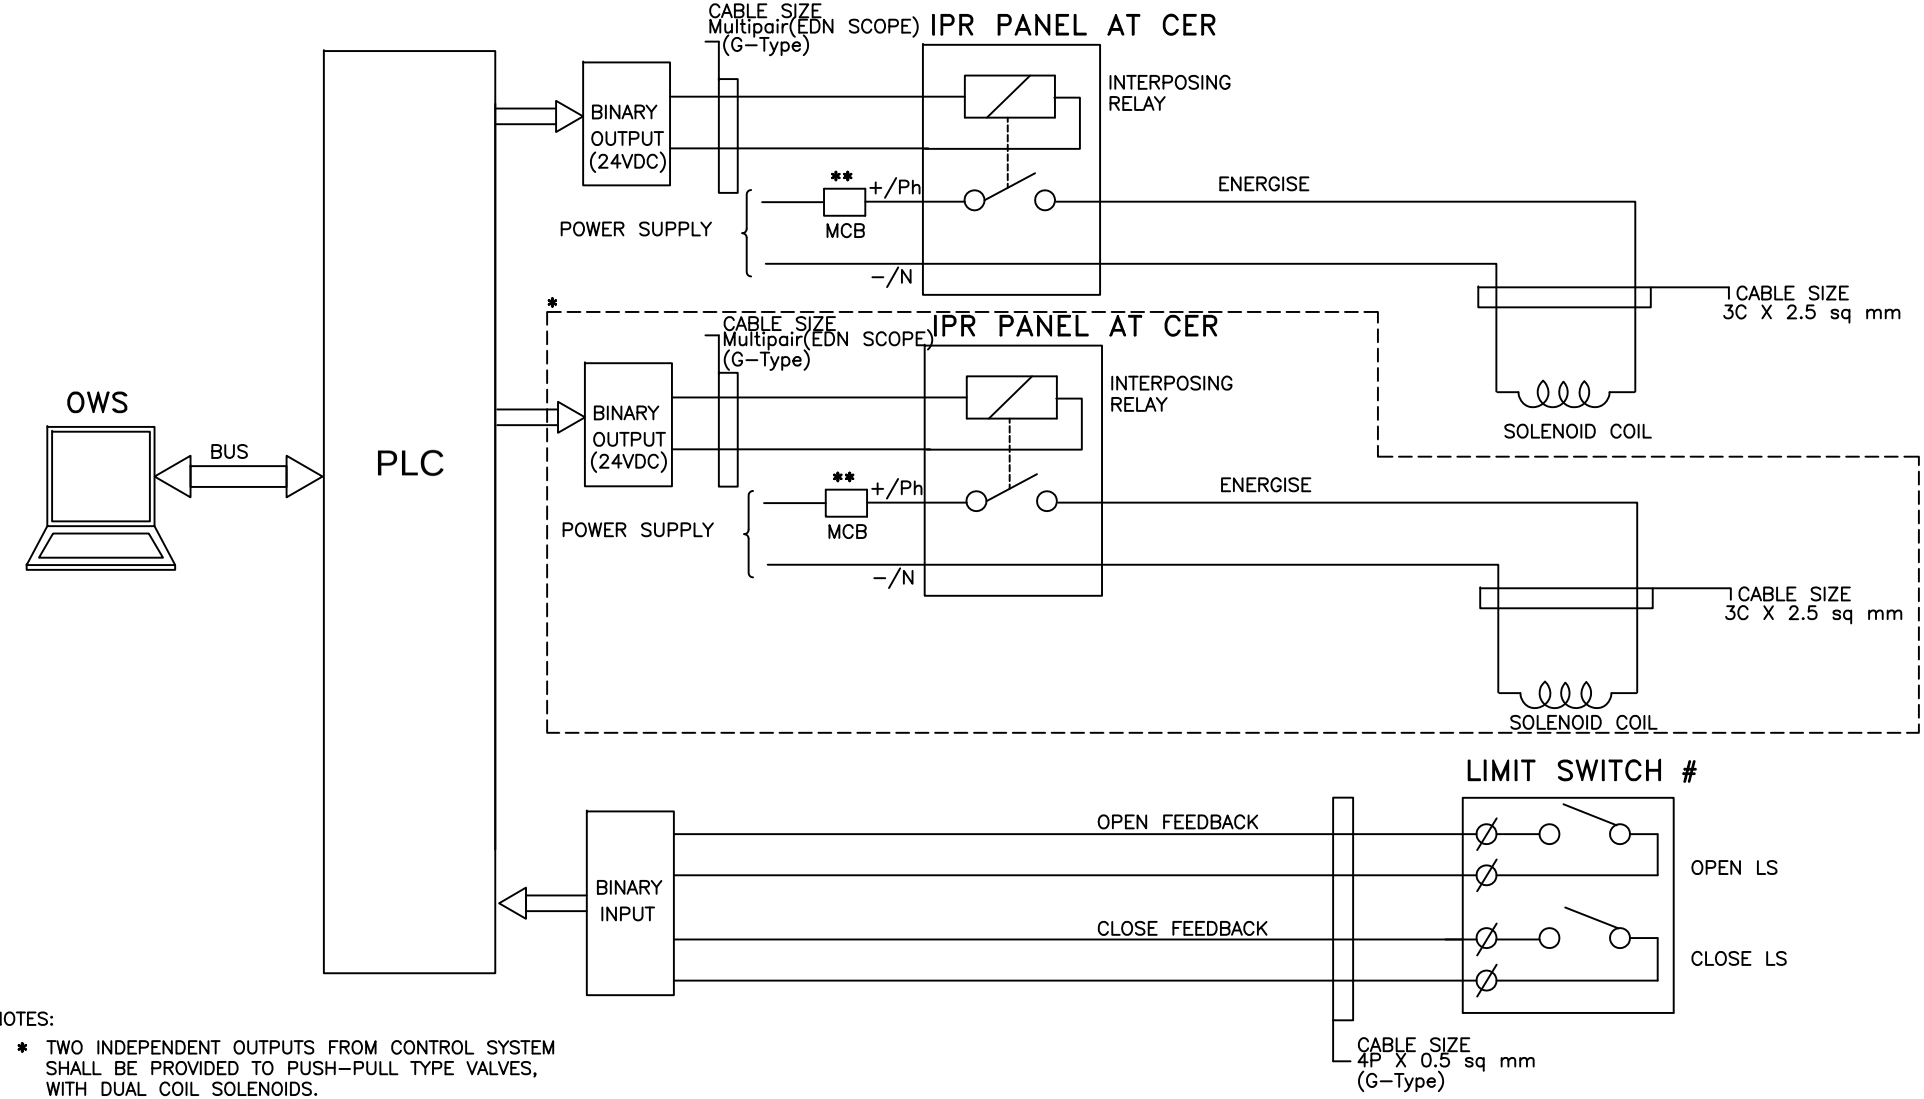

NOTES:

* TWO INDEPENDENT OUTPUTS FROM CONTROL SYSTEM SHALL BE PROVIDED TO PUSH–PULL TYPE VALVES, WITH DUAL COIL SOLENOIDS.

** MCB SHALL BE PROVIDED FOR EACH SOLENOID

\# FOR ON/OFF TYPE, SOLENOID ACTUATED CONTROL VALVE.

BHEL	PROJECT: 4 X 270 MW BHADRADRI TPS	DRG.NO.	PE–DM–411–145–I002
		DATE	18.11.2014
	TITLE PLC INTERFACE FOR SOLENOID DRIVE	REV.NO.	00
		SHT	9 OF 11

PLC INTERFACE FOR HT/LT UNIDIRECTIONAL DRIVES(BREAKER OPERATED)

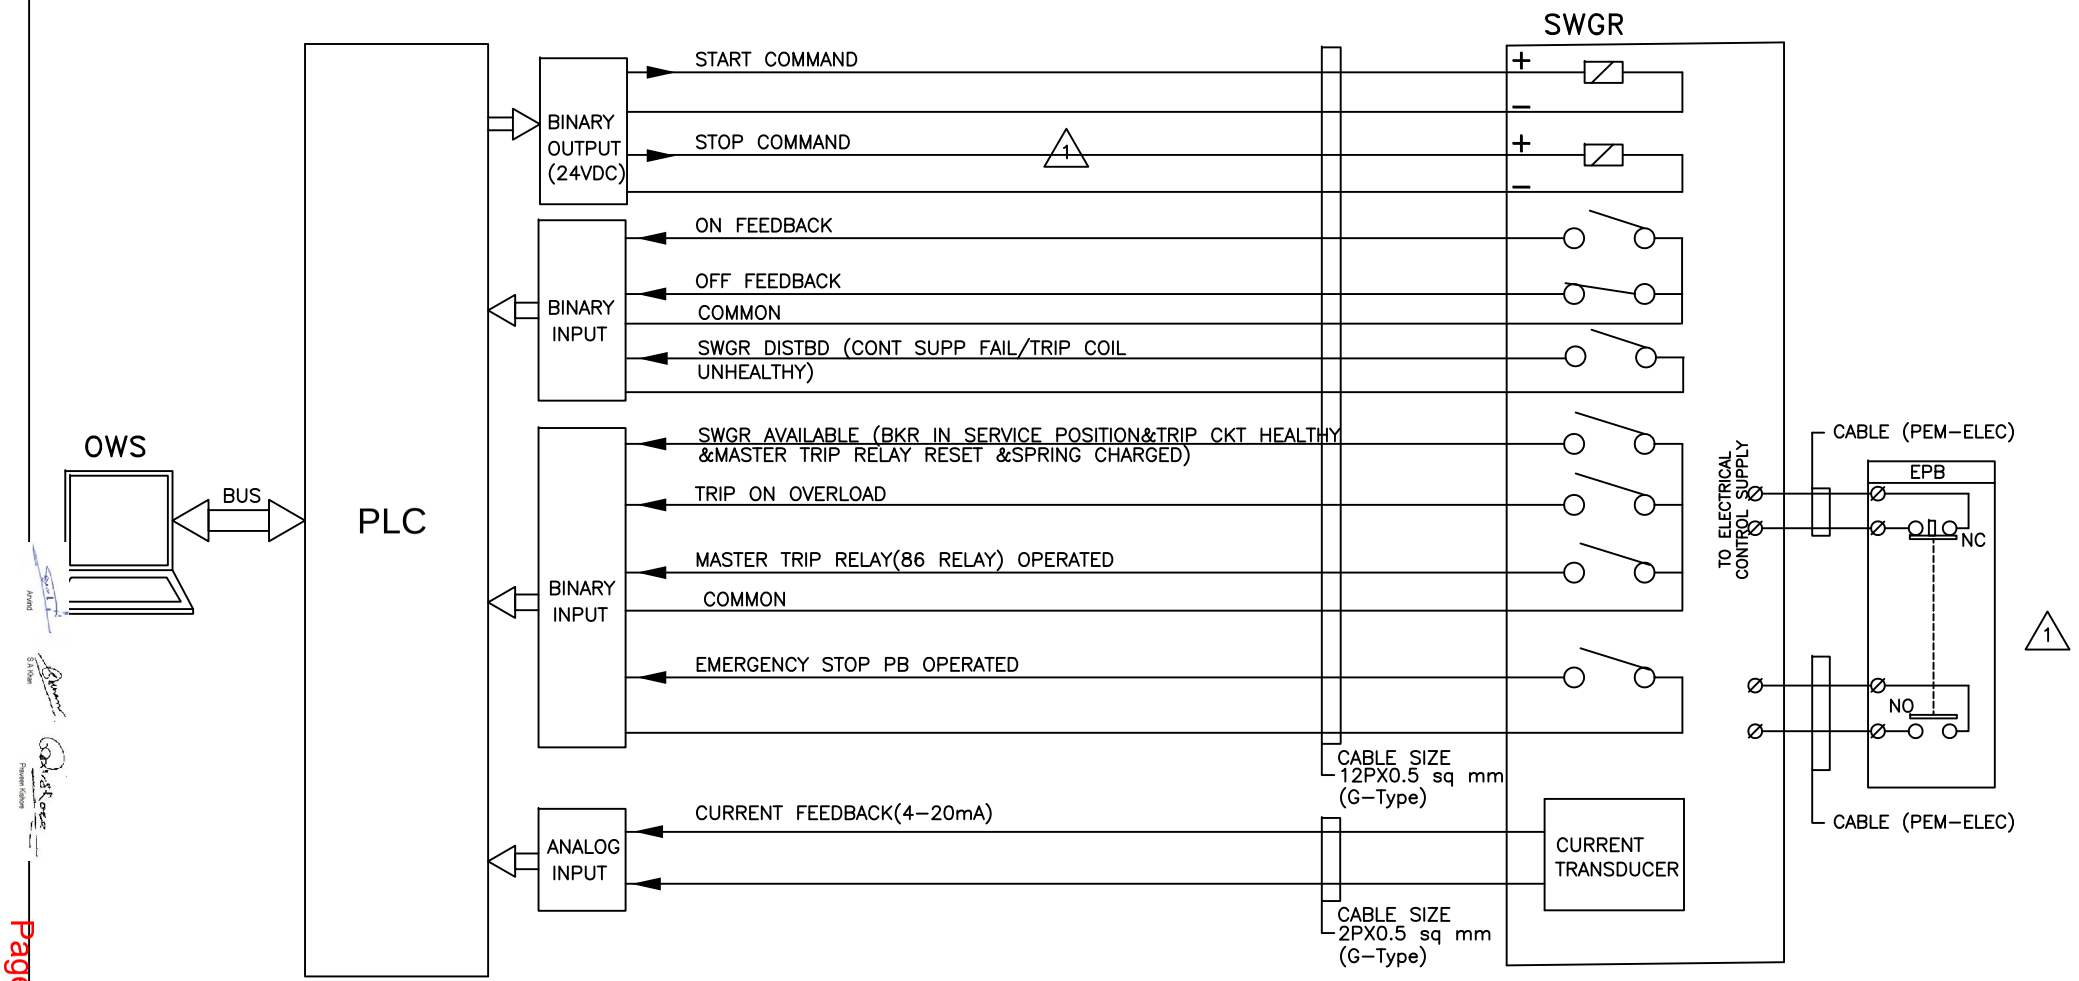

BHEL	PROJECT: 4 X 270 MW BHADRADRI TPS	DRG.NO.	PE–DM–411–145–I002
		DATE	06.02.2015
	TITLE PLC INTERFACE FOR UNIDIRECTIONAL HT DRIVE	REV.NO.	01
		SHT	10 OF 11

PLC INTERFACE FOR ANALOG DRIVE

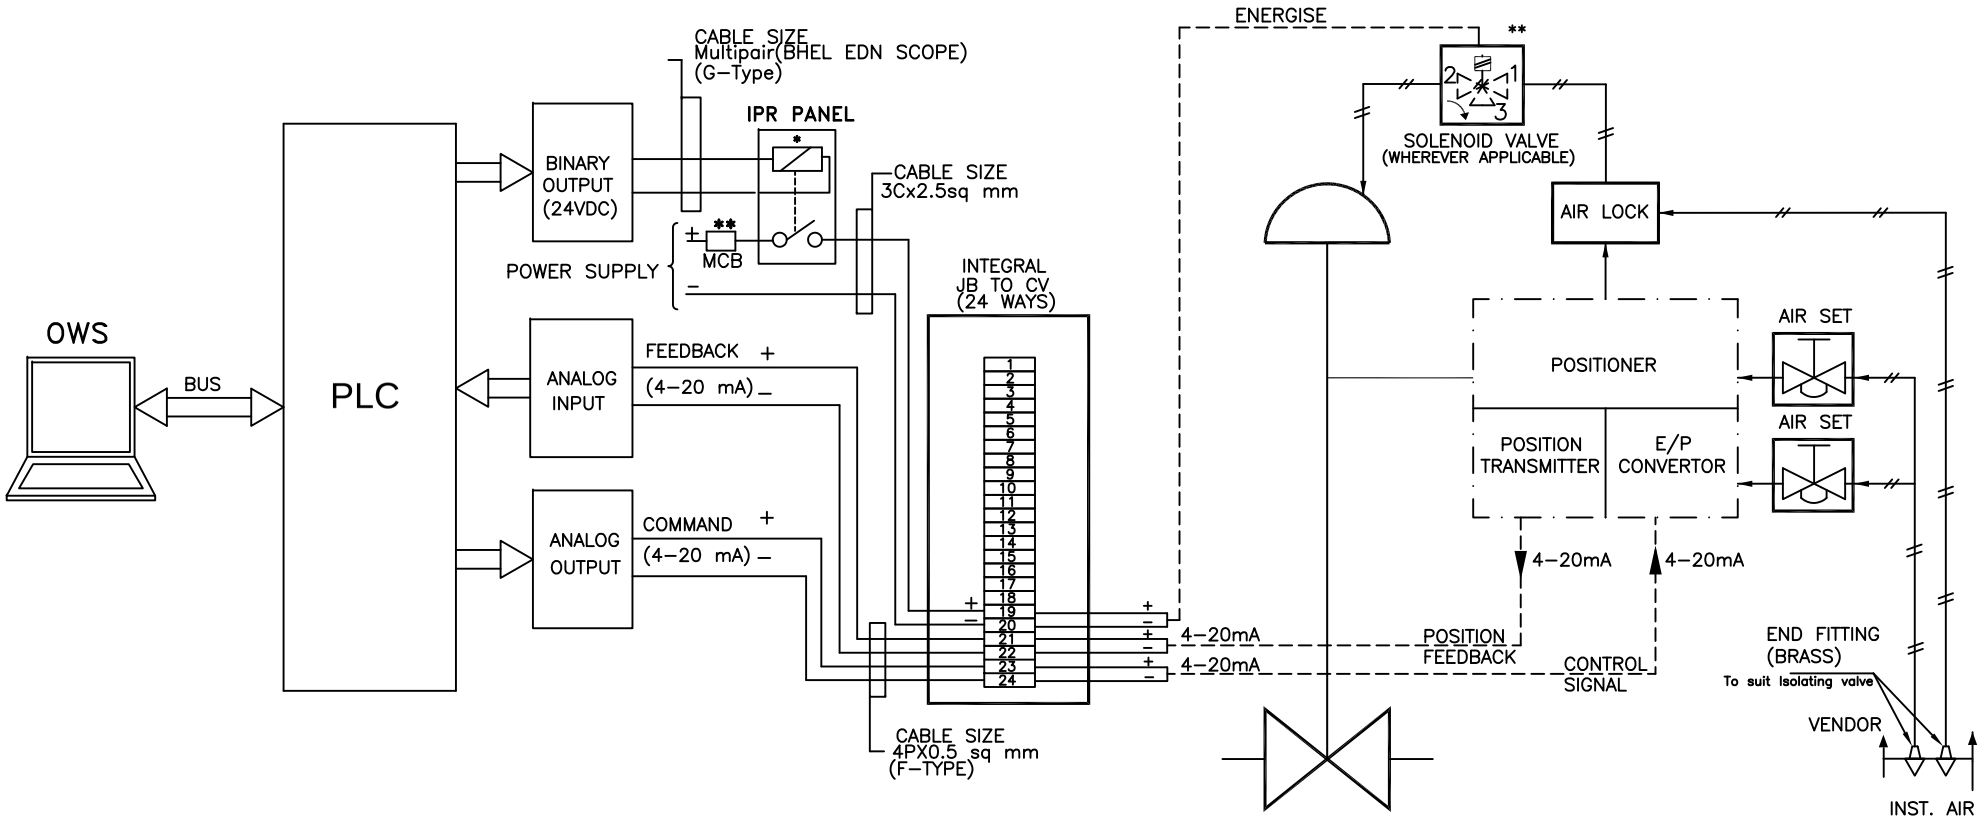

NOTES:

* APPLICABLE TO VALVES WHERE PROTECTION OPEN/CLOSE ACTION FOR CONTROL DEMAND OVERRIDING IS REQUIRED.

** MCB SHALL BE PROVIDED FOR EACH SOLENOID

BHEL	PROJECT: 4 X 270 MW BHADRADRI TPS	DRG.NO.	PE-DM-411-145-I002
		DATE	18.11.2014
	TITLE TYPICAL HOOK-UP DIAGRAM ANALOG DRIVE(WITH SMART POSITIONER)	REV.NO.	00
		SHT	1.1 OF 1.1

UPS SCHEME

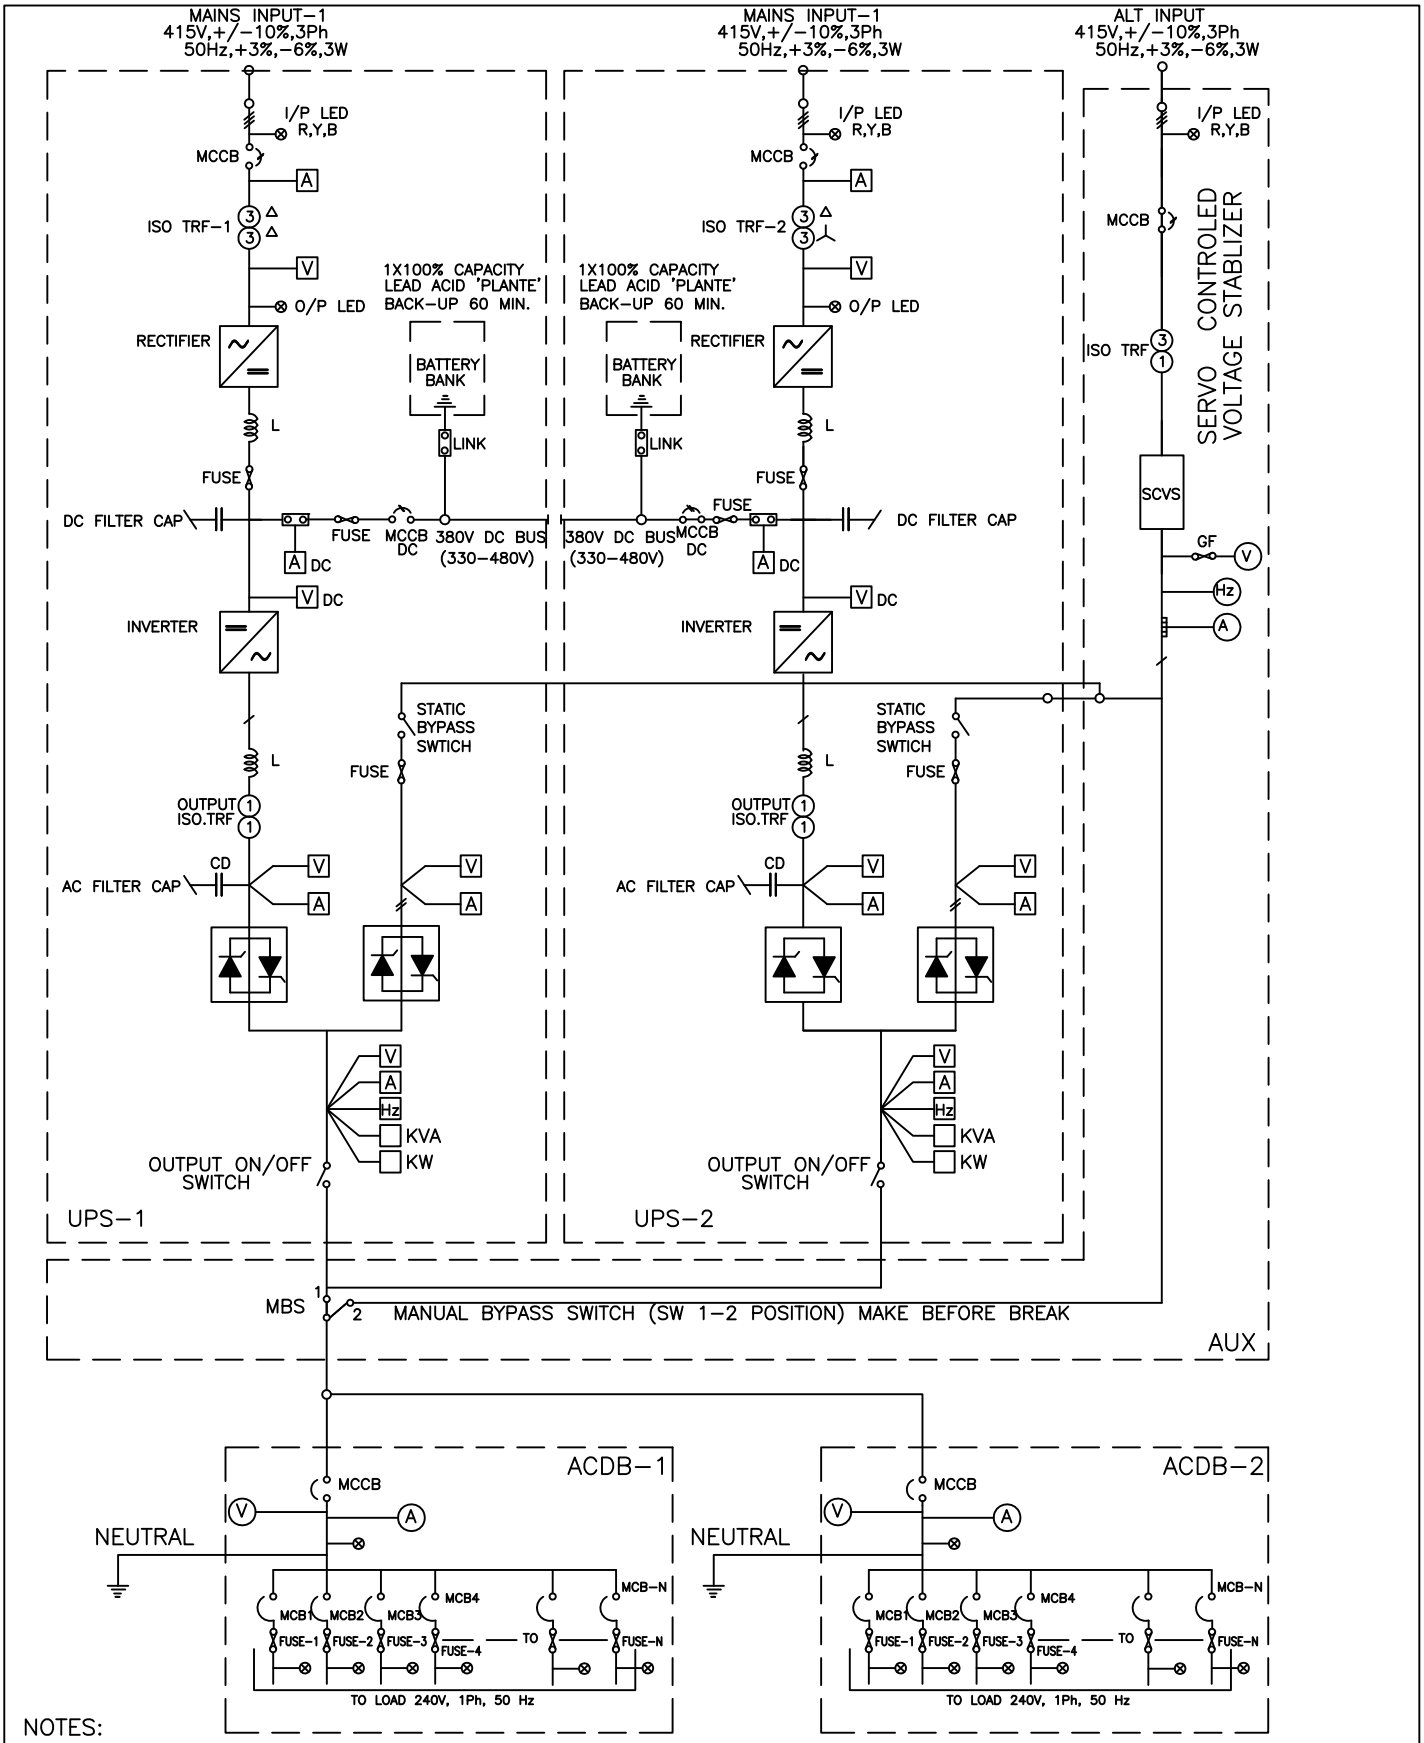

NOTES:

1. ACDB-1&2 NEUTRAL TO BE GROUNDED TO A DEDICATED GROUND.
2. ALL OUTPUT FEEDERS OF ACDB SHALL BE PROVIDED WITH AN LED AFTER THE FUSE FOR FEEDER ON INDICATION WITH FEEDER DESCRIPTION.
3. REDUNDANT FEEDERS SHALL BE LOCATED IN DIFFERENT ACDBs.

BHEL	4 X 270 MW BHADRADRI TPS	DRG. No.	PE-DG-411-145-I004		
	TITLE:- UPS SINGLE LINE DIAGRAM	REV. No.	00	DATE	21.03.2015
		SHEET	2 OF 2		

Arvind S A Khan Praveen Kishore

L1

INSTRUMENTATION DATA SHEET

1.00.00 SPECIFICATION FOR ELECTRONIC TRANSMITTERS

1.01.00 PRESSURE TRANSMITTER

1.	Working Principle	:	Smart (HART Compatible)
2.	Type	:	Microprocessor based, 2 – Wire
3.	Output Signal	:	4-20 mA DC along with superimposed digital signal
4.	Measuring Element	:	Capsule / Diaphragm
5.	Element material	:	SS-316 (Stainless Steel) or better
6.	Static Pressure	:	150 % of maximum span continuously, without affecting the calibration
7.	Turn-down ratio	:	100: 1
8.	Span and Zero	:	Continuous, tamper proof, remote as well locally adjustable with zero elevation and suppression by 100% of span
9.	Enclosure Class	:	IP-65 (Explosion proof for NEC Class-1, Division 1 area)
10.	Output Indicator	:	LCD (Integral indicator of 5 digit display)
11.	Nameplate	:	Tag number, service engraved in SS tag plate
12.	Body	:	SS
13.	Operating Voltage	:	24V DC
14.	Load	:	600 Ohms (min.) at 24 Volts D.C.
15.	Ambient Temperature	:	0 - 50 ^{O}C
16.	Performance:	:	
	i. Accuracy		± 0.075% of Span or better

Arvind S A Khan Praveen Kishore

	ii. Repeatability		± 0.05% of Span or better
17.	Sealing/Isolation	:	Extended diaphragm (Silicon oil/ Flurolub filled) with 5 meters SS armoured capillary for corrosive/viscous/solid bearing or slurry type fluid applications
18.	Accessories	:	a. Universal mounting bracket suitable for 2" pipe mounting b. High tensile carbon steel U-bolts c. Siphon for steam and hot water services d. ½" NPT 2-valve stainless steel manifold, constructed from SS316 bar stock e. Companion flange with nuts, bolts and gaskets f. ½" NPT cable gland g. Handheld calibrator
19.	Adjustment/Calibration/ Maintenance	:	From handheld calibrator/ HART management system

Notes: For primary air/ secondary air/ flue gas applications, DP type transmitters shall be provided for pressure measurement.

LVDT type is not acceptable.

1.02.00 DIFFERENTIAL PRESSURE TRANSMITTER / FLOW TRANSMITTER

1.	Working Principle	:	Smart (HART Compatible)
2.	Type	:	Microprocessor based, 2 – Wire
3.	Output Signal	:	4-20 mA DC along with superimposed digital signal
4.	Measuring Element	:	Capsule / Diaphragm

Arvind S A Khan Praveen Kishore

5.	Element material	:	SS-316 (Stainless Steel) or better
6.	Static Pressure	:	150 % of maximum span continuously, without affecting the calibration
7.	Turn-down ratio	:	100: 1
8.	Span and Zero	:	Continuous, tamper proof, remote as well locally adjustable with zero elevation and suppression by 100% of span
9.	Enclosure Class	:	IP-65 (Explosion proof for NEC Class-1, Division 1 area)
10.	Output Indicator	:	LCD (Integral indicator of 5 digit display)
11.	Nameplate	:	Tag number, service engraved in SS tag plate
12.	Body	:	SS
13.	Operating Voltage	:	24V DC
14.	Load	:	600 Ohms (min.) at 24 Volts D.C.
15.	Ambient Temperature	:	0 - 50 ^{O}C
16.	Performance:		
	i. Accuracy	:	± 0.075% of Span or better
	ii. Repeatability	:	± 0.05% of Span or better
17.	Sealing/Isolation	:	Extended diaphragm (Silicon oil/ Flurolub filled) with 5 meters SS armoured capillary for corrosive/viscous/solid bearing or slurry type fluid applications
18.	Accessories	:	a. Universal mounting bracket suitable for 2” pipe mounting b. High tensile carbon steel U-bolts

Arvind S A Khan Praveen Kishore

c. Siphon for steam and hot water services

d. ½" NPT 5-valve stainless steel manifold, constructed from SS316 bar stock

e. Companion flange with nuts, bolts and gaskets

f. ½" NPT cable gland

g. Handheld calibrator

19. Adjustment/Calibration/ Maintenance : From handheld calibrator/ HART management system

1.03.00 Displacer Type Level Transmitters

1. Type : Smart (HART Compatible)
2. Stages of operation : Continuous
3. Material :
4. i. Displacer SS-316
5. ii. Suspension wire SS-316
6. iii. Torque tube housing SS
7. iv. Torque tube Inconel
8. v. Displacer chamber SS
9. vi. Transmitter Housing SS
10. Operating Voltage : 24 V DC
11. Transmission : Microprocessor based, 2-wire
12. Output Signal : 4-20 mA DC along with superimposed digital signal
13. Static / overload : Maximum static pressure without

Arvind S A Khan Praveen Kishore

	pressure		permanent deformation or loss of accuracy
14.	Turn-down ratio	:	10 : 1 or better
15.	Zero & Span	:	Continuous, tamper proof, remote as well locally adjustable with zero elevation and suppression by 100% of span
16.	Enclosure Class	:	IP-65
17.	Output Indicator	:	LCD type (Integral indicator of 5 digit display)
18.	Nameplate	:	Tag number and Service engraved in stainless steel tag plate
19.	Ambient Temperature	:	0 - 50 ^{O}C
20.	Load Impedance	:	600 Ohms at 24 Volts (minimum)
21.	Process Connection	:	2” Flanged
22.	Performance - Accuracy	:	$\pm$ 0.075 % of span or better
23.	Accessories	:	a) Counter Flange, nuts, bolts, gaskets etc b) Weights for 5 point calibration of instruments c) Vent and drain plugs d) ½” NPT Glands e) Handheld calibrator
24.	Preferred Features	:	a) Test plug connection and cutout terminals physically separated from other electronics b) Electronic Damping facility (adjustable)
25.	Adjustment/Calibration/ Maintenance	:	From handheld calibrator/ HART management system

Arvind S A Khan Praveen Kishore

	26.	Applications	:	During detail engineering on Owner's approval

1.04.00 MASS FLOW METER

1.04.01 SENSOR

	1.	Measuring Principle	:	Coriolis Mass flow
	2.	Primary Element	:	Flow Tube of 316SS or better
	3.	Heating Arrangement	:	Integral
	4.	Temperature Control	:	For heavy fuel oil application
	5.	Process Connection	:	Flanged of rating as per process requirement
	6.	Drain	:	Self-draining facility
	7.	Enclosure	:	Stainless steel
	8.	Accessories	:	Counter flanges, Mounting nuts, bolts, gaskets etc.

1.04.02 TRANSMITTER

	1.	Measured quantities	:	Mass Flow rate, Total Mass Flow, Density
	2.	Input Signal Processing	:	Smart (HART compatible)
	3.	Display	:	LCD
	4.	Output	:	2 nos. isolated output of 4-20mA DC selectable from four measured quantities
	5.	Load	:	< 750 ohms
	6.	Power supply	:	240V AC, 50 Hz

Arvind S A Khan Praveen Kishore

7.	Turn Down	:	100:1
8.	Accuracy	:	± 0.2 % of measured value
9.	Housing	:	IP 65 (Explosion proof)
10.	Nameplate	:	Tag number, service engraved in stainless steel tag plate
11.	Accessories	:	a) Handheld calibrator b) Mounting U-bolts, nuts, bolts, prefab cable etc c) ½"NPT cable gland
12.	Adjustment/Calibration/ /Maintenance	:	From handheld calibrator/ HART management system
13.	Applications	:	Fuel Oil service

1.05.00 RADAR TYPE LEVEL MEASUREMENT

1.	Type	:	Smart (HART Compatible)
2.	Antenna	:	Co axial / guided wave radar /–Overspill protection
3.	Principle	:	TDR (Time Domain Reflectometry)
4.	Communication	:	Two wire 4-20mA DC with HART
5.	Environmental temperature	:	0 – 50 ºC
6.	Enclosure	:	IP-65 (Explosion proof for NEC Class-1, Division 1 area)
7.	Calibration	:	a) Self calibration with internal reference b) Zero & Span calibration
8.	Process Connection	:	External cage mounting Flanged /screwed
9.	Electronic Housing	:	Epoxy painted Die-Cast aluminium

Arvind S A Khan Praveen Kishore

			alloy
10.	Antenna / Flange assembly	:	316 SS or Hestalloy (as required)
11.	Power supply	:	24 V DC
12.	Output Indicator	:	LCD
13.	Accuracy	:	5 mm or 0.1% of probe length
14.	Accessories	:	a) Handheld calibrator
		:	b) Counter Flange, nuts, bolts, gaskets etc
		:	c) ½"NPT cable gland
		:	d) SS Nameplate
15.	Adjustment/Calibration/ /Maintenance	:	From handheld calibrator/ HART management system
16.	Applications	:	Vessels under vacuum or low pressure applications, solid levels

1.06.00 ULTRASONIC LEVEL TRANSMITTER

1.	Type	:	Microprocessor based, 2-wire, Smart (HART Compatible)
2.	Operating Principle	:	Detection of reflected ultrasonic pulse
3.	Output Signal	:	4-20 mA DC along with superimposed digital signal
4.	Operating frequency	:	10 KHz to 50 KHz (typical)
5.	Display	:	LCD
6.	Temperature Compensation	:	Built in –Programmable
7.	Power supply	:	24 V DC
8.	Enclosure	:	SS, IP-65 (Explosion proof for NEC Class-1, Division 1 area)

Arvind S A Khan Praveen Kishore

9.	Zero & Span	:	Continuous, tamper proof, remote as well locally adjustable. It shall be possible to calibrate the instrument without any level in the sump/ tank
10.	Accuracy & Repeatability	:	0.15 % of span or better
11.	Resolution	:	0.1 % of span
12.	Operating temp.	:	Transmitter- 500 C and Sensor - 800 C
13.	MOC Sensor	:	SS-316/Body- PVC and Face – Polyurethene
14.	Mounting	:	4" Flanged/ 2" NPT for sensor and Transmitter on panel
15.	Accessories	:	a) Handheld calibrator b) Weather canopy for protection from direct sunlight and direct rain c) ½"NPT cable gland d) All mounting hardware (SS-316), Prefab cable e) SS Nameplate
16.	Diagnosis	:	On-line
17.	Status Indication	:	Power On, HI, HI-HI, Lo, LO-LO, Fault
18.	Output Contacts	:	2 SPDT, 230V, 5A
19.	Adjustment/Calibration/ /Maintenance	:	From handheld calibrator/ HART management system
20.	Applications	:	Coal Bunker, Water Service etc.

Arvind S A Khan Praveen Kishore

1.07.00 ULTRASONIC FLOW TRANSMITTER

1.	Type	:	Ultrasonic – Clamp On
2.	Accuracy	:	+/- 1 % of reading
3.	Repeatability	:	+/- 0.3 % of reading
4.	Rangeability	:	400 : 1
5.	Output Signal	:	4-20 mA DC with HART
6.	Measured Parameter	:	Volumetric flow, Totalized flow and flow Velocity
7.	Display	:	LCD with internal Key Pad (Flow rate & Totalization)
8.	Power Supply	:	24 V DC (2 Wire)
9.	Enclosure	:	SS (IP- 68 – Submersible)
10.	Mounting	:	SS Chain or Strap
11.	Accessories		1. Handheld calibrator 2. ½"NPT cable gland 3. Transducer cable 4. All mounting hardware (SS-316) 5. SS Nameplate
12.	Adjustment/Calibration/ /Maintenance	:	From handheld calibrator/ HART management system
13.	Applications	:	Plant water service

Note: Multi-path insertion type (minimum 4 path) Ultrasonic Flow meter shall be provided for Raw water/ Cooling Water flow measurements.

2.00.00 **HART HAND HELD CALIBRATOR**

Hand held calibrators (5 nos. for each type) shall be provided for adjustment/ calibration/maintenance of the HART compatible

Arvind S A Khan Praveen Kishore

transmitters. The hand held calibrator shall be suitable for all types of transmitters supplied in the package. If one type of hand held type calibrator is not suitable for communicating with all types of transmitters then separate hand held calibrator will be provided.

3.00.00 PROCESS ACTUATED SWITCHES

3.01.00 PRESSURE SWITCH

1.	Type	:	i. Piston for high pressure application ii. Bellow / Diaphragm for low pressure application
2.	Sensing element material	:	SS-316. All other wetted part SS316
3.	Case Material	:	SS
4.	Setter Scale	:	Black graduation on white linear scale. Graduation 0-100% with red pointer for set points
5.	Over range	:	150 % of maximum pressure
6.	Adjustments	: :	a) Internal Set Point b) Differential adjustment
7.	End Connection	:	1/2" NPT bottom connected
8.	Switch configuration	:	Two SPDT (240V, 5A AC/220V, 0.5A DC)
9.	Switch Type	:	Snap acting, shock & vibration proof
10.	Terminal Block	:	Suitable for full ring lugs
11.	Enclosure Class	:	IP-65 (Explosion proof for NEC Class-1, Division 1 area)
12.	Performance	: :	a) Repeat accuracy ± 1.0% b) Accuracy of Setting Indication of ± 1.5%
13.	Ambient temperature	:	0 – 50 Deg.C

Arvind S A Khan Praveen Kishore

14.	Nameplate	:	Tag number, service engraved in SS tag plate
15.	Accessories	:	a) Silicon oil/ Flurolub filled Remote diaphragm seal with SS-316 capillary for corrosive/ viscous/ solid bearing or slurry type fluid applications b) Snubbers for pulsating fluid applications c) Siphons for steam and hot water services d) Retention ring and screws for surface mounting e) 1/2" NPT 2 Valve SS-316 barstock manifold f) ½" NPT cable gland
16.	Applications	:	During Detail Engineering on Owner's approval

3.02.00 DIFFERENTIAL PRESSURE SWITCH

1.	Type	:	i. Piston for high pressure application ii. Bellow / Diaphragm for low pressure application
2.	Sensing element material	:	SS-316. All other wetted part SS316
3.	Case Material	:	SS
4.	Setter Scale	:	Black graduation on white linear scale. Graduation 0-100% with red pointer for set points
5.	Over range	:	150 % of maximum pressure

Arvind S A Khan Praveen Kishore

6.	Adjustments	:	a) Internal Set Point
		:	b) Differential adjustment
7.	End Connection	:	1/2" NPT bottom/ back connected
8.	Switch configuration	:	Two SPDT (240V, 5A AC/220V, 0.5A DC)
9.	Switch Type	:	Snap acting, shock & vibration proof
10.	Terminal Block	:	Suitable for full ring lugs
11.	Enclosure Class	:	IP-65 (Explosion proof for NEC Class-1, Division 1 area)
12.	Performance	:	a) Repeat accuracy ± 1.0% b) Accuracy of Setting Indication of ± 1.5%
13.	Ambient temperature	:	0 – 50 Deg.C
14.	Nameplate	:	Tag number, service engraved in SS tag plate
15.	Accessories	:	a) Silicon oil/ Flurolub filled Remote diaphragm seal with SS-316 capillary Diaphragm seals for corrosive/ viscous/ solid bearing or slurry type fluid applications b) Snubbers for pulsating fluid applications c) Siphons for steam and hot water services d) Retention ring and screws for surface mounting e) 1/2" NPT 5 Valve SS-316 barstock manifold f) ½" NPT cable gland
16.	Applications	:	During Detail Engineering on Owner's

Arvind S A Khan Praveen Kishore

approval

3.03.00 LEVEL SWITCH

3.03.01 FLOAT OPERATED

1.	Float material	:	SS-316
2.	Wetted parts	:	SS-316
3.	Float chamber	:	Stainless steel/Carbon steel, construction welded
4.	Float chamber mounting	:	Side mounted
5.	Fluid connection	:	Side – Side
6.	Fluid connection size	:	1" ANSI RF Flange (rubber line, if required)
7.	Drain	:	½ inch NPT with Plug
8.	Pressure rating of chamber	:	Minimum 1.5 times of design pressure
9.	Repeatability	:	+/- 1.5 mm or better
10.	Switch housing	:	Stainless Steel
11.	Switch housing type	:	IP- 65
12.	Type of switch	:	Snap acting magnetically operated hermetically sealed
13.	Switch configuration	:	2 SPDT (5A, 240 V AC, 0.5A, 220V DC)
14.	Accessories	:	a) Counter flange, nuts & bolts, suitable gasket etc. b) Steel globe type drain valve c) ½"NPT cable gland

Arvind S A Khan Praveen Kishore

			d)	Stainless steel nameplate with alpha-numeric engraved for service and tag
	15. Application	:	During Detail Engineering on Owner's approval	

3.04.00 FLOW SWITCH

1.	Type	:	Paddle /Piston/Disk	
2.	Wetted part material	:	Stainless steel or Hastelloy for acidic application	
3.	End connection	:	a)	Threaded upto 1" line size with integral Tee
		:	b)	Flanged for line size > 1 ½"
4.	Enclosure material	:	Stainless Steel	
5.	Enclosure class	:	IP 65	
6.	Switch configuration	:	2 SPDT (5A, 240 V AC, 0.5A, 220V DC)	
7.	Repeatibility	:	2%	
8.	Cable connection	:	½"NPTF	
9.	Accessories	:	a)	Tee, Counter flange, nuts & bolts, suitable gasket etc
			b)	½"NPT cable gland
			c)	Stainless steel nameplate with alpha-numeric engraved for service and tag

3.05.00 RF LEVEL SWITCH

Arvind S A Khan Praveen Kishore

1.	Type	:	RADIO FREQUENCY
	Sensing probe		
2.	Material	:	SS-316
3.	Mounting	:	Threaded
4.	Application Temperature	:	250°C (Max.)
	Electronic Controller		
5.	Input Supply Voltage	:	240V AC ±10%, 50 Hz.
6.	Relay Output	:	2 SPDT (240V AC, 5A)
7.	Ambient Temperature	:	50 °C
8.	Enclosure Protection	:	IP-66
9.	Enclosure Housing	:	SS
10.	Local LED Indication	:	Normal Level Power On Alarm Level Probe Healthy
11.	Switching Repeatability	:	±0.5%
12.	Accessories	:	Co-axial cable for probe connection to controller SS Tag plate ½" NPT Cable Glands
13.	Application	:	Solid level

3.06.00 CONDUCTIVITY TYPE LEVEL SWITCH

1.	Type	:	Conductivity discrimination
2.	Probe MOC	:	SS-316
3.	Mounting	:	Flanged on external cage
4.	Application Temperature	:	250°C (Max.)
5.	Test Pressure	:	Two times rated pressure

Arvind S A Khan Praveen Kishore

6.	Input Supply Voltage	:	240V AC ±10%, 50 Hz.
7.	Input	:	Four independent channel with selectable switching threshold for water conductivity
8.	Relay Output	:	2 SPDT (240V AC, 5A)
9.	Ambient Temperature	:	50 °C
10.	Enclosure Protection	:	IP-65 (Explosion proof for NEC Class-1, Division-1 area)
11.	Enclosure Housing	:	SS
12.	Local LED Indication	:	HI,LO, HIGH-HIGH, LOW-LOW Power Fault
13.	Accessories	:	a) Interconnecting cable from probe to electronics b) Mounting accessories c) External cage d) Washer & Gasket e) ½" NPT Cable Glands f) SS Tag Plate
14.	Application	:	During Detail Engineering on Owner's approval

3.07.00 TEMPERATURE SWITCH

1.	Type	:	Bimetallic or gas filled
2.	Sensing Element Material	:	SS-316
3.	Bulb Material	:	SS-316
4.	Capillary	:	Stainless Steel armored

Arvind S A Khan Praveen Kishore

5.	Movement Material	:	Stainless Steel
6.	Case material	:	Stainless Steel with neoprene gasket and clear glass where applicable cover conforming to IP-65. (Explosion proof for NEC Class-1, Division 1 area).
7..	Scale	:	Black graduation on white linear scale. Graduation 0-100% with red pointer for set points
8.	Over range Protection	:	120 %
9.	Instrument connection	:	Bottom
10.	Switch configuration	:	Two SPDT (240V, 5A AC/220V, 0.5A DC)
11.	Switch type	:	Snap acting, shock and vibration-proof
12.	Adjustability	:	Internal Set point adjustable over span range
13.	Compensation	:	a) Capillary compensation with invar wire throughout the capillary length b) Case compensation
14.	Performance		
	a) Scale Accuracy	:	±1.0 % of full scale
	b) Repeatability	:	< 0.5 % of full range
	c) Response time	:	Less than 40 seconds with thermowell
15.	Capillary length	:	5 meters (minimum) for local mounting/15 meters for local panel mounting
16.	Nameplate	:	Tag number, service engraved in stainless steel tag plate
17.	Accessories	:	Mounting accessories, ½" NPT cable gland
18.	Applications	:	During Detail Engineering on Owner's

Arvind S A Khan Praveen Kishore

approval

4.00.00 LOCAL INSTRUMENTS

4.01.00 PRESSURE GAUGE AND DIFFERENTIAL PRESSURE GAUGE

1.	Type	:	Bourdon/Bellows/Diaphragm
2.	Sensing & Socket	:	SS-316
3.	Movement Material	:	SS-316
4.	Case Material	:	Stainless steel. IP-65 (Explosion proof for NEC Class-1, Division 1 area)
5.	Dial Size	:	Generally 150 mm
6.	Scale	:	Black lettering on white in 270 O arc.
7.	Window	:	Shatterproof glass
8.	Range Selection	:	Normal process pressure: 50~70 % of range
9.	Over-range Protection	:	125% of maximum range by internal stop. External stop at zero
10.	Adjustment	:	For Zero adjustment (Micrometer screw external) For Range adjustment (Micrometer screw internal).
11.	Element Connection	:	Argon welding
12.	Process Connection	:	1/2" NPT (M) Bottom for local, back for panel mounting
13.	Performance	:	Accuracy of ± 1.0 % of span or better
14.	Operating ambient	:	0 - 50 ^{O}C
15.	Safety Feature	:	Blow out disc /diaphragm at the back
16.	Accessories	:	a) Snubbers for pulsating fluid application.discharge b) Stainless steel Diaphragm seals

Arvind S A Khan Praveen Kishore

			for corrosive/ viscous/ solid bearing or slurry type fluid applications
		c)	3-Way SS316 Gauge cock for pressure gauges
		d)	5-valve SS316 manifold from barstock for differential pressure gauge
		e)	Siphons for steam and hot water services
	17. Nameplate	:	Tag number, service engraved in stainless steel tag plate

4.02.00 LEVEL INDICATOR (FLOAT & BOARD TYPE)

1.	Type	:	Float and Board
2.	Float Material	:	SS-316
3.	Float Cable	:	SS-316
4.	Indicator Assembly	:	Epoxy painted Aluminium
5.	Guide wire spring assembly	:	SS-316 (2 Nos.)
6.	Guide Wire Anchor	:	SS-316
7.	Scale Board	:	Anodized Aluminium with engraved marking (Minimum graduation 10mm), mounting brackets and suitable hardware required as per tank height
8.	Elbow Assembly	:	Anodized Aluminium
9.	Flanges	:	RF , ANSI 150 , SS (3 Nos.)
10.	Accuracy	:	± 10 mm or better
11.	Accessories	:	All mounting accessories including counter flange, nuts & bolts, suitable

gasket etc. as applicable, SS Tag plate

4.03.00 GAUGE GLASS

1.	Type	:	Reflex /Transparent
2.	Material		
	Glass	:	Toughened borosilicate resistant to thermal shock
	Body Material	:	~~Carbon Steel~~ Stainless Steel
	Enclosure	:	IP-65 (Explosion proof for NEC Class-1, Division 1 area)
3.	Integral cocks & valves/Fittings	:	i. SS 316
4.		:	ii. Rubber lined corrosion resistant stainless steel (for DM/RO service)
5.	Vessel Connection	:	ANSI Flanged SS316
6.	Accessories	:	i. Integral cocks ii. Drain Valves iii. Companion Flanges, Bolts, nuts, gaskets, SS Tag plate iv. Illuminating lamps, Mica shield as required v. Calibrated scale
7.	Pressure rating	:	Twice the maximum working pressure
8.	Temperature	:	300 ^{O} C
9.	Other details	:	For larger lengths (greater than 1200mm), additional gauge glasses shall be provided with minimum of 50 mm overlap.

Arvind S A Khan Praveen Kishore

4.04.00 SLIGHT GLASS

1.	Type	:	Flap-type.
2.	End connection	:	Screwed / Flanged
3.	Material		
	a) Body	:	SS- 304
	b) Cover plate	:	SS- 304
	c) Indicator	:	SS- 316
4.	Sight Glass	:	Toughened Borosilicate
5.	Gasket	:	Neoprene
6.	Bolts & Nuts	:	High tensile steel.
7.	Hydraulic Test Pressure	:	1.5 times maximum working pressure
8.	Accessories	:	Companion Flanges, Bolts, nuts, gaskets as required, SS Tag plate.

4.05.00 ROTAMETER

1.	Type	:	ON-LINE for line upto and including 50 mm NB. Borosilicate BY-PASS for line size above 50 NB
2.	Metering tube	:	Toughened Borosilicate
3.	Float	:	SS-316
4.	End fittings	:	SS-316
5.	Packing material	:	Teflon / PTFE
6.	Casing	:	Stainless Steel
7.	Gland Rings /Followers/ Other wetted parts	:	Stainless Steel
8.	Orifice Plate	:	Stainless Steel (for bypass type)
9.	Operating Temperature	:	0-50 Deg. c

Arvind S A Khan Praveen Kishore

10.	Test Pressure	:	200% of maximum operating pressure
11.	Scale	:	250 mm nominal length
12.	Graduation	:	Direct reading
13.	Process Connection	:	Flanged (RF) to line size as per ANSI standards (150#)
14.	Tapping	:	D & D/2
15.	Accuracy	:	+/- 2% of full scale reading
16.	Reproducibility	:	Within 0.5% of instantaneous reading
17.	Accessories	:	SS Tag Plate, orifice plate

5.00.00 TEMPERATURE ELEMENTS & ACCESSORIES

5.01.00 RESISTANCE TEMPERATURE DETECTOR

1.	Type	:	Platinum (Duplex), Ungrounded
2.	Platinum (Duplex), Ungrounded	:	100 ohm at 0 ^{O}C
3.	Base	:	Wound on ceramic (anti-inductive)
4.	Wiring	:	3 Wire
5.	Protecting Tube		
	a) O.D.	:	6 mm
	b) Material	:	SS-316, Seamless
	c) Filling	:	Magnesium oxide (Purity above 99.4%).
6.	Response time	:	a) 15 sec. (bare).
			b) 30 sec. (with thermowell)
7.	Calibration	:	DIN 43760
8.	Accuracy	:	± 0.5%
9.	Head		
	a) Type	:	IP-65 universal screwed type

Arvind S A Khan Praveen Kishore

	b)	Material	:	Stainless Steel
	c)	Terminal blocks	:	Nickel plated Brass-screw type / silver plated
	d)	Cable connection	:	½" NPT gland and grommet
	e)	Others	:	Terminal head cover with SS chain and suitable gasket. Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable).
10.	Accessories		:	a) Adjustable nipple-union-nipple [1/2" Sch 80 X ½" NPT] with thermowell connection b) Compression fittings/unions c) Flanges etc. (for flanged connections only) d) Thermowell (As specified below)
11.	Thermowell connection		:	½" NPT (M) or 150 RF Flanged
12.	Nameplate		:	Tag number, service engraved in stainless steel tag plate

Arvind S A Khan Praveen Kishore

Note: The specifications for RTDs of winding/ bearing of motor/pump, can be as per their manufacturer standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice. However, the type of RTD shall be Pt-100.

5.02.00 THERMOCOUPLES

1.	Type	:	a) 16 SWG wire of Chromel Alumel) (Type-K) b) Duplex c) Ungrounded
2.	Protecting Tube		
	a) O.D.	:	6 mm
	b) Material	:	SS-316, Seamless
	c) Filling	:	Magnesium oxide (Purity above 99.4%).
3.	Response time	:	a) < 20 seconds for measurement b) < 10 seconds for control
4.	Accuracy	:	$\pm$ 1.1^0 C up to 300 ^{0} C & 0.4% of measured temperature range above 300 ^{0}C
5.	Head		
	a) Type	:	IP-65 universal screwed type
	b) Material	:	Stainless Steel
	c) Terminal blocks	:	Nickel plated Brass-screw type / silver plated
	d) Cable connection	:	½" NPT gland and grommet
6.	e) Others	:	Terminal head cover with SS chain and suitable gasket.

Arvind S A Khan Praveen Kishore

			Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable).
7.	Accessories	:	a) Adjustable nipple-union-nipple [1/2" Sch 80 X ½" NPT] with thermowell connection b) Compression fittings/unions c) Flanges etc. (for flanged connections only) d) Thermowell (As specified below)
8.	Thermowell connection	:	½" NPT (M) or 150 RF Flanged
9.	Nameplate	:	Tag number, service engraved in stainless steel tag plate

5.03.00 TEMPERATURE GAUGE

1.	Type	:	Expansion type (Liquid filled system)
2.	Sensing Element Material	:	Bourdon – SS-316
3.	Bulb and Capillary Material	:	SS-316
4.	Capillary Tubing	:	Inner sheath - solid drawn Material copper tube Outer sheath - PVC tube
5.	Movement Materials	:	Stainless Steel / Direct Bourdon tip connection to pointer spindle
6.	Case Material	:	Stainless Steel stove enameled, black finish, threaded bezel ring, clear glass

			cover conforming to IP 65.
7.	Dial size	:	150 mm
8.	Scale	:	Black lettering on white background in 270 Deg.C arc
9.	Over range protection	:	125 percent of FSD
10.	Capillary Glanding	:	1/2" NPT(M) x compression fitting (SS) to suit capillary
11.	Instrument Connection	:	Bottom connection for local mounting, back connection for panel mounting
12.	Process Connection	:	½" NPT (M) or 150 RF Flanged
13.	Extension Neck Length	:	50 mm
14.	Compensation	:	a) Capillary compensation
15.		:	b) Case compensation
16.	Performance	:	a) Accuracy : + /- 1.0 percent of full scale Deflection
		:	b) Repeatability : Less than 0.5 percent of full range
		:	c) Response time: 15 seconds (max.).
17.	Capillary length	:	3.0 meters (local) / 15.0 metres (local panel)
18.	Other features	:	Shatter proof glass
19.	Nameplate	:	Tag number, service engraved in stainless steel tag plate
20.	Accessories	:	SS316 Thermowell

5.04.00 THERMOWELL

1.	Material	:	SS-316
2.	Manufacture	:	Drilled from bar stock, Hex Head, Tapered design (As per ASME PTC 19.3)

Arvind S A Khan Praveen Kishore

3.	Process connection	:	M33x2
4.	Certification	:	Not applicable
5.	Bore concentricity	:	+5% of wall thickness
6.	Identification mark	:	Tag number punched on head
7.	Surface treatment	:	Polish after machining
8.	Element connection	:	½" NPT (M) or 150 RF Flanged
9.	Head	:	Hex
10.	Length of the hex head	:	31.75 mm (min.)
11.	Accessories	:	SS Plug and chain for test thermo wells SS Nameplate, Flange with companion flange & all required accessories for flanged connections.

Note: Wake frequency calculations shall be furnished for all thermowells for approval.

Thermowells shall be designed such that the resonant frequency is above the exciting frequencies generated by vortex shedding in the process fluid.

5.05.00 METAL TEMPERATURE THERMOCOUPLE

1.	Measuring medium	:	Metal temperature
2.	Type	:	Chromel Alumel (Type-K) Duplex, Ungrounded
3.	Insulation	:	Mineral Insulation Magnesium Oxide
4.	Wire gauge	:	16 AWG
5.	Protective sheath	:	SS
6.	Protective sheath diameter	:	8 mm O.D.
7.	Characteristics	:	Special limits of error as in ANSI thermocouple MC 96.01
8.	Accessories	:	½" BSP SS sliding end connector, weld pad, clamps of heat resistant steel

1.	Type	:	Hydrometer Type
2.	Mounting	:	On line
3.	Accuracy	:	+/- 2% of range
4.	Scale	:	Black letter on white scale
5.	End connection	:	PVC flange

9.06.00 DENSITY/ CONCENTRATION METER

1.	Wetted Part		Stainless Steel
2.	Enclosure		Stainless Steel (IP-65)
3.	Power Supply		24 V DC
4.	Output signal	:	4-20 mA DC (isolated) into 600 ohms
5.	Accuracy		±0.001 g/cc
6.	Indication	:	LCD display
7.	Temp. Compensation	:	Integral
8.	Accessories		Mounting hardware, integral amplifier (if required), cable glands, tag plate etc.

10.00.00 **SOLENOID VALVES**

1.	Operating Principle	:	Electromagnetic (noiseless)
2.	Coil voltage rating	:	240 V AC /24 V DC (as required)
3.	Ways	:	2/3/4 way
4.	Port size	:	1/4" NPT all ports
5.	Body	:	SS bar stock
	Trim	:	SS-316
6.	Duty	:	Suitable for continuous energization
7.	Sealing	:	Airtight and leak proof
8.	Ambient Temperature	:	0 - 50 ^{O} C

Arvind S A Khan Praveen Kishore

9.	Fluid Temperature	:	0-150 ^{O} C (approx.)
10.	Coil Enclosure	:	Stainless Steel
11.	Insulation	:	Class-H
12.	Coil Casing	:	IP-65 (Explosion proof for NEC Class-1, Division-1 area)
13.	Mounting	:	On pipe or on panel
14.	Cable Connection	:	½" NPT
15.	Accessories	:	Cable glands, SS Tag plate

Arvind S A Khan Praveen Kishore

Instrumentation Check List

CHECK LIST FOR PRESSURE SWITCH

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECK FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS	P	V	V	
	1.1 MODEL NO/TAG NO						
	1.2 RANGE						
	1.3 END CONN						
	1.4 NO. OF CONTACT						
2	CALIBRATION			P	V	V	
	2.1 REPEATABILITY						
	2.2 SET POINT ADJUSTMENT						
	2.3 DIFFERENTIAL						
3	OVER PR & LEAK TEST			P	V	V	
4	ELECT. INSULATION/HV TEST	ONE		P	V	V	
5	REVIEW OF TC FOR MATERIALS OF	FOR LOT		V	V	V	
	5.1 SENSOR						
	5.2 MOVEMENT						
	5.3 PROCESS CONNECTION						
	5.4 HOUSING						
6	REVIEW OF TC FOR DEGREE OF PROTECTION	TYPE TEST		V	V	V	
7	REVIEW OF TC OF MICROSWITCH	FOR LOT		V	V	V	

** M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification

Note :

1. Quantum of check shall be as below :
   100 % - By Manufacturer
2. Manufacturer to carry out ROUTINE TEST on 100 %.
3. Contractor to provide compliance certificate for tests/checks verifid by contractor and the same alongwith test certificates to be verified by BHEL

Arvind S A Khan Praveen Kishore

STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)

CHECK LIST FOR TRANSMITTER

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECKS FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS	P	W	V	
	VISUAL.						
	MODEL/TAG No						
2	PROCESS CONNECTION			P	W	V	
3	ACCURACY			P	W	V	
4	REPEATABILITY			P	W	V	
5	HYSTERESIS			P	W	V	
6	EFFECT OF TEMP VARIATION ON ACCURACY			P	W	V	
7	SPAN / ZERO ADJUSTMENT	ONE / TYPE		P	W	V	
8	EFFECT OF SUPPLY VOLTAGE VARIATION			P	W	V	
9	EFFECT OF LOADING (500 OHM METERS)			P	W	V	
10	HIGH PRESSURE TEST	SEE NOTE-1 BELOW		P	W	V	
11	BURN-IN TEST	ONE / TYPE		P	W	V	
12	DEGREE OF PROTECTION			P	W	V	
13	ACCESSORIES AS APPLICABLE	SEE NOTE-1 BELOW		V	V	V	

Legend :

** M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL,
P = Perform, W = Witness, V = Verification

Note :

1. Quantum of check shall be as below :
   100 % - By Manufacturer
2. Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
3. When material corelation are not available manufacturer's compliance to be provided.
4. Contractor to provide compliance certificate for tests/checks verifid by contractor and submit the same alongwith test certificates to be verified by BHEL.

Arvind S A Khan Praveen Kishore

STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)

CHECK LIST FOR PRESSURE & DP GAUGE

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECK FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS	P	W	V	
	SENSOR TYPE						
	DIAL SIZE						
	MODEL NO/TAG NO						
	RANGE/SCALE						
	SWITCH CONTACT RATING & NOS.						
	END CONNECTION						
2	CALIBRATION			P	W	V	
	ACCURACY						
	REPEATABILITY						
	SET POINT ADJUSTMENT						
3	OVER PRESSURE & LEAK TEST			P	W	V	
4	OPERATION OF PRESSURE. RELIEF DEVICE	ONE		P	W	V	
5	REVIEW OF TC FOR	FOR LOT		V	V	V	
	MATERIALS OF SENSOR						
	MOVEMENT						
	PROCESS CONNECTION						
	HOUSING						
6	REVIEW OF TC FOR DEGREE OF PROTECTION	TYPE TEST		V	V	V	
7	ACCESSORIES AS APPLICABLE	SEE NOTE-1 BELOW		V	V	V	

Legend :

** M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL,
P = Perform, W = Witness, V = Verification

Note :

1. Quantum of check shall be as below :
   100 % - By Manufacturer
2. Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
3. Manufacturer to carry out ROUTINE TEST on 100 %.
4. When material corelation is not available, MFR's compliance to be provided
5. Contractor to provide compliance certificate for tests/checks verifid by contractor and submit the same alongwith test certificates to be verified by BHEL.

Arvind S A Khan Praveen Kishore

STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)

CHECK LIST FOR LEVEL GAUGE

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECK FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS / DRWGS	P	W	V	
	TYPE						
	MODEL/ TAG NO.						
	DAIL SIZE						
	RANGE/SCALE						
	END CONNECTION						
2	DIMENSIONS, PROCESS CONNECTION			P	W	V	
3	ACCURACY			P	W	V	
4	MATERIAL TC FOR	ONE / LOT		P	V	V	
	BODY ISO.						
	VALVE						
	GAUGE GLASS						
5	HYD. TEST	SEE NOTE-1 BELOW		P	W	V	
6	ACCESSORIES AS APPLICABLE			P	W	V	

Legend :

** M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification

Note :

1. Quantum of check shall be as below :
   100 % - By Manufacturer
2. Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
3. Manufacturer to carry out ROUTINE TEST on 100 %.
4. Contractor to provide compliance certificate for tests/checks verifid by contractor and submit the same alongwith test certificates to be verified by BHEL.

Arvind S A Khan Praveen Kishore

STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)

CHECK LIST FOR ANNUNCIATORS

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECK FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS	P	W	V	
	TYPE/ MODEL						
	DIMENSIONS OF HARDWARE						
	MODULARITY						
	SEQUENCE						
	FACIA DETAILS						
2	FUNCTIONAL TEST	100%		P	W	V	
3	IMMUNE TO STEP VARIATIONS IN THE POWER SUPPLY	SEE NOTE-1 BELOW		P	W	V	
4	DEGREE OF PROTECTION FOR ENCLOSURE	TYPE TEST		P	W	V	
5	I/R CHECK	SEE NOTE-1 BELOW		P	W	V	
6	RESPONSE			P	W	V	

Legend :

** M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification

Note :

1. Quantum of check shall be as below :
   100 % - By Manufacturer
2. Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
3. Manufacturer to carry out ROUTINE TEST on 100 %.
4. Contractor to provide compliance certificate for tests/checks verifid by contractor and submit the same alongwith test certificates to be verified by BHEL.

Arvind S A Khan Praveen Kishore

LCP & JUNCTION BOXES SPECIFICATION

1.00.00 **GENERAL REQUIREMENT**

1.01.00 ENCLOSURES FOR INSTRUMENTS AND OTHER EQUIPMENT

1.01.01 All panels, cabinets, distribution boxes, junction boxes, terminal boxes and all other field mounted equipment / enclosures shall have suitable environmental protection as detailed in Section-I of this volume of the specification.

1.02.00 SURFACE PREPARATION & PAINTING

1.02.01 All sheet metal panel/ desk exterior steel surfaces shall be sand blasted, ground smooth and painted as specified below.

1.02.02 Suitable filler shall be applied to all pits, blemishes and voids in the surface. The filler shall be sanded so that surfaces are level and flat; corners are smooth and even. Exposed raw metal edges shall be ground burr-free. The entire surface shall be blast clean to remove rust and scale and all other residue due to the fabrication operation. Oil, grease and salts etc. shall be removed from the panels by one or more solvent cleaning methods prior to blasting.

1.02.03 Two spray coats of inhibitive epoxy primer surfacer shall be applied to all exterior and interior surfaces, each coat of primer surfacer shall be of dry film thickness of 1.5 mil. A minimum of two spray coats of final finish color (Catalyzed epoxy or polyurethane) shall be applied to all surface of dry film thickness 2.0 Mil. The finish colors for exterior and interior surfaces shall conform to the following shades:

- Exterior – Opaline green shade 275 of IS: 5 or equivalent international code..
- Interior - Brilliant White.

1.02.04 Paint films, which show sags, cheeks, blisters, teardrops, fat edges or other painting imperfections, shall not be acceptable.

1.03.00 WIRING

1.03.01 All spare contacts of relays, switches and push buttons shall be wired up to the terminal blocks. All intercommunications between sections of panels/desks shall be furnished.

1.03.02 Each wire shall be identified at both ends with wire designation as per approved wiring diagram. Heat shrinkable type ferrules with indelible computerized ink print shall be used with cross- identification.

1.03.03 All wire termination shall be made with insulated sleeve and crimping type lugs. Wire shall not be spliced or tapped between terminals. Open-ended terminal lugs will not be accepted. Wires shall not be looped around the terminal screws or studs.

Arvind S A Khan Praveen Kishore

1.03.04 Internal wiring should be terminated uniformly on one side of the terminal block leaving the other side available for termination of outgoing cables. Internal wiring shall be grouped so that all outgoing wiring to each particular remote location is terminated on adjacent terminal blocks. Interior wiring and jumperings shall be arranged so that external connections can be made from internal side of terminal blocks. Common connections shall be limited to two (2) wires per terminal.

1.03.05 Wiring shall be arranged to ensure free access to all instrument or devices for maintenance. No wire shall be routed across the face or rear of any device in a manner, which will impede the opening of covers or obstruct access to leads, terminals or devices

1.03.06 Wires shall be dressed and run in trays or troughs with clamp-on type covers. Wirings may be neatly bunched in groups by non-metallic cleats or bands. Each group shall be adequately supported along its run to prevent sagging or strain on termination.

1.03.07 Shield wires shall be terminated on separate terminal blocks. Common connections shall be limited to two wires per terminal. Signal circuit shields shall be grounded at the power supply end only or as recommended by manufacturer.

1.03.08 All low level signal cables shall be separately bundled to from control cable and maintained at 300 mm minimum spacing from control bundles.

1.03.09 Panel internal wiring shall follow distinct color-coding to segregate different voltage levels viz. 24V DC, 48V, 110V AC, 240V AC, 220V DC etc.

1.03.10 Thermocouple lead wires, analyzer measuring lead wires, or any other lead wires carrying measuring signal of the order of low milli volt or micro volt shall be electrically and physically isolated from other AC and DC wiring. Shielded wires used in such cases for panel internal wiring shall be continuous and ungrounded with the shield terminated individually and separately in panel terminal block.

1.03.11 Wiring to door mounted devices shall be provided with multi-strand wires of (49 strands minimum) adequate loop lengths of hinge-wire so that multiple door openings will not cause fatigue failure of the conductor.

1.03.12 Internal wiring in factory pre-wired electronic systems cabinets may be installed according to the Contractor's standard wire size, insulation, and method of termination on internal equipment. Insulation for all wiring, including circuit board wiring, back panel wiring, power supply wiring and interconnecting cables between devices shall pass the vertical flame test per IPCEAS-1981. Identification of conductors may be done by insulation color-coding identified on drawings or by printed wiring lists.

1.04.00 TERMINAL BLOCKS

1.04.01 All terminal blocks shall be rail mounted/ post mounted type, cage clamp type with high quality non-flammable insulating material of melamine suitable for working temperature of 105 Deg C. The terminal blocks in field mounted junction boxes, instrument enclosures racks etc. shall be suitable for cage clamp connections. The terminal blocks in Control Equipment Room termination/ marshalling cubicles shall be suitable for post mounted cage clamp connection at the field input end. The exact type of terminal blocks to be provided by Bidder shall be subject to Owner.

1.04.02 All terminal blocks shall be provided complete with all required accessories including assembly rail, locking pin and section, end brackets, small partitions, transparent covers, support brackets, distance sleeves, warning level, marking etc. For RTDs ring - tong type lugs shall be used at Junction Boxes.

1.04.03 The characteristics of the terminal blocks shall be as follows.

i) High contact force, independent of conductor cross-section and large contact surface area.

ii) Integrated self-loosening protection to avoid shifting of contact surface that may allow contamination of connection point.

iii) Inspection and maintenance free (resistant to thermal aging and vibration)

iv) Low and constant voltage drop

1.04.04 The insulation of the terminal blocks shall be of suitable thermoplastic material.

1.04.05 The spacing between Terminal blocks channels in panels and cubicles shall be adequate for routing the cable troughs and to allow adequate free workspace for termination and removal of wires. The terminal blocks shall be arranged with atleast 100 mm clearance between two sets of terminal blocks and junction box walls.

1.04.06 Signals of different voltage levels shall be clearly segregated by providing separate rows to each type of signal and by using terminal blocks of different color for each type of signal and by providing barrier strips between them.

1.04.07 Terminal blocks shall be provided with white marking strips / self-adhesive marker cards and where permitted by the safety codes and standards, shall be without covers. Power terminals and high voltage (above 48 volts) terminals shall have protection covers. All terminals shall be provided with permanent terminal identification numbers on both sides.

1.04.08 At least 20% spare unused terminals shall be provided on each terminal block for circuit modifications and for termination of all conductors in a multi-conductor control cable.