

5.00.00 PERFORMANCE

The actuator shall meet the following performance requirements:

- 5.01.00 Open and close the valve completely and make leak-tight valve closure without jamming.
- 5.02.00 Attain full speed operation before valve load is encountered and imparts an unseating blow to start the valve in motion (hammer blow effect).
- 5.03.00 Operate the valve stem at standard stem speed and shall function against design differential pressure across the valve seat.
- 5.04.00 The motor reduction gearing shall be sufficient to lock the shaft when the motor is de-energised and prevent drift from torque switch spring pressure.
- 5.05.00 The entire mechanism shall withstand shock resulting from closing with improper setting of limit switches or from lodging of foreign matter under the valve seat.

6.00.00 SPECIFIC REQUIREMENT
6.01.00 Construction

- 6.01.01 The actuator shall essentially comprise the drive motor, torque/ limit switches, gear train, clutch, hand wheel, position indicator/ transmitter, in-built thermostat for over load protection, space heater and internal wiring.
- 6.01.02 The actuator enclosure shall be totally enclosed, dust tight, weather-proof suitable for outdoor use without necessity of any canopy. Degree of protection of enclosure for motor actuator shall be IP-65.
- 6.01.03 All electrical equipment, accessories and wiring shall be provided with tropical finish to prevent fungus growth.
- 6.01.04 The actuator shall be designed for mounting in any position without any lubricant leakage or operating difficulty.

6.02.00 Motor

- 6.02.01 The drive motor shall be three phase, squirrel cage, induction machine with minimum class B insulation and IPW-55 enclosure, designed for high torque and reversing service. Canopy shall be provided for outdoor service.
- 6.02.02 The motor shall be designed for full voltage direct on-line start, with starting current limited to 6 times full-load current.
- 6.02.03 The motor shall be capable of starting at 85 percent of rated voltage and running at 80 percent of rated voltage at rated torque and 85 percent rated voltage at 33 percent excess rated torque for a period of 5 minutes each.
- 6.02.04 Motor leads shall be terminated in the limit switch compartment.
- 6.02.05 Motor actuators for valves/dampers shall be with integral starter with 3phase/3wire, 415V AC and operable from remote.

- 6.02.06 Earthing terminals shall be provided on either side of the motor.
- 6.03.00 **Limit Switches**
- Each actuator shall be provided with following limit switches: -
- 6.03.01 2 torque limit switches, one for each direction of travel, self-locking, adjustable torque type.
- 6.03.02 4 end-of-travel limit switches, two for each direction of travel.
- 6.03.03 2 position limit switches, one for each direction of travel, each adjustable at any position from fully open to fully closed positions of the valve/damper.
- 6.03.04 Each limit switch shall have 2 NO + 2 NC potential free contacts. Contact rating shall be 5A at 240V A.C. or 0.5A at 220V D.C.
- 6.04.00 **Hand Wheel**
- Each actuator shall be provided with a hand wheel for emergency manual operation. The hand wheel shall de-clutch automatically when the motor is energized.
- 6.05.00 **Position Indicator/Transmitter**
- The actuator shall have:
- 6.05.01 One (1) built-in local position indicator for 0-100% travel.
- 6.05.02 One (1) position transmitter, 4-20 mA current signal as position feedback, for remote indicator.
- 6.06.00 **Space Heater**
- A space heater shall be included in the limit switch compartment suitable for 240V, 1 phase, 50 Hz supply.
- 6.07.00 **Wiring**
- All electrical devices shall be wired up to and terminated in a terminal box. All wiring shall be done with 1100 V grade fire resistance PVC insulated stranded copper conductor of not less than 2.5 Sq.mm cross section. All wiring shall be identified at both ends with ferrules. All the electrical actuators shall have uniform wiring.
- 6.08.00 **Terminal Box**
- The terminal box shall be weather proof, with removable front cover and cable glands for cable connection. The terminal shall be suitable for connection of 2.5 Sq.mm copper conductor.
- 7.00.00 **ACCESSORIES**

As required for the driven equipment, the actuator shall be furnished with starting equipment mounted on the actuator. This shall include:

- 7.01.00 One (1) triple pole MCCB
- 7.02.00 One (1) reversing starter with mechanically interlocked contactors, 3 thermal overload relays, 2 NO + 2 NC auxiliary contacts for each contactor.
- 7.03.00 One (1) remote-local selector switch.
- 7.04.00 CLOSE-STOP-OPEN oil tight push buttons with indication lights.
- 7.05.00 415/240 V control transformer with primary & secondary fuses.

8.00.00 **TEST**

The actuator and all components thereof shall be subject to tests as per relevant Standards. In addition, if any special test is called for in equipment specification, the same shall be performed.

9.00.00 **DRAWINGS, DATA & MANUALS**

- 9.01.00 Drawings, Data & Manuals shall be submitted in triplicate with the bid and in quantities and procedures as specified in General Conditions of Contract and/or elsewhere in the specification for approval and subsequent distribution after the issue of 'Letter of Intent'.

9.02.00 **To be submitted with Bid**

Data sheet for each type of actuator shall be furnished along with internal wiring diagram, suggested control schematic and torque limit switch contact development and manufacturer's catalogues. Drawings, Data & Manuals shall be submitted in triplicate with the bid and in quantities and procedures as specified in General Conditions of Contract and/or elsewhere in the specification for approval and subsequent distribution after the issue of 'Letter of Intent'.

9.03.00 **To be submitted for Owner / Purchaser's Approval and Distribution**

All relevant drawings and data pertaining to the equipment like GTP, GA drawing, foundation plan, BOM, control & schematics, QAP, etc. shall be submitted by the Bidder for approval of Owner/Owner's consultant. Also refer clause no. 1.19.02(u) of Section-I of Volume – V-A : Technical Specifications for Electrical Equipment & Accessories.

ANNEXURE-A

DESIGN DATA

1.0 AUXILIARY POWER SUPPLY

S	upply	Description	Consumer
	L.V. Supply (i)	415V, 3Ø, 3W, 50 Hz Effectively earthed Fault level 50 kA symm. for 1 sec.	u Motors above 0.2kW pto less than 175kW.
	(ii)	240V AC/415V AC 240V, 1Ø, 2W, 50 Hz effectively earthed	Motors upto 0.2kW. o Lighting, Space heat- ing , A.C supply for Contr- l & protective devices.
	D.C. Supply	220V, 2W, unearthed Fault level 25* kA. for 1 sec.	& D.C. alarm, control protective devices

* Indicative only, the actual value will be decided by the Bidder, after substantiating the same by calculation.

2.0 RANGE OF VARIATION

A.C. Supply :

V	voltage	:	± 10%
	Frequency	:	+3% to -5%.
	Combined Volt + frequency	:	10% (absolute sum)

During starting of large motor, the voltage may drop to 80% of the rated voltage for a period of 60 seconds. All electrical equipment while running shall successfully ride over such period without affecting system performance.

D.C. Supply :

Voltage	:	187 to 242
---------	---	------------



Technical specification for
CONTROL & INSTRUMENTATION

1X800 MW KOTHAGUDEM

SPEC NO.: **PE-TS-410-145-I**

VOLUME

SECTION

REV. NO.

00


DATE : 10.03.2015

SHEET

OF

Actuator Data Sheet

FORM NO. PEM-6666-0


	SPECIFICATION FOR MOTORISED VALVE ACTUATOR		SPECIFICATION NO.:			
			VOLUME			
			SECTION			
			REV. NO.	00	DATE:	06.01.2015
			SHEET	1	OF	3

Data Sheet A & B

DATA SHEET-A (TO BE FILLED BY PURCHASER)	DATA SHEET-B (TO BE FILLED-UP BY BIDDER)
---	---

GENERAL *	* PROJECT	1 X 800 MW KOTHAGUDAM TPS		
	OFFER REFERENCE			
	* TAG NO. SERVICE			
	* DUTY	<input type="checkbox"/> ON / OFF	<input type="checkbox"/> INCHING	
	* LINE SIZE (inlet/outlet): MATERIAL			
	* VALVE TYPE	<input type="checkbox"/> GLOBE <input type="checkbox"/> GATE <input type="checkbox"/> REG. GLOBE <input type="checkbox"/> BUTTERFLY		
	* OPENING / CLOSING TIME			
	* WORKING PRESSURE			
	AMBIENT CONDITION	SHALL BE SUITABLE FOR CONTINUOUS OPERATION UNDER AN AMBIENT TEMP. OF 0-55 DEG C AND RELATIVE HUMIDITY OF 0-95%		
	VALVE SEAT TEST PRESS	BIDDER TO SPECIFY		
	REQUIRED VALVE TORQUE	BIDDER TO SPECIFY		
	ACTUATOR RATED TORQUE	BIDDER TO SPECIFY		
CONSTRUCTION AND SIZING	CONSTRUCTION	TOTALLY ENCLOSED, DUST TIGHT, WEATHER PROOF, SUITABLE FOR OUTDOOR USE WITHOUT CANOPY, IP:65		
	MECHANICAL POSITION INDICATOR	TO BE PROVIDED FOR 0-100% TRAVEL		
	BEARINGS	DOUBLE SHIELDED, GREASE LUBRICATED ANTI-FRICTION.		
	GEAR TRAIN FOR LIMIT SWITCH/TORQUE SWITCH OPERATION	METAL (NOT FIBRE GEARS). SELF-LOCKING TO PREVENT DRIFT UNDER TORQUE SWITCH SPRING PRESSURE WHEN MOTOR IS DE-ENERGIZED.		
	SIZING	OPEN/CLOSE AT RATED SPEED AGAINST DESIGNED DIFFERENTIAL PRESSURE AT 90% OF RATED VOLTAGE. FOR ISOLATING SERVICE THREE SUCCESSIVE OPEN-CLOSE OPERATIONS OR 15 MINS. WHICHEVER IS HIGHER. FOR REGULATING SERVICE - 150 STARTS/HR MINIMUM		
HANDWHEEL	* REQUIRED	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	
	* ORIENTATION	<input type="checkbox"/> TOP MOUNTED	<input type="checkbox"/> SIDE MOUNTED	
	*TO DISENGAGE AUTOMATICALLY DURING MOTOR OPERATION.			
ELECTRIC ACTUATOR	ACTUATOR MAKE/MODEL	BIDDER TO SPECIFY		
	MOTOR MAKE / MODEL / TYPE / RATING (KW)	BIDDER TO SPECIFY		
	@ MOTOR TYPE	SQUIRREL CAGE INDUCTION MOTOR, STARTING CURRENT LIMITED TO SIX TIMES THE RATED CURRENT-INCLUSIVE OF I.S. TOLERANCE		
	ACTUATOR APPLICABLE WIRING DIAGRAM	<input checked="" type="checkbox"/> ENCLOSED <input checked="" type="checkbox"/> DRG. NO. 3-V-MISC-24227 R00 (INDICATIVE)		
	COLOUR SHADE	<input checked="" type="checkbox"/> BLUE (RAL 5012), To be decided during detail engg.		
	PAINT TYPE (## Refer Notes)	<input type="checkbox"/> ENAMEL <input checked="" type="checkbox"/> EPOXY <input type="checkbox"/>		
	SHAFT RPM	BIDDER TO SPECIFY		
	OLR SET VALUE	BIDDER TO SPECIFY		
	@ STARTING / FULL LOAD CURRENT	BIDDER TO SPECIFY		
	NO. OF REV FOR FULL TRAVEL	BIDDER TO SPECIFY		
	@ PWR SUPP TO MTR / STARTER	415V, 3PH, AC, 3 WIRE		
	@ CONTROL VOLTAGE REQUIREMENT	TO BE DERIVED FROM THE POWER SUPPLY TO THE STARTER <input type="checkbox"/> 230 V <input type="checkbox"/> 110 V		
	@ ENCLOSURE CLASS OF MOTOR	<input type="checkbox"/> IP 65 <input type="checkbox"/> FLAME PROOF		

FORM NO. PEM-6666-0


	SPECIFICATION FOR MOTORISED VALVE ACTUATOR		SPECIFICATION NO.:			
			VOLUME			
			SECTION			
			REV. NO.	00	DATE:	06.01.2015
			SHEET	2	OF	3

Data Sheet A & B

DATA SHEET-A (TO BE FILLED BY PURCHASER)	DATA SHEET-B (TO BE FILLED-UP BY BIDDER)
---	---

	@ INSULATION CLASS	CLASS-F TEMP. RISE LIMITED TO CLASS-B	
	@ WINDING TEMP PROTECTION	<input checked="" type="checkbox"/> THERMOSTAT (3 Nos.,1 IN EACH PHASE) <input type="checkbox"/> _____	
	SINGLE PHASE / WRONG PHASE SEQUENCE PROTECTION	REQUIRED	
INTEGRAL STARTER	INTEGRAL STARTER	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	TYPE OF SWITCHING DEVICE	<input checked="" type="checkbox"/> CONTACTORS <input type="checkbox"/> THYRISTORS	
	TYPE	<input checked="" type="checkbox"/> CONVENTIONAL <input type="checkbox"/> SMART (NON-INTRUSIVE)	
	IF SMART	NOT APPLICABLE	
	a) SERIAL LINK INTERFACE	<input type="checkbox"/> INTEGRAL <input type="checkbox"/> FIELD MOUNTED	
	b) SERIAL LINK PROTOCOL	<input type="checkbox"/> FOUNDATION FIELD-BUS <input type="checkbox"/> PROFI-BUS <input type="checkbox"/> DEVICE NET <input type="checkbox"/>	
	c) SERIAL LINK MEDIA	<input type="checkbox"/> TWISTED PAIR Cu-CBL <input type="checkbox"/> CO-AXIAL Cu-CBL <input type="checkbox"/> OFC	
	d) HAND HELD PROGRAMMER	<input type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	e) TYPE OF HAND HELD PROGRAMMER	<input type="checkbox"/> BLUETOOTH <input type="checkbox"/> INFRARED <input type="checkbox"/>	
	f) MASTER STATION	<input type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	g) MASTER STN INTRFACE WITH DCS	<input type="checkbox"/> MODBUS <input type="checkbox"/> TCP/IP	
	h) DETAILS OF SPECIAL CABLE	<input type="checkbox"/> ENCLOSED <input type="checkbox"/> NOT REQUIRED	
	STEP DOWN CONT. TRANSFORMER	<input checked="" type="checkbox"/> REQUIRED	
	OPEN / CLOSE PB	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	STOP PB	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	INDICATING LAMPS	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
LOCAL REMOTE S/S	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED		
STATUS CONTACTS FOR MONITORING	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED		
INTEGRAL STARTER DISTURBED SIGNAL	REQUIRED (O/L RELAY OPERATED, CONT. /POWER SUPPLY FAILED, S/S IN LOCAL, TORQUE SWITCH OPTD. MID WAY)		
INTERPOSING RELAY/OPTO COUPLER (Applicable for integral Starter)	TYPE OF ISOLATING DEVICE	<input checked="" type="checkbox"/> INTERPOSING RELAY <input type="checkbox"/> OPTO COUPLER <input type="checkbox"/> EITHER	
	QUANTITY	<input type="checkbox"/> 2 NOs. <input checked="" type="checkbox"/> 3 NOs.	
	DRIVING VOLTAGE	<input checked="" type="checkbox"/> 20.5 – 24V DC <input type="checkbox"/> _____ V DC	
	DRIVING CURRENT	<input checked="" type="checkbox"/> 125mA MAX <input type="checkbox"/> _____ mA MAX	
	LOAD RESISTANCE	<input checked="" type="checkbox"/> > 192 ohms - <25 k ohms <input type="checkbox"/> > _____ ohms - < _____ ohms	
TORQUE SWITCH (Not Applicable for Smart Actuator) (\$\$ Refer Notes)	MFR & MODEL NO.	BIDDER TO SPECIFY	
	OPEN / CLOSE	<input checked="" type="checkbox"/> 1 No. <input type="checkbox"/> 2Nos. / <input checked="" type="checkbox"/> 1 No. <input type="checkbox"/> 2Nos	
	CONTACT TYPE	2 NO + 2 NC	
	RATING	5A 240V AC AND 0.5A 220V DC	
	CALIBRATED KNOBS(OPEN&CLOSE TS)	REQUIRED FOR SETTING DESIRED TORQUE	
	ACCURACY	+3% OF SET VALUE	
LIMIT SWITCH (Not Applicable for Smart Actuator) (\$\$ Refer Notes)	MFR & MODEL NO.	BIDDER TO SPECIFY	
	OPEN : INT : CLOSE	<input type="checkbox"/> 1 No <input checked="" type="checkbox"/> 2 Nos.	2 Nos. (ADJ.) <input type="checkbox"/> 1 No. <input checked="" type="checkbox"/> 2Nos.
	CONTACT TYPE	2 NO + 2 NC	
	RATING (AC / DC)	5A 240V AC AND 0.5A 220V DC	

FORM NO. PEM-6666-0

	SPECIFICATION FOR MOTORISED VALVE ACTUATOR	SPECIFICATION NO.:		
		VOLUME		
		SECTION		
		REV. NO.	00	DATE: 06.01.2015
		SHEET	3	OF 3

Data Sheet A & B

DATA SHEET-A (TO BE FILLED BY PURCHASER)	DATA SHEET-B (TO BE FILLED-UP BY BIDDER)
---	---

POSITION TRANSMITTER	POSITION TRANSMITTER	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	MFR & MODEL NO.	BIDDER TO SPECIFY	
	TYPE	<input type="checkbox"/> ELECTRONIC (2 WIRE) R/I CONVERTER <input checked="" type="checkbox"/> ELECTRONIC (2 WIRE) CONTACTLESS	
	SUPPLY	<input checked="" type="checkbox"/> 24V DC <input type="checkbox"/>	
	OUTPUT	<input checked="" type="checkbox"/> 4-20mA	
	ACCURACY	± 1% FS	
SPACE HEATER	@SPACE HEATER	REQUIRED	
	@ POWER SUPPLY (NON INTEGRAL)	240V AC, 1 PH., 50 Hz	
	@ POWER SUPPLY (INTEGRAL)	240V AC , 1 PH/415/240 V CTRL TRANSFORMER WITH PRIMARY AND SECONDARY FUSES	
	@ RATING		
TERMINAL BOX	ACTUATOR/MOTOR TERMINAL BOX	REQUIRED	
	ENCL CLASS ACTUATOR/MOTOR T.B.	@ <input type="checkbox"/> IP 68 @ <input type="checkbox"/>	
	@ EARTHING TERMINAL	REQUIRED	
	PLUG & SOCKET(9 PIN) (FOR COMM, LS/TS FEED BACK, PoT)	<input type="checkbox"/> REQUIRED <input checked="" type="checkbox"/> NOT REQUIRED <input type="checkbox"/> 2 NOS. <input type="checkbox"/>	
CABLE GLANDS	@ POWER CABLE GLAND	SIZE:-----	
	@ SPACE HEATER CABLE GLAND	SIZE:-----	
	OTHER CONTROL CABLE GLANDS-1	INSTRUMENT CABLE SIZE FOR ON/OFF DUTY VALVES SHALL BE 8PX0.5 SQMM - ONE CABLE GLAND OF OD SIZE 20 MM. INSTRUMENT CABLE SIZE FOR INCHING DUTY TYPE VALVES SHALL HAVE TWO NO. CABLES (ONE NO. 8PX0.5 SQMM AND 2ND 2PX0.5 SQMM) - TWO NO. GLANDS OF OD SIZES 20 MM & 15 MM.	
	OTHER CONTROL CABLE GLANDS-2		
WEIGHT	TOTAL WEIGHT (ACTUATOR + ACCESSORIES)	BIDDER TO SPECIFY	_____ Kg.


NOTES:

1. **SCOPE:** DESIGN, MANUFACTURE, INSPECTION, TESTING AND DELIVERY TO SITE OF ELECTRIC ACTUATOR FOR INCHING OR OPEN / CLOSE DUTY.
 2. **CODES & STANDARDS:** DESIGN AND MATERIALS USED SHALL COMPLY WITH THE RELEVANT LATEST NATIONAL AND INTERNATIONAL STANDARD. AS A MINIMUM, THE FOLLOWING STANDARDS SHALL BE COMPLIED WITH:
IS-9334, IS-2147, IS-2148, IS-325, IS-2959, IS-4691 AND IS-4722
 3. TEMPERATURE RISE SHALL BE RESTRICTED TO 70 DEG. C FOR AMBIENT TEMPERATURE OF 50 DEG C.
 4. CABLE GLANDS OF DOUBLE COMPRESSION TYPE, BRASS MATERIAL, WITH NICKEL COATING SHALL BE PROVIDED.
 5. THE TORQUE SWITCHES SHALL BE PROVIDED WITH MECHANICAL LATCHING DEVICE TO PREVENT OPERATION WHEN UNSEATING FROM THE END POSITIONS. THE LATCHING DEVICE SHALL UNLATCH AS SOON AS THE VALVE LEAVES THE END POSITION. IF SUCH PROVISION IS NOT POSSIBLE, THE TORQUE SWITCHES SHALL BE BYPASSED BY END-POSITION LIMIT SWITCHES WHICH OPENS ON VALVE LEAVING END POSITION. THESE LIMIT SWITCHES ARE ADDITIONAL TO THE NUMBER OF LIMIT SWITCHES SPECIFIED ELSEWHERE.
 6. THE MOTOR SHALL OPERATE SATISFACTORILY UNDER THE +/- 10% SUPPLY VOLTAGE VARIATION AT RATED FREQUENCY. -5% TO +3% VARIATION IN FREQUENCY AT RATED SUPPLY VOLTAGE, SIMULTANEOUS VARIATION IN VOLTAGE & FREQUENCY THE SUM OF ABSOLUTE PERCENTAGE NOT EXCEEDING 10%.
 7. THE MOTOR SHALL BE SUITABLE FOR DIRECT ON LINE STARTING.
- \$\$ TORQUE SWITCH & LIMIT SWITCH SHALL ACT INDEPENDENT OF EACH OTHER. TANDEM OPERATION IS NOT ACCEPTABLE.**
- ## EPOXY PAINT IS RECOMMENDED FOR COASTAL AREAS.**

	VENDOR COMPANY SEAL
	NAME
	SIGNATURE
	DATE

NOTES* = TO BE FILLED BY MPL (LEAD AGENCY), @= TO BE FILLED BY ES

3-V-MISC-24227
DRAWING NO.

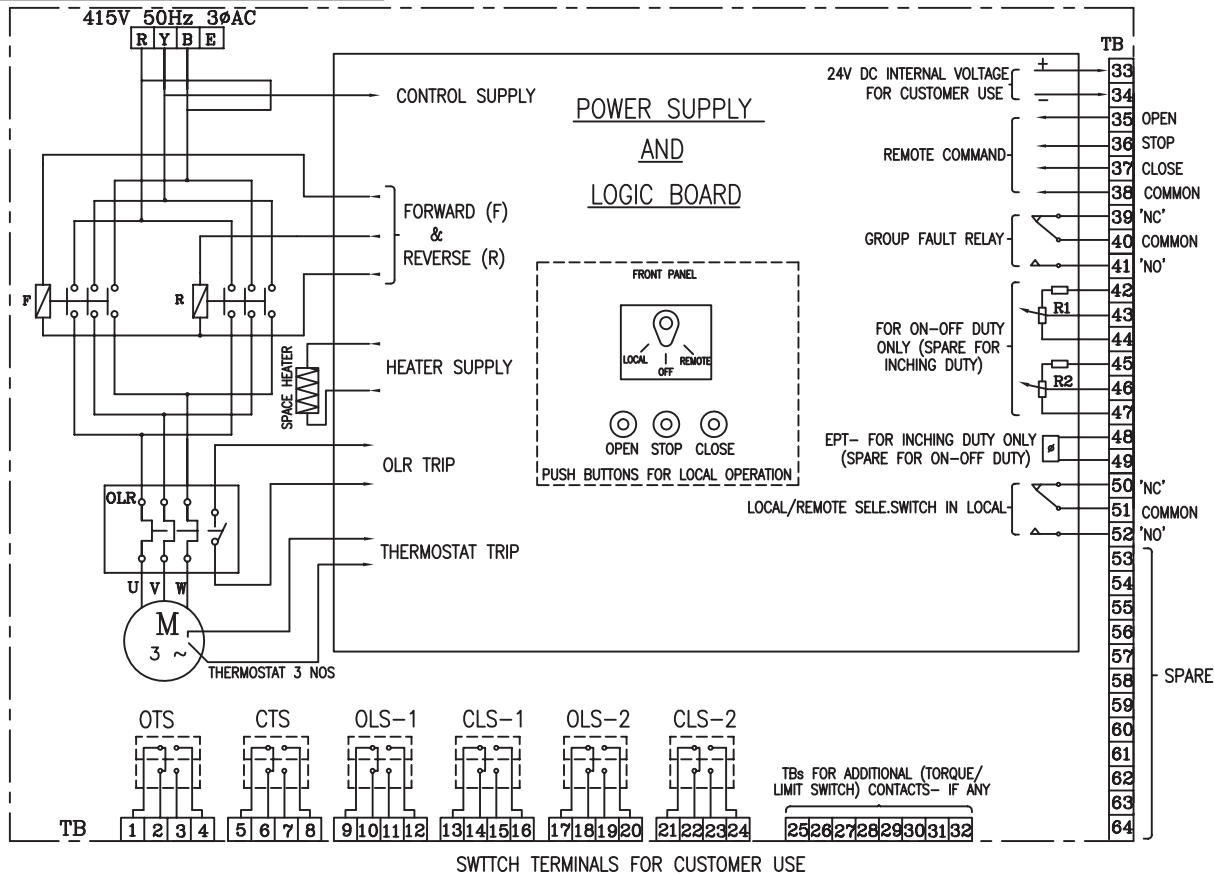

Switch	Terminal No.	Full Open	Intermediate	Full Close
OTS	1-2	OPEN AT OVER TORQUE DURING OPENING TRAVEL		
	3-4	CLOSE AT OVER TORQUE DURING OPENING TRAVEL		
CTS	5-6	OPEN AT OVER TORQUE DURING CLOSING TRAVEL		
	7-8	CLOSE AT OVER TORQUE DURING CLOSING TRAVEL		
OLS-1	9-10	INDICATES CONTACT CLOSED		
	11-12	INDICATES CONTACT OPEN		
CLS-1	13-14	INDICATES CONTACT CLOSED		
	15-16	INDICATES CONTACT OPEN		
OLS-2	17-18	INDICATES CONTACT CLOSED		
	19-20	INDICATES CONTACT OPEN		
CLS-2	21-22	INDICATES CONTACT CLOSED		
	23-24	INDICATES CONTACT OPEN		

CONTACT RATING: 5A AT 250V AC & 0.5A AT 220V DC

VALVES	OPEN		CLOSE	
	MAIN	BACK UP	MAIN	BACK UP
GATE VALVE OF 100 mm AND ABOVE IN 1500 CL AND ABOVE RATINGS	OLS	OTS *	CLS	CTS
ALL OTHER GATE & GLOBE VALVES	OLS	OTS *	CTS	#

- CLS NOT TO BE CONNECTED IN TRIP CIRCUIT
* - BYPASS OTS FOR INITIAL 5% OF TRAVEL (FOR GATE VALVES ONLY)

- NOTE:-
- ALL TORQUE AND LIMIT SWITCHES (OTS,CTS,OLS1&2, CLS1&2) ARE WITH 2NO+2NC CONTACTS '1NO+1NC' IS TERMINATED IN TBS 1-24, REMAINING CONTACTS ARE FOR INTERNAL USE. ANY SPARE CONTACTS WHICH ARE NOT USED INTERNALLY ARE TO BE TERMINATED IN TBS 25-32
 - CTS - TORQUE SWITCHES FOR CW ROTATION (CLOSE)
 - OTS - TORQUE SWITCHES FOR CCW ROTATION (OPEN)
 - OLS-1, OLS-2 - LIMITSWITCHES FOR POSITION OPEN
 - CLS-1, CLS-2 - LIMITSWITCHES FOR POSITION CLOSE
 - EPT - ELECTRONIC POSITION TRANSMITTER (Contactless, FOR INCHING DUTY)
 - R1-R2-POTENTIOMETER 2 x 100 OHMS (FOR ON-OFF DUTY)
 - FOR COMMANDS & EPT EITHER INTERNALLY GENERATED 24VDC OR EXTERNAL SUPPLY OF 24VDC CAN BE USED
 - M - MOTOR 3φ 415V 50 Hz AC SUPPLY

REV	DATE	ALTERED
		CHD & APPD

CAUTION: The information on this document is the property of BHARAT HEAVY ELECTRICALS LTD. It must not be used directly or indirectly in any way detrimental to the interest of the company.

TYPE OF PRODUCT ELECTRICAL VALVE ACTUATORS (AC) WITH INTEGRAL STARTERS OR NAME OF CUSTOMER/PROJECT (DRAWN FOR INTERMEDIATE POSITION OF VALVES)																					
BHARAT HEAVY ELECTRICALS LTD., UNIT: HIGH PRESSURE BOILER PLANT, TIRUCHIRAPALLI-620014. 365-121	<table border="1"> <tr> <th>DRN</th> <th>NAME</th> <th>SIGN</th> <th>DATE</th> <th>NO. OF VAR.</th> </tr> <tr> <td></td> <td>N.P.ESWAR</td> <td>N.P</td> <td>07.10.04</td> <td></td> </tr> <tr> <th>CHD</th> <td>D.DINAKARAN</td> <td>D.D</td> <td>07.10.04</td> <td></td> </tr> <tr> <th>APPD</th> <td>K.ARUNACHALAM</td> <td>K.A</td> <td>07.10.04</td> <td></td> </tr> </table>	DRN	NAME	SIGN	DATE	NO. OF VAR.		N.P.ESWAR	N.P	07.10.04		CHD	D.DINAKARAN	D.D	07.10.04		APPD	K.ARUNACHALAM	K.A	07.10.04	
DRN	NAME	SIGN	DATE	NO. OF VAR.																	
	N.P.ESWAR	N.P	07.10.04																		
CHD	D.DINAKARAN	D.D	07.10.04																		
APPD	K.ARUNACHALAM	K.A	07.10.04																		
<table border="1"> <tr> <th>DEPT</th> <th>VL</th> <th>SCALE</th> <th>WEIGHT (KG).</th> <th>REFERENCE INFORMATION</th> <th>NO. OF ITEMS</th> </tr> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </table>	DEPT	VL	SCALE	WEIGHT (KG).	REFERENCE INFORMATION	NO. OF ITEMS							<table border="1"> <tr> <th>TITLE</th> <th>CARD CODE</th> <th>DRAWING NO.</th> <th>REV</th> </tr> <tr> <td>WIRING DIAGRAM (TERMINAL PLAN) FOR ACTUATOR WITH INTEGRAL STARTER</td> <td>U 01</td> <td>3-V-MISC-24227</td> <td>0</td> </tr> </table>	TITLE	CARD CODE	DRAWING NO.	REV	WIRING DIAGRAM (TERMINAL PLAN) FOR ACTUATOR WITH INTEGRAL STARTER	U 01	3-V-MISC-24227	0
DEPT	VL	SCALE	WEIGHT (KG).	REFERENCE INFORMATION	NO. OF ITEMS																
TITLE	CARD CODE	DRAWING NO.	REV																		
WIRING DIAGRAM (TERMINAL PLAN) FOR ACTUATOR WITH INTEGRAL STARTER	U 01	3-V-MISC-24227	0																		



Technical specification for
CONTROL & INSTRUMENTATION

1X800 MW KOTHAGUDEM

SPEC NO.: **PE-TS-410-145-I**

VOLUME

SECTION

REV. NO. 00

DATE : 10.03.2015

SHEET OF

INSTRUMENTATION DATA SHEET

1.00.00 SPECIFICATION FOR ELECTRONIC TRANSMITTERS

1.01.00 PRESSURE TRANSMITTER

1. Working Principle : Smart (HART Compatible)
2. Type : Microprocessor based, 2 – Wire
3. Output Signal : 4-20 mA DC along with superimposed digital signal
4. Measuring Element : Capsule / Diaphragm
5. Element material : SS-316 (Stainless Steel) or better
6. Static Pressure : 150 % of maximum span continuously, without affecting the calibration
7. Turn-down ratio : 100: 1
8. Span and Zero : Continuous, tamper proof, remote as well locally adjustable with zero elevation and suppression by 100% of span
9. Enclosure Class : IP-65 (Explosion proof for NEC Class-1, Division 1 area)
10. Output Indicator : LCD (Integral indicator of 5 digit display)
11. Nameplate : Tag number, service engraved in SS tag plate
12. Body : SS
13. Operating Voltage : 24V DC
14. Load : 600 Ohms (min.) at 24 Volts D.C.
15. Ambient Temperature : 0 - 50 °C
16. Performance: :
 - i. Accuracy : $\pm 0.075\%$ of Span or better

- ii. Repeatability : $\pm 0.05\%$ of Span or better
17. Sealing/Isolation : Extended diaphragm (Silicon oil/ Fluorolub filled) with 5 meters SS armoured capillary for corrosive/viscous/solid bearing or slurry type fluid applications
18. Accessories :
- a. Universal mounting bracket suitable for 2" pipe mounting
 - b. High tensile carbon steel U-bolts
 - c. Siphon for steam and hot water services
 - d. 1/2" NPT 2-valve stainless steel manifold, constructed from SS316 bar stock
 - e. Companion flange with nuts, bolts and gaskets
 - f. 1/2" NPT cable gland
 - g. Handheld calibrator
19. Adjustment/Calibration/ Maintenance : From handheld calibrator/ HART management system

Notes: For primary air/ secondary air/ flue gas applications, DP type transmitters shall be provided for pressure measurement.
LVDT type is not acceptable.

1.02.00 DIFFERENTIAL PRESSURE TRANSMITTER / FLOW TRANSMITTER

1. Working Principle : Smart (HART Compatible)
2. Type : Microprocessor based, 2 – Wire
3. Output Signal : 4-20 mA DC along with superimposed digital signal
4. Measuring Element : Capsule / Diaphragm

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

-
- | | | | |
|-----|---------------------|---|---|
| 5. | Element material | : | SS-316 (Stainless Steel) or better |
| 6. | Static Pressure | : | 150 % of maximum span continuously, without affecting the calibration |
| 7. | Turn-down ratio | : | 100: 1 |
| 8. | Span and Zero | : | Continuous, tamper proof, remote as well locally adjustable with zero elevation and suppression by 100% of span |
| 9. | Enclosure Class | : | IP-65 (Explosion proof for NEC Class-1, Division 1 area) |
| 10. | Output Indicator | : | LCD (Integral indicator of 5 digit display) |
| 11. | Nameplate | : | Tag number, service engraved in SS tag plate |
| 12. | Body | : | SS |
| 13. | Operating Voltage | : | 24V DC |
| 14. | Load | : | 600 Ohms (min.) at 24 Volts D.C. |
| 15. | Ambient Temperature | : | 0 - 50 °C |
| 16. | Performance: | | |
| | i. Accuracy | : | ± 0.075% of Span or better |
| | ii. Repeatability | : | ± 0.05% of Span or better |
| 17. | Sealing/Isolation | : | Extended diaphragm (Silicon oil/ Fluorolub filled) with 5 meters SS armoured capillary for corrosive/viscous/solid bearing or slurry type fluid applications |
| 18. | Accessories | : | <ul style="list-style-type: none"> a. Universal mounting bracket suitable for 2" pipe mounting b. High tensile carbon steel U-bolts |

**DEVELOPMENT CONSULTANTS
(PCT-K-03-2013-14_V-VI_S VII_SS A.DOC)**

V V/S-VII/SS-A: 4

- c. Siphon for steam and hot water services
- d. ½" NPT 5-valve stainless steel manifold, constructed from SS316 bar stock
- e. Companion flange with nuts, bolts and gaskets
- f. ½" NPT cable gland
- g. Handheld calibrator

19. Adjustment/Calibration/ Maintenance : From handheld calibrator/ HART management system

1.03.00 Displacer Type Level Transmitters

- 1. Type : Smart (HART Compatible)
- 2. Stages of operation : Continuous
- 3. Material :
- 4. i. Displacer : SS-316
- 5. ii. Suspension wire : SS-316
- 6. iii. Torque tube housing : SS
- 7. iv. Torque tube : Inconel
- 8. v. Displacer chamber : SS
- 9. vi. Transmitter Housing : SS
- 10. Operating Voltage : 24 V DC
- 11. Transmission : Microprocessor based, 2-wire
- 12. Output Signal : 4-20 mA DC along with superimposed digital signal
- 13. Static / overload : Maximum static pressure without

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

	pressure		permanent deformation or loss of accuracy
14.	Turn-down ratio	:	10 : 1 or better
15.	Zero & Span	:	Continuous, tamper proof, remote as well locally adjustable with zero elevation and suppression by 100% of span
16.	Enclosure Class	:	IP-65
17.	Output Indicator	:	LCD type (Integral indicator of 5 digit display)
18.	Nameplate	:	Tag number and Service engraved in stainless steel tag plate
19.	Ambient Temperature	:	0 - 50 °C
20.	Load Impedance	:	600 Ohms at 24 Volts (minimum)
21.	Process Connection	:	2" Flanged
22.	Performance - Accuracy	:	± 0.075 % of span or better
23.	Accessories	:	<ul style="list-style-type: none"> a) Counter Flange, nuts, bolts, gaskets etc b) Weights for 5 point calibration of instruments c) Vent and drain plugs d) ½" NPT Glands e) Handheld calibrator
24.	Preferred Features	:	<ul style="list-style-type: none"> a) Test plug connection and cutout terminals physically separated from other electronics b) Electronic Damping facility (adjustable)
25.	Adjustment/Calibration/ Maintenance	:	From handheld calibrator/ HART management system

**DEVELOPMENT CONSULTANTS
(PCT-K-03-2013-14_V-VI_S VII_SS A.DOC)**

V V/IS-VII/SS-A: 6

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

26. Applications : During detail engineering on Owner's approval
- 1.04.00 MASS FLOW METER
- 1.04.01 SENSOR
1. Measuring Principle : Coriolis Mass flow
 2. Primary Element : Flow Tube of 316SS or better
 3. Heating Arrangement : Integral
 4. Temperature Control : For heavy fuel oil application
 5. Process Connection : Flanged of rating as per process requirement
 6. Drain : Self-draining facility
 7. Enclosure : Stainless steel
 8. Accessories : Counter flanges, Mounting nuts, bolts, gaskets etc.
- 1.04.02 TRANSMITTER
1. Measured quantities : Mass Flow rate, Total Mass Flow, Density
 2. Input Signal Processing : Smart (HART compatible)
 3. Display : LCD
 4. Output : 2 nos. isolated output of 4-20mA DC selectable from four measured quantities
 5. Load : < 750 ohms
 6. Power supply : 240V AC, 50 Hz

**DEVELOPMENT CONSULTANTS
(PCT-K-03-2013-14_V-VI_S VII_SS A.DOC)**

V V/S-VII/SS-A: 7

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

-
- | | | | |
|-----|---|---|---|
| 7. | Turn Down | : | 100:1 |
| 8. | Accuracy | : | ± 0.2 % of measured value |
| 9. | Housing | : | IP 65 (Explosion proof) |
| 10. | Nameplate | : | Tag number, service engraved in stainless steel tag plate |
| 11. | Accessories | : | a) Handheld calibrator
b) Mounting U-bolts, nuts, bolts, prefab cable etc
c) $\frac{1}{2}$ "NPT cable gland |
| 12. | Adjustment/Calibration/
/Maintenance | : | From handheld calibrator/ HART management system |
| 13. | Applications | : | Fuel Oil service |

1.05.00 RADAR TYPE LEVEL MEASUREMENT

- | | | | |
|----|---------------------------|---|---|
| 1. | Type | : | Smart (HART Compatible) |
| 2. | Antenna | : | Co axial / guided wave radar /Overspill protection |
| 3. | Principle | : | TDR (Time Domain Reflectometry) |
| 4. | Communication | : | Two wire 4-20mA DC with HART |
| 5. | Environmental temperature | : | 0 – 50 °C |
| 6. | Enclosure | : | IP-65 (Explosion proof for NEC Class-1, Division 1 area) |
| 7. | Calibration | : | a) Self calibration with internal reference
b) Zero & Span calibration |
| 8. | Process Connection | : | External cage mounting
Flanged /screwed |
| 9. | Electronic Housing | : | Epoxy painted Die-Cast aluminium |

**DEVELOPMENT CONSULTANTS
(PCT-K-03-2013-14_V-VI_S VII_SS A.DOC)**

V V/IS-VII/SS-A: 8

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

		alloy
10. Antenna / Flange assembly	:	316 SS or Hest alloy (as required)
11. Power supply	:	24 V DC
12. Output Indicator	:	LCD
13. Accuracy	:	5 mm or 0.1% of probe length
14. Accessories	:	a) Handheld calibrator
	:	b) Counter Flange, nuts, bolts, gaskets etc
	:	c) ½"NPT cable gland
	:	d) SS Nameplate
15. Adjustment/Calibration/ Maintenance	:	From handheld calibrator/ HART management system
16. Applications	:	Vessels under vacuum or low pressure applications, solid levels
1.06.00		ULTRASONIC LEVEL TRANSMITTER
1. Type	:	Microprocessor based, 2-wire, Smart (HART Compatible)
2. Operating Principle	:	Detection of reflected ultrasonic pulse
3. Output Signal	:	4-20 mA DC along with superimposed digital signal
4. Operating frequency	:	10 KHz to 50 KHz (typical)
5. Display	:	LCD
6. Temperature Compensation	:	Built in –Programmable
7. Power supply	:	24 V DC
8. Enclosure	:	SS, IP-65 (Explosion proof for NEC Class-1, Division 1 area)

**DEVELOPMENT CONSULTANTS
(PCT-K-03-2013-14_V-VI_S VII_SS A.DOC)**

V V/S-VII/SS-A: 9

Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS

EPC Bid Document
e-PCT/TS/K/02/2014-15

-
- | | | | |
|-----|-------------------------------------|---|---|
| 9. | Zero & Span | : | Continuous, tamper proof, remote as well locally adjustable. It shall be possible to calibrate the instrument without any level in the sump/ tank |
| 10. | Accuracy & Repeatability | : | 0.15 % of span or better |
| 11. | Resolution | : | 0.1 % of span |
| 12. | Operating temp. | : | Transmitter- 500 C and Sensor - 800 C |
| 13. | MOC Sensor | : | SS-316/Body- PVC and Face – Polyurethane |
| 14. | Mounting | : | 4" Flanged/ 2" NPT for sensor and Transmitter on panel |
| 15. | Accessories | : | <ul style="list-style-type: none"> a) Handheld calibrator b) Weather canopy for protection from direct sunlight and direct rain c) ½"NPT cable gland d) All mounting hardware (SS-316), Prefab cable e) SS Nameplate |
| 16. | Diagnosis | : | On-line |
| 17. | Status Indication | : | Power On, HI, HI-HI, Lo, LO-LO, Fault |
| 18. | Output Contacts | : | 2 SPDT, 230V, 5A |
| 19. | Adjustment/Calibration/ Maintenance | : | From handheld calibrator/ HART management system |
| 20. | Applications | : | Coal Bunker, Water Service etc. |

DEVELOPMENT CONSULTANTS
(PCT-K-03-2013-14_V-VI_S VII_SS A.DOC)

V VI/S-VII/SS-A: 10

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

1.07.00 ULTRASONIC FLOW TRANSMITTER

1. Type : Ultrasonic – Clamp On
2. Accuracy : +/- 1 % of reading
3. Repeatability : +/- 0.3 % of reading
4. Rangeability : 400 : 1
5. Output Signal : 4-20 mA DC with HART
6. Measured Parameter : Volumetric flow, Totalized flow and flow Velocity
7. Display : LCD with internal Key Pad (Flow rate & Totalization)
8. Power Supply : 24 V DC (2 Wire)
9. Enclosure : SS (IP- 68 – Submersible)
10. Mounting : SS Chain or Strap
11. Accessories
 1. Handheld calibrator
 2. ½”NPT cable gland
 3. Transducer cable
 4. All mounting hardware (SS-316)
 5. SS Nameplate
12. Adjustment/Calibration/ Maintenance : From handheld calibrator/ HART management system
13. Applications : Plant water service

Note: Multi-path insertion type (minimum 4 path) Ultrasonic Flow meter shall be provided for Raw water/ Cooling Water flow measurements.

2.00.00 **HART HAND HELD CALIBRATOR**

Hand held calibrators (5 nos. for each type) shall be provided for adjustment/ calibration/maintenance of the HART compatible

**DEVELOPMENT CONSULTANTS
(PCT-K-03-2013-14_V-VI_S VII_SS A.DOC)**

V VI/S-VII/SS-A: 11

transmitters. The hand held calibrator shall be suitable for all types of transmitters supplied in the package. If one type of hand held type calibrator is not suitable for communicating with all types of transmitters then separate hand held calibrator will be provided.

3.00.00 PROCESS ACTUATED SWITCHES

3.01.00 PRESSURE SWITCH

1. Type :
 - i. Piston for high pressure application
 - ii. Bellow / Diaphragm for low pressure application
2. Sensing element : SS-316.
material All other wetted part SS316
3. Case Material : SS \dagger
4. Setter Scale : Black graduation on white linear scale.
Graduation 0-100% with red pointer for set points
5. Over range : 150 % of maximum pressure
6. Adjustments :
 - a) Internal Set Point
 - b) Differential adjustment
7. End Connection : 1/2" NPT bottom connected
8. Switch configuration : Two SPDT (240V, 5A AC/220V, 0.5A DC)
9. Switch Type : Snap acting, shock & vibration proof
10. Terminal Block : Suitable for full ring lugs
11. Enclosure Class : IP-65 (Explosion proof for NEC Class-1, Division 1 area)
12. Performance :
 - a) Repeat accuracy \pm 1.0%
 - b) Accuracy of Setting Indication of \pm 1.5%
13. Ambient temperature : 0 – 50 Deg.C

-
14. Nameplate : Tag number, service engraved in SS tag plate
15. Accessories : a) Silicon oil/ Fluorolub filled Remote diaphragm seal with SS-316 capillary for corrosive/ viscous/ solid bearing or slurry type fluid applications
b) Snubbers for pulsating fluid applications
c) Siphons for steam and hot water services
d) Retention ring and screws for surface mounting
e) 1/2" NPT 2 Valve SS-316 barstock manifold
f) 1/2" NPT cable gland
16. Applications : During Detail Engineering on Owner's approval

3.02.00 DIFFERENTIAL PRESSURE SWITCH

1. Type : i. Piston for high pressure application
ii. Bellow / Diaphragm for low pressure application
2. Sensing element material : SS-316.
All other wetted part SS316
3. Case Material : SS
4. Setter Scale : Black graduation on white linear scale. Graduation 0-100% with red pointer for set points
5. Over range : 150 % of maximum pressure

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

-
- | | | | |
|-----|----------------------|---|---|
| 6. | Adjustments | : | a) Internal Set Point |
| | | : | b) Differential adjustment |
| 7. | End Connection | : | 1/2" NPT bottom/ back connected |
| 8. | Switch configuration | : | Two SPDT (240V, 5A AC/220V, 0.5A DC) |
| 9. | Switch Type | : | Snap acting, shock & vibration proof |
| 10. | Terminal Block | : | Suitable for full ring lugs |
| 11. | Enclosure Class | : | IP-65 (Explosion proof for NEC Class-1, Division 1 area) |
| 12. | Performance | : | a) Repeat accuracy $\pm 1.0\%$
b) Accuracy of Setting Indication of $\pm 1.5\%$ |
| 13. | Ambient temperature | : | 0 – 50 Deg.C |
| 14. | Nameplate | : | Tag number, service engraved in SS tag plate |
| 15. | Accessories | : | a) Silicon oil/ Fluorolub filled Remote diaphragm seal with SS-316 capillary Diaphragm seals for corrosive/ viscous/ solid bearing or slurry type fluid applications
b) Snubbers for pulsating fluid applications
c) Siphons for steam and hot water services
d) Retention ring and screws for surface mounting
e) 1/2" NPT 5 Valve SS-316 barstock manifold
f) 1/2" NPT cable gland |
| 16. | Applications | : | During Detail Engineering on Owner's |

**DEVELOPMENT CONSULTANTS
(PCT-K-03-2013-14_V-VI_S VII_SS A.DOC)**

V V/S-VII/SS-A: 14

approval

3.03.00 LEVEL SWITCH

3.03.01 FLOAT OPERATED

1. Float material : SS-316
2. Wetted parts : SS-316
3. Float chamber : Stainless steel/Carbon steel,
construction welded
4. Float chamber : Side mounted
mounting
5. Fluid connection : Side – Side
6. Fluid connection size : 1" ANSI RF Flange (rubber line, if
required)
7. Drain : ½ inch NPT with Plug
8. Pressure rating of : Minimum 1.5 times of design pressure
chamber
9. Repeatability : +/- 1.5 mm or better
10. Switch housing : Stainless Steel
11. Switch housing type : IP- 65
12. Type of switch : Snap acting magnetically operated
hermetically sealed
13. Switch configuration : 2 SPDT (5A, 240 V AC, 0.5A, 220V DC)
14. Accessories : a) Counter flange, nuts
& bolts, suitable
gasket etc.
b) Steel globe type
drain valve
c) ½"NPT cable gland

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

-
- d) Stainless steel nameplate with alpha-numeric engraved for service and tag
15. Application : During Detail Engineering on Owner's approval
- 3.04.00 FLOW SWITCH
1. Type : Paddle /Piston/Disk
2. Wetted part material : Stainless steel or Hastelloy for acidic application
3. End connection : a) Threaded upto 1" line size with integral Tee
: b) Flanged for line size > 1 ½"
4. Enclosure material : Stainless Steel
5. Enclosure class : IP 65
6. Switch configuration : 2 SPDT (5A, 240 V AC, 0.5A, 220V DC)
7. Repeatability : 2%
8. Cable connection : ½"NPTF
9. Accessories : a) Tee, Counter flange, nuts & bolts, suitable gasket etc
b) ½"NPT cable gland
c) Stainless steel nameplate with alpha-numeric engraved for service and tag
- 3.05.00 RF LEVEL SWITCH

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

-
- | | | |
|-----------------------------|---|--|
| 1. Type | : | RADIO FREQUENCY |
| Sensing probe | | |
| 2. Material | : | SS-316 |
| 3. Mounting | : | Threaded |
| 4. Application | : | 250°C (Max.) |
| Temperature | | |
| Electronic Controller | | |
| 5. Input Supply Voltage | : | 240V AC ±10%, 50 Hz. |
| 6. Relay Output | : | 2 SPDT (240V AC, 5A) |
| 7. Ambient Temperature | : | 50 °C |
| 8. Enclosure Protection | : | IP-66 |
| 9. Enclosure Housing | : | SS |
| | | Normal Level |
| | | Power On |
| 10. Local LED Indication | : | Alarm Level |
| | | Probe Healthy |
| 11. Switching Repeatability | : | ±0.5% |
| | | Co-axial cable for probe connection to |
| | | controller |
| 12. Accessories | : | SS Tag plate |
| | | ½" NPT Cable Glands |
| 13. Application | : | Solid level |

3.06.00 CONDUCTIVITY TYPE LEVEL SWITCH

- | | | |
|------------------|---|-----------------------------|
| 1. Type | : | Conductivity discrimination |
| 2. Probe MOC | : | SS-316 |
| 3. Mounting | : | Flanged on external cage |
| 4. Application | : | 250°C (Max.) |
| Temperature | | |
| 5. Test Pressure | : | Two times rated pressure |

DEVELOPMENT CONSULTANTS
(PCT-K-03-2013-14_V-VI_S VII_SS A.DOC)

V VI/S-VII/SS-A: 17

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

6.	Input Supply Voltage	:	240V AC \pm 10%, 50 Hz. Four independent channel with
7.	Input	:	selectable switching threshold for water conductivity
8.	Relay Output	:	2 SPDT (240V AC, 5A)
9.	Ambient Temperature	:	50 °C
10.	Enclosure Protection	:	IP-65 (Explosion proof for NEC Class-1, Division-1 area)
11.	Enclosure Housing	:	SS HI,LO, HIGH-HIGH, LOW-LOW
12.	Local LED Indication	:	Power Fault
13.	Accessories	:	<ul style="list-style-type: none"> a) Interconnecting cable from probe to electronics b) Mounting accessories c) External cage d) Washer & Gasket e) ½" NPT Cable Glands f) SS Tag Plate
14.	Application	:	During Detail Engineering on Owner's approval
3.07.00	TEMPERATURE SWITCH		
1.	Type	:	Bimetallic or gas filled
2.	Sensing Element Material	:	SS-316
3.	Bulb Material	:	SS-316
4.	Capillary	:	Stainless Steel armored

DEVELOPMENT CONSULTANTS
(PCT-K-03-2013-14_V-VI_S VII_SS A.DOC)

V VI/S-VII/SS-A: 18

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

-
5. Movement Material : Stainless Steel
6. Case material : Stainless Steel with neoprene gasket and clear glass where applicable cover conforming to IP-65. (Explosion proof for NEC Class-1, Division 1 area).
- 7.. Scale : Black graduation on white linear scale. Graduation 0-100% with red pointer for set points
8. Over range Protection : 120 %
9. Instrument connection : Bottom
10. Switch configuration : Two SPDT (240V, 5A AC/220V, 0.5A DC)
11. Switch type : Snap acting, shock and vibration-proof
12. Adjustability : Internal Set point adjustable over span range
13. Compensation : a) Capillary compensation with invar wire throughout the capillary length
b) Case compensation
14. Performance
- a) Scale Accuracy : ± 1.0 % of full scale
- b) Repeatability : < 0.5 % of full range
- c) Response time : Less than 40 seconds with thermowell
15. Capillary length : 5 meters (minimum) for local mounting/15 meters for local panel mounting
16. Nameplate : Tag number, service engraved in stainless steel tag plate
17. Accessories : Mounting accessories, 1/2" NPT cable gland
18. Applications : During Detail Engineering on Owner's

approval

4.00.00 **LOCAL INSTRUMENTS**

4.01.00 PRESSURE GAUGE AND DIFFERENTIAL PRESSURE GAUGE

1. Type : Bourdon/Bellows/Diaphragm
2. Sensing & Socket : SS-316
3. Movement Material : SS-316
4. Case Material : Stainless steel. IP-65 (Explosion proof for NEC Class-1, Division 1 area)
5. Dial Size : Generally 150 mm
6. Scale : Black lettering on white in 270 O arc.
7. Window : Shatterproof glass
8. Range Selection : Normal process pressure: 50~70 % of range
9. Over-range Protection : 125% of maximum range by internal stop. External stop at zero
For Zero adjustment (Micrometer screw external)
10. Adjustment : For Range adjustment (Micrometer screw internal).
11. Element Connection : Argon welding
12. Process Connection : 1/2" NPT (M) Bottom for local, back for panel mounting
13. Performance : Accuracy of ± 1.0 % of span or better
14. Operating ambient : 0 - 50 °C
15. Safety Feature : Blow out disc /diaphragm at the back
16. Accessories : a) Snubbers for pulsating fluid application.discharge
b) Stainless steel Diaphragm seals

for corrosive/ viscous/ solid bearing or slurry type fluid applications

c) 3-Way SS316 Gauge cock for pressure gauges

d) 5-valve SS316 manifold from barstock for differential pressure gauge

e) Siphons for steam and hot water services

17. Nameplate : Tag number, service engraved in stainless steel tag plate

4.02.00 LEVEL INDICATOR (FLOAT & BOARD TYPE)

1. Type : Float and Board
2. Float Material : SS-316
3. Float Cable : SS-316
4. Indicator Assembly : Epoxy painted Aluminium
5. Guide wire spring assembly : SS-316 (2 Nos.)
6. Guide Wire Anchor : SS-316
Anodized Aluminium with engraved marking (Minimum graduation 10mm),
7. Scale Board :
mounting brackets and suitable hardware required as per tank height
8. Elbow Assembly : Anodized Aluminium
9. Flanges : RF , ANSI 150 , SS (3 Nos.)
10. Accuracy : ± 10 mm or better
11. Accessories : All mounting accessories including counter flange, nuts & bolts, suitable

gasket etc. as applicable, SS Tag plate

4.03.00 GAUGE GLASS

- | | | | |
|----|----------------------------------|---|---|
| 1. | Type | : | Reflex /Transparent |
| 2. | Material | : | Toughened borosilicate resistant to thermal shock |
| | Glass | : | Carbon Steel Stainless Steel |
| | Body Material | : | IP-65 (Explosion proof for NEC Class-1, Division 1 area) |
| 3. | Integral cocks & valves/Fittings | : | i. SS 316 |
| 4. | | : | Rubber lined corrosion resistant
ii. stainless steel (for DM/RO service) |
| 5. | Vessel Connection | : | ANSI Flanged SS316 |
| 6. | Accessories | : | i. Integral cocks
ii. Drain Valves
iii. Companion Flanges, Bolts, nuts, gaskets, SS Tag plate
iv. Illuminating lamps, Mica shield as required
v. Calibrated scale |
| 7. | Pressure rating | : | Twice the maximum working pressure |
| 8. | Temperature | : | 300 °C
For larger lengths (greater than 1200mm), additional gauge glasses shall be provided with minimum of 50 mm overlap. |
| 9. | Other details | : | |

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

-
- 4.04.00 SLIGHT GLASS
1. Type : Flap-type.
 2. End connection : Screwed / Flanged
 3. Material
 - a) Body : SS- 304
 - b) Cover plate : SS- 304
 - c) Indicator : SS- 316
 4. Sight Glass : Toughened Borosilicate
 5. Gasket : Neoprene
 6. Bolts & Nuts : High tensile steel.
 7. Hydraulic Test Pressure : 1.5 times maximum working pressure
 8. Accessories : Companion Flanges, Bolts, nuts, gaskets as required, SS Tag plate.
- 4.05.00 ROTAMETER
1. Type : ON-LINE for line upto and including 50 mm NB.
: Borosilicate BY-PASS for line size above 50 NB
 2. Metering tube : Toughened Borosilicate
 3. Float : SS-316
 4. End fittings : SS-316
 5. Packing material : Teflon / PTFE
 6. Casing : Stainless Steel
 7. Gland Rings : Stainless Steel
/Followers/ Other :
wetted parts
 8. Orifice Plate : Stainless Steel (for bypass type)
 9. Operating Temperature : 0-50 Deg. c

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

- | | | |
|------------------------|---|--|
| 10. Test Pressure | : | 200% of maximum operating pressure |
| 11. Scale | : | 250 mm nominal length |
| 12. Graduation | : | Direct reading |
| 13. Process Connection | : | Flanged (RF) to line size as per ANSI standards (150#) |
| 14. Tapping | : | D & D/2 |
| 15. Accuracy | : | +/- 2% of full scale reading |
| 16. Reproducibility | : | Within 0.5% of instantaneous reading |
| 17. Accessories | : | SS Tag Plate, orifice plate |

5.00.00 TEMPERATURE ELEMENTS & ACCESSORIES

5.01.00 RESISTANCE TEMPERATURE DETECTOR

- | | | |
|----------------------------------|---|--|
| 1. Type | : | Platinum (Duplex), Ungrounded |
| 2. Platinum (Duplex), Ungrounded | : | 100 ohm at 0 °C |
| 3. Base | : | Wound on ceramic (anti-inductive) |
| 4. Wiring | : | 3 Wire |
| 5. Protecting Tube | | |
| a) O.D. | : | 6 mm |
| b) Material | : | SS-316, Seamless |
| c) Filling | : | Magnesium oxide (Purity above 99.4%). |
| 6. Response time | : | a) 15 sec. (bare).
b) 30 sec. (with thermowell) |
| 7. Calibration | : | DIN 43760 |
| 8. Accuracy | : | ± 0.5% |
| 9. Head | | |
| a) Type | : | IP-65 universal screwed type |

**DEVELOPMENT CONSULTANTS
(PCT-K-03-2013-14_V-VI_S VII_SS A.DOC)**

V VI/S-VII/SS-A: 24

- b) Material : Stainless Steel
- c) Terminal blocks : Nickel plated Brass-screw type / silver plated
- d) Cable connection : ½" NPT gland and grommet
- e) Others : Terminal head cover with SS chain and suitable gasket.
- Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable).
- Adjustable nipple-union-nipple [1/2" Sch 80 X ½" NPT] with thermowell connection
10. Accessories :
- a) Thermowell connection
- b) Compression fittings/unions
- c) Flanges etc. (for flanged connections only)
- d) Thermowell (As specified below)
11. Thermowell connection : ½" NPT (M) or 150 RF Flanged
12. Nameplate : Tag number, service engraved in stainless steel tag plate

Note: The specifications for RTDs of winding/ bearing of motor/pump, can be as per their manufacturer standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice. However, the type of RTD shall be Pt-100.

5.02.00 THERMOCOUPLES

1. Type :
 - a) 16 SWG wire of Chromel Alumel) (Type-K)
 - b) Duplex
 - c) Ungrounded
2. Protecting Tube
 - a) O.D. : 6 mm
 - b) Material : SS-316, Seamless
 - c) Filling : Magnesium oxide (Purity above 99.4%).
3. Response time :
 - a) < 20 seconds for measurement
 - b) < 10 seconds for control
4. Accuracy : $\pm 1.1^{\circ} \text{C}$ up to 300°C & 0.4% of measured temperature range above 300°C
5. Head
 - a) Type : IP-65 universal screwed type
 - b) Material : Stainless Steel
 - c) Terminal blocks : Nickel plated Brass-screw type / silver plated
 - d) Cable connection : $\frac{1}{2}$ " NPT gland and grommet
6.
 - e) Others : Terminal head cover with SS chain and suitable gasket.

Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable).

7. Accessories :
- a) Adjustable nipple-union-nipple [1/2" Sch 80 X 1/2" NPT] with thermowell connection
 - b) Compression fittings/unions
 - c) Flanges etc. (for flanged connections only)
 - d) Thermowell (As specified below)
8. Thermowell connection : 1/2" NPT (M) or 150 RF Flanged
9. Nameplate : Tag number, service engraved in stainless steel tag plate

5.03.00 TEMPERATURE GAUGE

1. Type : Expansion type (Liquid filled system)
2. Sensing Element Material : Bourdon – SS-316
3. Bulb and Capillary Material : SS-316
4. Capillary Tubing : Inner sheath - solid drawn Material
copper tube
Outer sheath - PVC tube
5. Movement Materials : Stainless Steel / Direct Bourdon tip connection to pointer spindle
6. Case Material : Stainless Steel stove enameled, black finish, threaded bezel ring, clear glass

		cover conforming to IP 65.
7.	Dial size	: 150 mm
8.	Scale	: Black lettering on white background in 270 Deg.C arc
9.	Over range protection	: 125 percent of FSD
10.	Capillary Glanding	: 1/2" NPT(M) x compression fitting (SS) to suit capillary
11.	Instrument Connection	: Bottom connection for local mounting, back connection for panel mounting
12.	Process Connection	: 1/2" NPT (M) or 150 RF Flanged
13.	Extension Neck Length	: 50 mm
14.	Compensation	: a) Capillary compensation
15.		: b) Case compensation
16.	Performance	: a) Accuracy : + /- 1.0 percent of full scale Deflection
		: b) Repeatability : Less than 0.5 percent of full range
		: c) Response time: 15 seconds (max.).
17.	Capillary length	: 3.0 meters (local) / 15.0 metres (local panel)
18.	Other features	: Shatter proof glass
19.	Nameplate	: Tag number, service engraved in stainless steel tag plate
20.	Accessories	: SS316 Thermowell

5.04.00 THERMOWELL

1.	Material	: SS-316
2.	Manufacture	: Drilled from bar stock, Hex Head, Tapered design (As per ASME PTC 19.3)

- | | | | |
|-----|------------------------|---|---|
| 3. | Process connection | : | M33x2 |
| 4. | Certification | : | Not applicable |
| 5. | Bore concentricity | : | +5% of wall thickness |
| 6. | Identification mark | : | Tag number punched on head |
| 7. | Surface treatment | : | Polish after machining |
| 8. | Element connection | : | ½" NPT (M) or 150 RF Flanged |
| 9. | Head | : | Hex |
| 10. | Length of the hex head | : | 31.75 mm (min.) |
| 11. | Accessories | : | SS Plug and chain for test thermo wells
SS Nameplate, Flange with companion
flange & all required accessories for
flanged connections. |

Note: Wake frequency calculations shall be furnished for all thermowells for approval.

Thermowells shall be designed such that the resonant frequency is above the exciting frequencies generated by vortex shedding in the process fluid.

5.05.00 METAL TEMPERATURE THERMOCOUPLE

- | | | | |
|----|----------------------------|---|---|
| 1. | Measuring medium | : | Metal temperature |
| 2. | Type | : | Chromel Alumel (Type-K)
Duplex, Ungrounded |
| 3. | Insulation | : | Mineral Insulation Magnesium Oxide |
| 4. | Wire gauge | : | 16 AWG |
| 5. | Protective sheath | : | SS |
| 6. | Protective sheath diameter | : | 8 mm O.D. |
| 7. | Characteristics | : | Special limits of error as in ANSI thermocouple MC 96.01 |
| 8. | Accessories | : | ½" BSP SS sliding end connector, weld pad, clamps of heat resistant steel |

Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS

EPC Bid Document
e-PCT/TS/K/02/2014-15

1. Type : Hydrometer Type
2. Mounting : On line
3. Accuracy : +/- 2% of range
4. Scale : Black letter on white scale
5. End connection : PVC flange

9.06.00 DENSITY/ CONCENTRATION METER

1. Wetted Part : Stainless Steel
2. Enclosure : Stainless Steel (IP-65)
3. Power Supply : 24 V DC
4. Output signal : 4-20 mA DC (isolated) into 600 ohms
5. Accuracy : ± 0.001 g/cc
6. Indication : LCD display
7. Temp. Compensation : Integral
8. Accessories : Mounting hardware, integral amplifier (if required), cable glands, tag plate etc.

10.00.00 SOLENOID VALVES

1. Operating Principle : Electromagnetic (noiseless)
2. Coil voltage rating : 240 V AC /24 V DC (as required)
3. Ways : 2/3/4 way
4. Port size : 1/4" NPT all ports
5. Body : SS bar stock
- Trim : SS-316
6. Duty : Suitable for continuous energization
7. Sealing : Airtight and leak proof
8. Ambient Temperature : 0 - 50 ° C

DEVELOPMENT CONSULTANTS
(PCT-K-03-2013-14_V-VI_S VII_SS A.DOC)

V VI/S-VII/SS-A: 42