


SIGN & DATE		HP RELIEF VALVE				413137U9005
		LIST OF DOCUMENTS AND DRAWINGS				Rev.0
						Page 1 of 1

SUPERSEDES INVENTORY NO.

A. SCOPE OF THE DOCUMENT:
This document lists down the drawings and documents to be followed for executing the order of one number of HP relief valve.

B. LIST OF DOCUMENTS AND DRAWINGS:

S.no.	Item description	Drawing / Document no.	Rev/ Index
1	Specification – HP Relief valve with pneumatic actuator	413137U9100	
2	HP Relief valve drg	4-13137-U9101	
3	Technical purchasing specification: Valves	41313795102	
4	Electrical specs for limit switch and solenoid valves	41810221002	

COPYRIGHT AND CONFIDENTIAL
The information on this documents is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company

INVENTORY NO.	CIE	Ms Saswati Srivastava		PED	Anil Kumar	
	AGREED DEPTT.	NAME	SIGNATURE & DATE	DEPTT	NAME	SIGNATURE & DATE

No.	Item	Specifications – HP Relief Valve with Pneumatic Actuator																																				
1.	Doc no. Rev no.	413137U9100 00																																				
2.	Basic data: Valve Body Material : ASTM-A182F11/G17CrMo5-5 Inlet connection : 168.3 X 10.97 mm Outlet connection : 273.1 X 7.8 mm <table border="1" data-bbox="236 607 1430 992"> <thead> <tr> <th rowspan="2">Pos*</th> <th rowspan="2">Description</th> <th colspan="2">Dimension acc to ASME B36.10M</th> <th colspan="3">Connection</th> </tr> <tr> <th>NPS</th> <th>Schedule</th> <th>Type</th> <th>Form/Figure</th> <th>Standard</th> </tr> </thead> <tbody> <tr> <td>G23</td> <td>Inlet at HP Relief Valve</td> <td>6"</td> <td>80</td> <td>Butt Weld</td> <td>5B</td> <td>ASME B16.25</td> </tr> <tr> <td>G24</td> <td>Outlet at HP Relief Valve</td> <td>10"</td> <td>30</td> <td>Butt Weld</td> <td>4</td> <td>ASME B16.25</td> </tr> <tr> <td>T840</td> <td>Control Air Connection at HP Relief Valve</td> <td>G3/4"</td> <td>-</td> <td>Thread</td> <td>-</td> <td>EN ISO 228-1</td> </tr> </tbody> </table> <p>*See Indicative Drawing for details.</p>					Pos*	Description	Dimension acc to ASME B36.10M		Connection			NPS	Schedule	Type	Form/Figure	Standard	G23	Inlet at HP Relief Valve	6"	80	Butt Weld	5B	ASME B16.25	G24	Outlet at HP Relief Valve	10"	30	Butt Weld	4	ASME B16.25	T840	Control Air Connection at HP Relief Valve	G3/4"	-	Thread	-	EN ISO 228-1
Pos*	Description	Dimension acc to ASME B36.10M		Connection																																		
		NPS	Schedule	Type	Form/Figure	Standard																																
G23	Inlet at HP Relief Valve	6"	80	Butt Weld	5B	ASME B16.25																																
G24	Outlet at HP Relief Valve	10"	30	Butt Weld	4	ASME B16.25																																
T840	Control Air Connection at HP Relief Valve	G3/4"	-	Thread	-	EN ISO 228-1																																
3.	Valve design	Spindle			vertical																																	
		Steam Flow Direction			Under the valve cone in opening direction																																	
		Fittings			Perforated cage																																	
		KVS-Valve			178 m ³ /h																																	
		Seat diameter			According to tech. design																																	
		Valve stroke			According to tech. design																																	
		Spindle sealing			Graphite																																	
		Leakage Class			EN 1349-Seat leakage IV L1(0.01% KVS value)																																	
		Valve welding ends acc.to.			ASME B 16.25 Fig. 4 & 5 B																																	
4.	Pneumatic Actuator	Spring Working Direction			Opens the valve																																	
		Control Air Working Direction			Closes the valve																																	
		Solenoid valves idle			Opens the valve																																	
		Actuator shall be of proven for the application and shall be subject to BHEL approval																																				
		Travel Time (100% stroke)			Open ≤ 1 sec. Close ≤ 2 sec.																																	
		Fail safe position of actuator			Valve open																																	

		Control Air Connection acc. to	G3/4" (Type Thread as per EN ISO 228-1)
		Pressure of control air	5 bar ≤ p <10 bar
		Min available Control Air Pressure for the design of the actuator	5 bar
		Design differential pressure of actuator	≥ 75.3 bar
		Additional force of the actuator	≥ 20 %
5.	Equipment	3/2-Way-Solenoid valves , connected in series. All pneumatic components are piped. All electrical equipments are wired to a terminal box.	2 pieces
		3/2-way pneumatic valve	2 pieces
		Proximity switch OPEN:	1 piece
		Proximity switch CLOSE:	1 piece
		Filter Regulator with pressure gauge: Adjustment range 0-10 bar, adjusted and sealed at 5 bar	1 piece
6.	Design parameter	Pressure [bar abs]	Temperature [°C]
	Maximal long term	70.1	387
	Maximal short term:	76.5	449
	15 min. per event and max.10,000h of lifetime	18.0	480
	1000 h	18.0	510
	1 min per single event	76.5	510
	The following design data of the adjacent pipes have to be considered:		
	MAWP/MAWT Valve inlet	53.12 bar g	373
	MAWP/MAWT Valve outlet	4.6 bar g	329
	Maximum temperature difference in operation between valve inlet and valve outlet in design case maximal long term		350°C
	Minimal pressure at the valve outlet, approx.		0.113 bar (a)
7.	Seismic Requirements:	Safe operation	Horizontal: 0.3g Vertical: 0.2 g
8.	Installation	Indoor	


	Ambient Conditions	Ambient Temperature min/max	0°C / 50°C
		Absolute Humidity	≥ 60 g/m ³
9.	KKS Labeling	Unit code	
	HP-Relief Valve	LBC41AA051	
	3/2-Way Solenoid Valve 1	LBC41AA051A	
	3/2-Way Solenoid Valve 2	LBC41AA051B	
	3/2-Way Pneumatic Valve 1	LBC41AA051C	
	3/2-Way Pneumatic Valve 2	LBC41AA051D	
	Proximity Switch – Position 100% OPEN	LBC41CG051B	
	Proximity Switch – Position 0% CLOSE	LBC41CG051C	
	Air filter	LBC41AT021	
	Pressure Relief Valve	LBC41AA261	
	Pressure Gauge	LBC41CP501	
	Terminal Box	LBC41GF051	
1	Further Requirements;	We expect in the scope of the agreed quality documentation at least the procurement according to article 10, PED directive 97/23/EC required conformity declaration. The classification of the pressure equipment on the basis of the given layout data in the order (fluid, pressure, volume, nominal size, max temperature) are incumbent on the supplier. As well, the choice of the corresponding conformity quality processes is to carry out by the supplier. The quality declaration must contain all details according to appendix VII of the directive 97/23/EC.	

Prepared by		Approved by	
Anil Kumar	Ms Saswati Srivastava	S K Gupta	B S Rana
Engr- PED	DGM-CIE	SDGM-PED	SDGM-CIE

FIRST ANGLE PROJECTION (ALL DIMENSIONS ARE IN mm) FORM DG 39(B)

REV	DATE	ALTERED	REV	DATE	ALTERED	GMS No./ C.B.O.M. - NO.		STATUS OF DRG U	
		CHECKED			CHECKED				
ZONE			ZONE			AGREED DEPT	NAME	SIGN	DATE

COPYRIGHT AND CONFIDENTIAL
 THE INFORMATION ON THIS DOCUMENT IS THE PROPERTY OF BHARAT HEAVY ELECTRICALS LIMITED. IT MUST NOT BE USED DIRECTLY OR INDIRECTLY IN ANY WAY DETERIMENTAL TO THE INTEREST OF THE COMPANY.

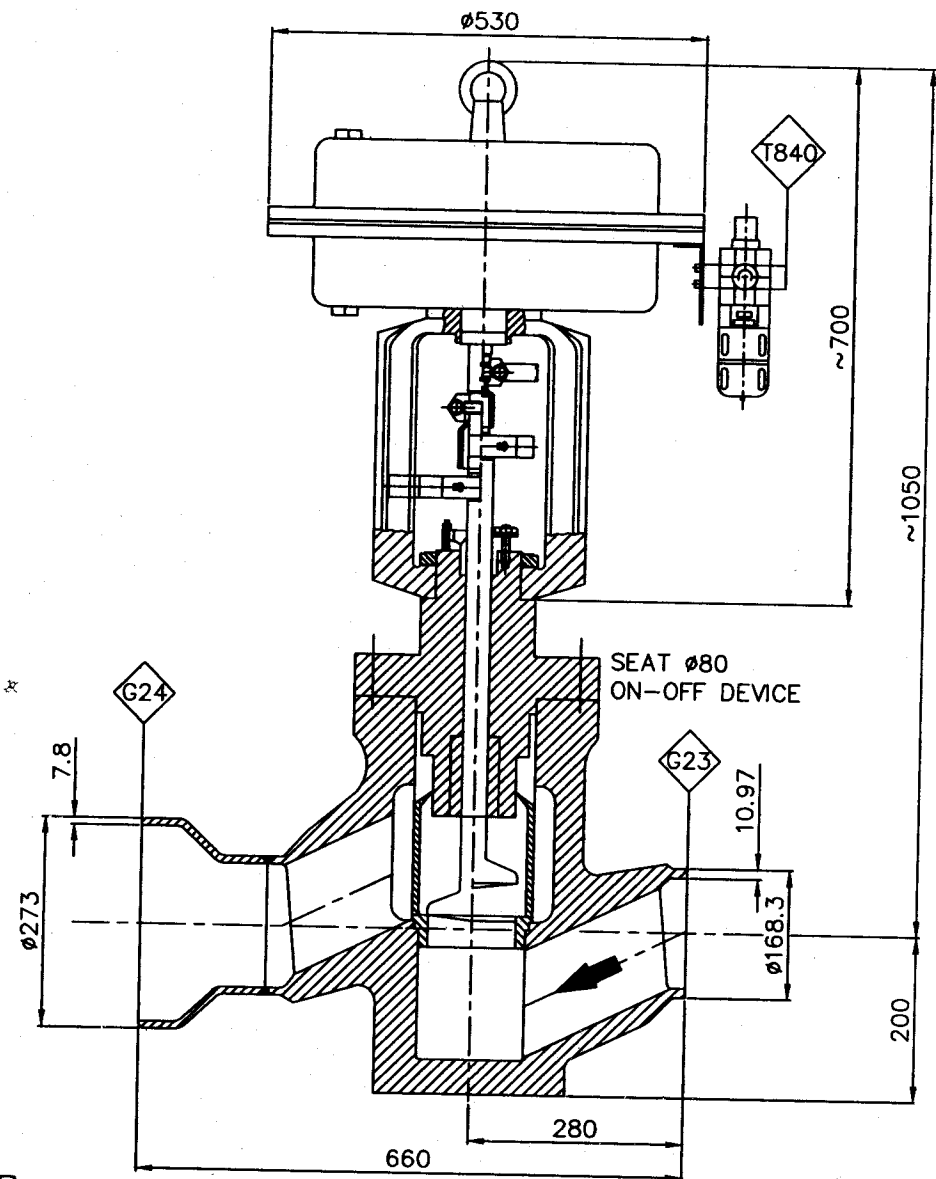

NOTE: -

1. WELD EDGE AS PER FORM FIG. 2A OF ASME B16.25.
2. TYPE OF ACTUATOR, NUMBER OF CYLINDERS AND DIMENSIONS OF VALVE AND ACTUATOR AS GIVEN IN THIS DRAWING ARE INDICATIVE.



BHARAT HEAVY ELECTRICALS LTD.
RANIPUR, HARDWAR

DRN	NAME	SIGN	DATE	NO. OF VAR
P.S.SHARMA	-Sd-	23.12.14		
ANIL KUMAR	-Sd-	23.12.14		
APPD	S.K.GUPTA	-Sd-	23.12.14	

Inventory No.	DEPT STE	SCALE N.T.S.	WEIGHT (KG) -	REF. TO ASSY. DRG.	ITEM No. -	NO. OF ITEMS -
	CODE 4011					
TITLE : HP RELIEF VALVE			CARD CODE 7	DRAWING NO. 4-13137-U9101	REV 00	
				SHEET No. 01	No. OF SHEETS 01	

Table of content		page
1	Scope of Application	2
2	Type-tested Valves	2
3	Referenced Documents	2
4	Technical Data and Design.....	2
5	Inspection certificate / Declaration of Compliance in Dependence on Fluid, Pressure and Temperature	2
6	QA-Requirements regarding the Valve Manufacturer and his Suppliers	2
7	Manufacturing and Inspection Plan (MIP)	3
8	Condition for Manufacturing.....	3
9	Fabrication and Inspection.....	3
9.1	Steel Castings	3
9.2	Rolled or Forged Material.....	3
9.3	Connecting Elements	3
9.4	Welding.....	3
9.5	Manufacturing Inspections	4
10	Marking	4
11	Surface Protection	4
12	Documentation.....	5
13	Final inspection.....	5
14	Delivery and Packing.....	5
15	Guarantee.....	6
16	Spares	6
17	Special Tools & Tackles	6
18	Supplementary Requirements.....	6
19	Deviations	6

Continued page 2 to 6

1 Scope of Application

This Technical Purchasing Specification covers valves for evacuating of bottled up pressurized steam from steam turbine unit during load throw-off. During normal operation of turbine, this valve shall remain in tightly closed position and down steam side of the valve shall be subjected to condenser vacuum. The valve is to be suitably designed to prevent the ingress of air through valve glands into the system.

The requirements of this specification are valid as far as no other requirements are given in the enquiry.

2 Type-tested Valves

Valves with a valid type-testing certificate according to PED97/23/EC and to the corresponding VdTÜV-Merkblätter, of TRD 110 attachment 1 as well as accordingly to the registration of DIN-DVGW fulfill the requirements of this specification.

For these valves the requirements for manufacturing and testing agreed upon with the TÜVs respectively with the DVGW-federation shall be fulfilled (declaration of commitment).

3 Referenced Documents

- AD2000-W 0
- AD2000-W 7
- AD2000-HP 0
- AD2000-HP 5/3
- TRD 100
- EN 287-1
- DIN EN ISO 15607
- DIN EN ISO 15609-1
- DIN EN ISO 15614-1
- EN 1418
- EN 10028
- EN 10204
- EN 10213
- EN 10222
- EN 10273
- DIN 1690-10
- EN 1559-1
- EN 1559-2
- EN 12266-1/-2
- DIN 17175,
- PED 97/23/EC

In case of differences or contradictions of the referenced documents the higher requirements shall be applied.

4 Technical Data and Design

The criteria, e.g. fluid, pressure, temperature, material of the casing, etc., as well as other technical data are given in the enquiry.

5 Inspection certificate / Declaration of Compliance in Dependence on Fluid, Pressure and Temperature

For all valves an Inspection Certification 3.1 according to EN 10204 must be provided.

6 QA-Requirements regarding the Valve Manufacturer and his Suppliers:

The valve manufacturer as well as his suppliers for the main components like e.g. pressure guiding components, instrumentation and control, shall have an introduced and well-working quality management system, e.g. according to EN ISO 9000 series or equivalent standard. Manufacturers of pressure guiding

components shall have in addition a certificate according to AD2000-W 0 respectively TRD 100.

As far as welding will be performed on the valves, the weld shop shall be certified according to AD2000-HP 0.

7 Manufacturing and Inspection Plan (MIP)

The valve manufacturer shall prepare a Manufacturing and Inspection Plan containing sufficient information on the sequence and extent of the valve inspections as well as the main raw material and shall deliver this to the purchaser for review at the latest 4 weeks after order receipt, but at least 2 weeks before starting manufacturing.

8 Condition for Manufacturing

Manufacturing of the valve mentioned in point 7 shall not be started before the review for the design as well as for the MIP has been given by the purchaser. To prohibit any delay the valve manufacturer shall call for missing reviews and remind the purchaser on time.

By reviewing the MIP the purchaser does not take on any responsibility for processes or manufacturing details of the valve manufacturer or his suppliers, or for the valve itself.

9 Fabrication and Inspection

9.1 Steel Castings

Steel castings, e.g. valve casings, covers, etc., shall be manufactured and inspected according to EN 10213 and EN 1559 part 1 and part 2 and DIN 1690 part 10, and following minimum requirements:

- Analysis (chemical composition) per heat
- Mechanical properties per heat and heat treatment batch, for castings with an individual weight > 1000 kg testing per casting
- Amount of non-destructive testing according to DIN 1690 part 10:
 - weld ends of valves without connection pieces: Quality class A with quality grades S1 + V1
 - transition areas: quality class B with quality grades S2 + V2
 - weld ends of valves with connection pieces: Quality class B with quality grades S2 + V2
- remaining areas of the casting: quality class D with quality grades S3 + V4; additionally for castings ≥ 500 kg or DN ≥ 400 mm each casting 100% volume inspection shall be performed.

9.2 Rolled or Forged Material

Rolled or forged material, e.g. connection piece, shall be manufactured and inspected according to the corresponding material standard, e.g. EN 10028, EN 10088, EN 10222, EN 10273, DIN EN 10216-2 and DIN 17440, etc. and following supplements:

- Analysis (chemical composition) per heat
- Mechanical properties per heat and heat treatment batch

9.3 Connecting Elements:

Connecting elements shall be manufactured and tested according to AD2000-W 7. As far as there is a requirement for a test certificate for grade properties, this shall be an inspection certificate 3.1 according to EN 10204.

9.4 Welding

As far as welding will be performed on the valves (also in case of fabrication welding on castings):

- Welding shall be performed only by welders tested in line with EN 287 or mechanized welds by welding operators tested in line with EN 1418
- Corresponding welding procedure specifications and procedure approval records according to
 - DIN EN ISO 15607
 - DIN EN ISO 15609-1
 - DIN EN ISO 15614-1 shall be available.
- Fabrication welds on castings shall be inspected according to DIN 1690.
- Fabrication welds having a length ≥ 150 mm or a depth $\geq 40\%$ of the wall thickness or a depth \geq

25 mm shall be recorded.

- Design welds shall be inspected according to AD2000-HP 5/3. In case of serial production manufacturer-specific inspection concepts may be applied with written agreement of the purchaser.
- If cast steel parts are subjected to heat treatment in the course of valve manufacture, all parts heated shall subsequently be subjected to a 100% surface crack examination.

9.5 Manufacturing Inspections

Manufacturing inspections shall be performed according to PED 97/23/EC / EN 12266. The PED 97/23/EC as a n superior legislation shall be observed and applied. These are especially:

- a) Pressure test
 - Test P10 according to EN 12266 part 1
- b) Leak test
 - Test P11 + P12, leakage class B according to EN 12266 part 1
- c) Functional test
 - Test F20 according to EN12266 part 2
- d) Verification of dimensions
 - Main dimensions
 - connecting dimensions

All tolerance ranges which are important for the function shall be recorded. as

 - Stem diameter
 - Diameters of guides and fits

10 Marking

Valves shall be marked as follows:

- The name and address or other means of identification of the manufacturer and, where appropriate, of his authorized representative established within the Community
- Nominal diameter
- Nominal pressure class
- Casing material
- Flow direction arrow
- Identification-no. (also commission-no.)
- The year of manufacture
- Identification of the pressure equipment according to its nature, such as type, series or batch identification and serial number
- Essential maximum/minimum allowable limits
- CE marking

Valves with a total weight > 1000 kg shall be marked additionally with a permanent information of the weight on the valve or on an safe name- plate.

The provisional KKS-Labels which are fabricated and properly sized are to be made of plastic or similar unbreakable material and attached to the component by wire. The lettering on the labels should include the KKS classification in back, permanent ink.

Marking of the materials for all pressure loaded casing components shall survive during all manufacturing processes according to AD2000-HP 0.

11 Surface Protection

Surface coating of non-stainless steel valves shall be applied as follows

<u>Paint (Coat)</u>	<u>Paint Type</u>	<u>No. of coat</u>	<u>DFT*</u>
Primer Paint	: Epoxy base Zinc rich primer paint	1 Coat	35
Intermediate Paint	: Epoxy TiO2 Pigmented Polyamide Cured Paint	1 Coat	70
Finish (Final) Paint	: Aliphatic Acrylic 2 Pack Polyurethane Finish paint	2 Coats	75

*DFT – Dry Film Thickness (final) in microns

- Shade as per RAL – Grey 9002

12 Documentation

All the documentation for the delivered valve shall remain with the valve manufacturer and shall be stored for at least 10 years. This documentation shall be labelled such as to ensure traceability and allocation to the corresponding valve and shall be marked as belonging to BHEL. The valve manufacturer shall check the documentation with respect to completeness and correctness before shipping the valve. The valve manufacturer shall certify this at the time of the delivery. It is the obligation of the valve manufacturer to hand over a copy of the total documentation to the purchaser on request and free-of-charge.

BHEL expects a documentation of the module/parts including all instructions which are necessary for service, installation and maintenance. Amendments will be requested separately.

In accordance to the Machinery Directive (98/37/EC) and Pressure Equipment Directive (97/23/EC) the following records and logs shall be provided to the purchaser in any case:

- manufactures declaration
- Declaration of conformity
- Material certificates
- Pressure test
- Non-destructive tests

The documentation - also that of the sub suppliers - shall be written in English language and shall contain at least:

- Test certificates of the prematerial (at least inspection certificate 3.1B according to EN 10204)
- Records of all inspections performed by the valve manufacturer or his sub suppliers during manufacturing:
 - Non-destructive inspections of e.g. weld areas or welds
 - Verification of dimensions
 - Pressure and leak tests
 - Functional tests
- Heat treatments performed
- The European Union guidelines and standards which are valid and can be used for the area of application (e.g. PED 97/23/EG, Low-Voltage Guideline 73/23/EWG, etc..) are to be designated in the declaration of conformity according to the remarks and applied quality modules, and shall include all relevant data (see e.g. appendix VII of Guideline 97/23/EG). Risk disclosure and danger analyses in accordance with EN 1050 are to be handed over to BHEL if necessary.
- If materials without European material approval are drawn on for the order (order papers/designs) (e.g. ANSI/ASME materials) appropriate substitute certificates from a designated authority shall be procured and documented accordingly. If the order pertains to a component of a total design group, then all certificates and certification of the component of the highest category of the total design group shall be made available.

13 Final inspection

The purchaser reserves the right to perform final inspections on his ordered parts in the shop of the valve manufacturer, as well as in the shop of his sub suppliers

14 Delivery and Packing

Details regarding delivery are given in the order, however at least following details shall be given together with the delivered parts:

Actualization of standards and instructions

- Purchaser
- Order-no. / project
- Manufacturer commission-no. / works-no.
- Specification
- Number of pieces
- Type / item
- Nominal diameter [DN]
- Maximum allowable pressure [PS]
- Maximum allowable temperature [TS]
- Fluid
- Manufacturer drawing-no.
- Identification-no. of the valve
- Piece weight

Together with the delivery of the valve the valve manufacturer shall hand over a certificate 2.1

according to EN 10204 in English, which confirms that the delivered valve fulfills the requirements given in the order and in this specification. Furthermore the valve manufacturer shall confirm that only materials as listed in the design bill of material have been used and that the documentation is available in his shop in line with Item 12 above and that he has checked the documentation carefully.

Packing of the valve shall be as follows:

- The valve shall be packed and locked that way, that in general case any damage will be prohibited.
- All openings shall be plugged.
- Detail parts respectively components shall be packed individually, however assignment shall be ensured.
- As far as necessary accessory devices for transportation purposes shall be attached to the valve and/or to the packing, e.g. lifting eyes and lifting signs.
- Bearing areas shall be marked, if necessary.

15 Guarantee

The supplier shall guarantee trouble free operation of the equipment for a period of 2 years after installation and commissioning or a period of 3 years from the date of dispatch of equipment whichever is earlier.

If during erection/commissioning and operation at site, any defect in any component is detected, purchaser's / owner's site representative shall prepare the assessment report and a copy of the same shall be forwarded to the supplier. The supplier shall replace / rectify the concerned items free of charge. The supplier, if he so desires, may depute his representative to site at his own cost otherwise the report of purchaser's / owner's site representative shall be binding on the supplier.

16 Spares

The offer of valves shall include the requirement of spares to be made available at the time of erection & commissioning. A separate offer of spares to be required for 3 to 5 years of operation shall also be separately enclosed along with main offer.

17 Special tools & tackles

Any special tools & tackles, required for erection, commissioning and maintenance of valves shall be included in main offer per set of valves.

18 Supplementary Requirements

The valve manufacturer shall send following documents in triplicate written in English language to the purchaser's department for records. Documents listed under a) and c) shall be delivered with the order acknowledgement:

- a) Part drawing showing the function of the valve and the design bill of material
- b) Operating and maintenance instruction
- c) Spare part list

19 Deviations

Any deviation from this purchasing specification has to be reported to the purchaser immediately. Any deviation is accepted only if this has been approved or accepted by the purchaser in writing. In case of any deviation from the specified properties, also if the proof by testing is not required, the purchaser has the right to reject the material.

BERUEHRUNGSLOSER INDUKTIVGEBER

Typ IFL 5-18-1125PK-1952-2

IFL 5-18-1125PK

- : Einbau im Metall
- : Einbaulage
- : Gehäuse
- : Sensortiefe
- : Anzugsmoment
- : Schockfestigkeit
- : Vibrationsfestigkeit
- : Schutzart

- : buendig
- : beliebig
- : Ms-vernickelt
- : Crastin
- : max. 4300 Ncm
- : 30g, 11 ms gem. IEC68-2-27
- : 10 Hz-55 Hz, 1 mm gem. IEC68-2-6
- : IP 67 fuer den Naeherungsschalter
- : IP 54 fuer die Steckverbindung
- : P


Schaltend nach
Elektrischer Anschluss

ueber Steckverbindung Harting HAN 7D mit 0,5mm² Goldkontakten
(Stecker gehoert zum Lieferumfang)


- Messart
- max. Schaltfrequenz
- Nennspannung
- Spannungsbereich
- Restwelligkeit
- Einschaltdauer
- Leertaststrom
- Laststrom
- Vernichtungsschutz
- Uebertast- u. Kurzschlusschutz: ja
- Nennschaltabstand
- Hysterese bei 20 Grad C
- Hysterese bei 110 Grad C
- Wiederholgenauigkeit
bei 20 Grad C
- Wiederholgenauigkeit
bei 110 Grad C
- Temperatur
- Ausgang
- Revisionslose Betriebszeit
- Lieferant

- : induktiv
- : 500 Hz
- : 24 VDC
- : 10-60 VDC
- : -10 %
- : 100 %
- : 4-8 mA
- : -100mA
- : ja
- : 5 mm
- : -0,5 mm (seitliches Anfahren bei 1,5mm Abstand)
- : -1,0 mm (seitliches Anfahren bei 1,5mm Abstand)
- : -0,10 mm (seitliches Anfahren bei 1,5mm Abstand)
- : -0,25 mm (seitliches Anfahren bei 1,5mm Abstand)
- : -25 Grad C bis 110 Grad C
- : Wechsler
- : min. 24.000 h
- : K. A. Schmersal & Co
- : Hoeddinghofe 30
- : 5600 Wuppertal 2


Geräteschlüssel: LGBAD
INSTRUMENTATION KEY:

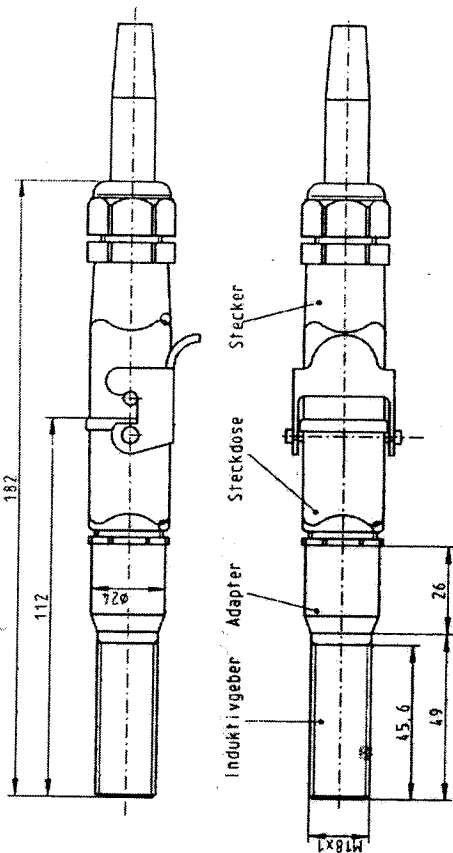

Schaltkurve

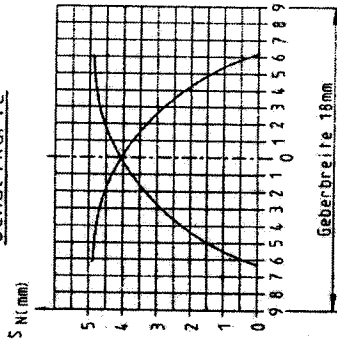

ANSCHLUSSBILD



NOTE: 1) Active proximity switch, for taking these wires for termination in J&B, NC Contact not used, Refer, Sh. 4.

2) FAIL SAFE CONDITION — DE-ENERGISED TO OPEN

TITLE : PROXIMITY SWITCH

BHART HEAVY ELECTRICAL LTD
HARIDWAR, RANIPUR, INDIA-249403

Drawing No. 41810221002 Sh 1

STGRAPH

PROXIMITY SWITCH FOR HPT EVACUATION

Translated version Doc. No. 41810221002

TYP IFL S-18-11zStPK-1952-2


MOUNTING IN METAL:	to be flush in metal
Mounting position:	Any position
Casing:	Ms. Nickel plated
Sensor surface	Crastin
Stud torque	Max 1300 Ncm
Shock reaction	30 gm, 11ms gem. IEC 68-2-27
Resistance to vibration	10Hz 55 Hz, 1mm.
Protection	IP67 for proximity probe
Protection	IP 54 for plug connector
Switching to	.P
Electrical connection	4 wire with Harting HAN 7D plug socket, with 0.5 mm ² gold contact
Mode of measurement	Inductive
Max switching frequency	500Hz
Voltage supply	24V
Supply range	10-6 VDC
Residual ripple	≤ 10%
Running time	100%
Stand by current	≤ 4.8 mA
Running current	≤ 100mA
Non reversible	Yes
Overvoltage protection (short ckt. proof):	Yes
Operating distance	5 mm
Switching hysteresis at 20 Deg	≤ 0.5mm (1.5 mm distance)
Switching hysteresis at 110 Deg	≤ 1.0mm (1.5 mm distance)
Repeat accuracy at 20 Deg	≤ 1.0mm (1.5 mm distance)
Repeat accuracy at 110 Deg	≤ .25mm (1.5 mm distance)
Temp sensor	-25°C to to 110 °C
Output	1 changeover contact with snap action
Inspection time	min 24000 hr
Manufacturer	KA Schemersal & Co Moeddinghofe & co 5600 Wupertal 2

TEST & INSPECTION

- 1.0 Type Test
 - 1.1.0: Degree of protection
- 2.0 Routine Test
 - 2.1.1: Functional and calibration test for limit switch
 - 2.1.2 Fail safe position of actuator
 - 2.1.3 Fully assembly i.e. the valve along with Pneumatic actuator shall be
- 3.0 Tested for proper function.
 - 3.1.0 Test and Guarantee Certificate Results of all tests enumerated in above shall be compiled in test certificate and to be submitted.
- 4.0 Vendor shall provide our inspector or authorized representative all facilities to witness the tests.

LBC41GF051:- X01

1	0	LBC41CG051C
2	0	LBC41CG051C
3	0	LBC41CG051C
4	0	LBC41CG051B
5	0	LBC41CG051B
6	0	LBC41CG051B
7	0	LBC41AA051A
8	0	LBC41AA051A
9	0	LBC41AA051B
10	0	LBC41AA051B
SH	0	SHIELD
SH	0	SHIELD
PE	0	GROUND
PE	0	GROUND

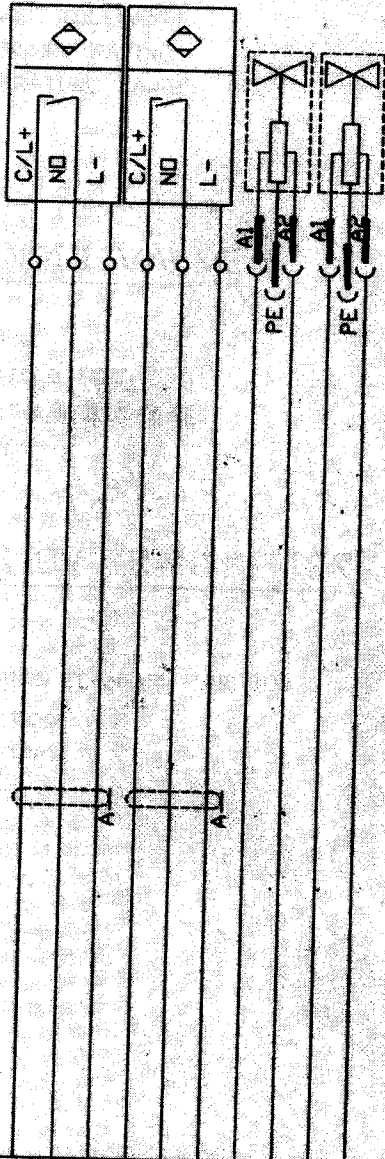

ASSIGNMENT OF CORE CONDUCTOR COLOURS (DINIEC 757)

- BK: BLACK
- BN: BROWN
- BU: BLUE
- GY: GREEN
- GR: GREY
- OR: ORANGE
- PK: PINK
- PU: PURPLE
- RD: RED
- WH: WHITE
- YE: YELLOW

- THE JUNCTION BOX AND THE JUNCTION BOX COVER HAS TO BE LABELLED WITH 'LBC41GF051'
- SHIELD (A), IF AVAILABLE, CONNECTED TO SHIELD TERMINALS (SH)
- GROUND (PE) CONNECTED TO GROUND TERMINALS

REV	REMARKS	TITLE: CONNECTION DIAGRAM HP DUMP VALVE LBC41		SH. NO. 4
		DRAWING NO. 41810221002		BY: /
		BHARAT HEAVY ELECTRICALS LIMITED HARIDWAR		

GENERAL REQUIREMENTS:

VOLTAGE:	24 V DC
VOLTAGE TOLERANCE:	min. +10/-15%
ENCLOSURE RATING:	min. IP65/ NEMA 4
TEMPERATURE RANGE:	+ 5°C TO 70°C (+41°F TO 158°F)

SOLENOID VALVE:

Relative	100%
ENERGIZED TIME:	CONSTANT RATED
COIL ISOLATION CLASS	F
Connection:	plug acc. TO DIN EN 175301-803

POSITION TRANSMITTER:

TYPE:	INDUCTIVE
SWITCHING ELEMENT FUNCTION	PNP NORMAL OPEN
Connection:	3-POLE
Connection:	plug acc. TO DIN EN 175301-803
SHIELD:	NOTREQUIRED BUT WIRED IF AVAILABLE

TITLE: ELECTR. SPEC. SOLENOID/GENERAL
/24DC/INDOOR



BHARAT HEAVY ELECTRICALS LTD
HARIDWAR, RANIPUR, INDIA-249403


DRAWING NO. 41810221002

SH. NO.

5

10 LBC41 AA051

RELATED DRAWINGS:

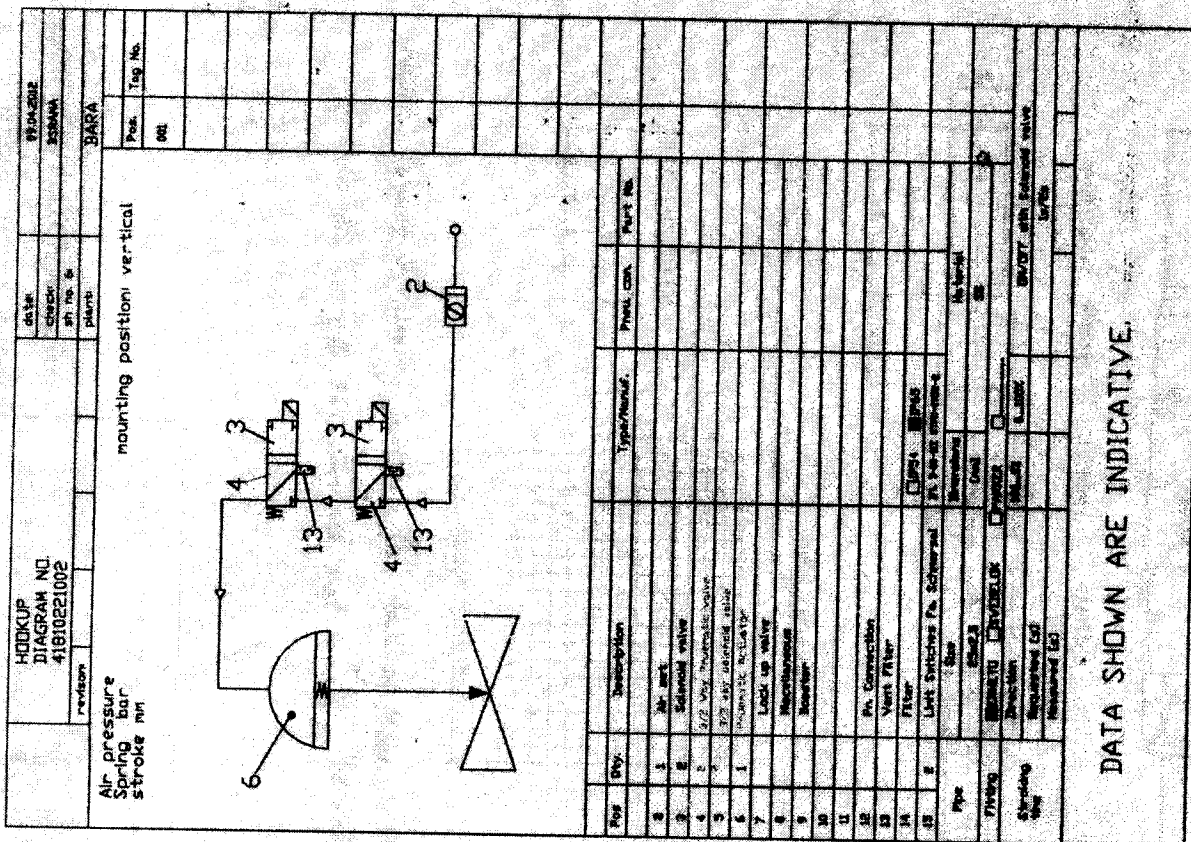

HOOKUP DIAGRAM NO 41810221002		date checked BY No. & plant	TRUCKS 333AAA
revision			BARA
Air pressure Spring bar stroke meter		mounting position vertical	Pos. Tag No. 001


Fig. No.	Description	Type/Manufacturer	Part No.	Part No.
1	Air inlet			
2	Stroke meter			
3	Pressure valve			
4	1/2" NPT. Pneumatic valve			
5	3/8" NPT. Lock up valve			
6	Spring bar			
7	Lock up valve			
8	Microswitch			
9				
10				
11				
12	Pin Connection			
13	Vent Filter			
14	Filter			
15	Lock Discharge Pin Switch			
16	Bar			
17	Stroke meter			
18	Stroke meter			
19	Stroke meter			
20	Stroke meter			
21	Stroke meter			
22	Stroke meter			
23	Stroke meter			
24	Stroke meter			
25	Stroke meter			
26	Stroke meter			
27	Stroke meter			
28	Stroke meter			
29	Stroke meter			
30	Stroke meter			
31	Stroke meter			
32	Stroke meter			
33	Stroke meter			
34	Stroke meter			
35	Stroke meter			
36	Stroke meter			
37	Stroke meter			
38	Stroke meter			
39	Stroke meter			
40	Stroke meter			
41	Stroke meter			
42	Stroke meter			
43	Stroke meter			
44	Stroke meter			
45	Stroke meter			
46	Stroke meter			
47	Stroke meter			
48	Stroke meter			
49	Stroke meter			
50	Stroke meter			
51	Stroke meter			
52	Stroke meter			
53	Stroke meter			
54	Stroke meter			
55	Stroke meter			
56	Stroke meter			
57	Stroke meter			
58	Stroke meter			
59	Stroke meter			
60	Stroke meter			
61	Stroke meter			
62	Stroke meter			
63	Stroke meter			
64	Stroke meter			
65	Stroke meter			
66	Stroke meter			
67	Stroke meter			
68	Stroke meter			
69	Stroke meter			
70	Stroke meter			
71	Stroke meter			
72	Stroke meter			
73	Stroke meter			
74	Stroke meter			
75	Stroke meter			
76	Stroke meter			
77	Stroke meter			
78	Stroke meter			
79	Stroke meter			
80	Stroke meter			
81	Stroke meter			
82	Stroke meter			
83	Stroke meter			
84	Stroke meter			
85	Stroke meter			
86	Stroke meter			
87	Stroke meter			
88	Stroke meter			
89	Stroke meter			
90	Stroke meter			
91	Stroke meter			
92	Stroke meter			
93	Stroke meter			
94	Stroke meter			
95	Stroke meter			
96	Stroke meter			
97	Stroke meter			
98	Stroke meter			
99	Stroke meter			
100	Stroke meter			

DATA SHOWN ARE INDICATIVE.

MANUFACTURER'S NAME AND ADDRESS		STANDARD QUALITY PLAN				TO BE FILLED BY BHEL				TO BE FILLED BY BHEL											
VENDOR'S NAME BHEL		ITEM		HP RELIEF VALVE		QP NO.		QA BI OP_116													
		DRG. NO.		AS PER PO		DATED		10/02/13													
		SPEC.		AS PER PO		REV		00													
COMPONENT & OPERATIONS		CHARACTERISTICS		CLASS		TYPE OF CHECK		QUANTUM OF CHECK		REFERENCE DOCUMENT		ACCEPTANCE NORMS		FORMAT OF RECORDS		AGENCY		REMARKS			
2		3		4		5		6		7		8		9		M		B		N	
1		3		4		5		6		7		8		9		10		11			

1.0- RAW MATERIALS & BOUGHT OUT ITEMS												
Sl. No.	Item Description	Physical & Chemical Properties	Class	Type of Check	Quantum of Check	Reference Document	Acceptance Norms	Format of Records	Agency	Remarks		
1.1	Body and Bonnet	Physical & Chemical Properties	MA	Physical & Chemical Examinations	One per Heat	BHEL, Approved Data Sheet	BHEL, Approved Data Sheet	Test Certificate	V	P		
1.2		Heat Treatment	MA	Verification	One per Heat	BHEL, Approved Data Sheet	BHEL, Approved Data Sheet	Test Certificate	V	P		
1.3		Visual Examination	MA	Visual Examination	100%	BHEL, Approved Data Sheet	BHEL, Approved Data Sheet	Test Certificate	V	P		
1.4		Internal Soundness	CR	Radiograph Test	100% on CA	ASME Sec V	ASME B 1634 Appendix I	Test Certificate	V	P		
1.5		Sub surface inspection	CR	Magnetic particle test	100% on Access Area	ASME Sec V	ASME B 1634 Appendix II	Test Certificate	V	P		
1.6	Trim (Plug Seat Ring & Stem)	Physical & Chemical Properties	MA	Physical & Chemical Examinations	One per Heat	BHEL, Approved Data Sheet	BHEL, Approved Data Sheet	Test Certificate	V	P		
1.7	Prosser Resisting Fasteners	Physical & Chemical Properties	MA	Physical & Chemical Examinations	One per Heat	BHEL, Approved Data Sheet	BHEL, Approved Data Sheet	Test Certificate	V	P		
1.8	Accessories	Visual	MA	Visual/Model Verification	100%	BHEL, Approved Data Sheet	BHEL, Approved Data Sheet	Compliance Certificate	V	P		

2.0- IN PROCESS INSPECTION												
Sl. No.	Item Description	Physical & Chemical Properties	Class	Type of Check	Quantum of Check	Reference Document	Acceptance Norms	Format of Records	Agency	Remarks		
2.1	Body, Bonnet, Plug, Seat Rings after machining	Dimensional Check	MA	Measurement	100%	BHEL, Approved Data Sheet/Drawing	BHEL, Approved Data Sheet/Drawing	IR	V	P		
2.2	Body & Bonnet	Pressure Resistance	CR	Hydro Test	100%	ASME B 1634/ BHEL, Approved Data Sheet	No Leak	IR	V	P		
2.3	Plug & Seat Contact	Blue match	MA	Plug & Seat Contact	100%	BHEL, Approved Data Sheet	Full line contact	IR	V	P		

MANUFACTURER/SUBCONTRACTOR		FOR CUSTOMER USE		APPROVED BY	
				 संजीव कुमार भारद्वाज Sanjeev Kumar Bhardwaj अधिकारी/Engineer	
LEGEND: I RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION. M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: CUSTOMER INDICATE 'W' PERFORM 'W' WITNESS AND 'V' VERIFICATION ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER					

गुणता आश्वासन/Quality Assurance
 बी. एच. ई. एल., हरिकार/BHEL Harikar

TO BE FILLED BY BHEL

TO BE FILLED BY BHEL

STANDARD QUALITY PLAN

MANUFACTURER'S NAME AND ADDRESS

BHEL	VENDOR'S NAME		ITEM	HP RELIEF VALVE	QP NO.	QA BI QP 116
	DRG. NO.	AS PER PO	DATED			10/02/13
	SPEC.	AS PER PO				
	REV	00				

SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS			REMARKS
								M	B	N	
1	2	3	4	5	6	7	8	9	D	10	11

Page 2 of 2

3.0- FINAL INSPECTION & TESTING

3.1	Hydro Test	CR	Hydro Test	100%	BHEL, Approved Data Sheet/Drawing	BHEL, Approved Data Sheet/Drawing	Test Certificate	✓	P	W	
3.2	Seat Leak Test	CR	Leak Test	100%	BHEL, Approved Data Sheet/Drawing	BHEL, Approved Data Sheet/Drawing	Test Certificate	✓	P	W	
3.3	Performance Test on Assembled valve fitted with Accessories	CR	Calibration (hysteresis, Travel, stroke, stroking time)	100%	BHEL, Approved Data Sheet	BHEL, Approved Data Sheet	Test Certificate	✓	P	W	
3.4	Packing Tightness	CR	Packing Leak Test	100%	BHEL, Approved Data Sheet	BHEL, Approved Data Sheet	Test Certificate	✓	P	W	
3.5	Control Valve Flow Capacity	CR	Capacity Test	One / Type	BHEL Approved Date Sheet/ISA 75.02	BHEL, Approved Full Capacity	Test Certificate	✓	P	V	
3.6	Model Verification of Actuator and positioner	MA	Visual	100%	BHEL Approved Date Sheet	BHEL, Approved Data Sheet	Test Certificate	✓	P	W	

4.0 PAINTING, PRESERVATION & PACKING

4.1	Final Inspection	MA	Dimension & Visual	100%	App GA Drawing	App GA Drawing	Test Certificate	-	P	W	
4.2	Painting	MA	Paint finish color shade	100%	Purchase Specification	Purchase Specification	-	-	P	V	
4.3	Assembled Valve Completeness	MA	Marking/Name Plate & Tagging	100%	BHEL, Approved Data Sheet	BHEL, Approved Data Sheet	-	-	P	W	
4.4	Packing	MA	Packing List, Safety	100%	Customer Spec	Customer Spec	-	✓	P	V	

MANUFACTURER/SUBCONTRACTOR

LEGEND:
 1) RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION.
 M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY
 N: CUSTOMER
 INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION
 ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER

FOR CUSTOMER USE

APPROVED BY: **Sanjeev**
 13/01/2015
संजीव कुमार भारद्वाज
 Sanjeev Kumar Bhardwaj
 अभियंता/Engineer
 गुणता आश्वासन/Quality Assurance
 बी. एच. ई. एल., हरिद्वार/BHEL Haridwar