

*28/04/2015*  
*Abhishek*

*28 April 2015*  
*Abhishek*

*28/04/15*  
*Abhishek*


- v) BEM registered vendors are also required to submit the credentials to meet the PQR. English translation shall also be submitted.
- iv) In case documents submitted for meeting PQR are in language other than English, notarized qualifying requirements having technical valid collaboration/licensing agreement.
- iii) Vendor may also qualify based on the credential of principal meeting package specific pre- in business. (10) years old as on date of application for registration/bid submission, for establishing continuity
- ii) Minimum two (2) nos. Purchase orders shall be submitted which should not be more than ten the same is not mentioned in performance certificate/purchase order.
- i) Vendor shall submit design documents to substantiate technical parameters specified in PQR, if Supplier to submit the following major documents:
  - iii) Minimum three purchase orders (placed with minimum gap of one(1) year from previous purchase order) from same purchaser meeting the minimum pre-qualifying requirement

OR

- ii) Minimum one second/repeat purchase order (placed with a minimum gap of one (1) year after commissioning of first order) from same purchaser meeting the minimum pre-qualifying requirement.

OR

- i) Copy of minimum one (1) performance certificate in English from end user along with copy of related Purchase Order specifying that the product is running successfully for one (1) year from date of commissioning.
- C) Air conditioning system should have been successfully in use for at least one year in power plant or other industries e.g. refinery/steel/process/commercial etc. For this the supplier has to submit either of following supporting documents meeting below mentioned conditions.
- B) Minimum capacity of single installed machine (Screw/ VAM) shall be 100 TR. (outsourced).
- A) Supplier should have designing/manufacturing capability and having testing facility (in house or


		POWER SECTOR-PEM NOIDA TECHNICAL PRE-QUALIFICATION REQUIREMENTS FOR OPEN/GLOBAL TENDERS To be read in conjunction with PEM general PQR Air Conditioning System
PACKAGE: AIR CONDITIONING SYSTEM		
DEPARTMENT : MECHANICAL		
AUXILIARY		
REVISION : 00		
DATE : 09-04-2015	PAGE : 1 of 2	

PRE-QUALIFICATION REQUIREMENTS


28/04/15  
*[Signature]*

28 April 2015  
*[Signature]*

28/04/2015  
*[Signature]*

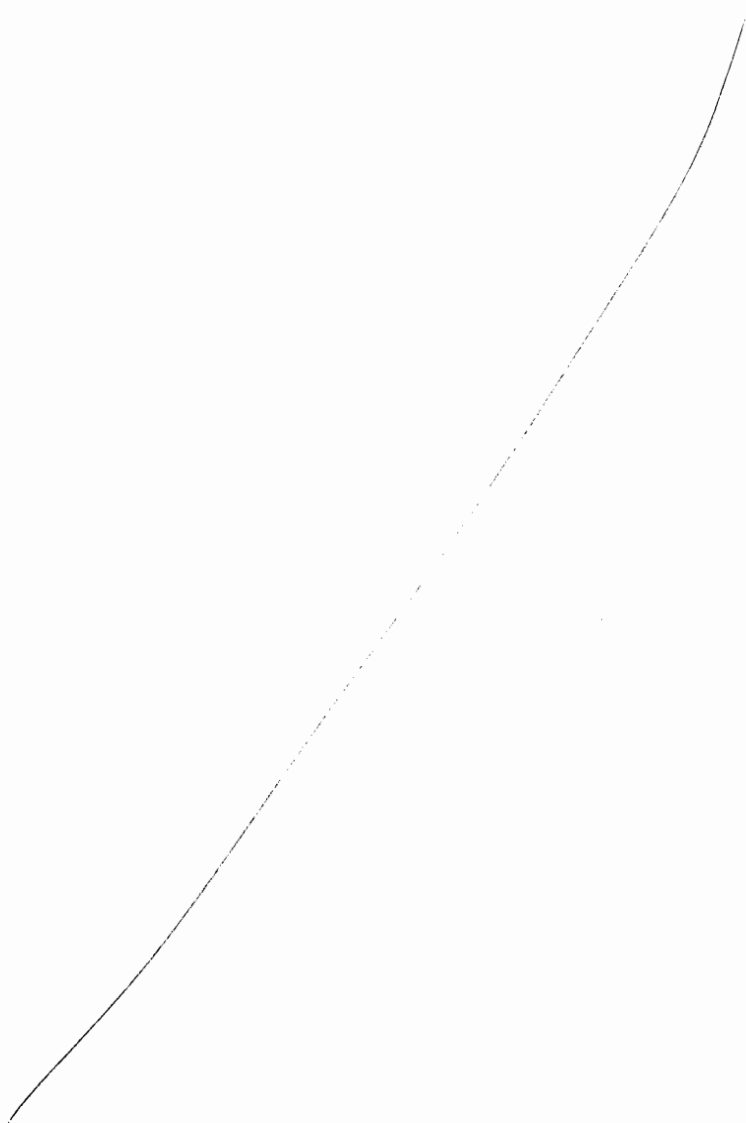

- vi) Notwithstanding anything stated above, BHEL reserves the right to assess the capabilities and capacity of the bidder/collaborators to perform the contract, as per BHEL evaluation procedure, should the circumstances warrant such assessment in the overall interest of BHEL.
- vii) Final acceptance of bidder is subject to End Customer's approval.

		<b>POWER SECTOR-PEM NOIDA</b> <b>TECHNICAL PRE-QUALIFICATION REQUIREMENTS</b> <b>FOR OPEN/GLOBAL TENDERS</b> To be read in conjunction with PEM general PQR Air Conditioning System	
PACKAGE: AIR CONDITIONING SYSTEM	DEPARTMENT : MECHANICAL	AUXILIARY	REVISION : 00
DATE : 09-04-2015	PAGE : 2 of 2		

**PRE-QUALIFICATION REQUIREMENTS**