


DRIVE CONTROL PHILOSOPHY

DCS INTERFACE FOR BIDIRECTIONAL DRIVE(WITH INTEGRAL STARTER)

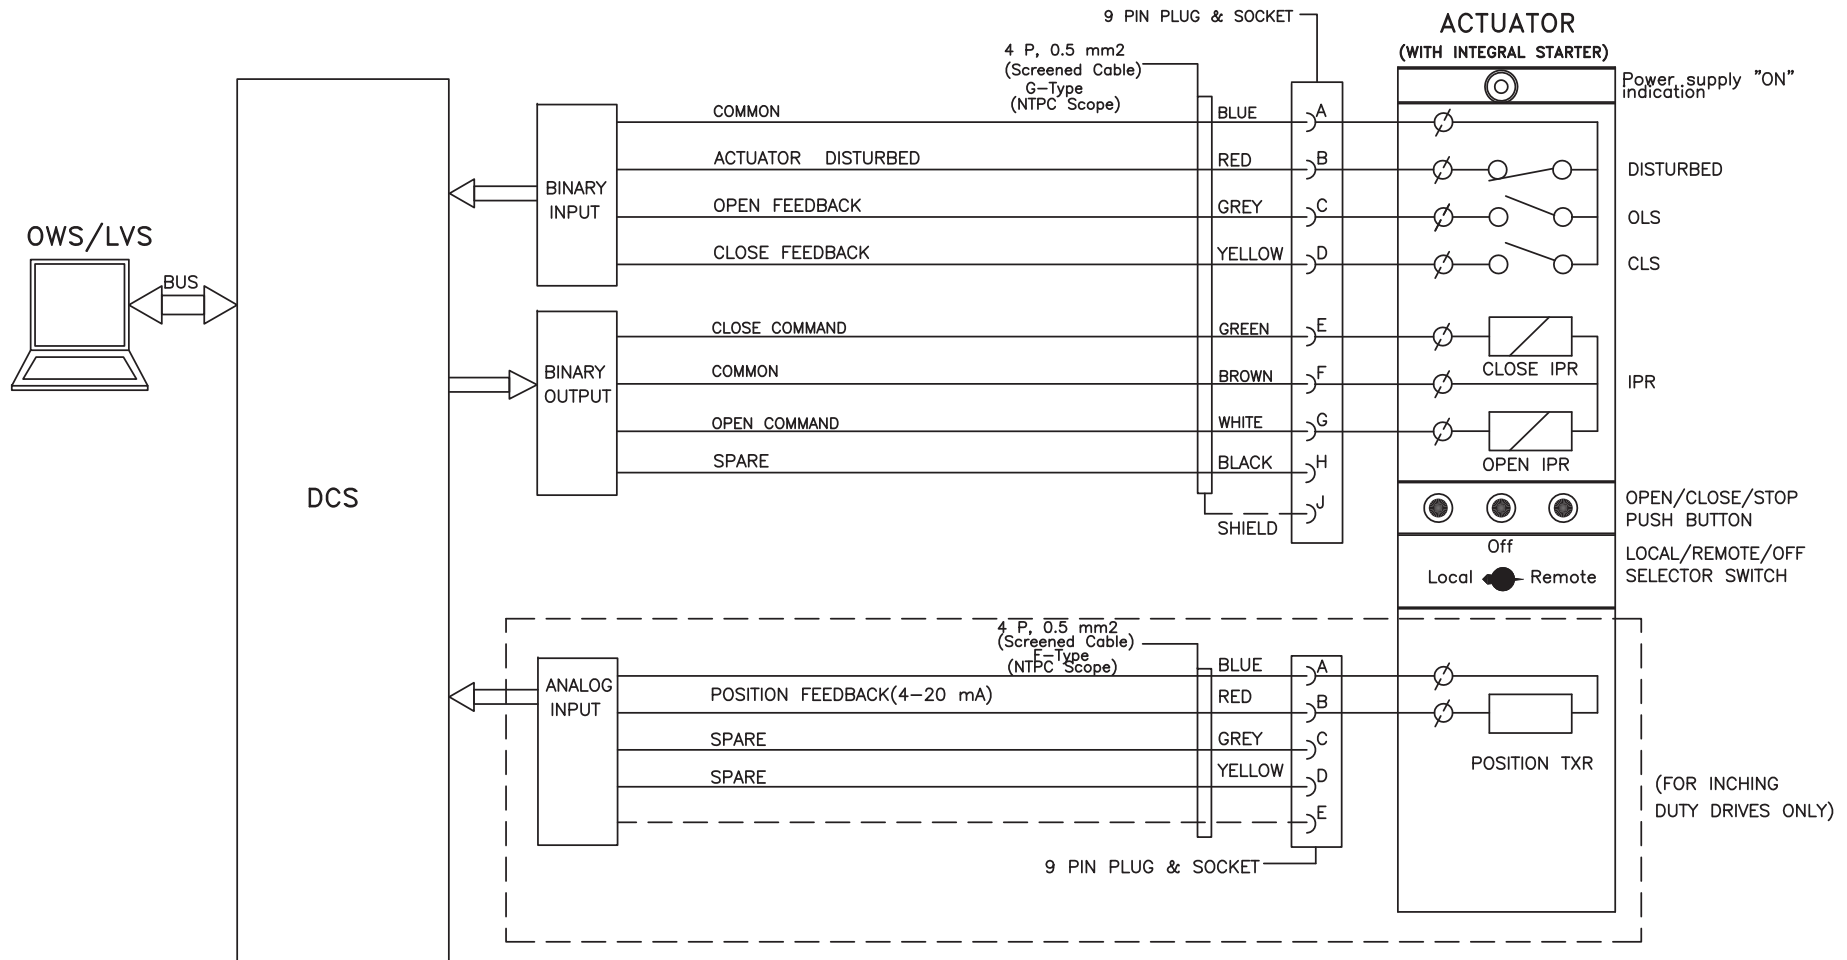


NOTE:


- DISTURBED=** Loss of Power supply (1 Phase/3 Phase),
Loss of control supply, Motor thermostat trip,
Thermal over load relay trip,
Local/Off/Remote Sel. switch in local or off mode.
Stop PB optd.




NTPC LIMITED		DRG.NO.	PE-DM-401-145-1002	
FEROZ GANDHI UNCHAHAR THERMAL POWER PLANT(1 X 500 MW)		DATE	05.03.2014	
TITLE	DCS INTERFACE FOR BIDIRECTIONAL DRIVE		REV.NO.	00
SHT	7	OF	13	

DCS INTERFACE FOR UNIDIRECTIONAL LT DRIVE (CONTACTOR CONTROLLED)

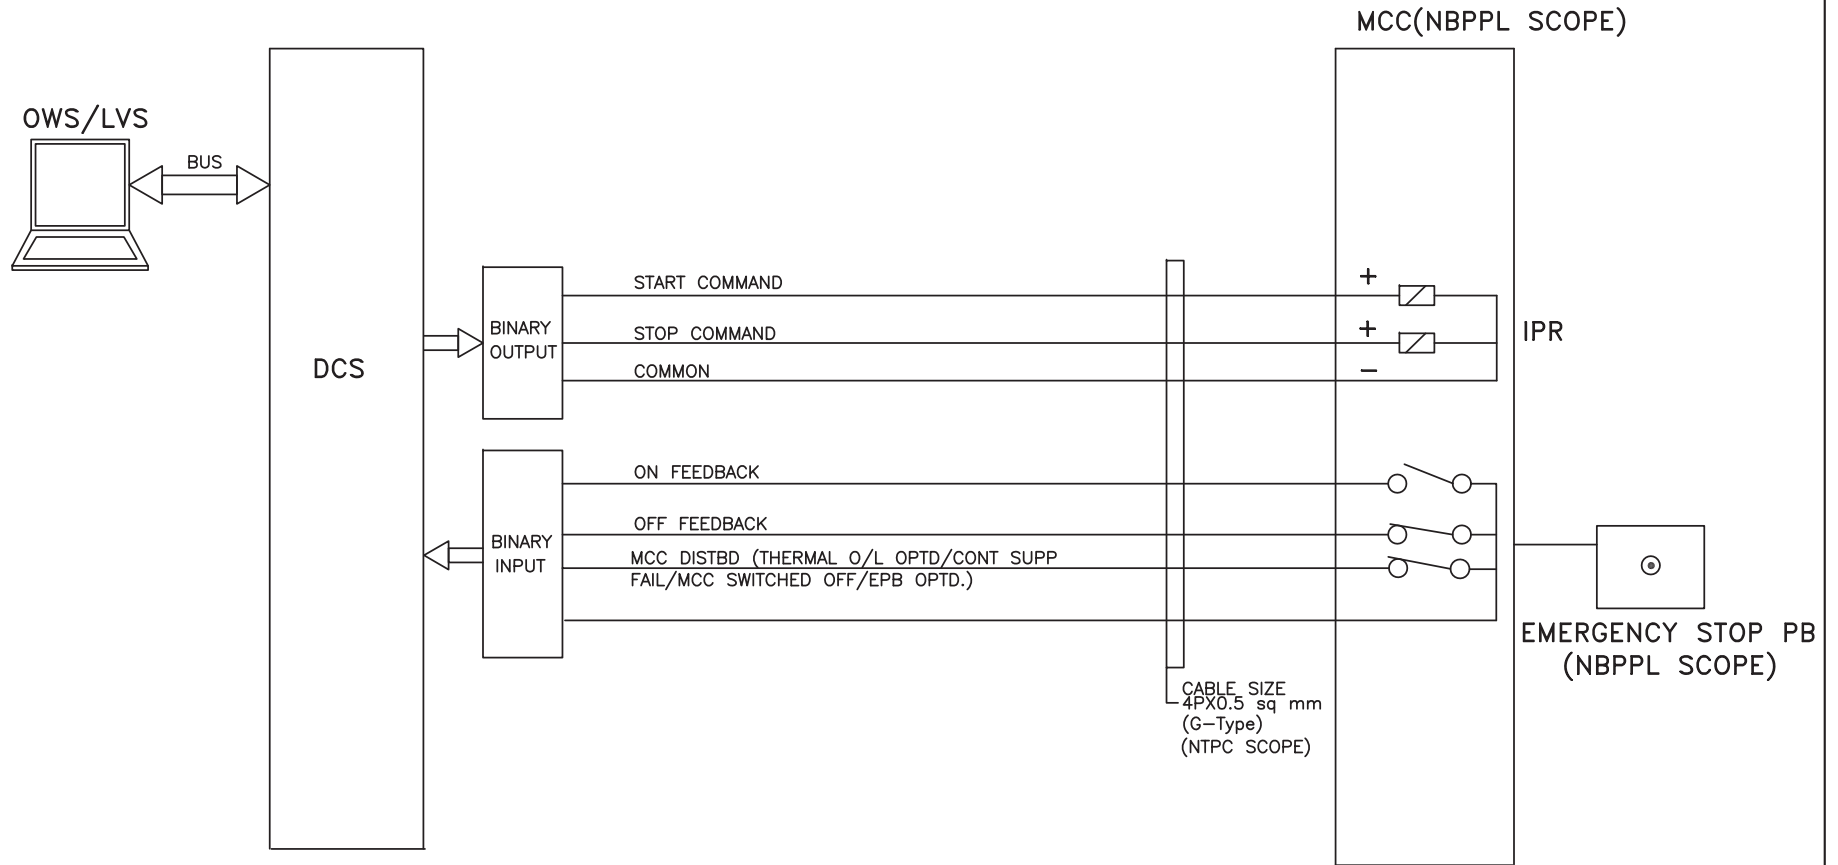

	NTPC LIMITED	DRG.NO.	PE-DM-401-145-I002	
	FEROZ GANDHI UNCHAHAR THERMAL POWER PLANT(1 X 500 MW)	DATE	05.03.2014	
	TITLE	REV.NO.	00	
	DCS INTERFACE FOR UNIDIRECTIONAL LT DRIVE	SHT	8	OF 13

DCS INTERFACE FOR SOLENOID DRIVE (24V DC/240V AC)

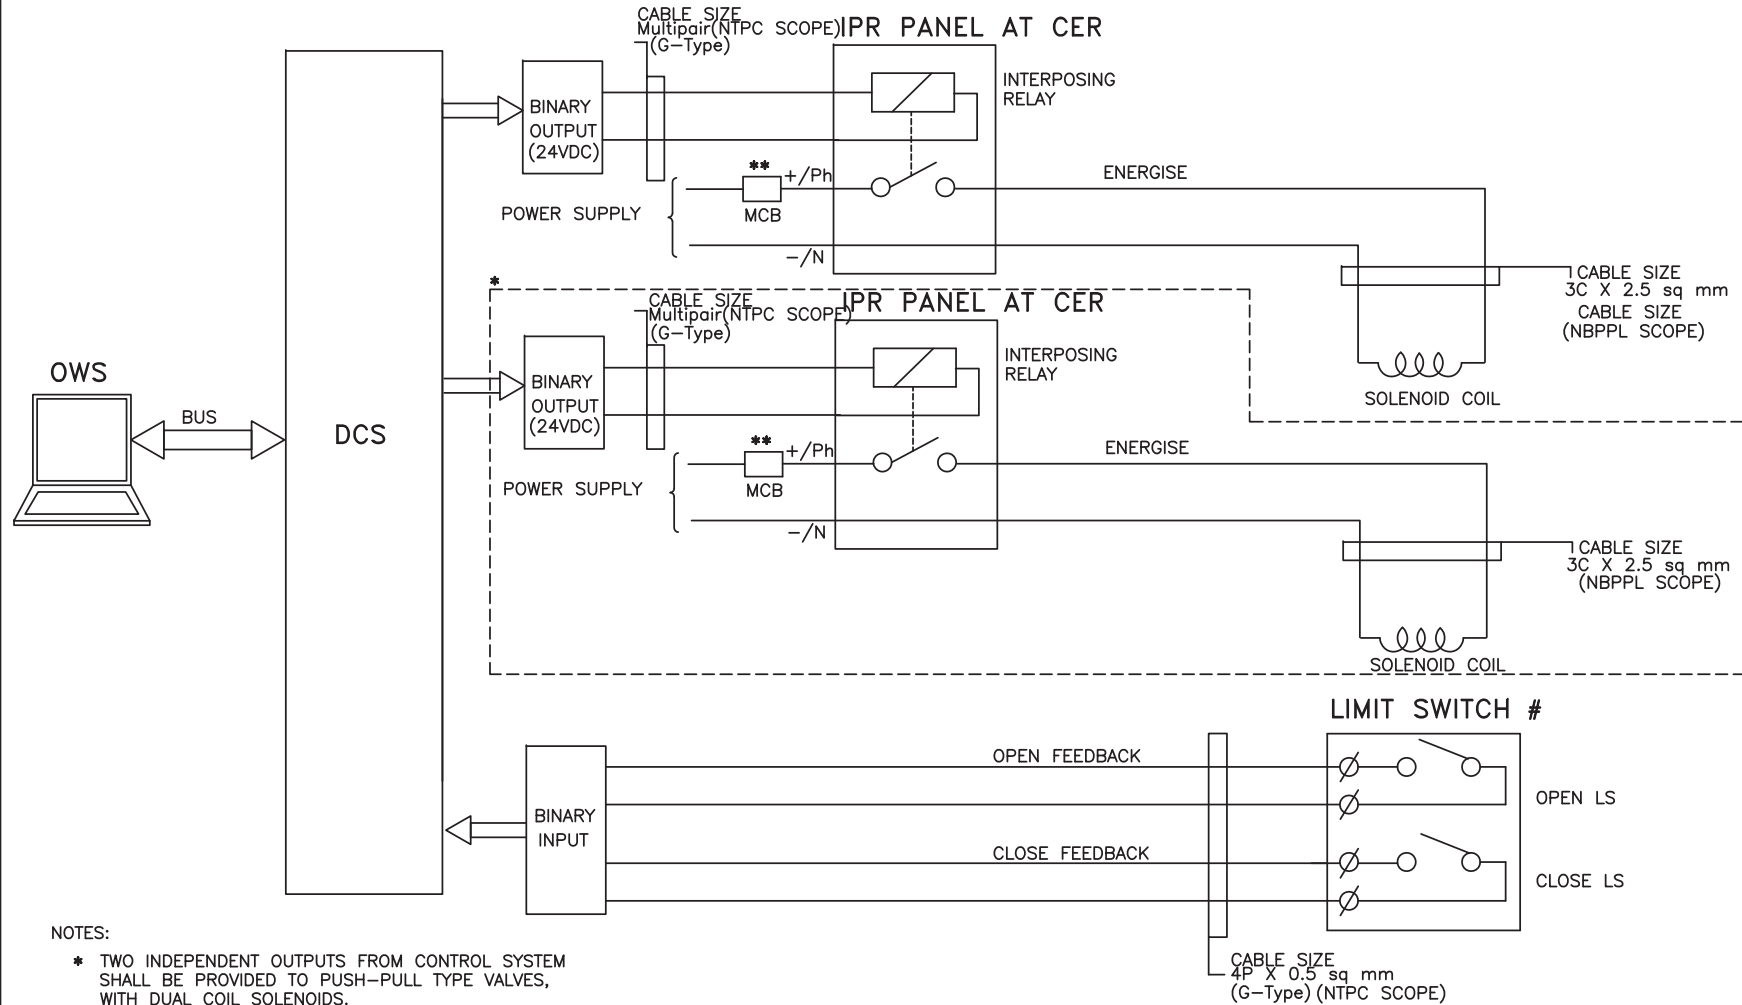

NOTES:

- * TWO INDEPENDENT OUTPUTS FROM CONTROL SYSTEM SHALL BE PROVIDED TO PUSH-PULL TYPE VALVES, WITH DUAL COIL SOLENOIDS.
- ** MCB SHALL BE PROVIDED FOR EACH SOLENOID
- # FOR ON/OFF TYPE, SOLENOID ACTUATED CONTROL VALVE.



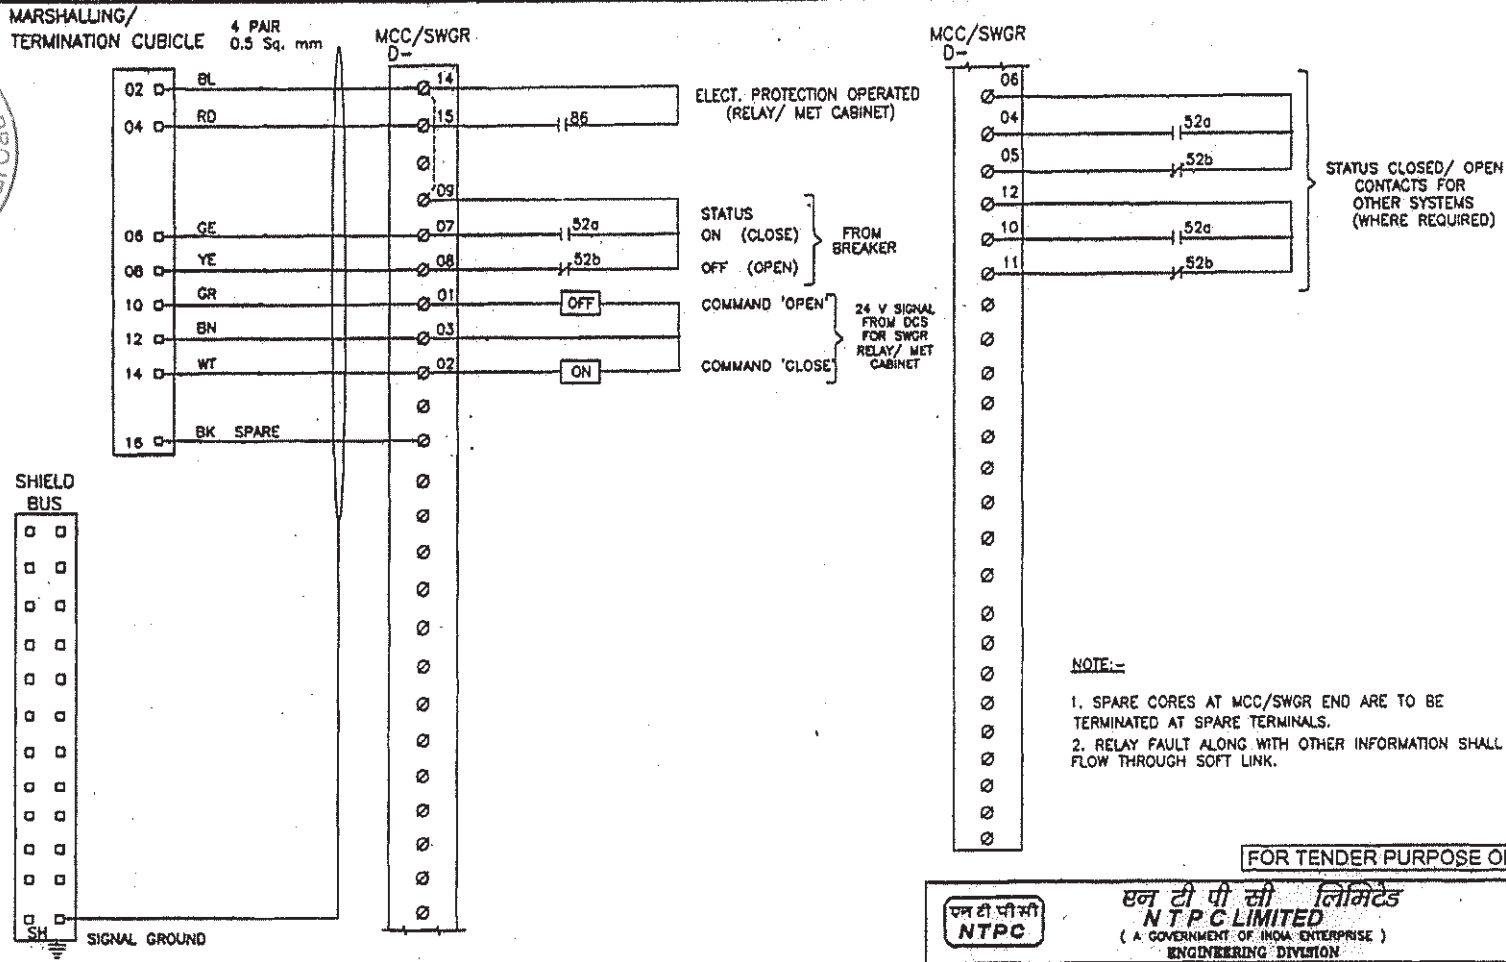
	NTPC LIMITED	DRG.NO.	PE-DM-401-145-I002	
	FEROZ GANDHI UNCHAHAR THERMAL POWER PLANT(1 X 500 MW)		DATE	05.03.2014
	TITLE DCS INTERFACE FOR SOLENOID DRIVE		REV.NO.	00
			SHT	9 OF 13

DIAGRAM OF INTERFACING WITH FIELD INSTRUMENTS



This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.



- NOTE:-**
1. SPARE CORES AT MCC/SWGR END ARE TO BE TERMINATED AT SPARE TERMINALS.
 2. RELAY FAULT ALONG WITH OTHER INFORMATION SHALL FLOW THROUGH SOFT LINK.


FOR TENDER PURPOSE ONLY

 एन टी पी सी लिमिटेड NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION			
PROJECT		TYPICAL THERMAL POWER PROJECT	
TITLE		INTERFACING OF FIELD INSTRUMENTS INTERFACE OF DDCMIS WITH MCC/SWGR/ACTUATOR (Elect. Bkr. - Non. Sync.-LT)	
REV. NO.	DESCRIPTION	DRWN	DESIGN
B	Revised for Numerical Relay based SWGR.		
REV. NO.	DESCRIPTION	CHKD.	DATE
			14.02.08
SIZE	SCALE	DRG. NO.	REV. NO.
A3	NTS	0000-405-POI-A-065	B
Cleared by			SH 12 OF 14


09974


08577

TYPE TEST REQUIREMENTS

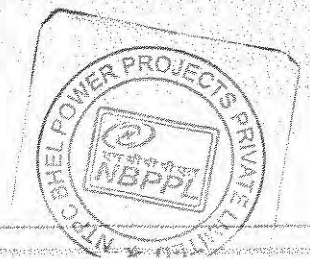



08578

CLAUSE NO.	TECHNICAL REQUIREMENTS		
1.00.00	TYPE TEST REQUIREMENTS		
1.01.00	General Requirements		
1.01.01	<p>The Contractor shall furnish the type test reports of all type tests as per relevant standards and codes as well as other specific tests indicated in this specification. If the bidder proposes a different standard/code from that indicated at table 3.00.00, same is acceptable provided the equivalence of the proposed standard is established by the bidder. A list of such tests are given for various equipment in table titled 'TYPE TEST REQUIREMENT FOR C&I SYSTEMS' at the end of this chapter and under the item Special Requirement for Solid State Equipments/Systems. For the balance equipment instrument, type tests may be conducted as per manufactures standard or if required by relevant standard.</p> <p>(a) Out of the tests listed, the Bidder/ sub-vendor/ manufacturer is required to conduct certain type tests specifically for this contract (and witnessed by Employer or his authorized representative) even if the same had been conducted earlier, as clearly indicated subsequently against such tests.</p> <p>(b) For the rest, submission of type test results and certificate shall be acceptable provided.</p> <ol style="list-style-type: none"> i. The same has been carried out by the Bidder/ sub-vendor on exactly the same model /rating of equipment. ii. There has been no change in the components from the offered equipment & tested equipment. iii. The test has been carried out as per the latest standards alongwith amendments as on the date of Bid opening. <p>(c) In case the approved equipment is different from the one on which the type test had been conducted earlier or any of the above grounds, then the tests have to be repeated and the cost of such tests shall be borne by the Bidder/ sub-vendor within the quoted price and no extra cost will be payable by the Employer on this account.</p>		
1.01.02	As mentioned against certain items, the test certificates for some of the items shall be reviewed and approved by the main Bidder or his authorized representative and the balance have to be approved by the Employer.		
1.01.03	The schedule of conduction of type tests/ submission of reports shall be submitted and finalized during pre-award discussion.		
1.01.04	For the type tests to be conducted, Contractor shall submit detailed test procedure for approval by Employer. This shall clearly specify test setup, instruments to be used, procedure, acceptance norms (wherever applicable), recording of different		
<p>SINGRAULI STPP STAGE-III (1X500 MW) EPC PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION - VI PART-B</p>	<p>SUB-SECTION-C-07 TYPE TEST REQUIREMENTS</p>	<p>PAGE 1 OF 10</p>





08579

CLAUSE NO.	TECHNICAL REQUIREMENTS			
1.01.05	<p>parameters, interval of recording precautions to be taken etc. for the tests to be carried out.</p> <p>The Bidder shall indicate in the relevant BPS schedule, the cost of the type test for each item only for which type tests are to be conducted specifically for this project. The cost shall only be payable after conduction of the respective type test in presence of authorize representative of Employer. If a test is waived off, then the cost shall not be payable.</p>			
2.00.00	<p>SPECIAL REQUIREMENT FOR SOLID STATE EQUIPMENTS/ SYSTEMS</p>			
2.01.00	<p>The minimum type test reports, over and above the requirements of above clause, which are to be submitted for each of the major C&I systems shall be as indicated below:</p> <ul style="list-style-type: none"> i) Surge Withstand Capability (SWC) for Solid State Equipments/ Systems <p>All solid state systems/ equipments shall be able to withstand the electrical noise and surges as encountered in actual service conditions and inherent in a power plant. All the solid state systems/ equipments shall be provided with all required protections that needs the surge withstand capability as defined in ANSI 37.90.1/ IEEE-472. Hence, all front end cards which receive external signals like Analog input & output modules, Binary input & output modules etc. including power supply, data highway, data links shall be provided with protections that meets the surge withstand capability as defined in ANSI 37.90.1/ IEEE-472. Complete details of the features incorporated in electronics systems to meet this requirement, the relevant tests carried out, the test certificates etc. shall be submitted along with the proposal. As an alternative to above, suitable class of EN 61000-4-12 which is equivalent to ANSI 37.90.1/ IEEE-472 may also be adopted for SWC test.</p> <ul style="list-style-type: none"> ii) Dry Heat test as per IEC-68-2-2 or equivalent. iii) Damp Heat test as per IEC-68-2-3 or equivalent. iv) Vibration test as per IEC-68-2-6 or equivalent. v) Electrostatic discharge tests as per EN 61000-4-2 or equivalent. vi) Radio frequency immunity test as per EN 61000-4-6 or equivalent. vii) Electromagnetic Field immunity as per EN 61000-4-3 or equivalent. <p>Test listed at item no. v, vi, vii, above are applicable for electronic cards only as defined under item (i) above.</p>			
<p>SINGRAULI STPP STAGE-III (1X500 MW) EPC PACKAGE</p>		<p>TECHNICAL SPECIFICATION SECTION - VI PART-B</p>	<p>SUB-SECTION-C-07 TYPE TEST REQUIREMENTS</p>	<p>PAGE 2 OF 10</p>




-08580


CLAUSE NO.	TECHNICAL REQUIREMENTS					
3.00.00	TYPE TEST REQUIREMENT FOR C&I SYSTEMS					
	Sl. No	Item	Test Requirement	Standard	Test To Be Specifically Conducted	NTPC's Approval Req. On Test Certificate
	Col 1	Col 2	Col 3	Col 4	Col 5	Col 6
	1	Elect. Metering instruments	As per standard (col 4)	IS-1248	No	Yes
	2	Transducers	As per standard (col 4)	IEC-60688, IS12784	No	Yes
	3	Thermocouple	Degree of protection test	IS-13947	No	No
	4	RTD	As per standard (col 4)	IEC-60751	No	No
	5	Electronic transmitter	As per standard (col 4)	BS-6447 / IEC-60770	No	Yes
	6	E/P converter	As per standard (col 4)	Mfr. standard	No	Yes
	7	Dust emission monitor	Degree of protection test	IS-13947	No	Yes
	8	Instrumentation Cables Twisted & Shielded*				
		-Conductor	Resistance test	VDE-0815	No	Yes
			Diameter test	IS-10810	No	Yes
			Tin Coating test (Persulphate test)	IS-8130	No	Yes
		-Insulation	Loss of mass	VDE 0472	No	Yes
			Ageing in air ovens**	VDE 0472	No	Yes
SINGRAULI STPP STAGE-III (1X500 MW) EPC PACKAGE	TECHNICAL SPECIFICATION SECTION - VI PART-B			SUB-SECTION-C-07 TYPE TEST REQUIREMENTS	PAGE 3 OF 10	




08581


CLAUSE NO.	TECHNICAL REQUIREMENTS			
	Tensile strength and elongation test before and after ageing**	VDE 0472	No	Yes
	Heat shock	VDE 0472	No	Yes
	Hot deformation	VDE 0472	No	Yes
	Shrinkage	VDE 0472	No	Yes
	Bleeding & blooming	IS-10810	No	Yes
	-Inner sheath***			
	Loss of mass	VDE 0472	No	Yes
	Heat shock	VDE 0472	No	Yes
	Cold bend/ cold impact test	VDE 0472	No	Yes
	Hot deformation	VDE 0472	No	Yes
	Shrinkage	VDE 0472	No	Yes
	-Outer sheath			
	Loss of mass	VDE 0472	No	Yes
	Ageing in air ovens**	VDE 0472	No	Yes
	Tensile strength and elongation test before and after ageing**	VDE 0472	No	Yes
	Heat shock	VDE 0472	No	Yes
	Hot deformation	VDE 0472	No	Yes
	Shrinkage	VDE 0472	No	Yes
	Bleeding & blooming	IS-10810	No	Yes
	Colour fastness to water	IS-5831	No	Yes
SINGRAULI STPP STAGE-III (1X500 MW) EPC PACKAGE	TECHNICAL SPECIFICATION SECTION - VI PART-B	SUB-SECTION-C-07 TYPE TEST REQUIREMENTS	PAGE 4 OF 10	




CLAUSE NO.	TECHNICAL REQUIREMENTS				
	Cold bend/ cold impact test	VDE-0472	No	Yes	
	Oxygen index test	ASTMD- 2863	No	Yes	
	Smoke Density Test	ASTMD- 2843	No	Yes	
	Acid gas generation test	IEC-60754-1	No	Yes	
-fillers	Oxygen index test	ASTMD- 2863	No	Yes	
	Acid gas generation test	IEC-60754-1	No	Yes	
-AL-MYLAR shield	Continuity test		No	Yes	
	Shield thickness		No	Yes	
	Overlap test		No	Yes	
-Over all cable	Flammability Test	IEEE 383	No	Yes	
	Swedish Chimney Test	SEN 4241475	No	Yes	
	Noise interference	IEEE Trans- actions	No	Yes	
	Dimensional checks	IS 10810	No	Yes	
	Cross talk	VDE-0472	No	Yes	
	Mutual capacitance	VDE-0472	No	Yes	
	HV test	VDE-0815	No	Yes	
	Drain wire continuity		No	Yes	




CLAUSE NO.	TECHNICAL REQUIREMENTS				एनटीपीसी NTPC																																				
	<p>* 1.0 All cables to be supplied shall be of type tested quality. The Contractor shall submit for Owner's approval the reports of all the type tests as listed in this specification and carried out within last five years from the date of bid opening. These reports should be for the tests conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client.</p> <p>2.0 In case the Contractor is not able to submit report of the type test(s) conducted within last five years from the date of bid opening, or in case the type test report(s) are not found to be meeting the specification requirements, the Contractor shall conduct all such tests under this contract free of cost to the Owner and submit the reports for approval.</p> <p>**These tests shall be carried out as per VDE0207 Part 6 & ASTM-D-2116 for TEFLON insulated & outer sheathed cables</p> <p>***Applicable for armoured cables only</p> <p>9 DC Power Supply System (Applicable for each model and rating)</p> <table border="1" data-bbox="686 929 1257 1836"> <tbody> <tr> <td>Degree of protection test</td> <td>IS-13947</td> <td>Yes</td> <td>Yes</td> </tr> <tr> <td>Short circuit current capability</td> <td>Approved procedure</td> <td>Yes</td> <td>Yes</td> </tr> <tr> <td>Voltage Proof Test</td> <td>UL 950, IEC950</td> <td>Yes</td> <td>Yes</td> </tr> <tr> <td>Burn In test</td> <td>Approved procedure</td> <td>Yes</td> <td>Yes</td> </tr> <tr> <td>Efficiency</td> <td>Approved procedure</td> <td>Yes</td> <td>Yes</td> </tr> <tr> <td>Audible Noise Test</td> <td>Approved procedure</td> <td>Yes</td> <td>Yes</td> </tr> <tr> <td>Fuse Clearing Capability</td> <td>Approved procedure</td> <td>Yes</td> <td>Yes</td> </tr> <tr> <td>Total harmonic content</td> <td>Approved procedure/CIGRE's</td> <td>Yes</td> <td>Yes</td> </tr> <tr> <td>Radio Frequency interference</td> <td>IEC-CISPR22, IEC-61000-</td> <td>Yes</td> <td>Yes</td> </tr> </tbody> </table>				Degree of protection test	IS-13947	Yes	Yes	Short circuit current capability	Approved procedure	Yes	Yes	Voltage Proof Test	UL 950, IEC950	Yes	Yes	Burn In test	Approved procedure	Yes	Yes	Efficiency	Approved procedure	Yes	Yes	Audible Noise Test	Approved procedure	Yes	Yes	Fuse Clearing Capability	Approved procedure	Yes	Yes	Total harmonic content	Approved procedure/CIGRE's	Yes	Yes	Radio Frequency interference	IEC-CISPR22, IEC-61000-	Yes	Yes	
Degree of protection test	IS-13947	Yes	Yes																																						
Short circuit current capability	Approved procedure	Yes	Yes																																						
Voltage Proof Test	UL 950, IEC950	Yes	Yes																																						
Burn In test	Approved procedure	Yes	Yes																																						
Efficiency	Approved procedure	Yes	Yes																																						
Audible Noise Test	Approved procedure	Yes	Yes																																						
Fuse Clearing Capability	Approved procedure	Yes	Yes																																						
Total harmonic content	Approved procedure/CIGRE's	Yes	Yes																																						
Radio Frequency interference	IEC-CISPR22, IEC-61000-	Yes	Yes																																						
SINGRAULI STPP STAGE-III (1X500 MW) EPC PACKAGE	TECHNICAL SPECIFICATION SECTION - VI PART-B	SUB-SECTION-C-07 TYPE TEST REQUIREMENTS	PAGE 6 OF 10																																						




08584

CLAUSE NO.	TECHNICAL REQUIREMENTS				
		4-12(9b), IEC-61000-4-3, IEC-61000-4-5, IEC-61000-4-6			
	Over Load Test	Approved procedure	Yes	Yes	
	Restart Test	Approved procedure	Yes	Yes	
	Output voltage tolerance	Approved procedure	Yes	Yes	
	Parallel operation	Approved procedure	Yes	Yes	
	ESD immunity Test	IEC-61000-4-2-9(1)	Yes	Yes	
	Electrical Fast transient/ Burst Immunity Test	IEC-61000-4-4	Yes	Yes	
	Surge Protection	IEC61312, IEC61024, VDE 100-534,	Yes	Yes	
	Insulation Test	Approved procedure	Yes	Yes	
	Load Tests.	Approved procedure	Yes	Yes	
	Preliminary light load test (without Battery supply)	Approved procedure	Yes	Yes	
	Load sharing	Approved procedure	Yes	Yes	
SINGRAULI STPP STAGE-III (1X500 MW) EPC PACKAGE	TECHNICAL SPECIFICATION SECTION - VI PART-B	SUB-SECTION-C-07 TYPE TEST REQUIREMENTS	PAGE 7 OF 10		



CLAUSE NO.	TECHNICAL REQUIREMENTS					एनटीपीसी NTPC	
10	Battery [#]	As per standard (col 4)	IS-10918	No	Yes		
11	DDCMIS	BMS	Safety requirements	VDE0116 Sec 8.7	No	Yes	
12	UPS (Applicable for each model and rating)		Degree of protection test	IS-13947	No	Yes	
			Load Test	Approved Procedure	Yes	Yes	
			Audible Noise Test	IEC 60146-2	No	Yes	
			Fuse Clearing Capability	Approved procedure	Yes	Yes	
			Relative harmonic content	Approved procedure	No	Yes	
			Radio interference	IEC 60146-2	No	Yes	
			Synchronous transfer test	IEC 60146-2	No	Yes	
			Temp rise test without redundant fans	Approved procedure	Yes	Yes	
			Input Voltage Variation Test	Approved procedure	No	Yes	
			Over Load Test	Approved procedure	No	Yes	
			Insulation Test	IEC 60146	No	Yes	




SINGRAULI STPP STAGE-III
(1X500 MW)
EPC PACKAGE


TECHNICAL SPECIFICATION
SECTION - VI
PART-B



SUB-SECTION-C-07
TYPE TEST
REQUIREMENTS


PAGE
8 OF 10

08586

CLAUSE NO.	TECHNICAL REQUIREMENTS					
		Restart Test	IEC 60146-2	No	Yes	
		Short Circuit current capability	IEC 60146-2	No	Yes	
		Output voltage & frequency tolerance	IEC 60146-2	No	Yes	
		Voltage /Current Division	IEC 60146-2	No	Yes	
		Efficiency Test	IEC 60146-2	Yes	Yes	
13	Voltage Stabilisers	Over Load Test	Approved procedure	No	Yes	
		Temp rise test without redundant fans	Approved procedure	No	Yes	
		Input voltage variation test	Approved procedure	No	Yes	
14	Public Address System					
	- Amplifiers	As per standard (col 4)	IS 9302, Part-II	No	Yes	
	Microphones	As per standard (col 4)	IS 9302, Part-III	No	Yes	
	Loudspeaker	As per standard (col 4)	IS 9302, Part-IV	No	Yes	
15	LIE / LIR	Degree of protection test	IS-13947	Yes	Yes	
16	Flue gas analyzers	Degree of protection test	IS-13947	No	Yes	
17	Master Clock	Functional test	As per	No	Yes	
SINGRAULI STPP STAGE-III (1X600 MW) EPC PACKAGE		TECHNICAL SPECIFICATION SECTION - VI PART-B		SUB-SECTION-C-07 TYPE TEST REQUIREMENTS	PAGE 9 OF 10	



CLAUSE NO.	TECHNICAL REQUIREMENTS						
				approved procedure			
18	CJC Box	Degree of protection test	Of IS-13947	No	Yes		
19	Junction Box	Degree of protection Test	Of IS-13947	No	Yes		
20	OPC Access Server, Data Exchange Server & Historical Data Access Server	OPC Compliance Testing		No	Yes (Self certification is also acceptable)	is	
	Conductivity Type Switch	Degree of protection test	of IS-2147	No	No		
	Local Gauges	Degree of protection test	of IS-2147	No	No		
	Process actuated Switches	Degree of protection test	of IS-2147	No	No		
	Control Valves	CV test	ISA 75.02	No	Yes		
	PLCs	As per standard (Col 4)	IEC 1131	No	No		
	Flow Nozzle Orifice plates	Calibration	ASME PTC BS 1042	Yes	Yes		
<p>## The contractor shall submit for Employers approval the reports of all the type test as per latest IS-10918 carried out within last five years from the date of Bid opening and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. The complete type test reports shall be for any rating of Battery in a particular group based on plate dimensions being manufactured by supplier.</p> <p>Note:</p> <p>Type Tests are to be conducted only for the items, which are being supplied as a part of this Package.</p>							
			SINGRAULI STPP STAGE-III (1X500 MW) EPC PACKAGE		TECHNICAL SPECIFICATION SECTION - VI PART-B	SUB-SECTION-C-07 TYPE TEST REQUIREMENTS	PAGE 10 OF 10

	SPECIFICATION FOR MOTORISED VALVE ACTUATOR		SPECIFICATION NO.: PE-ID-401-145-1902	
			VOLUME II B	
			SECTION D	
			REV. NO. 00	DATE: 25.03.14
			SHEET 2	OF 5
Data Sheet A & B				
DATA SHEET-A (TO BE FILLED BY PURCHASER)			DATA SHEET-B (TO BE FILLED-UP BY BIDDER)	
GENERAL*	* PROJECT			
	OFFER REFERENCE			
	* TAG NO. SERVICE			
	* DUTY	<input type="checkbox"/> ON / OFF	<input type="checkbox"/> INCHING	
	* LINE SIZE (inlet/outlet): MATERIAL			
	* VALVE TYPE	<input type="checkbox"/> GLOBE <input type="checkbox"/> GATE <input type="checkbox"/> REG. GLOBE <input type="checkbox"/> BUTTERFLY		
	* OPENING / CLOSING TIME			
	* WORKING PRESSURE			
	AMBIENT CONDITION	SHALL BE SUITABLE FOR CONTINUOUS OPERATION UNDER AN AMBIENT TEMP. OF 0-55 DEG C AND RELATIVE HUMIDITY OF 0-95%		
	VALVE SEAT TEST PRESS	BIDDER TO SPECIFY		
	REQUIRED VALVE TORQUE	BIDDER TO SPECIFY		
	ACTUATOR RATED TORQUE	BIDDER TO SPECIFY		
CONSTRUCTION AND SIZING	CONSTRUCTION	TOTALLY ENCLOSED, WEATHER PROOF, IP:55		
	MECHANICAL POSITION INDICATOR	TO BE PROVIDED FOR 0-100% TRAVEL		
	BEARINGS	DOUBLE SHIELDED, GREASE LUBRICATED ANTI-FRICTION.		
	GEAR TRAIN FOR LIMIT SWITCH/TORQUE SWITCH OPERATION	METAL (NOT FIBRE GEARS). SELF-LOCKING TO PREVENT DRIFT UNDER TORQUE SWITCH SPRING PRESSURE WHEN MOTOR IS DE-ENERGIZED.		
	SIZING	OPEN/CLOSE AT RATED SPEED AGAINST DESIGNED DIFFERENTIAL PRESSURE AT 85% OF RATED VOLTAGE. FOR ISOLATING SERVICE THREE SUCCESSIVE OPEN-CLOSE OPERATIONS OR 15 MINS. WHICHEVER IS HIGHER. FOR INCHING SERVICE - 150 STARTS/HR MINIMUM & FOR REGULATING SERVICE - 600 STARTS/HR MINIMUM.		
HANDWHEEL	* REQUIRED	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO	
	* ORIENTATION	<input type="checkbox"/> TOP MOUNTED	<input type="checkbox"/> SIDE MOUNTED	
	*TO DISENGAGE AUTOMATICALLY DURING MOTOR OPERATION.			
ELECTRIC ACTUATOR	ACTUATOR MAKE/MODEL	BIDDER TO SPECIFY		
	MOTOR MAKE / MODEL / TYPE / RATING (KW)	BIDDER TO SPECIFY		
	@ MOTOR TYPE	SQUIRREL CAGE INDUCTION MOTOR SUITABLE FOR DOL STARTING		
	ACTUATOR APPLICABLE WIRING DIAGRAM	<input checked="" type="checkbox"/> ENCLOSED (BIDDER TO CONFIRM) A: <input type="checkbox"/> DRG. NO. 3-V-MISC-24227 R00 B: <input type="checkbox"/> DRG. NO. 3-V-MISC-24550 R00 C: <input checked="" type="checkbox"/> DRG. NO. 3-V-MISC-24283 R00 D: <input type="checkbox"/> DRG. NO. 4-V-MISC-90271 R11 E: <input type="checkbox"/> For Thyristor based Integral starter, Bidder/Vendor to furnish wiring diagram		
	COLOUR SHADE	<input checked="" type="checkbox"/> BLUE (RAL 5012)	<input type="checkbox"/>	
	PAINT TYPE (## Refer Notes)	<input checked="" type="checkbox"/> ENAMEL	<input type="checkbox"/> EPOXY	<input type="checkbox"/>
	SHAFT RPM	BIDDER TO SPECIFY		
	OLR SET VALUE	BIDDER TO SPECIFY		
	@ STARTING / FULL LOAD CURRENT	BIDDER TO SPECIFY		
	NO. OF REV FOR FULL TRAVEL	BIDDER TO SPECIFY		
	@ PWR SUPP TO MTR / STARTER	415V, 3PH, AC		
	@ CONTROL VOLTAGE REQUIREMENT	110V AC/ 24VDC TO BE DERIVED SUITABLY FROM 415V POWER SUPPLY		



**SPECIFICATION
FOR
MOTORISED VALVE ACTUATOR**

SPECIFICATION NO.: PE-ID-401-145-I902

VOLUME II B

SECTION D

REV. NO. 00

DATE: 25.03.14

SHEET 3

OF 5

Data Sheet A & B

DATA SHEET-A
(TO BE FILLED BY PURCHASER)

DATA SHEET-B
(TO BE FILLED-UP BY BIDDER)

	@ ENCLOSURE CLASS OF MOTOR	TOTALLY ENCLOSED, SELF VENTILATED IP-55 DOP	
	@ INSULATION CLASS	CLASS B OR BETTER, TEMPERATURE RISE 70 DEG C OVER 50 DEG C AMBIENT	
	@ WINDING TEMP PROTECTION	■ THERMOSTAT (3 Nos., 1 IN EACH PHASE)	
	SINGLE PHASE / WRONG PHASE SEQUENCE PROTECTION	REQUIRED	
INTEGRAL STARTER	INTEGRAL STARTER	■ REQUIRED □ NOT REQUIRED	
	TYPE OF SWITCHING DEVICE	■ CONTACTORS □ THYRISTORS	
	TYPE	■ CONVENTIONAL □ SMART (NON-INTRUSIVE)	
	IF SMART		
	a) SERIAL LINK INTERFACE	□ INTEGRAL □ FIELD MOUNTED	
	b) SERIAL LINK PROTOCOL	□ FOUNDATION FIELD-BUS □ PROFI-BUS □ DEVICE NET □	
	c) SERIAL LINK MEDIA	□ TWISTED PAIR Cu-CBL □ CO-AXIAL Cu-CBL □ OFC	
	d) HAND HELD PROGRAMMER	□ REQUIRED □ NOT REQUIRED	
	e) TYPE OF HAND HELD PROGRAMMER	□ BLUETOOTH □ INFRARED □	
	f) MASTER STATION	□ REQUIRED □ NOT REQUIRED	
	g) MASTER STN INTRFACE WITH DCS	□ MODBUS □ TCP/IP	
	h) DETAILS OF SPECIAL CABLE	□ ENCLOSED □ NOT REQUIRED	
	STEP DOWN CONT. TRANSFORMER	■ REQUIRED	
	OPEN / CLOSE PB	■ REQUIRED □ NOT REQUIRED	
	STOP PB	■ REQUIRED □ NOT REQUIRED	
	INDICATING LAMPS	■ REQUIRED □ NOT REQUIRED	
	LOCAL REMOTE S/S	■ REQUIRED □ NOT REQUIRED	
STATUS CONTACTS FOR MONITORING	■ REQUIRED □ NOT REQUIRED		
INTEGRAL STARTER DISTURBED SIGNAL	REQUIRED (O/L RELAY OPERATED, CONT./POWER SUPPLY FAILED, S/S IN LOCAL, TORQUE SWITCH OPTD. MID WAY)		
INTERPOSING RELAY/OPTO COUPLER (Applicable for integral Starter)	TYPE OF ISOLATING DEVICE	■ INTERPOSING RELAY □ OPTO COUPLER □ EITHER	
	QUANTITY	■ 2 NOS. □ 3 NOS.	
	DRIVING VOLTAGE	■ 20.5 – 24V DC □ _____ V DC	
	DRIVING CURRENT	■ 125mA MAX □ _____ mA MAX	
	LOAD RESISTANCE	■ > 192 ohms - <25 k ohms □ > _____ ohms - < _____ ohms	
TORQUE SWITCH (Not Applicable for Smart Actuator) (\$\$ Refer Notes)	MFR & MODEL NO.	BIDDER TO SPECIFY	
	OPEN / CLOSE	■ 1 No. □ 2Nos. / ■ 1 No. □ 2Nos	
	CONTACT TYPE	2 NO + 2 NC	
	RATING	5A 240V AC AND 0.5A 220V DC	
	CALIBRATED KNOBS(OPEN&CLOSE TS)	REQUIRED FOR SETTING DESIRED TORQUE	
	ACCURACY	+3% OF SET VALUE	
LIMIT SWITCH (Not Applicable for Smart Actuator) (\$\$ Refer Notes)	MFR & MODEL NO.	BIDDER TO SPECIFY	
	OPEN : INT : CLOSE	□ 1 No. □ 2 Nos. (ADJ.) □ 1 No. ■ 2Nos.	
	CONTACT TYPE	2 NO + 2 NC	
	RATING (AC / DC)	5A 240V AC AND 0.5A 220V DC	



**SPECIFICATION
FOR
MOTORISED VALVE ACTUATOR**

SPECIFICATION NO.: PE-ID-401-145-1902

VOLUME II B

SECTION D

REV. NO. 00

DATE: 25.03.14

SHEET 4

OF 5

Data Sheet A & B

DATA SHEET-A
(TO BE FILLED BY PURCHASER)

DATA SHEET-B
(TO BE FILLED-UP BY BIDDER)

POSITION TRANSMITTER	POSITION TRANSMITTER (For inching duty & other specific applications)	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	MFR & MODEL NO.	BIDDER TO SPECIFY	
	TYPE	<input type="checkbox"/> ELECTRONIC (2 WIRE) R/I CONVERTER <input checked="" type="checkbox"/> ELECTRONIC (2 WIRE) CONTACTLESS	
	SUPPLY	<input checked="" type="checkbox"/> 24V DC <input type="checkbox"/>	
	OUTPUT	<input checked="" type="checkbox"/> 4-20mA	
	ACCURACY	\pm 1% FS	
SPACE HEATER	@SPACE HEATER	REQUIRED	
	@ POWER SUPPLY (NON INTEGRAL)	N.A	
	@ POWER SUPPLY (INTEGRAL)	BIDDER TO SPECIFY	
	@ RATING		
TERMINAL BOX	ACTUATOR/MOTOR TERMINAL BOX	REQUIRED	
	ENCL CLASS ACTUATOR/MOTOR T.B.	@ <input type="checkbox"/> IP 68 @ <input checked="" type="checkbox"/> IP 55	
	@ EARTHING TERMINAL	REQUIRED TWO	
	PLUG & SOCKET(9 PIN) (FOR COMMD, LS/TS FEED BACK, PoT)	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED <input checked="" type="checkbox"/> 2 NOS. <input type="checkbox"/>	
CABLE GLANDS	@ POWER CABLE GLAND	SIZE:--TO BE PROVIDED DURING DETAILED ENGINEERING	
	@ SPACE HEATER CABLE GLAND	SIZE:----- TO BE PROVIDED DURING DETAILED ENGINEERING	
	OTHER CONTROL CABLE GLANDS-1	<input type="checkbox"/> 1No. for BFV of CW PUMP	
	OTHER CONTROL CABLE GLANDS-2	QUANTITY & SIZE : TO BE PROVIDED DURING DETAILED ENGINEERING	
WEIGHT	TOTAL WEIGHT (ACTUATOR + ACCESSORIES)	BIDDER TO SPECIFY	_____ Kg.



NOTES:

- SCOPE:** DESIGN, MANUFACTURE, INSPECTION, TESTING AND DELIVERY TO SITE OF ELECTRIC ACTUATOR FOR INCHING OR OPEN / CLOSE DUTY.
 - CODES & STANDARDS:** DESIGN AND MATERIALS USED SHALL COMPLY WITH THE RELEVANT LATEST NATIONAL AND INTERNATIONAL STANDARD. AS A MINIMUM, THE FOLLOWING STANDARDS SHALL BE COMPLIED WITH: IS-9334, IS-2147, IS-2148, IS-325, IS-2959, IS-4691 AND IS-4722
 - TEMPERATURE RISE SHALL BE RESTRICTED TO 70 DEG. C FOR AMBIENT TEMPERATURE OF 50 DEG C.
 - CABLE GLANDS OF DOUBLE COMPRESSION TYPE, BRASS MATERIAL SHALL BE PROVIDED.
 - THE TORQUE SWITCHES SHALL BE PROVIDED WITH MECHANICAL LATCHING DEVICE TO PREVENT OPERATION WHEN UNSEATING FROM THE END POSITIONS. THE LATCHING DEVICE SHALL UNLATCH AS SOON AS THE VALVE LEAVES THE END POSITION. IF SUCH PROVISION IS NOT POSSIBLE, THE TORQUE SWITCHES SHALL BE BYPASSED BY END-POSITION LIMIT SWITCHES WHICH OPENS ON VALVE LEAVING END POSITION. THESE LIMIT SWITCHES ARE ADDITIONAL TO THE NUMBER OF LIMIT SWITCHES SPECIFIED ELSEWHERE.
 - THE MOTOR SHALL OPERATE SATISFACTORILY UNDER THE +/- 10% SUPPLY VOLTAGE VARIATION AT RATED FREQUENCY, -5% TO +3% VARIATION IN FREQUENCY AT RATED SUPPLY VOLTAGE, SIMULTANEOUS VARIATION IN VOLTAGE & FREQUENCY THE SUM OF ABSOLUTE PERCENTAGE NOT EXCEEDING 10%.
 - THE MOTOR SHALL BE SUITABLE FOR DIRECT ON LINE STARTING.
 - LIMIT SWITCH AND DISTURBANCE SIGNALS SHALL BE AVAILABLE TO DCS/PLC EVEN WHEN THE POWER SUPPLY TO THE ACTUATORS IS NOT AVAILABLE.
- \$\$ TORQUE SWITCH & LIMIT SWITCH SHALL ACT INDEPENDENT OF EACH OTHER. TANDEM OPERATION IS NOT ACCEPTABLE.**
- ## EPOXY PAINT IS RECOMMENDED FOR COASTAL AREAS.**

	PREPARED BY	CHECKED BY	APPROVED BY	VENDOR COMPANY SEAL
NAME	ANUJ WADHWA	AMIT TYAGI	BHARAT SINGH	NAME
SIGNATURE				SIGNATURE
DATE	25.03.2014	25.03.2014	25.03.2014	DATE

NOTES* = TO BE FILLED BY MPL (LEAD AGENCY). @ = TO BE FILLED BY ES

3-V-MISC-24283
DRAWING NO

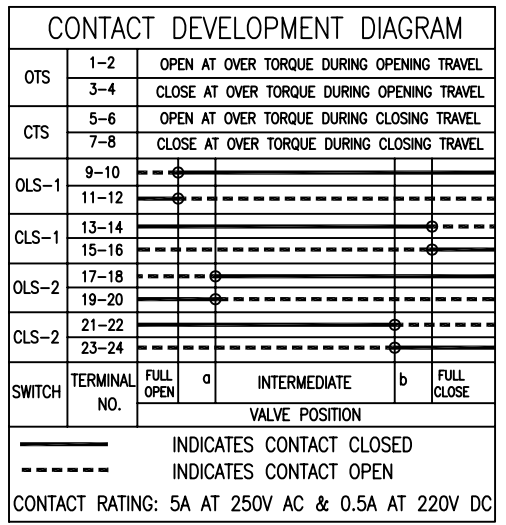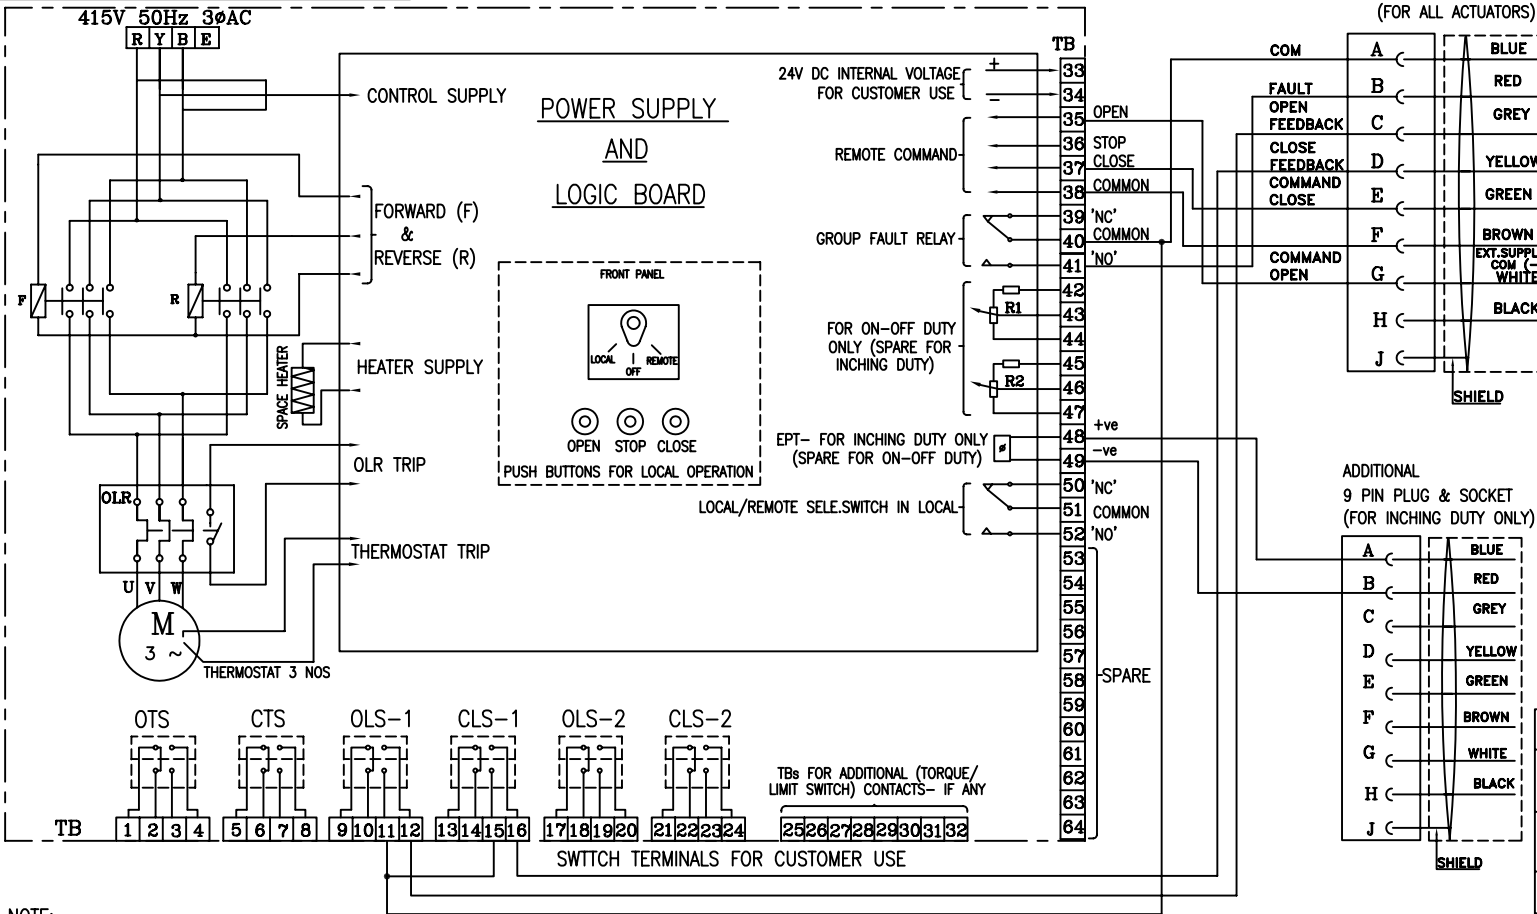

SETTING PROCEDURE OF POSITION LIMIT AND TORQUE SWITCH

VALVES	OPEN		CLOSE	
	MAIN	BACK UP	MAIN	BACK UP
GATE VALVE OF 100 mm AND ABOVE IN 1500 CL AND ABOVE RATINGS	OLS	OTS *	CLS	CTS
ALL OTHER GATE & GLOBE VALVES	OLS	OTS *	CTS	#

- CLS NOT TO BE CONNECTED IN TRIP CIRCUIT
* - BYPASS OTS FOR INITIAL 5% OF TRAVEL (FOR GATE VALVES ONLY)

- NOTE:-
- ALL TORQUE AND LIMIT SWITCHES (OTS,CTS,OLS1&2, CLS1&2) ARE WITH 2NO+2NC CONTACTS '1NO+1NC' IS TERMINATED IN TBS 1-24, REMAINING CONTACTS ARE FOR INTERNAL USE.
ANY SPARE CONTACTS WHICH ARE NOT USED INTERNALLY ARE TO BE TERMINATED IN TBS 25-32
 - CTS - TORQUE SWITCHES FOR CW ROTATION (CLOSE)
 - OTS - TORQUE SWITCHES FOR CCW ROTATION (OPEN)
 - OLS-1, OLS-2 - LIMITSWITCHES FOR POSITION OPEN
 - CLS-1, CLS-2 - LIMITSWITCHES FOR POSITION CLOSE
 - EPT - ELECTRONIC POSITION TRANSMITTER (CONTACTLESS TYPE, FOR INCHING DUTY)
 - R1-R2-POTENTIOMETER 2 x 100 OHMS (FOR ON-OFF DUTY)
 - FOR COMMANDS & EPT EITHER INTERNALLY GENERATED 24 VDC OR EXTERNAL SUPPLY OF 24VDC CAN BE USED
 - M - MOTOR 3φ 415V 50 Hz AC SUPPLY
 - TORQUE SWITCH BYPASS WITH LIMITSWITCH BOTH ON OPEN & CLOSE DIRECTION TO BE DONE INTERNALLY.

REV	DATE	ALTERED
		CHD & APPD

CAUTION: The information on this document is the property of BHARAT HEAVY ELECTRICALS LTD. It must not be used directly or indirectly in any way detrimental to the interest of the company.

TYPE OF PRODUCT OR NAME OF CUSTOMER/PROJECT		ELECTRICAL VALVE ACTUATORS (AC) WITH INTEGRAL STARTERS FOR NTPC PROJECTS (DRAWN FOR INTERMEDIATE POSITION OF VALVES)							
BHARAT HEAVY ELECTRICALS LTD., UNIT: HIGH PRESSURE BOILER PLANT, TIRUCHIRAPALLI-620014.		DRN	N.P.ESWAR	SIGN	N.P	DATE	17.03.05	NO. OF	VAR.
		CHD	D.DINAKARAN	D.D		17.03.05			
		APPD	K.ARUNACHALAM	K.A		17.03.05			
DEPT	VL	SCALE	WEIGHT (KG).	REFERENCE INFORMATION				NO. OF ITEMS	
CODE		NTS							
TITLE						CARD CODE	DRAWING NO.		REV
WIRING DIAGRAM (TERMINAL PLAN)						U 01	3-V-MISC-24283		0
FOR ACTUATOR WITH INTEGRAL STARTER WITH PLUG & SOCKET FOR NTPC PROJECTS									



STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)

CHECK LIST FOR SOLENOID VALVES

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks	
				M	C	B		
1	CHECK FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS	P	W	V		
	TYPE							
	MAKE							
	MODEL No.							
2	MATERIAL (BODY. PLUNGER/TRIM)			P	W	V		
3	PORT SIZE			P	W	V		
4	CABLE CONNECTION SIZE			P	W	V		
5	ENCLOSURE CLASS			P	W	V		TYPE TEST CERTIFICATE TO BE FURNISHED BY VENDOR
6	No. OF COILS & INSULATION CLASS			P	W	V		TEST CERTIFICATE TO BE FURNISHED FOR INSULATION CLASS BY VENDOR
7	POWER SUPPLY CHECK	P	W	V				
8	IR / HV TEST	P	W	V				
9	FUCTIONAL TEST	P	W	V				

Legend :

** M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification

Note :

1. Quantum of check shall be as below :
100 % - By Manufacturer
2. Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
3. Contractor to provide compliance certificate for tests/checks verifid by contractor and submit the same alongwith test certificates to be verified by BHEL.



STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)

CHECK LIST FOR FLOW SWITCH

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECK FOR	100%	APPROVED SPEC./ DATA SHEETS	P	W	V	
	TYPE						
	RANGE						
	MODEL / TAG No.						
	END CONNECTION						
	DIMENSIONS						
	SIZE						
2	ACCURACY & REPEATABILITY (WET CALIBRATION)	100%		P	W	V	
3	HV / IR	100%		P	W	V	
4	CONTACT RATING / No. OF CONTACTS	RANDOM	P	W	V		
5	MATERIAL TC FOR BODY, WET PARTS, SENSING ELEMENT	ONE / LOT	P	W	V		
6	ACCESSORIES AS APPLICABLE	100%	P	W	V		
7	DEGREE OF PROTECTION	ONE / LOT	P	W	V		
8	OVER PRESSURE TEST	100%	P	W	V		


Legend :

** M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification


Note :

- Quantum of check shall be as below :
100 % - By Manufacturer
- Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
- Manufacturer to carry out routine test for 100%
- Contractor to provide compliance certificate for tests/checks verified by contractor and submit the same alongwith test certificates to be verified by BHEL.

INSTALLATION DIAGRAMS OF MEASURING INSTRUMENTS



This document is the property of NATIONAL THERMAL POWER CORPORATION LTD.
 No part of this document will be reproduced by any means without the written permission.

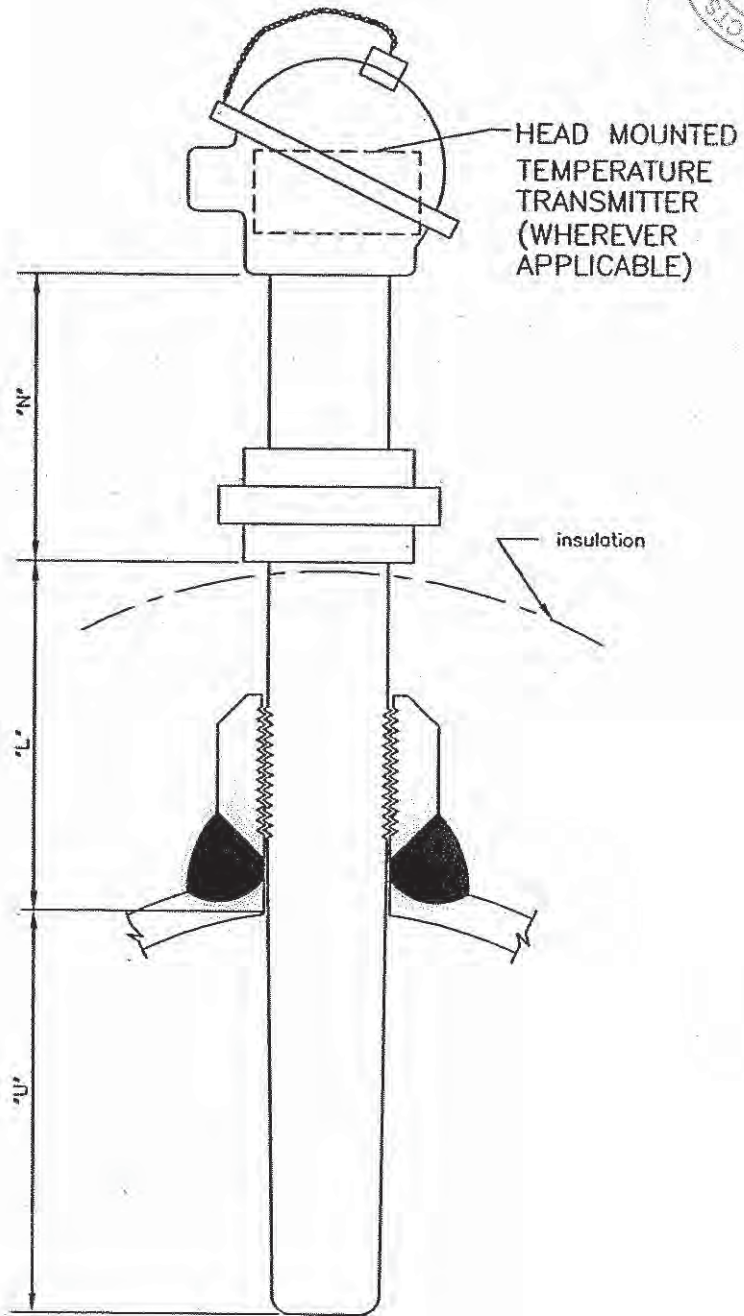

FOR TENDER PURPOSE ONLY

एन टी पी सी
NTPC


एन टी पी सी लिमिटेड
NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT	TYPICAL THERMAL POWER PROJECT SG, TG AND BOP PACKAGE		
TITLE	THERMOCOUPLE DIMENSION DEFINITIONS		
SIZE	SCALE	DRG. NO.	REV. NO.
A4	N.T.S.	0000-999-POI-A-055	A

REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	CAJ	APPR.	DATE
A	FIRST ISSUE									
CLEARED BY										


29660

LEVEL MEASUREMENT

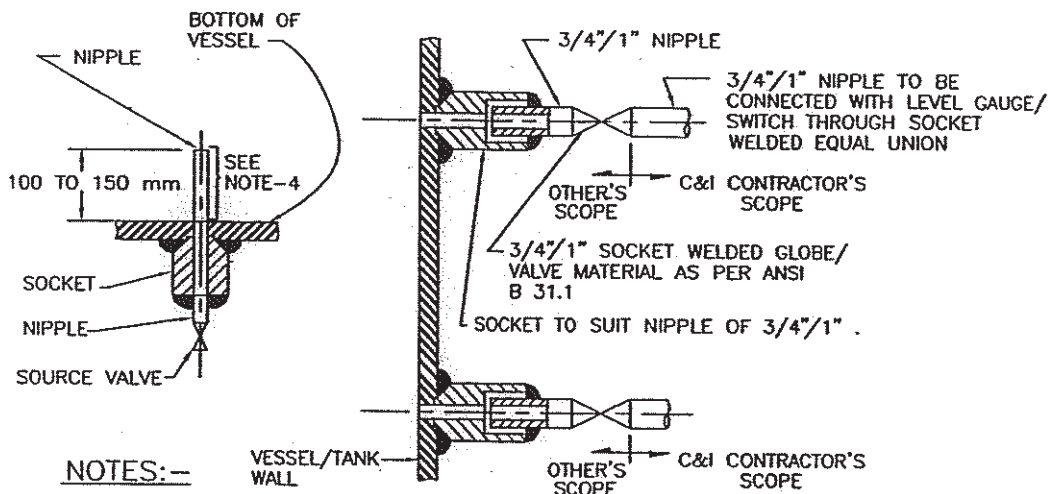

NOTES:-

1. THIS TYPE OF PROCESS CONNECTION SHALL BE USED FOR LEVEL GAUGE AND EXTERNAL CAGE TYPE FLOAT OR DISPLACER OPERATED LEVEL SWITCH.
2. FOR GAUGES 3/4" NIPPLE ALONG WITH 3/4" SW SOURCE VALVE AND FOR SWITCHES 1" NIPPLE ALONG WITH 1" SW SOURCE VALVE SHALL BE PROVIDED AS PROCESS CONNECTION.
3. SOURCE CONNECTION ON VESSEL SHOULD NOT BE LOCATED AT PLACES SUBJECTED TO INTERFACE AND TURBULENCE FROM INLETS AND OUTLETS.
4. IF LOWER CONNECTION IS TAKEN FROM BOTTOM OF THE VESSEL THEN THE NIPPLE MUST BE 100 mm TO 150 mm ABOVE THE BOTTOM OF THE VESSEL.

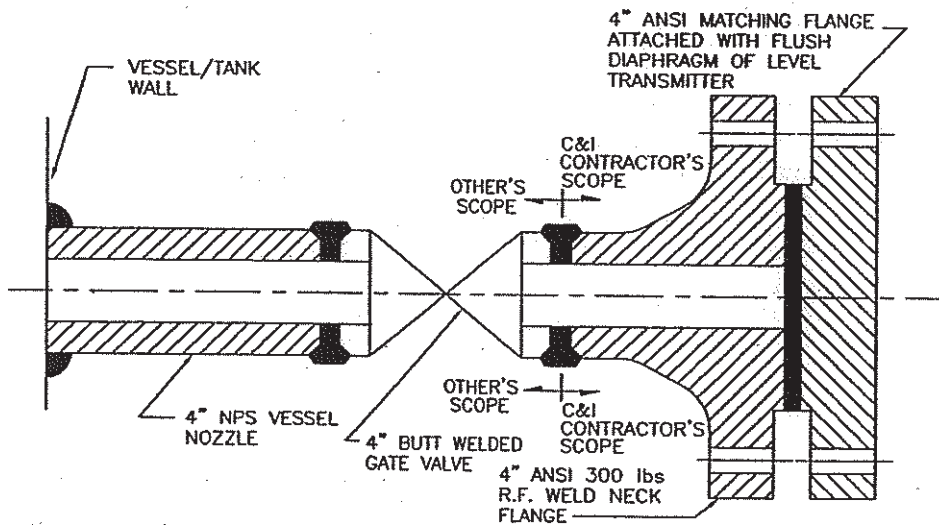



NOTES:-

1. THIS TYPE OF PROCESS CONNECTION SHALL BE PROVIDED FOR TANK LEVEL MEASUREMENT OF VISCOUS OR CORROSIVE LIQUID USING FLUSH DIAPHRAGM/WAFER TYPE LEVEL TRANSMITTER.
2. WELDING OF MATCHING FLANGE TO GATE VALVE SHALL BE DONE BY BIDDER.

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.


FOR TENDER PURPOSE ONLY



 एन टी पी सी लिमिटेड NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION										
PROJECT TYPICAL THERMAL POWER PROJECT (STATION C&I PACKAGE)										
TITLE INSTRUMENT SOURCE CONNECTION DETAILS										
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	CL	APPR.	DATE
A	FIRST ISSUE									
SIZE	SCALE	DRG. NO.	0000-405-POI-A-035				REV. NO.	A		
A4	N.T.S.							57-13 of 14		

09950

FLOW MEASUREMENT

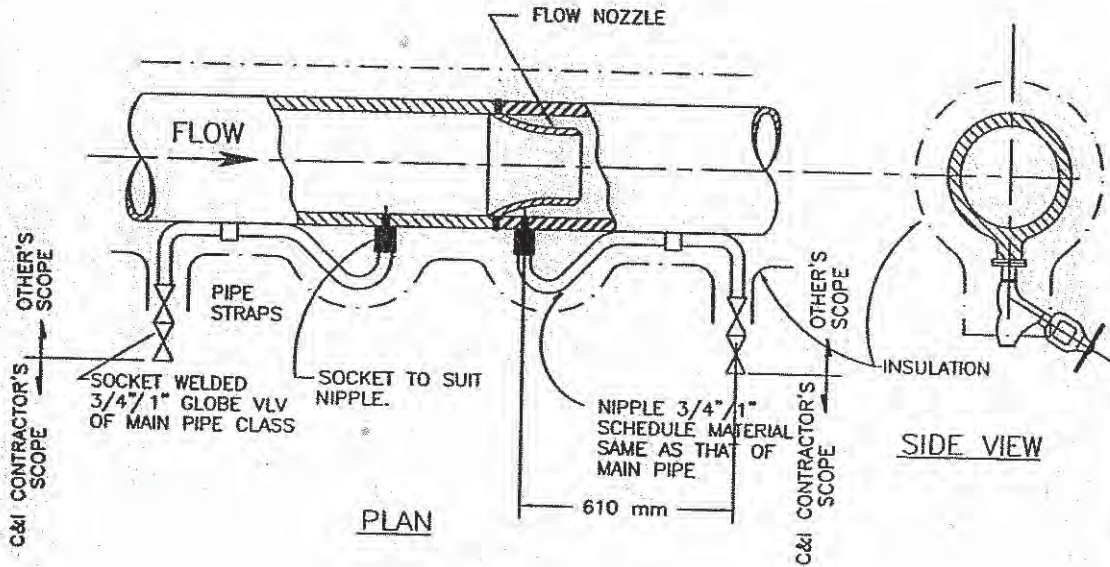

NOTES:-

1. THIS METHOD OF CONNECTING NIPPLES AND VALVES ON THE HORIZONTAL PIPE IS APPLICABLE FOR MEASUREMENT OF STEAM AT TEMP. ABOVE 455°C .
2. FOR STEAM SERVICE IN HORIZONTAL PIPE THE PRESSURE HOLES AND CONNECTING NIPPLES SHOULD BE IN THE HORIZONTAL PLANE OF THE PIPE CENTRE LINE.
3. THE ENTIRE LENGTH OF THESE NIPPLES AS WELL AS SHUT OFF VALVES SHOULD BE LAGGED IN WITH STEAM LINE AS SHOWN IN THE DRAWING.
4. FLOW ELEMENTS SHALL BE PROVIDED WITH 3 PAIRS OF TAPPING POINTS.


This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.



FOR TENDER PURPOSE ONLY

एन टी पी सी लिमिटेड NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION																																							
PROJECT					TYPICAL THERMAL POWER PROJECT (STATION C&I PACKAGE)																																		
TITLE																																							
INSTRUMENT SOURCE CONNECTION DETAILS																																							
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 15%;">A</td> <td style="width: 25%;">FIRST ISSUE</td> <td style="width: 10%; text-align: center;">1</td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> </tr> <tr> <td>REV.</td> <td>DESCRIPTION</td> <td>DRAWN</td> <td>DESIGN</td> <td>CHKD.</td> <td>M</td> <td>E</td> <td>C</td> <td>C&I</td> <td>APPR.</td> </tr> <tr> <td colspan="10" style="text-align: center;">Cleared by</td> </tr> </table>										A	FIRST ISSUE	1								REV.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	APPR.	Cleared by									
A	FIRST ISSUE	1																																					
REV.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	APPR.																														
Cleared by																																							
SIZE	SCALE	DRG. NO.	0000-405-POI-A-035				REV. NO.	A																															
A4	N.T.S.					Sh-9 of 14																																	


TEMP. MEASUREMENT

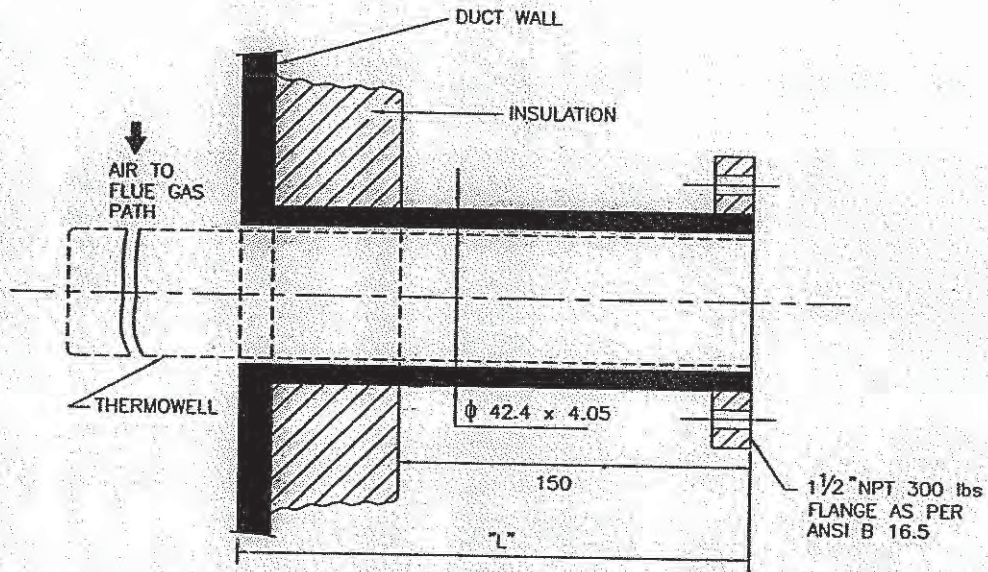

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

NOTES:-

1. THIS TYPE OF TEMPERATURE CONNECTIONS SHALL BE PROVIDED FOR TEMPERATURE MEASUREMENT IN AIR AND FLUE GAS DUCT.
2. MATERIAL OF THERMOWELL SHALL BE OF 316SS.
3. EXTERNAL CONNECTION SHALL BE OF SLIP ON FLANGED TYPE AND THERMOWELL DESIGN SHALL BE AS PER ASME.PTC-19.3 (REFER NOTES 9&10 OF DRG.NO. 0000-405-POI-A-035, Sh-6 Of 14).
4. BIDDER TO SUPPLY AND INSTALL THE COUNTER FLANGED AND THERMOWELL (ALONG WITH TEMP. ELEMENT).
5. ALL DIMENSIONS ARE INDICATIVE ONLY.




FOR TENDER PURPOSE ONLY

 एन टी पी सी लिमिटेड NTPC LIMITED (A COMPANY OF NDA ENTERPRISE) ENGINEERING DIVISION	
PROJECT	TYPICAL THERMAL POWER PROJECT (STATION C&I PACKAGE)
TITLE	INSTRUMENT SOURCE CONNECTION DETAILS
DRG. NO.	0000-405-POI-A-035
REV. NO.	A

REV. NO.	DESCRIPTION	DATE	BY	CHKD.	APPD.	DATE
A	FIRST ISSUE					

09948


TEMP. MEASUREMENT

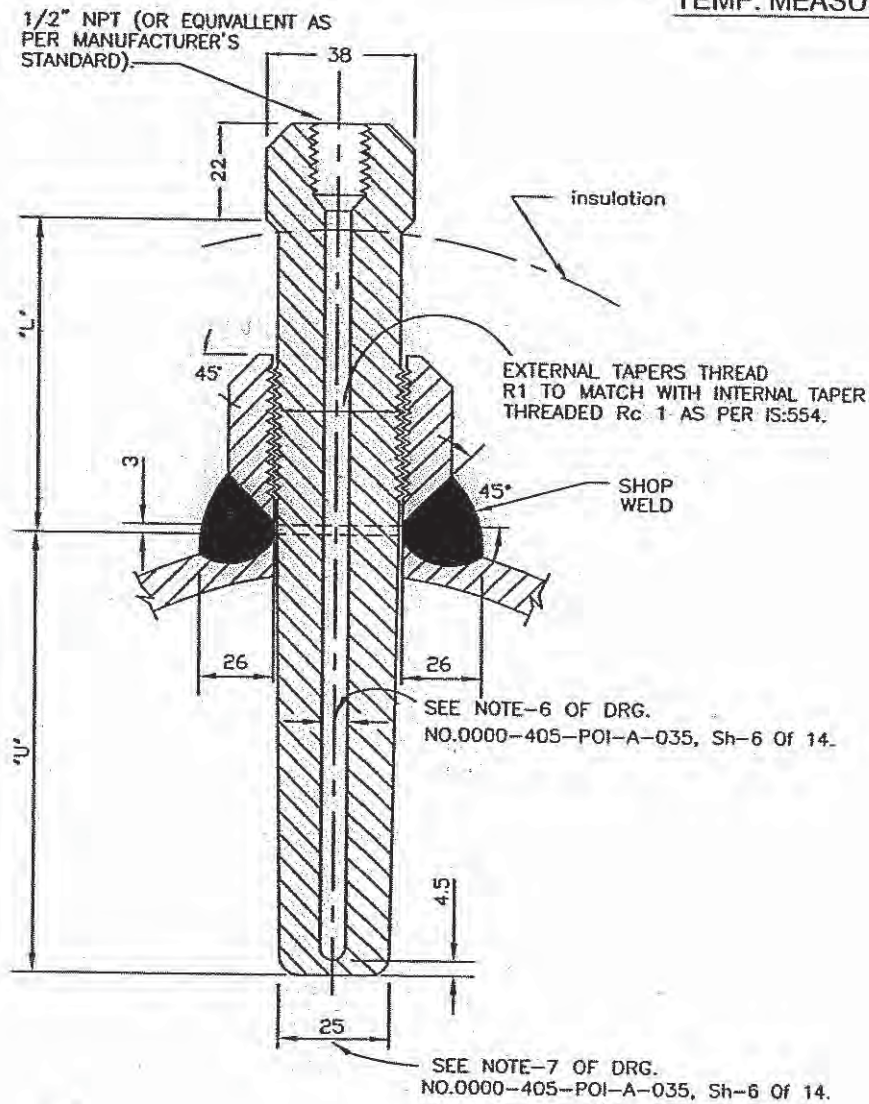


NOTES:-

1. THIS TYPE OF TEMPERATURE BOSS IS APPLICABLE FOR THE PROCESS PRESSURE/TEMPERATURE BELOW 40 Kg/Cm²(g)/400°C
2. FOR PRESSURE TIGHT JOINTS THE BOSS SHOULD HAVE INTERNAL TAPERED PIPE THREAD Rc 1 AS PER IS:554. THE LENGTH OF THREAD ENGAGEMENT SHOULD BE AS PER ABOVE STANDARD.
3. PIPES HAVING PROBABILITY OF PROLONGED VIBRATION SEAL WELDING MAY BE DONE ALL AROUND AFTER TIGHTENING THERMOWELL WITHIN THE BOSS.
4. SEE NOTES-2 TO 14 OF DRG. NO. 0000-405-POI-A-035, Sh-6 Of 14.

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.




FOR TENDER PURPOSE ONLY

 एन टी पी सी लिमिटेड NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION															
PROJECT TYPICAL THERMAL POWER PROJECT (STATON C&I PACKAGE)															
TITLE INSTRUMENT SOURCE CONNECTION DETAILS															
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	E&I	INCH.	APPR.	DATE	SIZE	SCALE	DRG. NO.	REV. NO.
A	FIRST ISSUE											A4	N.T.S.	0000-405-POI-A-035	A
CLEARED BY														Sh-7 Of 14	

09947


TEMP. MEASUREMENT

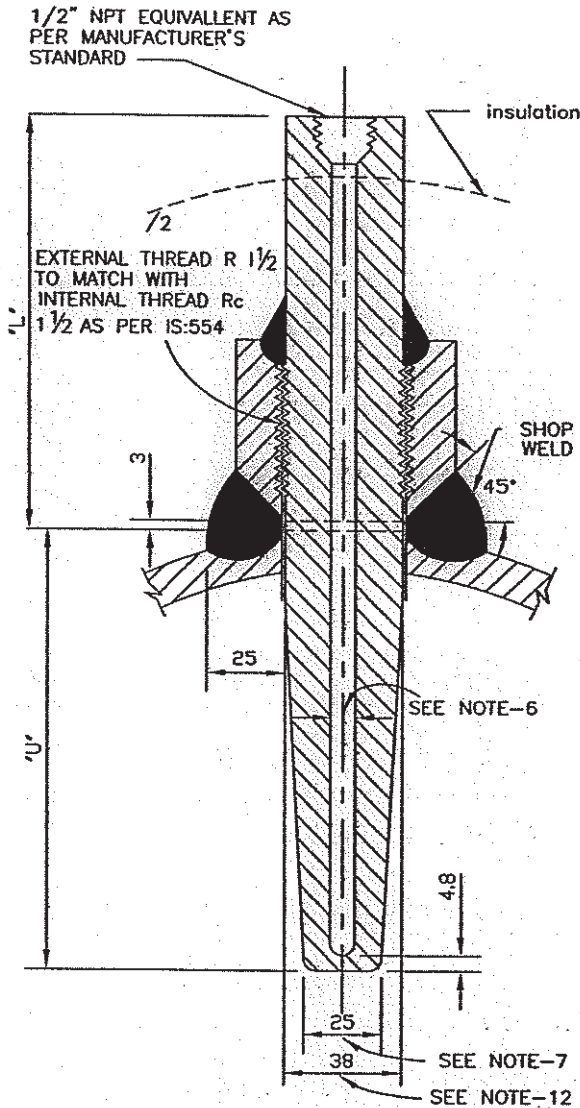

NOTES:-

1. THIS TYPE OF TEMPERATURE BOSS SHALL BE USED FOR THE PROCESS PRESS EQUAL/ABOVE 40 Kg/Cm2(g).
2. THE MATERIAL OF THE BOSS SHOULD BE SIMILAR TO THAT OF PIPING MATERIAL OF SPECIFICATION.
3. ALL WELD TO BE TESTED IN ACCORDANCE WITH APPLICABLE CODES BY MANUFACTURER.
4. MATERIAL OF THE THERMOWELL SHALL BE OF 316SS.
5. THERMOWELL SHALL BE DRILLED BARSTOCK TYPE.
6. INTERNAL BORE OF THE THERMOWELL SHOULD BE SELECTED BASED ON THE NORMAL SIZE OF THE SENSING ELEMENT AS PER ASME,PTC-19.3.
7. THE BOTTOM DIAMETER OF THE THERMOWELL TYPICALLY SHOWN HERE SHALL BE SUBJECT TO VARIATION BASED ON THE INTERNAL BORE OF THERMOWELL AND THICKNESS OF THERMOWELL MATERIAL TO WITHSTAND THE PROCESS PRESS AND TEMP. AS PER ASME,PTC-19.3.
8. THE TYPE OF TAPERED THERMOWELL SHALL BE USED FOR LIQUID VELOCITIES UP TO 92M.P.S.(300F.T.P.S.).
9. THERMOWELL WITH THE INSULATION LAG EXTENSIONS SHALL BE USED WHEREVER APPLICABLE.
10. ACTIVITIES TO BE COMPLETED AT THE SHOP: WELD THE BOSS ON THE PIPE AND DRILL THE HOLE IN THE PIPE IN ALIGNMENT WITH HOLE IN THE BOSS. PROVIDE INTERNAL THREAD AS PER IS:554 TO MATCH WITH THE THERMOWELL EXTERNAL THREAD.
11. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE STATED.
12. WILL BE SUITABLE TO MATCH THE STUB DIMENSIONS AS PER RC 1 1/2
13. THE "U" & "L" DIMENSIONS SHALL BE SELECTED BASED ON PARTICULAR APPLICATION AND THE SAME SHALL BE SUBJECT TO OWNER'S APPROVAL DURING DETAILED ENGINEERING.
14. ALL DIMENSIONS ARE INDICATIVE ONLY.

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.




FOR TENDER PURPOSE ONLY

एन टी पी सी लिमिटेड NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION													
PROJECT TYPICAL THERMAL POWER PROJECT (STATION C&I PACKAGE)													
TITLE INSTRUMENT SOURCE CONNECTION DETAILS													
A	FIRST ISSUE	DRWN	DESIGN	CHKD	M	E	C	ELG	INCH	APPD.	DATE		
REV. NO.	DESCRIPTION	CLEARED BY								SIZE	SCALE	DRG. NO.	REV. NO.
										A4	N.T.S.	0000-405-POI-A-035	A
										Sh-8 of 14			

09946

TEMP. MEASUREMENT

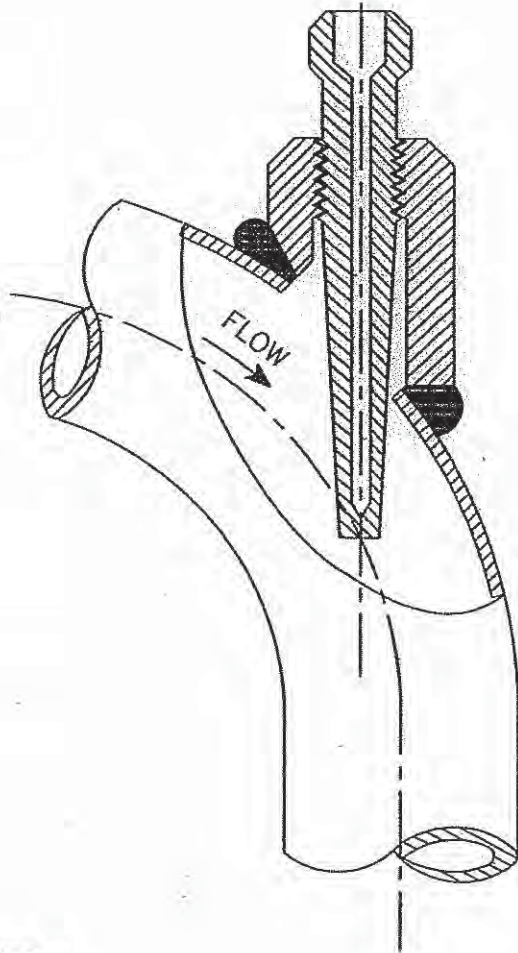



NOTES:-

1. FLOW INSTALLATION OF THERMOWELL SHALL BE APPLICABLE FOR 4" AND SMALLER LINE SIZE BUT LIMITED TO MINIMUM 3" LINE SIZE.
2. FOR 2" AND SMALLER LINE SIZE NECESSARY EXPANDER OF ELBOW FORM (AS SHOWN) OF MINIMUM 3" SIZE SHALL BE USED.
3. ELBOW EXPANDER SECTION IN HORIZONTAL PLANE MAY BE USED FOR LIQUID SERVICES. ONLY STEAM SERVICES EXPANDER SECTION MAY BE USED IN VERTICAL PLAN.

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.


FOR TENDER PURPOSE ONLY



 एन टी पी सी लिमिटेड NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION			
PROJECT		TYPICAL THERMAL POWER PROJECT (STATION C&I PACKAGE)	
TITLE		INSTRUMENT SOURCE CONNECTION DETAILS	
REV. NO.	DESCRIPTION	DATE	BY
A	FIRST ISSUE		


DESIGNED	CHECKED	APPROVED	DATE
SIZE	SCALE	DRG. NO.	REV. NO.
A4	N.T.S.	0000-405-POI-A-035	A

TEMP. MEASUREMENT

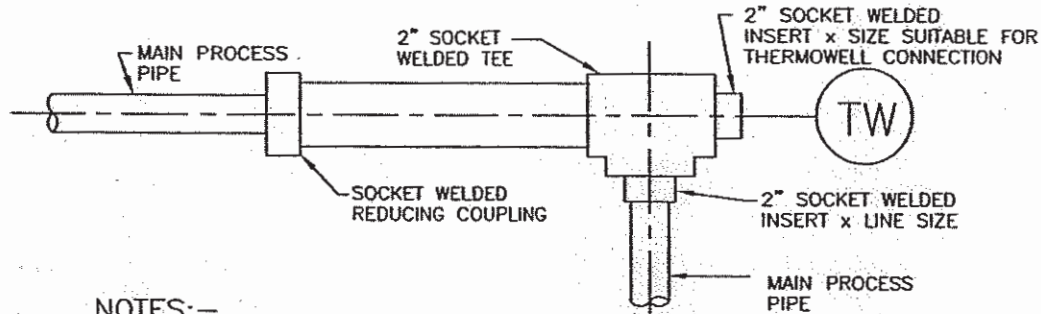

NOTES:-

1. THIS TYPE OF THERMOWELL INSTALLATION IS SUITABLE FOR THE PROCESS PIPE OF 2" NPS AND SMALLER.
2. FOR STEAM SERVICE THIS TYPE OF THERMOWELL INSTALLATION 90° BEND MAY BE USED ONLY IN VERTICAL PLANE.
3. THE LENGTH OF THE LARGER PIPE SECTION SHALL BE MINIMUM 150mm (IT MUST BE GREATER THAN THERMOWELL LENGTH).

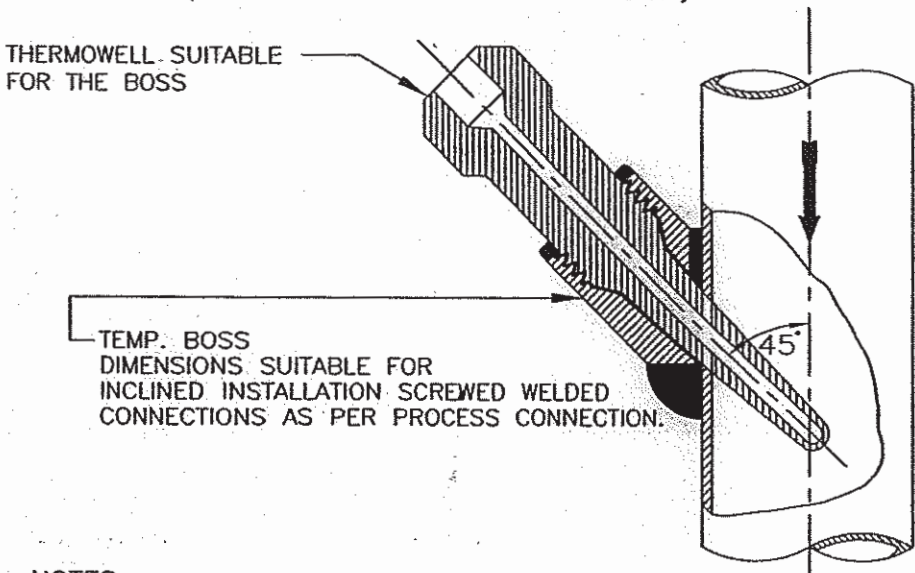


NOTES:-

1. INCLINED INSTALLATION OF THERMOWELL SHALL BE APPLICABLE FOR 4" AND SMALLER LINE SIZE BUT LIMITED TO MIN. 3" LINE SIZE.
2. FOR 2" AND SMALLER LINE SIZE NECESSARY EXPANDER OF MIN. 3" SIZE OF MAIN PIPING SPECIFICATION SHALL BE USED.
3. THIS TYPE OF INSTALLATION IS APPLICABLE FOR HORIZONTAL AND VERTICAL PIPE SECTION.
4. FOR STEAM SERVICES EXPANDER SECTION MAY BE USED ONLY IN VERTICAL RUN.
5. THE EXPANDER SECTION SHALL BE OF ADEQUATE LENGTH (ATLEAST 3-4 TIMES DIA OF THE MAIN PROCESS PIPE AT BOTH SIDE OF THE INSTALLED THERMOWELL).

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.


FOR TENDER PURPOSE ONLY



		एन टी पी सी लिमिटेड NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION	
PROJECT		TYPICAL THERMAL POWER PROJECT (STATION C&I PACKAGE)	
TITLE		INSTRUMENT SOURCE CONNECTION DETAILS	
NO.	DESCRIPTION	DRWN	DESIGN
		CHKD.	M
		E	C
		CLD	APPL
		DATE	
		Cleared by	
SIZE	SCALE	DRG. NO.	REV. NO.
A4	N.T.S.	0000-405-POI-A-035	A

09944

PRESS. MEASUREMENT

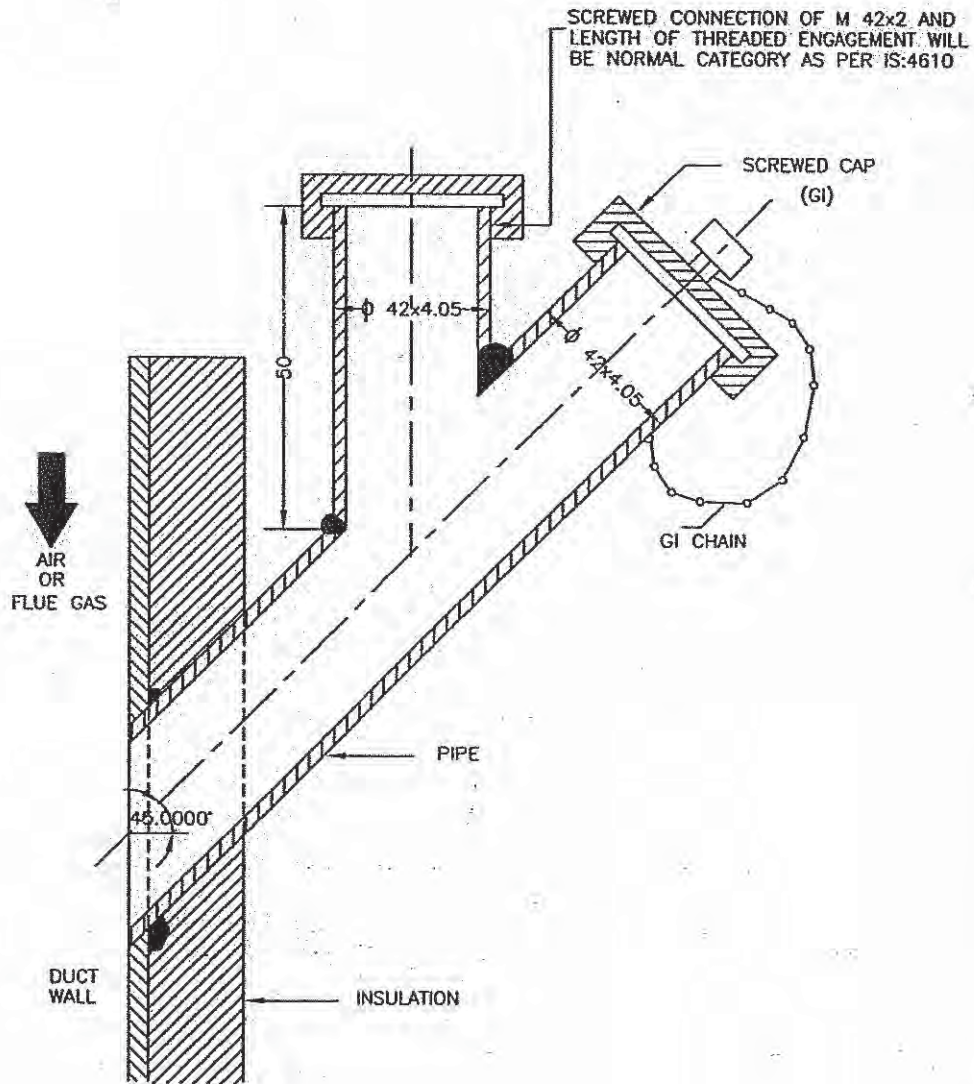



This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

NOTES:-

1. THIS TYPE OF PRESSURE CONNECTION SHALL BE PROVIDED FOR PRESSURE MEASUREMENTS IN AIR AND FLUE GAS DUCT/FURNACE.
2. DIMENSIONS ARE INDICATIVE ONLY.

FOR TENDER PURPOSE ONLY




		एन टी पी सी लिमिटेड NTPC LIMITED <small>(A GOVERNMENT OF INDIA ENTERPRISE)</small> <small>ENGINEERING DIVISION</small>	
PROJECT		TYPICAL THERMAL POWER PROJECT (STATION C&I PACKAGE)	
TITLE		INSTRUMENT SOURCE CONNECTION DETAILS	
REV. NO.	DESCRIPTION	DRG. NO.	REV. NO.
A	FIRST ISSUE	0000-405-POI-A-035	A
SIZE	SCALE	DRG. NO.	REV. NO.
A4	N.T.S.	0000-405-POI-A-035	A

APPROVED BY	DATE	CHECKED BY	DATE	DESIGNED BY	DATE	DRAWN BY	DATE
CLEARED BY							


This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

PRESSURE MEASUREMENT


(SYSTEM PR. >40Kg/Sq Cm CL 9000)

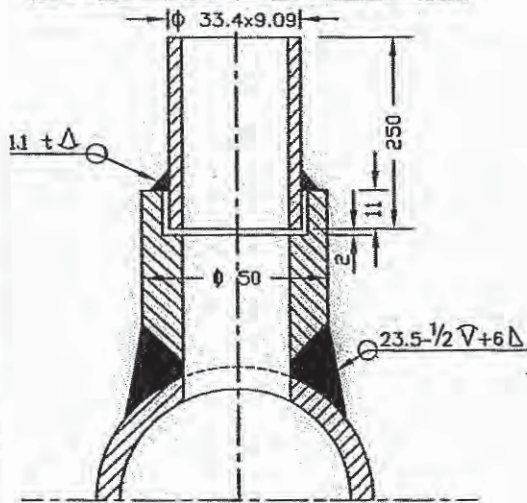


(SYSTEM PR. >40Kg/Sq Cm CL 6000)

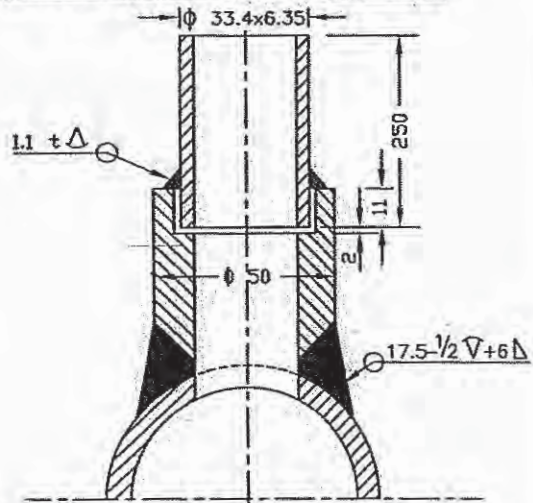

(SYSTEM PR. <40Kg/Sq cm Nb 25 CL 3000)

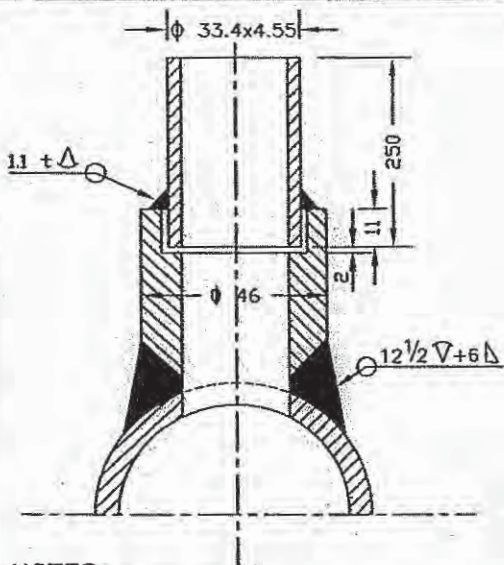


(SYSTEM PR. <40Kg/Sq cm Nb 15 CL 3000)

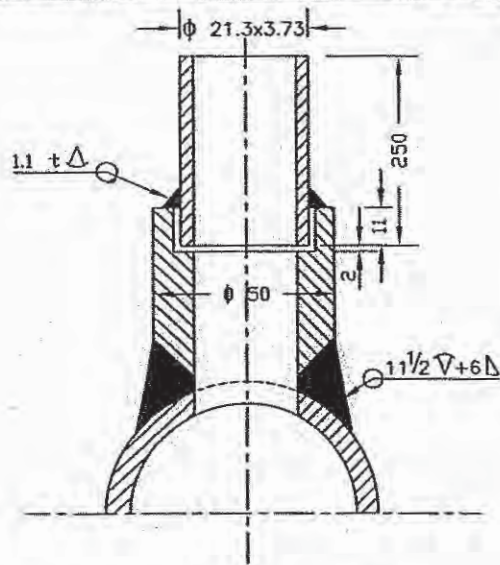

NOTES:--

1. MATERIAL OF THE BOSS AND NIPPLE SHALL BE THE SAME AS THE PIPE INTO WHICH IT IS WELDED AND CONFIRM TO ANSI B 16.11.
2. THE LENGTH OF THE NIPPLE SHOULD BE 250mm.
3. THE OTHER END OF THE NIPPLE SHALL BE SOCKET WELDED WITH 1" GLOBE VALVE OF MATERIAL AS PER ANSI B 16.1.
4. TWO ISOLATED VALVES ARE TO BE USED FOR PRESSURE = >40 Kg/Cm2 & TEMP. = >280°C.
5. EDGE HOLE MUST BE CLEAN AND SQUARE OR ROUNDED SLIGHTLY (1/64" RADIUS) FREE FROM BURRS, WIRE EDGES OR OTHER IRREGULARITIES.
6. ORIENTATION OF TAP WILL BE VARY WITH TYPE OF PROCESS FLUID AND NATURE OF RUN OF THE PIPE.
7. ACTIVITIES TO BE COMPLETED AT THE SHOP, WELD THE COUPLING (OR BOSS) ON THE PIPE AND DRILL PRESSURE CONNECTION HOLE (SAME AS I D OF NIPPLE) IN THE PIPE IN ALIGNMENT WITH HOLE IN THE COUPLING.
8. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.


FOR TENDER PURPOSE ONLY




		एन टी पी सी लिमिटेड NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION	
PROJECT		TYPICAL THERMAL POWER PROJECT (STATION C&I PACKAGE)	
TITLE		INSTRUMENT SOURCE CONNECTION DETAILS	
DRG. NO.	0000-405-POI-A-035	SCALE	N.T.S.
REV. NO.	A	SIZE	A4
Sh-2 Of 14			

NO.	DESCRIPTION	DIVN	DESIGN	CHKD.	M	E	C	CHK	INCH.	APPD.	DATE
A	FIRST ISSUE										
CLEARED BY											

PRESS. MEASUREMENT

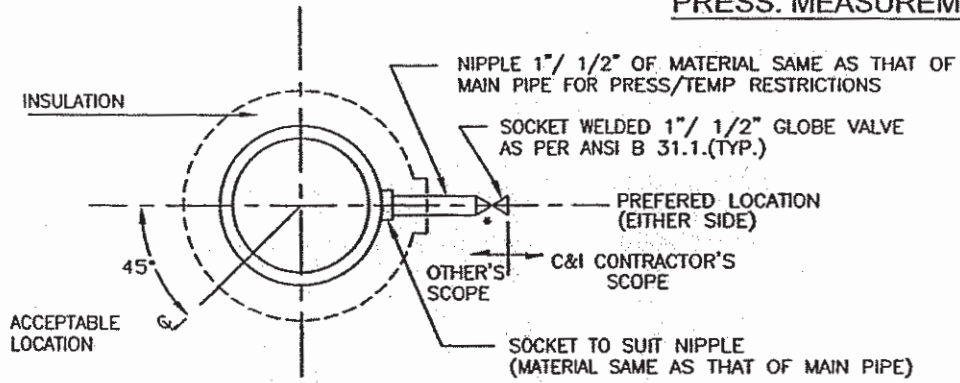


**ELEVATION
LIQUID SERVICE**

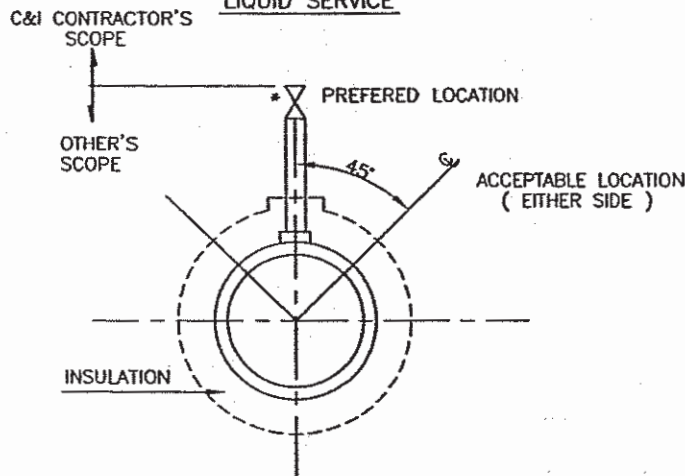

**ELEVATION
STEAM SERVICE**

PRESSURE CONNECTION ON HORIZONTAL PIPE

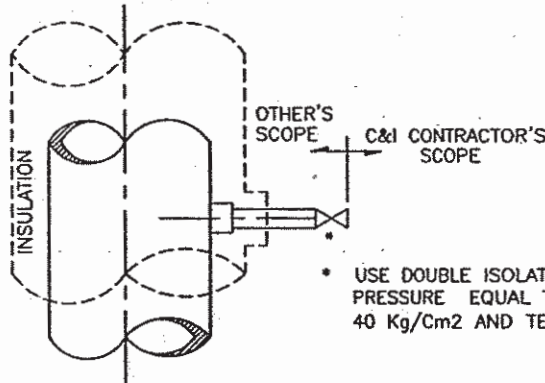


**ELEVATION
LIQUID OR STEAM SERVICE**

PRESSURE CONNECTIONS ON VERTICAL PIPES

• USE DOUBLE ISOLATION VALVES FOR PRESSURE EQUAL TO OR EXCEEDING 40 Kg/Cm2 AND TEMP. MORE THAN 280°C.



This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.



FOR TENDER PURPOSE ONLY


एन टी पी सी लिमिटेड NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION																																						
PROJECT TYPICAL THERMAL POWER PROJECT (STATION C&I PACKAGE)																																						
TITLE INSTRUMENT SOURCE CONNECTION DETAILS																																						
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 5%;">REV. NO.</td> <td style="width: 25%;">DESCRIPTION</td> <td style="width: 5%;">DRAWN</td> <td style="width: 5%;">DESIGN</td> <td style="width: 5%;">CHG.</td> <td style="width: 5%;">M</td> <td style="width: 5%;">E</td> <td style="width: 5%;">C</td> <td style="width: 5%;">C&I</td> <td style="width: 5%;">INSTR.</td> <td style="width: 5%;">APPR.</td> <td style="width: 5%;">DATE</td> <td style="width: 10%;">SIZE A4</td> <td style="width: 10%;">SCALE N.T.S.</td> <td style="width: 15%;">DRG. NO. 0000-405-POI-A-035</td> <td style="width: 10%;">REV. NO. A</td> </tr> <tr> <td colspan="12" style="text-align: center;">Cleared by</td> <td style="text-align: center;">Sh-1 of 14</td> </tr> </table>										REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHG.	M	E	C	C&I	INSTR.	APPR.	DATE	SIZE A4	SCALE N.T.S.	DRG. NO. 0000-405-POI-A-035	REV. NO. A	Cleared by												Sh-1 of 14
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHG.	M	E	C	C&I	INSTR.	APPR.	DATE	SIZE A4	SCALE N.T.S.	DRG. NO. 0000-405-POI-A-035	REV. NO. A																							
Cleared by												Sh-1 of 14																										

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

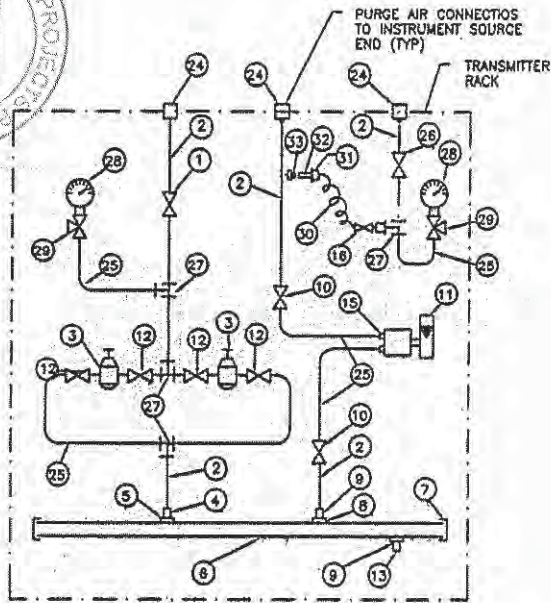

TYPICAL PURGE AIR CONNECTION INSIDE THE INST. ENCLOSURE

(APPLICABLE FOR AIR & FLUE GAS SERVICE INSTRUMENTS REQUIRING PURGE AIR)

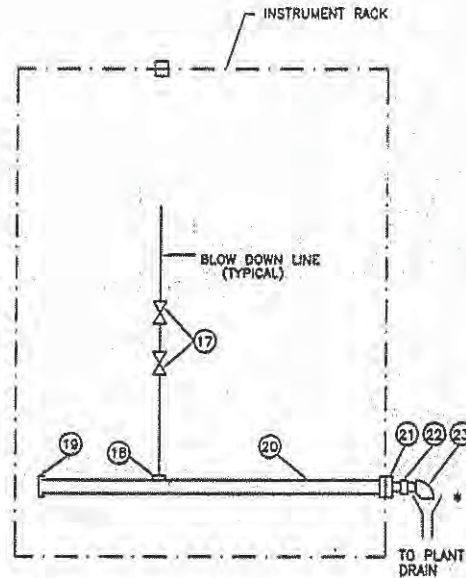

TYPICAL BLOW DOWN HEADER CONNECTION INSIDE THE INSTRUMENT RACK/ENCLOSURE

NOTE:-

- * 1. DRAIN SHALL BE CONNECTED BY THE BIDDER TO THE NEAREST PLANT DRAIN THROUGH OPEN FUNNEL (1/2").
- ** 2. FOR AIR/FLUE GAS LIE FOR DRAINING THE IMPULSE LINE BETWEEN ITEM 17 DRAIN POT TO BE PROVIDED ALONGWITH DRAIN HEADER, 3/4" SW HALF COUPLER, ITEM 19, 20, 22, 23 & FUNNEL ALONGWITH 1/2" PIPING TO PLANT DRAIN HEADER SHALL BE PROVIDED FOR STM/WATER. ALL ITEMS EXCEPT DRAIN POT TO BE PROVIDED.
- 3. GI PIPES SHALL BE PROVIDED FOR PURGE AIR CONNECTION OUTSIDE I/E/L/R.

LIST OF MATERIALS

ITEM NO.	DESCRIPTION
1.	ISOLATION VALVE(gate/globe). SS.
2.	1/2" O.D. SEAMLESS SS PIPE.
3.	1/2" NPT (F) AIR FILTER REGULATOR.
4.	1/2" NPT x 1/2" O.D. (M) CONNECTOR SS.
5.	1/2" NPT (F) COUPLER SS.
6.	1" NB INST. AIR HEADER SS.
7.	1" PSB END CAP SS.
8.	1/2" NPT (F) COUPLER SS.
9.	1/2" NPT x 1/2" O.D. (M) CONNECTOR SS.
10.	1/2" COMP. NEEDLE VALVE SS.
11.	1/2" NPT (F) AIR PURGE SET.
12.	1/2" NPT (M) x 1/2" COMP VALVE SS.
13.	1/2" NPT PLUG SS.
14.	
15.	1/2" TUBE SS CONNECTOR.
16.	1/2" TUBE COMP. EQUAL TEE UNION.
17.	DRAIN VALVE 1/2" SW FOR WTR/STM/COND & 3/4" FOR AIR/FLUE GAS.
18.	1/2" SW HALF COUPLER.
19.	2" SW CAP SS.
20.	2" NB ASTMA 105 GR. B SCH.80 BLOWDOWN HEADER
21.	2" PSW x 1" NPT (F) COUPLING.
22.	1" NPT x 1" BSP HEX NIPPLE.
23.	1" BSP ELBOW.
24.	BULKHEAD-SS 1/2" SW x 1/2" NB THREADED, SUITABLE FOR GI PIPE CONNECTION
25.	1/2" O.D. SEAMLESS TUBE SS.
26.	1/2" SW PRESS. GAUGE ISOLATION VALVE SS.
27.	1/2" TUBE x 1/2" NPT (F) BRANCH TEE SS.
28.	4" DIAL x 1/2" NPT PR. GAUGE.
29.	1/2" SW x 1/2" NPT (F) PR. GAUGE VALVE SS.
30.	1/2" I.D. NYLON FLEX HOSE BRAIDED WITH SS WIRE.
31.	1/2" NPT (M) x 1/2" HOSE BARBED CONN. SS.
32.	1/2" NPT (F) QUICK DISCONNECT SS.
33.	1/2" NPT (M) QUICKDISCONNECT SS.


FOR TENDER PURPOSE ONLY

		<p>एन टी पी सी लिमिटेड NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION</p>	
PROJECT		TYPICAL THERMAL POWER PROJECT (STATION C&I PACKAGE)	
TITLE		INSTRUMENT INSTALLATION DIAGRAM TYPICAL PURGE AIR CONNECTION & BLOWDOWN HEADER CONNECTION INSIDE INSTRUMENT RACK	
REV. NO.	DESCRIPTION	SIZE	SCALE
A	FIRST ISSUE	A3	N.T.S.
DATE	26.04.08	DRG. NO.	0000-405-POI-A-034
CLEARED BY		REV. NO.	A

CAD FILE NAME: D:\NORTH KARANPURA_3x660MW\0000-405-POI-A-034RA.DWG


09941

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

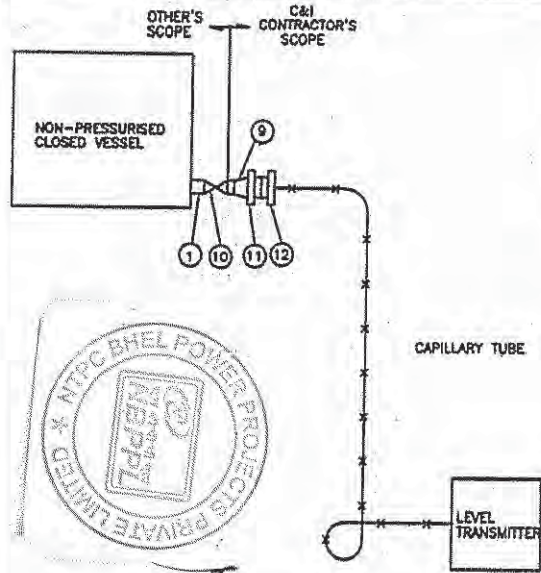

ELEVATION

LEVEL MEASUREMENT OF VISCOUS OR CORROSIVE LIQUID
IN CLOSED VESSEL USING FLUSH DIAPHRAGM/WAFER TYPE
LEVEL TRANSMITTER WITH REMOTE SEAL

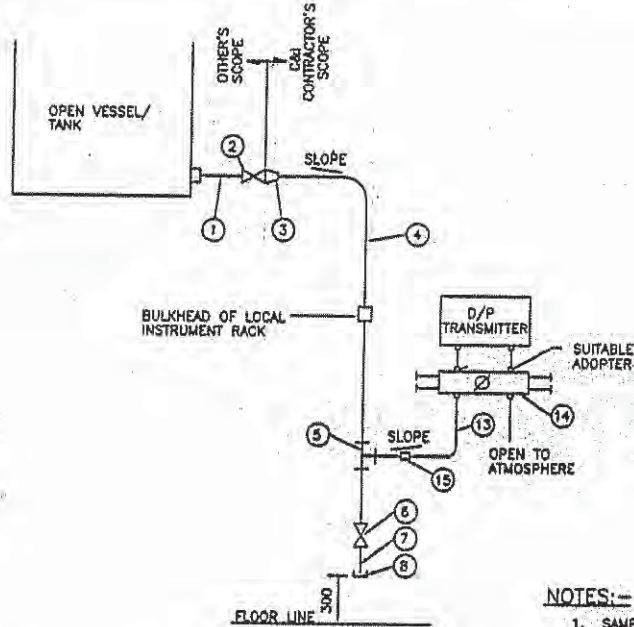

ELEVATION

LEVEL MEASUREMENT OF CLEAN LIQUID IN AN OPEN VESSEL
USING D/P TRANSMITTER

LIST OF MATERIALS

ITEM NO.	DESCRIPTION
1.	3/4" / 1" NPS 40/80 CARBON STEEL PIPE.
2.	3/4" SW GLOBE VALVE.
3.	3/4" / 1/2" SW REDUCING INSERT.
4.	1/2" NPS SCH. 40/80 CS PIPE.
5.	1/2" SW EQUAL TEE.
6.	1/2" SW GLOBE VALVE.
7.	1/2" NPS SWx1/2" NPT(M) CS NIPPLE.
8.	1/2" NPT (F) CS CAP.
9.	3/4" TO 4" EXPANDER.
10.	3/4" BUTT WELDED GATE VALVE.
11.	4" ANSI 300 lbs R.F. WELD NECK FLANGE.
12.	4" ANSI MATCHING FLANGE WITH FLUSH DIAPHRAGM OF LEVEL TRANSMITTER.
13.	SS TUBE.
14.	3-VALVE MANIFOLD (FOR DETAIL REF. DRG. NO. 0000-405-POI-A-023)
15.	1/2" PIPE x 1/2" TUBE UNION.

NOTES:-


1. SAME NOTES UNDER DRG. NO. 0000-405-POI-A-023.
2. FOR VACUUM APPLICATION OTHER PORT OF TRANSMITTER SHALL BE KEPT OPEN TO ATMOSPHERE.

FOR TENDER PURPOSE ONLY

<p>एन टी पी सी लिमिटेड NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION</p>	
PROJECT	TYPICAL THERMAL POWER PROJECT (STATION C&I PACKAGE)
TITLE	INSTRUMENT INSTALLATION DIAGRAM (LEVEL MEASUREMENT-OPEN VESSEL)
REV. NO.	A
DESCRIPTION	
DRAWN	DESIGN
CHKD.	
M	E
C	C&I
ARCH.	APPD
DATE	26.04.06
SIZE	A3
SCALE	N.T.S.
DRG. NO.	0000-405-POI-A-033
REV. NO.	A

09940

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

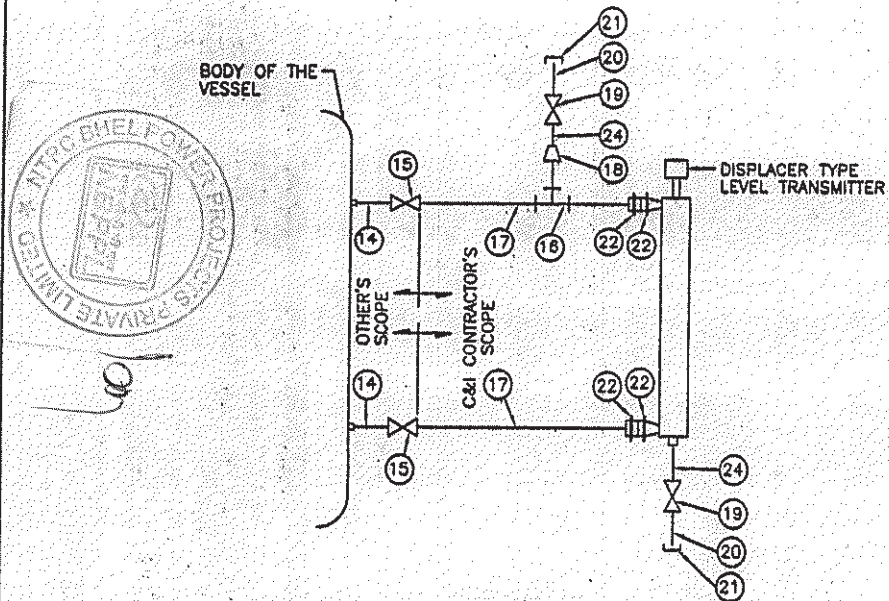

ELEVATION
DISPLACER TYPE LEVEL TRANSMITTER WITH SIDE CONNECTION

LIST OF MATERIALS

ITEM NO.	DESCRIPTION
1.	
2.	
3.	
4.	
5.	
6.	
7.	
8.	
9.	
10.	
11.	
12.	
13.	
14.	2" NPS SCH. 40/80 (AS PER PROCESS REQUIREMENT) VESSEL NOZZLE
15.	2" SW GLOBE VALVE.
16.	2" SW EQUAL TEE.
17.	2" NPS SCH. 40/80 CS/AS PIPE
18.	2" x 3/4" SW REDUCING INSERT.
19.	3/4" SW GLOBE VALVE
20.	3/4" NPS SW x 3/4" NPT (M) CS/AS NIPPLE.
21.	3/4" NPT (F) CS CAP.
22.	2" ANSI 300 lbs RAISED-FRASE WELD NECK FLANGE.
23.	2" ANSI FLANGE OF LEVEL TRANSMITTER.
24.	3/4" NPS SCH. 40/80 CARBON STEEL PIPE.

NOTES:-

- SAME NOTES AS UNDER DRG. NO.0000-405-POI-A-023 (WHICHEVER ARE RELEVANT).

FOR TENDER PURPOSE ONLY





एन टी पी सी लिमिटेड
NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT	TYPICAL THERMAL POWER PROJECT (STATION C&I PACKAGE)		
TITLE	INSTRUMENT INSTALLATION DIAGRAM (LEVEL MEASUREMENT USING DISPLACER TYPE TRANSMITTERS)		
SIZE	SCALE	DRG. NO.	REV. NO.
A3	N.T.S.	0000-405-POI-A-032	A

REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH.	APPD	DATE
A	FIRST ISSUE										28.04.06
					CLEARED BY						

00939

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

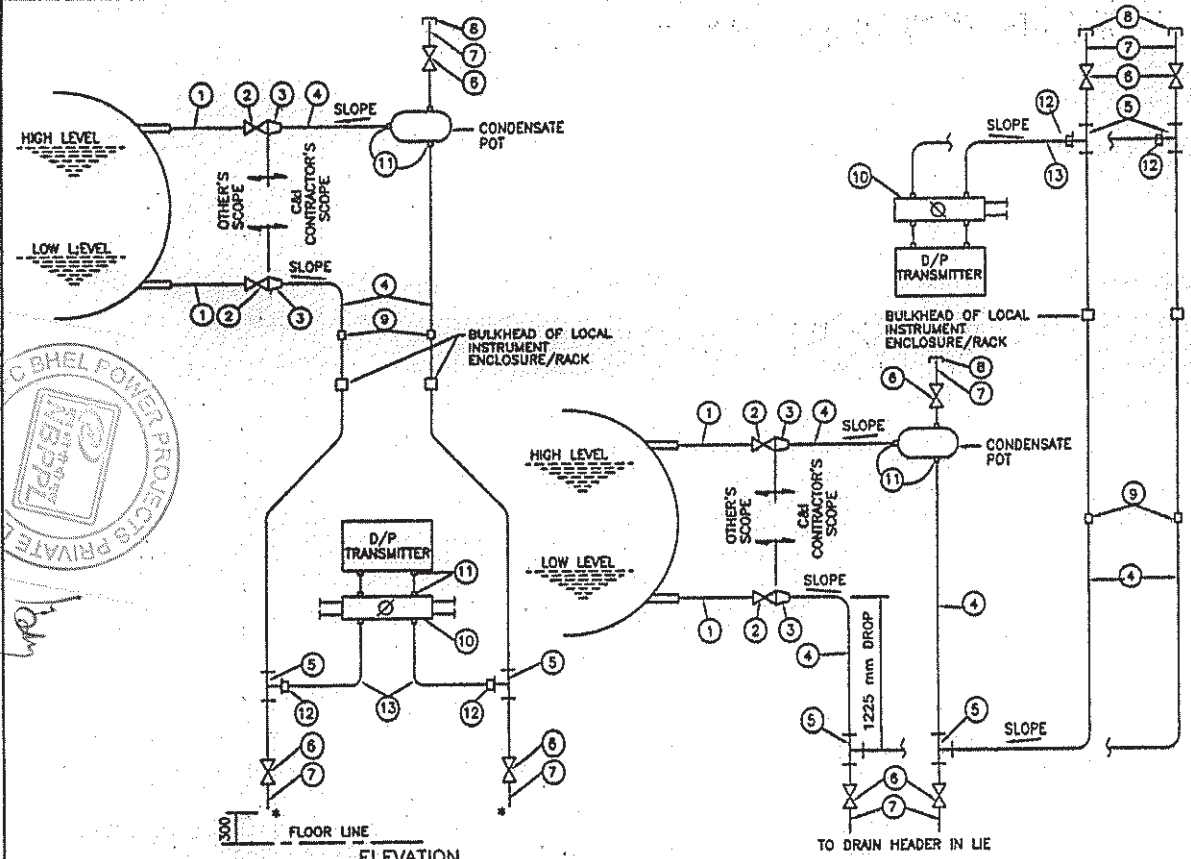

LIST OF MATERIALS

ITEM NO.	DESCRIPTION
1.	1" NPS SCH.40/80/160/XXS/#91 (AS PER PROCESS REQUIREMENT) CARBON /ALLOY STEEL PIPE.
2.	1" SW GLOBE VALVE.
3.	3/4"/1" TO 1/2" REDUCING INSERT.
4.	1/2" NPS SCH.80/160/XXS(AS PER PROCESS REQ.)CS/AS PIPE.
5.	1/2" SW EQUAL TEE.
6.	1/2" SW GLOBE VALVE.
7.	1/2" NPS SWx1/2" NPT(M) CS/AS NIPPLE.
8.	1/2 NPT (F) CS CAP.
9.	1/2" PIPE UNION.
10.	3-VALVE MANIFOLD (FOR DETAILS REF. DRG. NO.0000-405-POI-A-026).
11.	SUITABLE ADAPTER.
12.	1/2" PIPE x 1/2" TUBE UNION.
13.	S.S. TUBE.

NOTES:-

- 1. SAME NOTES AS UNDER DRG. NO.0000-405-POI-A-023. (WHICHEVER ARE RELEVANT).
- * TO DRAIN HEADER IN LIE/LIR.

ELEVATION
 TRANSMITTER MOUNTED BELOW INSTRUMENT SOURCE POINT TRANSMITTER MOUNTED ABOVE INSTRUMENT SOURCE POINT **FOR TENDER PURPOSE ONLY**

LEVEL MEASUREMENT OF CLEAR NON-VISCOUS OR NON-CORROSIVE LIQUID IN CLOSED VESSEL WITH CONDENSABLE ATMOSPHERE USING D/P TRANSMITTER

एन टी पी सी लिमिटेड NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE.) ENGINEERING DIVISION
PROJECT: TYPICAL THERMAL POWER PROJECT (STATION C&I PACKAGE)
TITLE: INSTRUMENT INSTALLATION DIAGRAM (LEVEL MEASUREMENT USING D/P TRANSMITTERS)
REV. NO. A FIRST ISSUE DATE: 28.04.06 DRAWN DESIGN CHKD. M E C C&I ARCH. APPD DATE CLEARED BY
SIZE: A3 SCALE: N.T.S. DRG. NO.: 0000-405-POI-A-032 REV. NO.: A SH 1 OF 2

09938