

5.00.00 **PERFORMANCE**

The actuator shall meet the following performance requirements:

- 5.01.00 Open and close the valve completely and make leak-tight valve closure without jamming.
- 5.02.00 Attain full speed operation before valve load is encountered and imparts an unseating blow to start the valve in motion (hammer blow effect).
- 5.03.00 Operate the valve stem at standard stem speed and shall function against design differential pressure across the valve seat.
- 5.04.00 The motor reduction gearing shall be sufficient to lock the shaft when the motor is de-energised and prevent drift from torque switch spring pressure.
- 5.05.00 The entire mechanism shall withstand shock resulting from closing with improper setting of limit switches or from lodging of foreign matter under the valve seat.

6.00.00 **SPECIFIC REQUIREMENT**

6.01.00 **Construction**

- 6.01.01 The actuator shall essentially comprise the drive motor, torque/ limit switches, gear train, clutch, hand wheel, position indicator/ transmitter, in-built thermostat for over load protection, space heater and internal wiring.
- 6.01.02 The actuator enclosure shall be totally enclosed, dust tight, weather-proof suitable for outdoor use without necessity of any canopy. Degree of protection of enclosure for motor actuator shall be IP-65.
- 6.01.03 All electrical equipment, accessories and wiring shall be provided with tropical finish to prevent fungus growth.
- 6.01.04 The actuator shall be designed for mounting in any position without any lubricant leakage or operating difficulty.

6.02.00 **Motor**

- 6.02.01 The drive motor shall be three phase, squirrel cage, induction machine with minimum class B insulation and IPW-55 enclosure, designed for high torque and reversing service. Canopy shall be provided for outdoor service.
- 6.02.02 The motor shall be designed for full voltage direct on-line start, with starting current limited to 6 times full-load current.
- 6.02.03 The motor shall be capable of starting at 85 percent of rated voltage and running at 80 percent of rated voltage at rated torque and 85 percent rated voltage at 33 percent excess rated torque for a period of 5 minutes each.
- 6.02.04 Motor leads shall be terminated in the limit switch compartment.
- 6.02.05 Motor actuators for valves/dampers shall be with integral starter with 3phase/3wire, 415V AC and operable from remote.

- 6.02.06 Earthing terminals shall be provided on either side of the motor.
- 6.03.00 **Limit Switches**
- Each actuator shall be provided with following limit switches: -
- 6.03.01 2 torque limit switches, one for each direction of travel, self-locking, adjustable torque type.
- 6.03.02 4 end-of-travel limit switches, two for each direction of travel.
- 6.03.03 2 position limit switches, one for each direction of travel, each adjustable at any position from fully open to fully closed positions of the valve/damper.
- 6.03.04 Each limit switch shall have 2 NO + 2 NC potential free contacts. Contact rating shall be 5A at 240V A.C. or 0.5A at 220V D.C.
- 6.04.00 **Hand Wheel**
- Each actuator shall be provided with a hand wheel for emergency manual operation. The hand wheel shall de-energize automatically when the motor is energized.
- 6.05.00 **Position Indicator/Transmitter**
- The actuator shall have:
- 6.05.01 One (1) built-in local position indicator for 0-100% travel.
- 6.05.02 One (1) position transmitter, 4-20 mA current signal as position feedback, for remote indicator.
- 6.06.00 **Space Heater**
- A space heater shall be included in the limit switch compartment suitable for 240V, 1 phase, 50 Hz supply.
- 6.07.00 **Wiring**
- All electrical devices shall be wired up to and terminated in a terminal box. All wiring shall be done with 1100 V grade fire resistance PVC insulated stranded copper conductor of not less than 2.5 Sq.mm cross section. All wiring shall be identified at both ends with ferrules. All the electrical actuators shall have uniform wiring.
- 6.08.00 **Terminal Box**
- The terminal box shall be weather proof, with removable front cover and cable glands for cable connection. The terminal shall be suitable for connection of 2.5 Sq.mm copper conductor.
- 7.00.00 **ACCESSORIES**

As required for the driven equipment, the actuator shall be furnished with starting equipment mounted on the actuator. This shall include:

- 7.01.00 One (1) triple pole MCCB
- 7.02.00 One (1) reversing starter with mechanically interlocked contactors, 3 thermal overload relays, 2 NO + 2 NC auxiliary contacts for each contactor.
- 7.03.00 One (1) remote-local selector switch.
- 7.04.00 CLOSE-STOP-OPEN oil tight push buttons with indication lights.
- 7.05.00 415/240 V control transformer with primary & secondary fuses.

8.00.00 **TEST**

The actuator and all components thereof shall be subject to tests as per relevant Standards. In addition, if any special test is called for in equipment specification, the same shall be performed.

9.00.00 **DRAWINGS, DATA & MANUALS**

- 9.01.00 Drawings, Data & Manuals shall be submitted in triplicate with the bid and in quantities and procedures as specified in General Conditions of Contract and/or elsewhere in the specification for approval and subsequent distribution after the issue of 'Letter of Intent'.

9.02.00 **To be submitted with Bid**

Data sheet for each type of actuator shall be furnished along with internal wiring diagram, suggested control schematic and torque limit switch contact development and manufacturer's catalogues. Drawings, Data & Manuals shall be submitted in triplicate with the bid and in quantities and procedures as specified in General Conditions of Contract and/or elsewhere in the specification for approval and subsequent distribution after the issue of 'Letter of Intent'.

9.03.00 **To be submitted for Owner / Purchaser's Approval and Distribution**

All relevant drawings and data pertaining to the equipment like GTP, GA drawing, foundation plan, BOM, control & schematics, QAP, etc. shall be submitted by the Bidder for approval of Owner/Owner's consultant. Also refer clause no. 1.19.02(u) of Section-I of Volume – V-A : Technical Specifications for Electrical Equipment & Accessories.

  
VIVEK KUMAR, SA Khan, Praveen Mishra

**ANNEXURE-A**

**DESIGN DATA**

1.0 AUXILIARY POWER SUPPLY

S	upply	Description	Consumer
	L.V. Supply (i)	415V, 3Ø, 3W, 50 Hz Effectively earthed  Fault level 50 kA symm. for 1 sec.	u Motors above 0.2kW pto less than 175kW.
	(ii)	240V AC/415V AC  240V, 1Ø, 2W, 50 Hz effectively earthed	Motors upto 0.2kW.  o Lighting, Space heat- ing , A.C supply for Contr- l & protective devices.
	D.C. Supply	220V, 2W, unearthed  Fault level 25* kA. for 1 sec.	& D.C. alarm, control protective devices

\* Indicative only, the actual value will be decided by the Bidder, after substantiating the same by calculation.

2.0 RANGE OF VARIATION

A.C. Supply :

V	oltage	:	± 10%
	Frequency	:	+3% to -5%.
	Combined Volt + frequency	:	10% (absolute sum)

During starting of large motor, the voltage may drop to 80% of the rated voltage for a period of 60 seconds. All electrical equipment while running shall successfully ride over such period without affecting system performance.

D.C. Supply :

Voltage	:	187 to 242
---------	---	------------



Technical specification for  
**CONTROL & INSTRUMENTATION**

**1X800 MW KOTHAGUDEM**

SPEC NO.: **PE-TS-410-145-I**

VOLUME

SECTION

REV. NO. 00

DATE : 18.03.2015

SHEET OF

# Actuator Data Sheet

  
VIVEK KUMAR SA Khan Praveen Kishore



**SPECIFICATION  
FOR  
MOTORISED VALVE ACTUATOR**

SPECIFICATION NO.:

VOLUME

SECTION

REV. NO.

00

DATE: 06.01.2015

SHEET

1

OF

3

**Data Sheet A & B**

DATA SHEET-A  
(TO BE FILLED BY PURCHASER)

DATA SHEET-B  
(TO BE FILLED-UP BY BIDDER)

<b>GENERAL*</b>	* PROJECT	<b>1 X 800 MW KOTHAGUDAM TPS</b>	
	OFFER REFERENCE		
	* TAG NO. SERVICE		
	* DUTY	<input type="checkbox"/> ON / OFF	<input type="checkbox"/> INCHING
	* LINE SIZE (inlet/outlet): MATERIAL		
	* VALVE TYPE	<input type="checkbox"/> GLOBE <input type="checkbox"/> GATE <input type="checkbox"/> REG. GLOBE <input type="checkbox"/> BUTTERFLY	
	* OPENING / CLOSING TIME		
	* WORKING PRESSURE		
	AMBIENT CONDITION	SHALL BE SUITABLE FOR CONTINUOUS OPERATION UNDER AN AMBIENT TEMP. OF 0-55 DEG C AND RELATIVE HUMIDITY OF 0-95%	
	VALVE SEAT TEST PRESS	BIDDER TO SPECIFY	
	REQUIRED VALVE TORQUE	BIDDER TO SPECIFY	
ACTUATOR RATED TORQUE	BIDDER TO SPECIFY		
<b>CONSTRUCTION AND SIZING</b>	CONSTRUCTION	TOTALLY ENCLOSED, DUST TIGHT, WEATHER PROOF, SUITABLE FOR OUTDOOR USE WITHOUT CANOPY, IP:65	
	MECHANICAL POSITION INDICATOR	TO BE PROVIDED FOR 0-100% TRAVEL	
	BEARINGS	DOUBLE SHIELDED, GREASE LUBRICATED ANTI-FRICTION.	
	GEAR TRAIN FOR LIMIT SWITCH/TORQUE SWITCH OPERATION	METAL (NOT FIBRE GEARS). SELF-LOCKING TO PREVENT DRIFT UNDER TORQUE SWITCH SPRING PRESSURE WHEN MOTOR IS DE-ENERGIZED.	
	SIZING	OPEN/CLOSE AT RATED SPEED AGAINST DESIGNED DIFFERENTIAL PRESSURE AT 90% OF RATED VOLTAGE. FOR ISOLATING SERVICE THREE SUCCESSIVE OPEN-CLOSE OPERATIONS OR 15 MINS. WHICHEVER IS HIGHER. FOR REGULATING SERVICE - 150 STARTS/HR MINIMUM	
<b>HANDWHEEL</b>	* REQUIRED	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	
	* ORIENTATION	<input type="checkbox"/> TOP MOUNTED <input type="checkbox"/> SIDE MOUNTED	
	*TO DISENGAGE AUTOMATICALLY DURING MOTOR OPERATION.		
<b>ELECTRIC ACTUATOR</b>	ACTUATOR MAKE/MODEL	BIDDER TO SPECIFY	
	MOTOR MAKE / MODEL / TYPE / RATING (KW)	BIDDER TO SPECIFY	
	@ MOTOR TYPE	SQUIRREL CAGE INDUCTION MOTOR, STARTING CURRENT LIMITED TO SIX TIMES THE RATED CURRENT-INCLUSIVE OF I.S. TOLERANCE	
	ACTUATOR APPLICABLE WIRING DIAGRAM	<input checked="" type="checkbox"/> ENCLOSED <input checked="" type="checkbox"/> DRG. NO. 3-V-MISC-24227 R00 (INDICATIVE)	
	COLOUR SHADE	<input checked="" type="checkbox"/> BLUE (RAL 5012), To be decided during detail engg.	
	PAINT TYPE (## Refer Notes)	<input type="checkbox"/> ENAMEL <input checked="" type="checkbox"/> EPOXY <input type="checkbox"/> .....	
	SHAFT RPM	BIDDER TO SPECIFY	
	OLR SET VALUE	BIDDER TO SPECIFY	
	@ STARTING / FULL LOAD CURRENT	BIDDER TO SPECIFY	
	NO. OF REV FOR FULL TRAVEL	BIDDER TO SPECIFY	
	@ PWR SUPP TO MTR / STARTER	415V, 3PH, AC, 3 WIRE	
	@ CONTROL VOLTAGE REQUIREMENT	TO BE DERIVED FROM THE POWER SUPPLY TO THE STARTER <input type="checkbox"/> 230 V <input type="checkbox"/> 110 V	
	@ ENCLOSURE CLASS OF MOTOR	<input type="checkbox"/> IP 65 <input type="checkbox"/> FLAME PROOF	



**SPECIFICATION  
FOR  
MOTORISED VALVE ACTUATOR**

SPECIFICATION NO.:	
VOLUME	
SECTION	
REV. NO.	00
DATE:	06.01.2015
SHEET	2 OF 3

**Data Sheet A & B**

DATA SHEET-A  
(TO BE FILLED BY PURCHASER)

DATA SHEET-B  
(TO BE FILLED-UP BY BIDDER)

	@ INSULATION CLASS	CLASS-F TEMP. RISE LIMITED TO CLASS-B	
	@ WINDING TEMP PROTECTION	<input checked="" type="checkbox"/> THERMOSTAT (3 Nos.,1 IN EACH PHASE) <input type="checkbox"/> _____	
	SINGLE PHASE / WRONG PHASE SEQUENCE PROTECTION	REQUIRED	
<b>INTEGRAL STARTER</b>	INTEGRAL STARTER	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	TYPE OF SWITCHING DEVICE	<input checked="" type="checkbox"/> CONTACTORS <input type="checkbox"/> THYRISTORS	
	TYPE	<input checked="" type="checkbox"/> CONVENTIONAL <input type="checkbox"/> SMART (NON-INTRUSIVE)	
	<b>IF SMART</b>	NOT APPLICABLE	
	a) SERIAL LINK INTERFACE	<input type="checkbox"/> INTEGRAL <input type="checkbox"/> FIELD MOUNTED	
	b) SERIAL LINK PROTOCOL	<input type="checkbox"/> FOUNDATION FIELD-BUS <input type="checkbox"/> PROFI-BUS <input type="checkbox"/> DEVICE NET <input type="checkbox"/> .....	
	c) SERIAL LINK MEDIA	<input type="checkbox"/> TWISTED PAIR Cu-CBL <input type="checkbox"/> CO-AXIAL Cu-CBL <input type="checkbox"/> OFC	
	d) HAND HELD PROGRAMMER	<input type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	e) TYPE OF HAND HELD PROGRAMMER	<input type="checkbox"/> BLUETOOTH <input type="checkbox"/> INFRARED <input type="checkbox"/> .....	
	f) MASTER STATION	<input type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	g) MASTER STN INTRFACE WITH DCS	<input type="checkbox"/> MODBUS <input type="checkbox"/> TCP/IP	
	h) DETAILS OF SPECIAL CABLE	<input type="checkbox"/> ENCLOSED <input type="checkbox"/> NOT REQUIRED	
	STEP DOWN CONT. TRANSFORMER	<input checked="" type="checkbox"/> REQUIRED	
	OPEN / CLOSE PB	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	STOP PB	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	INDICATING LAMPS	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
LOCAL REMOTE S/S	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED		
STATUS CONTACTS FOR MONITORING	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED		
INTEGRAL STARTER DISTURBED SIGNAL	REQUIRED (O/L RELAY OPERATED, CONT. /POWER SUPPLY FAILED, S/S IN LOCAL, TORQUE SWITCH OPTD. MID WAY)		
<b>INTERPOSING RELAY/OPTO COUPLER</b> (Applicable for integral Starter)	TYPE OF ISOLATING DEVICE	<input checked="" type="checkbox"/> INTERPOSING RELAY <input type="checkbox"/> OPTO COUPLER <input type="checkbox"/> EITHER	
	QUANTITY	<input type="checkbox"/> 2 Nos. <input checked="" type="checkbox"/> 3 Nos.	
	DRIVING VOLTAGE	<input checked="" type="checkbox"/> 20.5 – 24V DC <input type="checkbox"/> _____ V DC	
	DRIVING CURRENT	<input checked="" type="checkbox"/> 125mA MAX <input type="checkbox"/> _____ mA MAX	
	LOAD RESISTANCE	<input checked="" type="checkbox"/> > 192 ohms - <25 k ohms <input type="checkbox"/> > _____ ohms - < _____ ohms	
<b>TORQUE SWITCH</b> (Not Applicable for Smart Actuator) <b>(\$\$ Refer Notes)</b>	MFR & MODEL NO.	BIDDER TO SPECIFY	
	OPEN / CLOSE	<input checked="" type="checkbox"/> 1 No. <input type="checkbox"/> 2Nos. / <input checked="" type="checkbox"/> 1 No. <input type="checkbox"/> 2Nos	
	CONTACT TYPE	2 NO + 2 NC	
	RATING	5A 240V AC AND 0.5A 220V DC	
	CALIBRATED KNOBS(OPEN&CLOSE TS)	REQUIRED FOR SETTING DESIRED TORQUE	
	ACCURACY	+3% OF SET VALUE	
<b>LIMIT SWITCH</b> (Not Applicable for Smart Actuator) <b>(\$\$ Refer Notes)</b>	MFR & MODEL NO.	BIDDER TO SPECIFY	
	OPEN : INT : CLOSE	<input type="checkbox"/> 1 No <input checked="" type="checkbox"/> 2 Nos. (ADJ.) <input type="checkbox"/> 1 No. <input checked="" type="checkbox"/> 2 Nos. <input checked="" type="checkbox"/> 2Nos.	
	CONTACT TYPE	2 NO + 2 NC	
	RATING (AC / DC)	5A 240V AC AND 0.5A 220V DC	

VIVEK KUMAR SA Khan Praveen Kishore



**SPECIFICATION  
FOR  
MOTORISED VALVE ACTUATOR**

SPECIFICATION NO.:

VOLUME

SECTION

REV. NO.

00

DATE: 06.01.2015

SHEET

3

OF 3

**Data Sheet A & B**

DATA SHEET-A  
(TO BE FILLED BY PURCHASER)

DATA SHEET-B  
(TO BE FILLED-UP BY BIDDER)

<b>POSITION TRANSMITTER</b>	POSITION TRANSMITTER	<input checked="" type="checkbox"/> REQUIRED <input type="checkbox"/> NOT REQUIRED	
	MFR & MODEL NO.	BIDDER TO SPECIFY	
	TYPE	<input type="checkbox"/> ELECTRONIC (2 WIRE) R/I CONVERTER <input checked="" type="checkbox"/> ELECTRONIC (2 WIRE) CONTACTLESS	
	SUPPLY	<input checked="" type="checkbox"/> 24V DC <input type="checkbox"/> .....	
	OUTPUT	<input checked="" type="checkbox"/> 4-20mA	
	ACCURACY	<input checked="" type="checkbox"/> ± 1% FS	
<b>SPACE HEATER</b>	@SPACE HEATER	REQUIRED	
	@ POWER SUPPLY (NON INTEGRAL)	240V AC, 1 PH., 50 Hz	
	@ POWER SUPPLY (INTEGRAL)	240V AC , 1 PH/415/240 V CTRL TRANSFORMER WITH PRIMARY AND SECONDARY FUSES	
	@ RATING		
<b>TERMINAL BOX</b>	ACTUATOR/MOTOR TERMINAL BOX	REQUIRED	
	ENCL CLASS ACTUATOR/MOTOR T.B.	<input type="checkbox"/> IP 68                      @ <input type="checkbox"/> .....	
	@ EARTHING TERMINAL	REQUIRED	
	PLUG & SOCKET(9 PIN) (FOR COMM, LS/TS FEED BACK, PoT)	<input type="checkbox"/> REQUIRED <input checked="" type="checkbox"/> NOT REQUIRED <input type="checkbox"/> 2 NOS. <input type="checkbox"/> .....	
<b>CABLE GLANDS</b>	@ POWER CABLE GLAND	SIZE:-----	
	@ SPACE HEATER CABLE GLAND	SIZE:-----	
	OTHER CONTROL CABLE GLANDS-1	INSTRUMENT CABLE SIZE FOR ON/OFF DUTY VALVES SHALL BE 8PX0.5 SQMM - ONE CABLE GLAND OF OD SIZE 20 MM.	
	OTHER CONTROL CABLE GLANDS-2	INSTRUMENT CABLE SIZE FOR INCHING DUTY TYPE VALVES SHALL HAVE TWO NO. CABLES (ONE NO. 8PX0.5 SQMM AND 2ND 2PX0.5 SQMM) - TWO NO. GLANDS OF OD SIZES 20 MM & 15 MM.	
<b>WEIGHT</b>	TOTAL WEIGHT (ACTUATOR + ACCESSORIES)	BIDDER TO SPECIFY	_____ Kg.

**NOTES:**

- SCOPE:** DESIGN, MANUFACTURE, INSPECTION, TESTING AND DELIVERY TO SITE OF ELECTRIC ACTUATOR FOR INCHING OR OPEN / CLOSE DUTY.
  - CODES & STANDARDS:** DESIGN AND MATERIALS USED SHALL COMPLY WITH THE RELEVANT LATEST NATIONAL AND INTERNATIONAL STANDARD. AS A MINIMUM, THE FOLLOWING STANDARDS SHALL BE COMPLIED WITH:  
IS-9334, IS-2147, IS-2148, IS-325, IS-2959, IS-4691 AND IS-4722
  - TEMPERATURE RISE SHALL BE RESTRICTED TO 70 DEG. C FOR AMBIENT TEMPERATURE OF 50 DEG C.
  - CABLE GLANDS OF DOUBLE COMPRESSION TYPE, BRASS MATERIAL, WITH NICKEL COATING SHALL BE PROVIDED.
  - THE TORQUE SWITCHES SHALL BE PROVIDED WITH MECHANICAL LATCHING DEVICE TO PREVENT OPERATION WHEN UNSEATING FROM THE END POSITIONS. THE LATCHING DEVICE SHALL UNLATCH AS SOON AS THE VALVE LEAVES THE END POSITION. IF SUCH PROVISION IS NOT POSSIBLE, THE TORQUE SWITCHES SHALL BE BYPASSED BY END-POSITION LIMIT SWITCHES WHICH OPENS ON VALVE LEAVING END POSITION. THESE LIMIT SWITCHES ARE ADDITIONAL TO THE NUMBER OF LIMIT SWITCHES SPECIFIED ELSEWHERE.
  - THE MOTOR SHALL OPERATE SATISFACTORILY UNDER THE +/- 10% SUPPLY VOLTAGE VARIATION AT RATED FREQUENCY. -5% TO +3% VARIATION IN FREQUENCY AT RATED SUPPLY VOLTAGE, SIMULTANEOUS VARIATION IN VOLTAGE & FREQUENCY THE SUM OF ABSOLUTE PERCENTAGE NOT EXCEEDING 10%.
  - THE MOTOR SHALL BE SUITABLE FOR DIRECT ON LINE STARTING.
- \$\$ TORQUE SWITCH & LIMIT SWITCH SHALL ACT INDEPENDENT OF EACH OTHER. TANDEM OPERATION IS NOT ACCEPTABLE.**
- ## EPOXY PAINT IS RECOMMENDED FOR COASTAL AREAS.**

**VENDOR COMPANY SEAL**


NAME

SIGNATURE

DATE

NOTES\* = TO BE FILLED BY MPL (LEAD AGENCY),    @ = TO BE FILLED BY ES

DRAWING NO. 3-V-MISC-24227

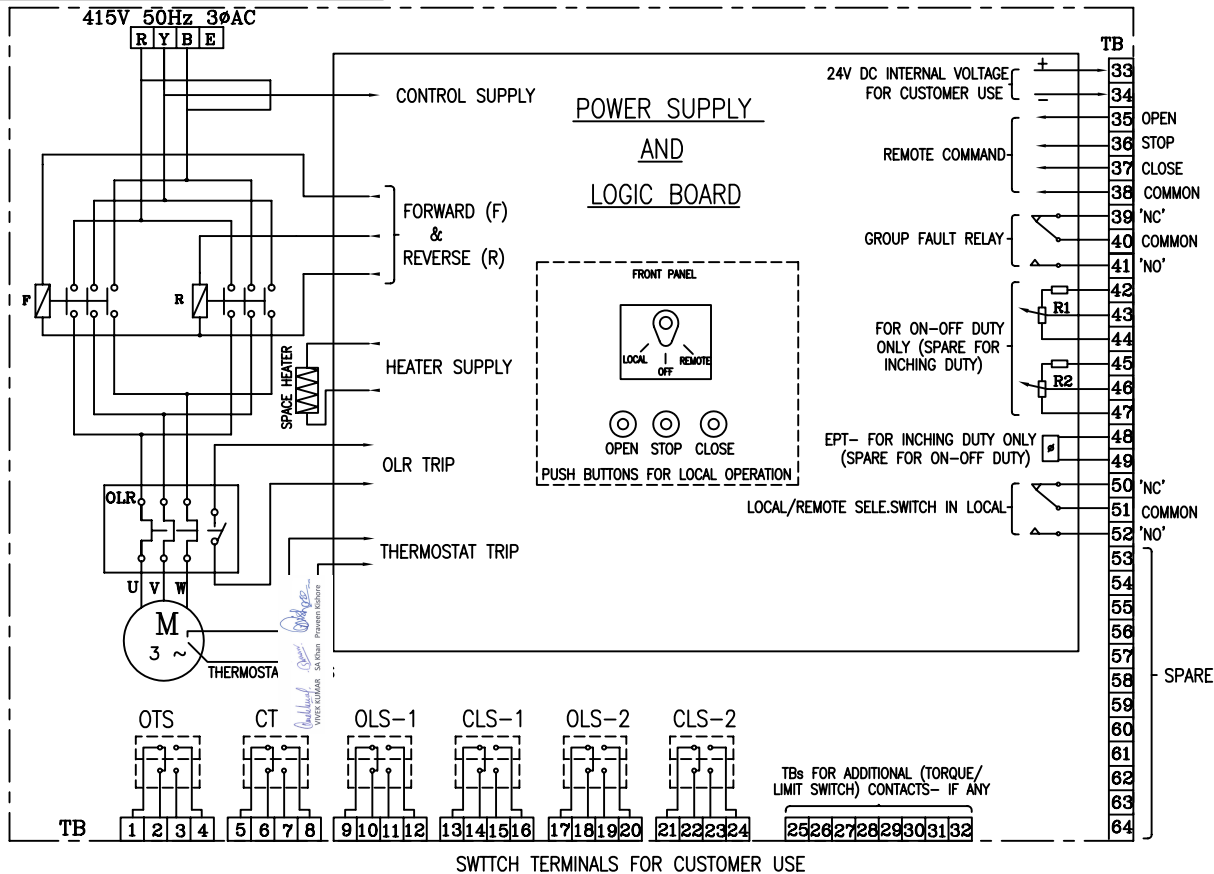

### CONTACT DEVELOPMENT DIAGRAM

OTS	1-2	OPEN AT OVER TORQUE DURING OPENING TRAVEL		
	3-4	CLOSE AT OVER TORQUE DURING OPENING TRAVEL		
CTS	5-6	OPEN AT OVER TORQUE DURING CLOSING TRAVEL		
	7-8	CLOSE AT OVER TORQUE DURING CLOSING TRAVEL		
OLS-1	9-10	INDICATES CONTACT CLOSED		
	11-12	INDICATES CONTACT OPEN		
CLS-1	13-14	INDICATES CONTACT CLOSED		
	15-16	INDICATES CONTACT OPEN		
OLS-2	17-18	INDICATES CONTACT CLOSED		
	19-20	INDICATES CONTACT OPEN		
CLS-2	21-22	INDICATES CONTACT CLOSED		
	23-24	INDICATES CONTACT OPEN		
SWITCH	TERMINAL NO.	FULL OPEN	INTERMEDIATE	FULL CLOSE
		a	b	
	VALVE POSITION			
	INDICATES CONTACT CLOSED			
	INDICATES CONTACT OPEN			

CONTACT RATING: 5A AT 250V AC & 0.5A AT 220V DC

### SETTING PROCEDURE OF POSITION LIMIT AND TORQUE SWITCH

VALVES	OPEN		CLOSE	
	MAIN	BACK UP	MAIN	BACK UP
GATE VALVE OF 100 mm AND ABOVE IN 1500 CL AND ABOVE RATINGS	OLS	OTS *	CLS	CTS
ALL OTHER GATE & GLOBE VALVES	OLS	OTS *	CTS	#

# - CLS NOT TO BE CONNECTED IN TRIP CIRCUIT  
\* - BYPASS OTS FOR INITIAL 5% OF TRAVEL (FOR GATE VALVES ONLY)

- NOTE:-
- ALL TORQUE AND LIMIT SWITCHES (OTS,CTS,OLS1&2, CLS1&2) ARE WITH 2NO+2NC CONTACTS '1NO+1NC' IS TERMINATED IN TBS 1-24, REMAINING CONTACTS ARE FOR INTERNAL USE. ANY SPARE CONTACTS WHICH ARE NOT USED INTERNALLY ARE TO BE TERMINATED IN TBS 25-32
  - CTS - TORQUE SWITCHES FOR CW ROTATION (CLOSE)
  - OTS - TORQUE SWITCHES FOR CCW ROTATION (OPEN)
  - OLS-1, OLS-2 - LIMITSWITCHES FOR POSITION OPEN
  - CLS-1, CLS-2 - LIMITSWITCHES FOR POSITION CLOSE
  - EPT - ELECTRONIC POSITION TRANSMITTER (Contactless, FOR INCHING DUTY)
  - R1-R2-POTENTIOMETER 2 x 100 OHMS (FOR ON-OFF DUTY)
  - FOR COMMANDS & EPT EITHER INTERNALLY GENERATED 24VDC OR EXTERNAL SUPPLY OF 24VDC CAN BE USED
  - M - MOTOR 3φ 415V 50 Hz AC SUPPLY

REV	DATE	ALTERED
		CHD & APPD

**CAUTION:** The information on this document is the property of BHARAT HEAVY ELECTRICALS LTD. It must not be used directly or indirectly in any way detrimental to the interest of the company.

<b>TYPE OF PRODUCT</b> ELECTRICAL VALVE ACTUATORS (AC) WITH INTEGRAL STARTERS <b>OR NAME OF CUSTOMER/PROJECT</b> (DRAWN FOR INTERMEDIATE POSITION OF VALVES)	
BHARAT HEAVY ELECTRICALS LTD., UNIT: HIGH PRESSURE BOILER PLANT, TIRUCHIRAPALLI-620014.	DRN N.P.ESWAR CHD D.DINAKARAN APPD K.ARUNACHALAM
DEPT VL CODE	SCALE WEIGHT (KG). REFERENCE INFORMATION NO. OF ITEMS
TITLE WIRING DIAGRAM (TERMINAL PLAN) FOR ACTUATOR WITH INTEGRAL STARTER	CARD CODE U 01 DRAWING NO. 3-V-MISC-24227 REV 0



Technical specification for  
**CONTROL & INSTRUMENTATION**

**1X800 MW KOTHAGUDEM**

SPEC NO.: **PE-TS-410-145-I**

VOLUME

SECTION

REV. NO. 00

DATE : 18.03.2015


SHEET OF

# Drive Control Philosophy

  
VIVEK KUMAR SA Khan Praveen Kishore




# PLC INTERFACE FOR UNIDIRECTIONAL LT DRIVE

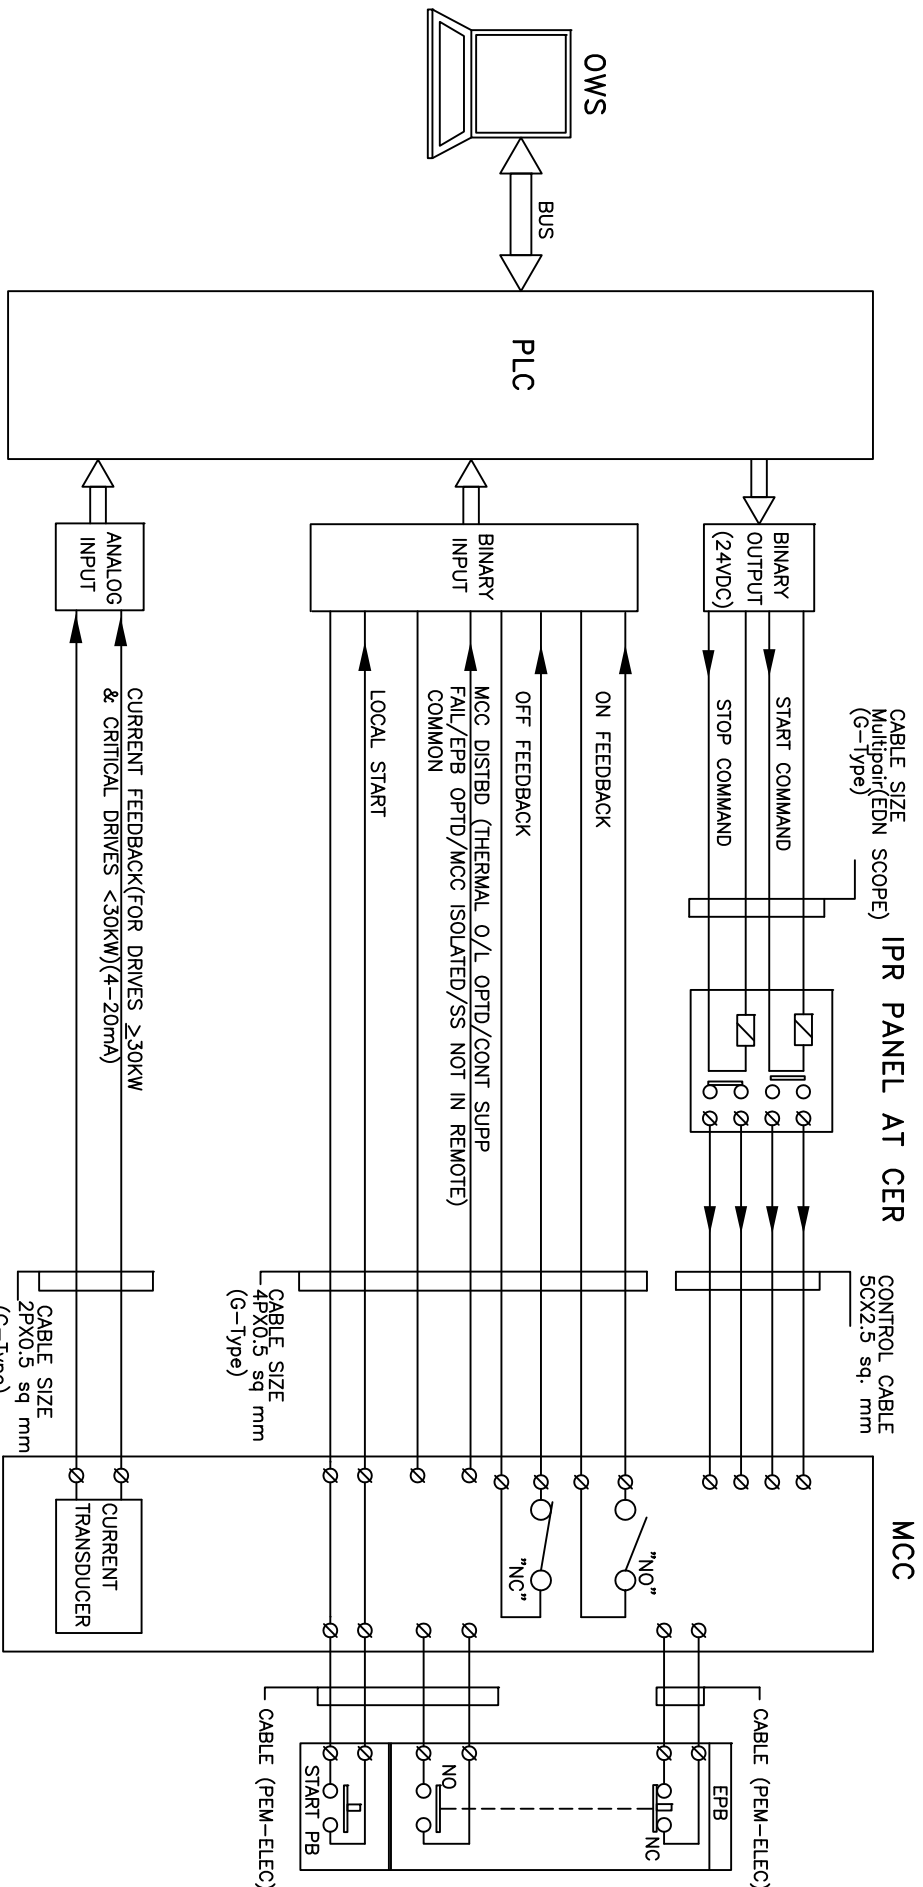

\* FOR LTUD DRIVES ALL LUBE OIL PUMPS, SCANNER AIR FANS, SEAL AIR FANS, 4-20mA CURRENT TRANSDUCER SHALL BE CONSIDERED.


<b>PROJECT:</b>	<b>1X800 KOTHAGUDEM TPS</b>
<b>TITLE:</b>	<b>STAGE-VII, UNIT-12</b>
<b>PLC INTERFACE FOR</b>	<b>UNIDIRECTIONAL LT DRIVE</b>
<b>DRG. NO.</b>	<b>PE-DM-410-145-1002</b>
<b>DATE</b>	<b>12.03.2015</b>
<b>REV. NO.</b>	<b>00</b>
<b>SHT</b>	<b>8 OF 11</b>

# PLC INTERFACE FOR SOLENOID DRIVE (24V DC / 240V AC UPS)

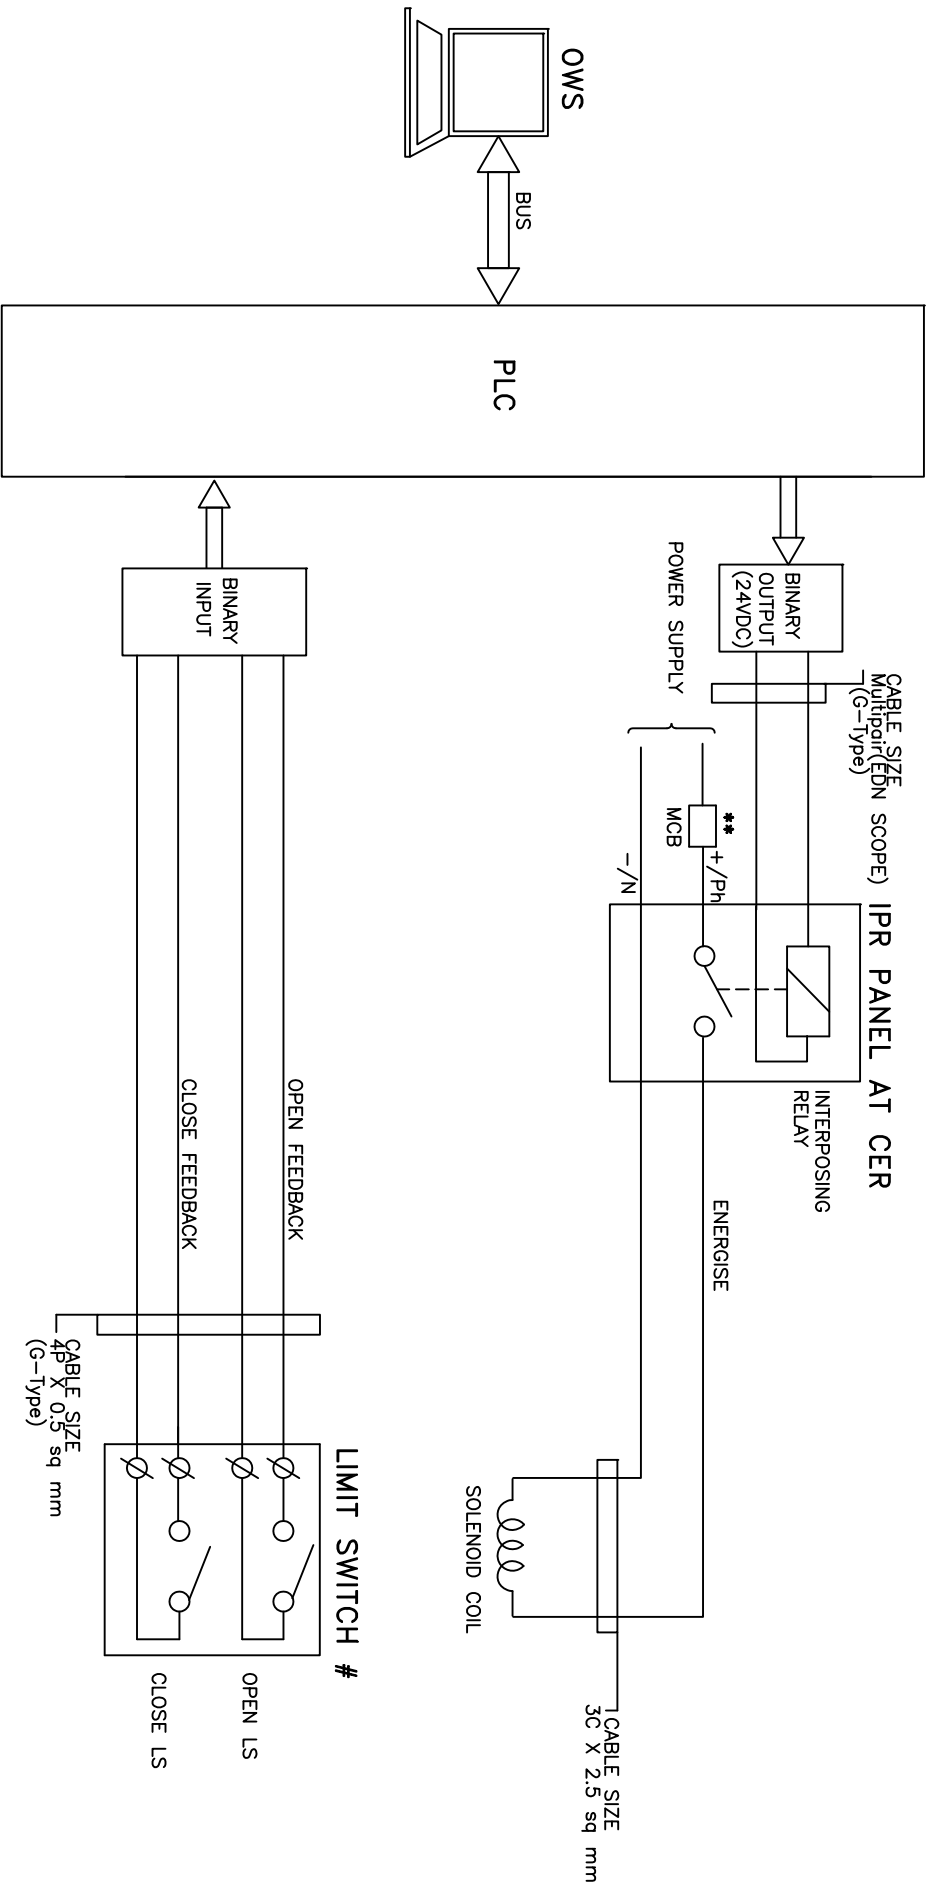


NOTES:

- \*\* MCB SHALL BE PROVIDED FOR EACH SOLENOID
- # FOR ON/OFF TYPE, SOLENOID ACTUATED CONTROL VALVE.

		<b>PROJECT:</b> 1X800 KOTHAGUDEM TPS STAGE-VII, UNIT-12	
<b>TITLE:</b> PLC INTERFACE FOR SOLENOID DRIVE (SINGLE COIL)		<b>DRG. NO.:</b> PE-DM-410-145-1002	<b>DATE:</b> 12.03.2015
SA KHAN VIVEK KUMAR	SA KHAN PRAVEEN KISHORE	<b>REV. NO.:</b> 00	<b>SHT</b> 9 <b>OF</b> 11




# PLC INTERFACE FOR HT/LT UNIDIRECTIONAL DRIVES(BREAKER OPERATED)

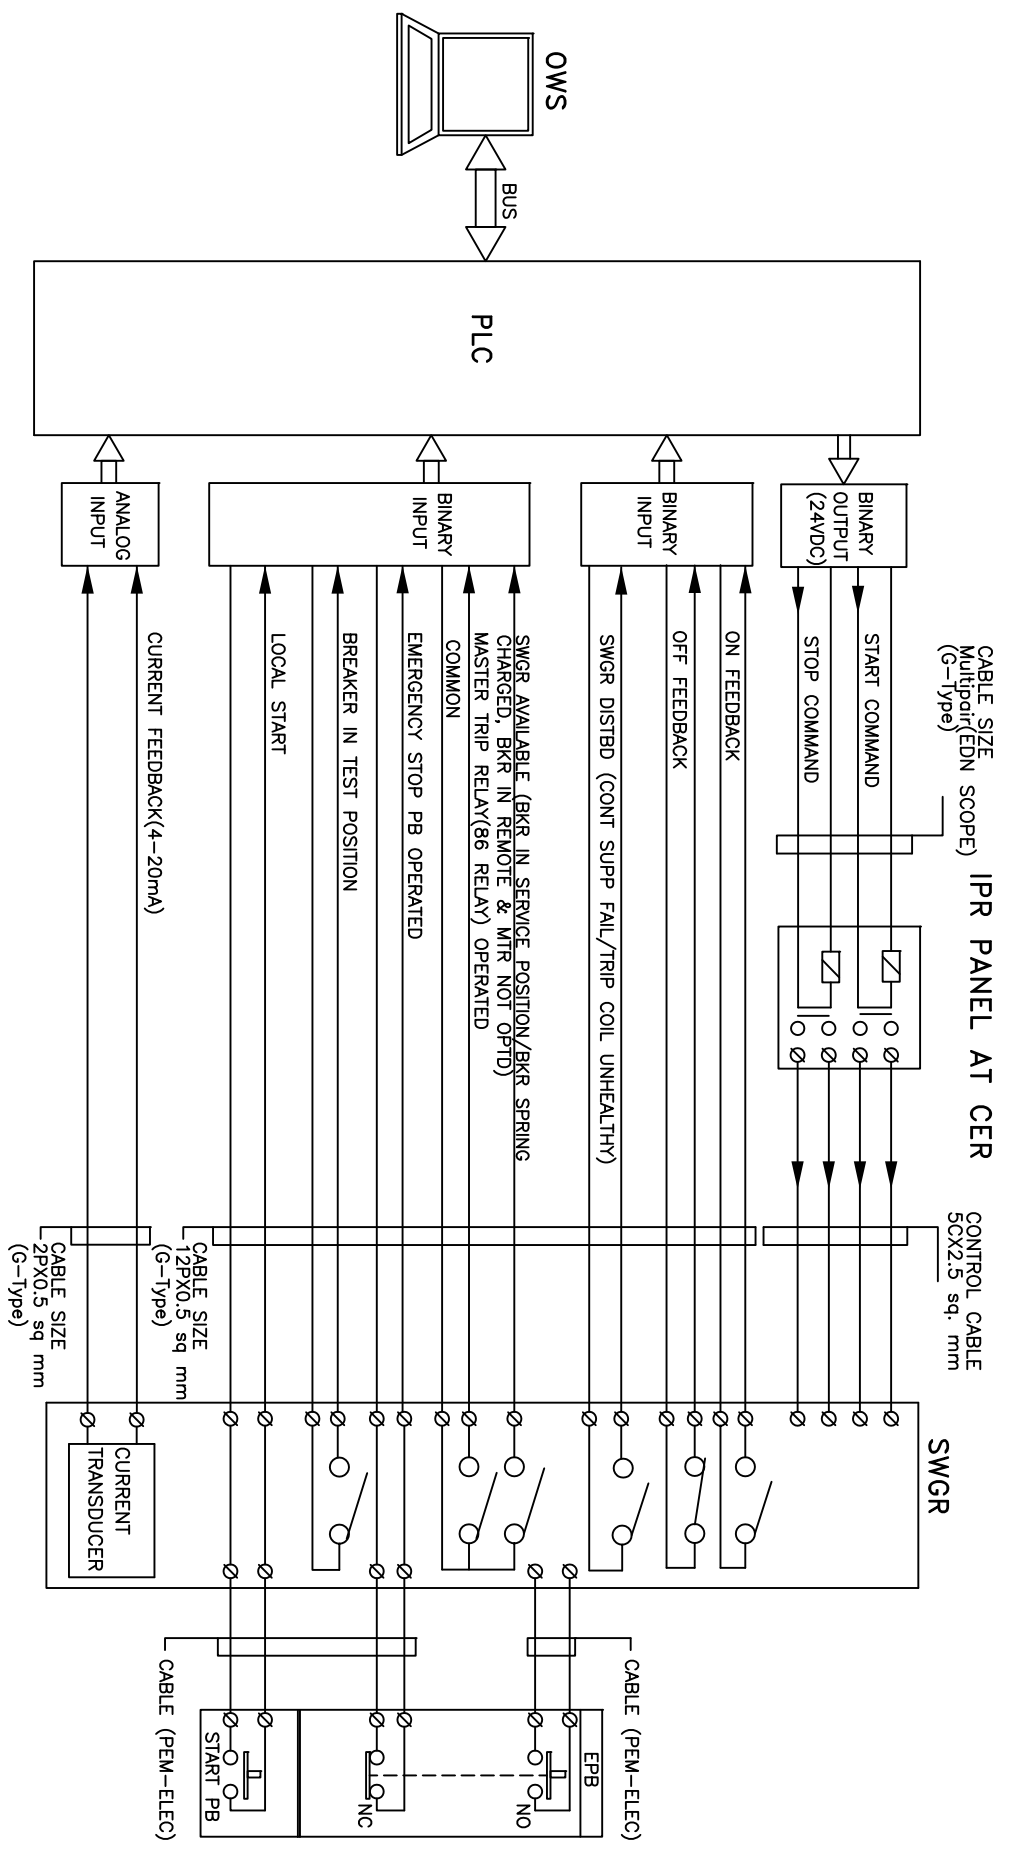

<b>PROJECT:</b> 1X800 KOTHAGUDEM TPS		DRG.NO.	PE-DM-410-145-1002
<b>TITLE:</b> PLC INTERFACE FOR UNIDIRECTIONAL HT DRIVE		DATE	12.03.2015
		REV.NO.	00
		SHT	10 OF 11



  
 M/s. Praveen Kishore
   
 VIVEK KUMAR SA KHAN
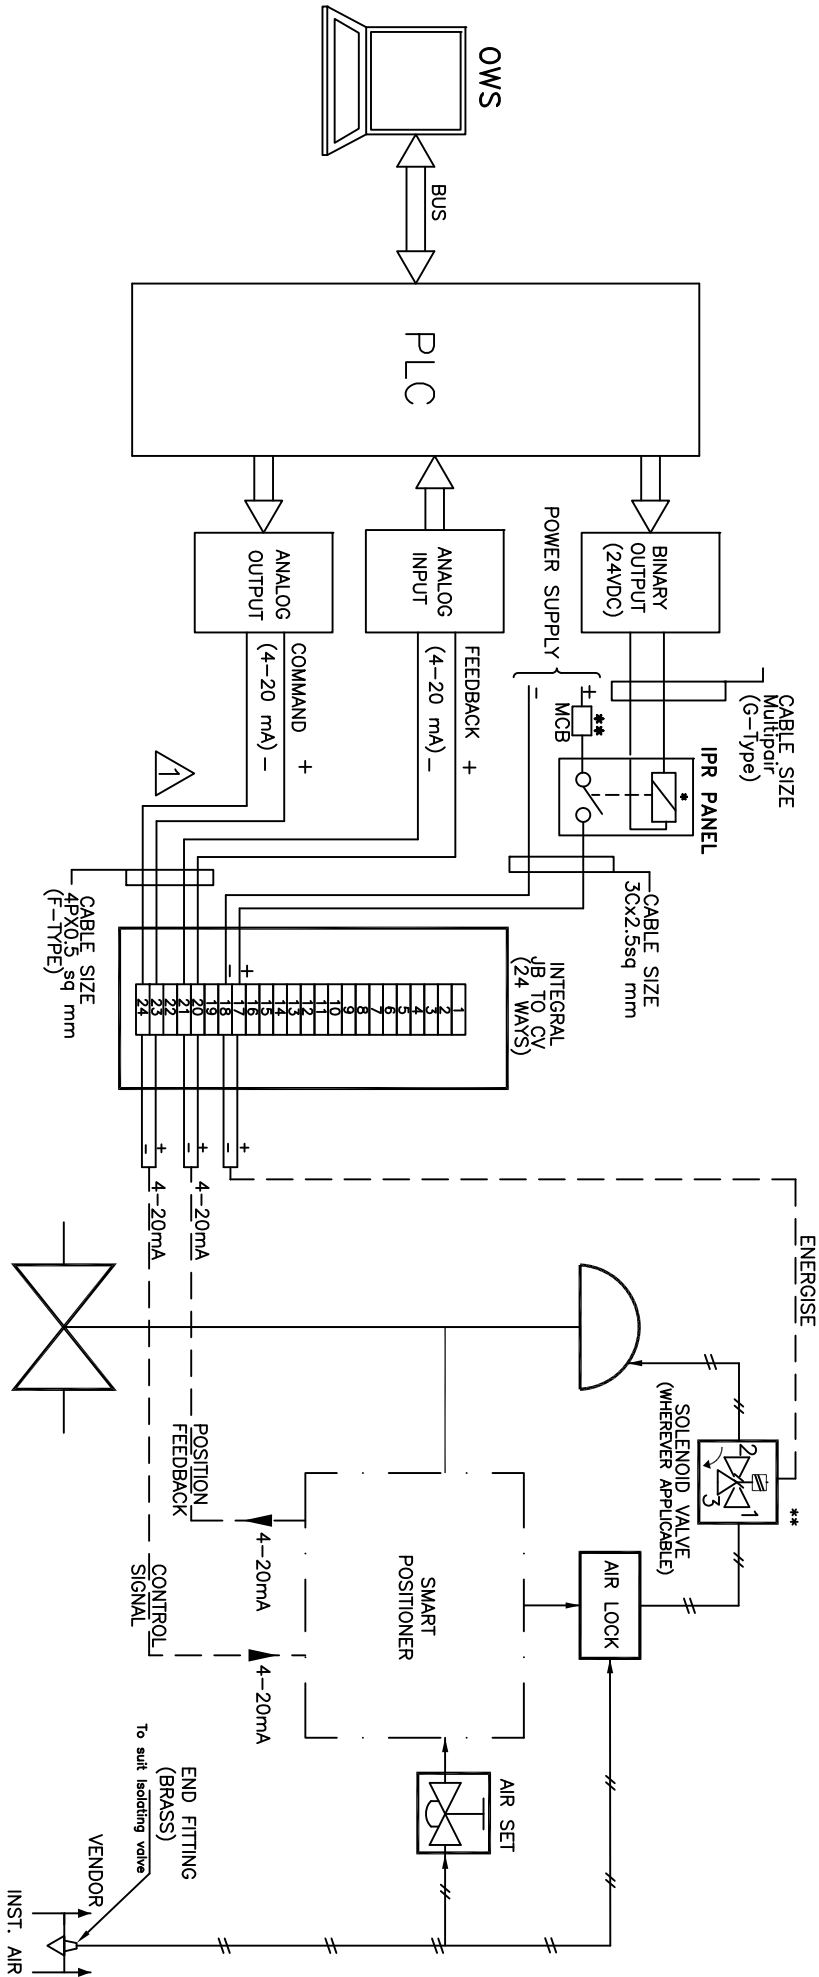
# PLC INTERFACE FOR ANALOG DRIVE (WITH SMART POSITIONER)



NOTES:

\*\* APPLICABLE TO VALVES WHERE PROTECTION OPEN/CLOSE ACTION FOR CONTROL DEMAND OVERRIDING IS REQUIRED.

		<b>PROJECT:</b> 1X800 KOTHAGUDEM TPS STAGE-VII, UNIT-12	
<b>TITLE:</b> TYPICAL HOOK-UP DIAGRAM ANALOG DRIVE (WITH SMART POSITIONER)		<b>DRG. NO.:</b> PE-DM-410-145-1002	<b>DATE:</b> 12.03.2015
Mr. Praveen Kishore SA KHAN	Mr. Vivek Kumar	<b>REV. NO.:</b> 00	<b>SHT:</b> 11 OF 11



Technical specification for  
**CONTROL & INSTRUMENTATION**

**1X800 MW KOTHAGUDEM**

SPEC NO.: **PE-TS-410-145-I**

VOLUME

SECTION

REV. NO. 00

DATE : 18.03.2015

SHEET OF

# INSTRUMENTATION DATA SHEET

  
VIVEK KUMAR SA Khan Praveen Kishore

1.00.00 SPECIFICATION FOR ELECTRONIC TRANSMITTERS

1.01.00 PRESSURE TRANSMITTER

1. Working Principle : Smart (HART Compatible)
2. Type : Microprocessor based, 2 – Wire
3. Output Signal : 4-20 mA DC along with superimposed digital signal
4. Measuring Element : Capsule / Diaphragm
5. Element material : SS-316 (Stainless Steel) or better
6. Static Pressure : 150 % of maximum span continuously, without affecting the calibration
7. Turn-down ratio : 100: 1
8. Span and Zero : Continuous, tamper proof, remote as well locally adjustable with zero elevation and suppression by 100% of span
9. Enclosure Class : IP-65 (Explosion proof for NEC Class-1, Division 1 area)
10. Output Indicator : LCD (Integral indicator of 5 digit display)
11. Nameplate : Tag number, service engraved in SS tag plate
12. Body : SS
13. Operating Voltage : 24V DC
14. Load : 600 Ohms (min.) at 24 Volts D.C.
15. Ambient Temperature : 0 - 50 °C
16. Performance: :
  - i. Accuracy :  $\pm 0.075\%$  of Span or better

- ii. Repeatability :  $\pm 0.05\%$  of Span or better
17. Sealing/Isolation : Extended diaphragm (Silicon oil/ Fluorolub filled ) with 5 meters SS armoured capillary for corrosive/viscous/solid bearing or slurry type fluid applications
18. Accessories :
- a. Universal mounting bracket suitable for 2" pipe mounting
  - b. High tensile carbon steel U-bolts
  - c. Siphon for steam and hot water services
  - d. 1/2" NPT 2-valve stainless steel manifold, constructed from SS316 bar stock
  - e. Companion flange with nuts, bolts and gaskets
  - f. 1/2" NPT cable gland
  - g. Handheld calibrator
19. Adjustment/Calibration/ Maintenance : From handheld calibrator/ HART management system

Notes: For primary air/ secondary air/ flue gas applications, DP type transmitters shall be provided for pressure measurement.  
LVDT type is not acceptable.

1.02.00 DIFFERENTIAL PRESSURE TRANSMITTER / FLOW TRANSMITTER

- 1. Working Principle : Smart (HART Compatible)
- 2. Type : Microprocessor based, 2 – Wire
- 3. Output Signal : 4-20 mA DC along with superimposed digital signal
- 4. Measuring Element : Capsule / Diaphragm

- 
5. Element material : SS-316 (Stainless Steel) or better
6. Static Pressure : 150 % of maximum span continuously, without affecting the calibration
7. Turn-down ratio : 100: 1
8. Span and Zero : Continuous, tamper proof, remote as well locally adjustable with zero elevation and suppression by 100% of span
9. Enclosure Class : IP-65 (Explosion proof for NEC Class-1, Division 1 area)
10. Output Indicator : LCD (Integral indicator of 5 digit display)
11. Nameplate : Tag number, service engraved in SS tag plate
12. Body : SS
13. Operating Voltage : 24V DC
14. Load : 600 Ohms (min.) at 24 Volts D.C.
15. Ambient Temperature : 0 - 50 °C
16. Performance:
- i. Accuracy :  $\pm 0.075\%$  of Span or better
  - ii. Repeatability :  $\pm 0.05\%$  of Span or better
17. Sealing/Isolation : Extended diaphragm (Silicon oil/ Fluorolub filled ) with 5 meters SS armoured capillary for corrosive/viscous/solid bearing or slurry type fluid applications
18. Accessories :
- a. Universal mounting bracket suitable for 2" pipe mounting
  - b. High tensile carbon steel U-bolts

- c. Siphon for steam and hot water services
- d. ½” NPT 5-valve stainless steel manifold, constructed from SS316 bar stock
- e. Companion flange with nuts, bolts and gaskets
- f. ½” NPT cable gland
- g. Handheld calibrator

19. Adjustment/Calibration/ Maintenance : From handheld calibrator/ HART management system

1.03.00 Displacer Type Level Transmitters

- 1. Type : Smart (HART Compatible)
- 2. Stages of operation : Continuous
- 3. Material :
- 4. i. Displacer : SS-316
- 5. ii. Suspension wire : SS-316
- 6. iii. Torque tube housing : SS
- 7. iv. Torque tube : Inconel
- 8. v. Displacer chamber : SS
- 9. vi. Transmitter Housing : SS
- 10. Operating Voltage : 24 V DC
- 11. Transmission : Microprocessor based, 2-wire
- 12. Output Signal : 4-20 mA DC along with superimposed digital signal
- 13. Static / overload : Maximum static pressure without

  
 Vivek Kumar, SA Khan, Praveen Mishra

	pressure		permanent deformation or loss of accuracy
14.	Turn-down ratio	:	10 : 1 or better
15.	Zero & Span	:	Continuous, tamper proof, remote as well locally adjustable with zero elevation and suppression by 100% of span
16.	Enclosure Class	:	IP-65
17.	Output Indicator	:	LCD type (Integral indicator of 5 digit display)
18.	Nameplate	:	Tag number and Service engraved in stainless steel tag plate
19.	Ambient Temperature	:	0 - 50 °C
20.	Load Impedance	:	600 Ohms at 24 Volts (minimum)
21.	Process Connection	:	2" Flanged
22.	Performance - Accuracy	:	± 0.075 % of span or better
23.	Accessories	:	<ul style="list-style-type: none"> <li>a) Counter Flange, nuts, bolts, gaskets etc</li> <li>b) Weights for 5 point calibration of instruments</li> <li>c) Vent and drain plugs</li> <li>d) ½" NPT Glands</li> <li>e) Handheld calibrator</li> </ul>
24.	Preferred Features	:	<ul style="list-style-type: none"> <li>a) Test plug connection and cutout terminals physically separated from other electronics</li> <li>b) Electronic Damping facility (adjustable)</li> </ul>
25.	Adjustment/Calibration/ Maintenance	:	From handheld calibrator/ HART management system

- 
26. Applications : During detail engineering on Owner's approval
- 1.04.00 MASS FLOW METER
- 1.04.01 SENSOR
1. Measuring Principle : Coriolis Mass flow
  2. Primary Element : Flow Tube of 316SS or better
  3. Heating Arrangement : Integral
  4. Temperature Control : For heavy fuel oil application
  5. Process Connection : Flanged of rating as per process requirement
  6. Drain : Self-draining facility
  7. Enclosure : Stainless steel
  8. Accessories : Counter flanges, Mounting nuts, bolts, gaskets etc.
- 1.04.02 TRANSMITTER
1. Measured quantities : Mass Flow rate, Total Mass Flow, Density
  2. Input Signal Processing : Smart (HART compatible)
  3. Display : LCD
  4. Output : 2 nos. isolated output of 4-20mA DC selectable from four measured quantities
  5. Load : < 750 ohms
  6. Power supply : 240V AC, 50 Hz

- |     |   |   |   |
|-----|---|---|---|
| 7.  | Turn Down                               | : | 100:1   |
| 8.  | Accuracy                                | : | $\pm 0.2$ % of measured value   |
| 9.  | Housing                                 | : | IP 65 (Explosion proof)   |
| 10. | Nameplate                               | : | Tag number, service engraved in stainless steel tag plate   |
| 11. | Accessories                             | : | a) Handheld calibrator<br>b) Mounting U-bolts, nuts, bolts, prefab cable etc<br>c) $\frac{1}{2}$ "NPT cable gland |
| 12. | Adjustment/Calibration/<br>/Maintenance | : | From handheld calibrator/ HART management system  |
| 13. | Applications                            | : | Fuel Oil service  |

1.05.00 RADAR TYPE LEVEL MEASUREMENT

- |    |                           |   |   |
|----|---------------------------|---|---|
| 1. | Type                      | : | Smart (HART Compatible)   |
| 2. | Antenna                   | : | Co axial / guided wave radar / Overspill protection                       |
| 3. | Principle                 | : | TDR (Time Domain Reflectometry)   |
| 4. | Communication             | : | Two wire 4-20mA DC with HART  |
| 5. | Environmental temperature | : | 0 – 50 °C   |
| 6. | Enclosure                 | : | IP-65 (Explosion proof for NEC Class-1, Division 1 area)                  |
| 7. | Calibration               | : | a) Self calibration with internal reference<br>b) Zero & Span calibration |
| 8. | Process Connection        | : | External cage mounting<br>Flanged /screwed                                |
| 9. | Electronic Housing        | : | Epoxy painted Die-Cast aluminium  |

- alloy
10. Antenna / Flange assembly : 316 SS or Hest alloy (as required)
  11. Power supply : 24 V DC
  12. Output Indicator : LCD
  13. Accuracy : 5 mm or 0.1% of probe length
  14. Accessories :
    - a) Handheld calibrator
    - b) Counter Flange, nuts, bolts, gaskets etc
    - c) ½”NPT cable gland
    - d) SS Nameplate
  15. Adjustment/Calibration/ /Maintenance : From handheld calibrator/ HART management system
  16. Applications : Vessels under vacuum or low pressure applications, solid levels

1.06.00 ULTRASONIC LEVEL TRANSMITTER

1. Type : Microprocessor based, 2-wire, Smart (HART Compatible )
2. Operating Principle : Detection of reflected ultrasonic pulse
3. Output Signal : 4-20 mA DC along with superimposed digital signal
4. Operating frequency : 10 KHz to 50 KHz (typical)
5. Display : LCD
6. Temperature Compensation : Built in –Programmable
7. Power supply : 24 V DC
8. Enclosure : SS, IP-65 (Explosion proof for NEC Class-1, Division 1 area)

9. Zero & Span : Continuous, tamper proof, remote as well locally adjustable. It shall be possible to calibrate the instrument without any level in the sump/ tank
10. Accuracy & Repeatability : 0.15 % of span or better
11. Resolution : 0.1 % of span
12. Operating temp. : Transmitter- 500 C and Sensor - 800 C
13. MOC Sensor : SS-316/Body- PVC and Face – Polyurethane
14. Mounting : 4” Flanged/ 2” NPT for sensor and Transmitter on panel
15. Accessories :
- a) Handheld calibrator
  - b) Weather canopy for protection from direct sunlight and direct rain
  - c) ½”NPT cable gland
  - d) All mounting hardware (SS-316), Prefab cable
  - e) SS Nameplate
16. Diagnosis : On-line
17. Status Indication : Power On, HI, HI-HI, Lo, LO-LO, Fault
18. Output Contacts : 2 SPDT, 230V, 5A
19. Adjustment/Calibration/ /Maintenance : From handheld calibrator/ HART management system
20. Applications : Coal Bunker, Water Service etc.

1.07.00 ULTRASONIC FLOW TRANSMITTER

1. Type : Ultrasonic – Clamp On
2. Accuracy : +/- 1 % of reading
3. Repeatability : +/- 0.3 % of reading
4. Rangeability : 400 : 1
5. Output Signal : 4-20 mA DC with HART
6. Measured Parameter : Volumetric flow, Totalized flow and flow Velocity
7. Display : LCD with internal Key Pad (Flow rate & Totalization)
8. Power Supply : 24 V DC (2 Wire)
9. Enclosure : SS (IP- 68 – Submersible)
10. Mounting : SS Chain or Strap
11. Accessories
  1. Handheld calibrator
  2. ½”NPT cable gland
  3. Transducer cable
  4. All mounting hardware (SS-316)
  5. SS Nameplate
12. Adjustment/Calibration/ /Maintenance : From handheld calibrator/ HART management system
13. Applications : Plant water service

*Note: Multi-path insertion type (minimum 4 path) Ultrasonic Flow meter shall be provided for Raw water/ Cooling Water flow measurements.*

2.00.00 **HART HAND HELD CALIBRATOR**

Hand held calibrators (5 nos. for each type) shall be provided for adjustment/ calibration/maintenance of the HART compatible

transmitters. The hand held calibrator shall be suitable for all types of transmitters supplied in the package. If one type of hand held type calibrator is not suitable for communicating with all types of transmitters then separate hand held calibrator will be provided.

3.00.00 **PROCESS ACTUATED SWITCHES**

3.01.00 PRESSURE SWITCH

1. Type :
  - i. Piston for high pressure application
  - ii. Bellow / Diaphragm for low pressure application
2. Sensing element : SS-316.  
material All other wetted part SS316
3. Case Material : SS $\dagger$
4. Setter Scale : Black graduation on white linear scale.  
Graduation 0-100% with red pointer for set points
5. Over range : 150 % of maximum pressure
6. Adjustments :
  - a) Internal Set Point
  - b) Differential adjustment
7. End Connection : 1/2" NPT bottom connected
8. Switch configuration : Two SPDT (240V, 5A AC/220V, 0.5A DC)
9. Switch Type : Snap acting, shock & vibration proof
10. Terminal Block : Suitable for full ring lugs
11. Enclosure Class : IP-65 (Explosion proof for NEC Class-1, Division 1 area)
12. Performance :
  - a) Repeat accuracy  $\pm 1.0\%$
  - b) Accuracy of Setting Indication of  $\pm 1.5\%$
13. Ambient temperature : 0 – 50 Deg.C

14. Nameplate : Tag number, service engraved in SS tag plate
15. Accessories : a) Silicon oil/ Fluorolub filled Remote diaphragm seal with SS-316 capillary for corrosive/ viscous/ solid bearing or slurry type fluid applications  
b) Snubbers for pulsating fluid applications  
c) Siphons for steam and hot water services  
d) Retention ring and screws for surface mounting  
e) 1/2" NPT 2 Valve SS-316 barstock manifold  
f) 1/2" NPT cable gland
16. Applications : During Detail Engineering on Owner's approval

3.02.00 DIFFERENTIAL PRESSURE SWITCH

1. Type : i. Piston for high pressure application  
ii. Bellow / Diaphragm for low pressure application
2. Sensing element : SS-316.  
material All other wetted part SS316
3. Case Material : SS
4. Setter Scale : Black graduation on white linear scale. Graduation 0-100% with red pointer for set points
5. Over range : 150 % of maximum pressure

- 
- |     |                      |   |  |
|-----|----------------------|---|--|
| 6.  | Adjustments          | : | a) Internal Set Point  |
|     |                      | : | b) Differential adjustment   |
| 7.  | End Connection       | : | 1/2" NPT bottom/ back connected  |
| 8.  | Switch configuration | : | Two SPDT (240V, 5A AC/220V, 0.5A DC)   |
| 9.  | Switch Type          | : | Snap acting, shock & vibration proof   |
| 10. | Terminal Block       | : | Suitable for full ring lugs  |
| 11. | Enclosure Class      | : | IP-65 (Explosion proof for NEC Class-1, Division 1 area)   |
| 12. | Performance          | : | a) Repeat accuracy $\pm 1.0\%$   |
|     |                      |   | b) Accuracy of Setting Indication of $\pm 1.5\%$   |
| 13. | Ambient temperature  | : | 0 – 50 Deg.C   |
| 14. | Nameplate            | : | Tag number, service engraved in SS tag plate   |
| 15. | Accessories          | : | a) Silicon oil/ Fluorolub filled Remote diaphragm seal with SS-316 capillary Diaphragm seals for corrosive/ viscous/ solid bearing or slurry type fluid applications |
|     |                      |   | b) Snubbers for pulsating fluid applications   |
|     |                      |   | c) Siphons for steam and hot water services  |
|     |                      |   | d) Retention ring and screws for surface mounting  |
|     |                      |   | e) 1/2" NPT 5 Valve SS-316 barstock manifold   |
|     |                      |   | f) 1/2" NPT cable gland  |
| 16. | Applications         | : | During Detail Engineering on Owner's   |

approval

3.03.00 LEVEL SWITCH

3.03.01 FLOAT OPERATED

1. Float material : SS-316
2. Wetted parts : SS-316
3. Float chamber : Stainless steel/Carbon steel,  
construction welded
4. Float chamber : Side mounted  
mounting
5. Fluid connection : Side – Side
6. Fluid connection size : 1” ANSI RF Flange (rubber line, if  
required)
7. Drain : ½ inch NPT with Plug
8. Pressure rating of chamber : Minimum 1.5 times of design pressure
9. Repeatability : +/- 1.5 mm or better
10. Switch housing : Stainless Steel
11. Switch housing type : IP- 65
12. Type of switch : Snap acting magnetically operated  
hermetically sealed
13. Switch configuration : 2 SPDT (5A, 240 V AC, 0.5A, 220V DC)
14. Accessories :
  - a) Counter flange, nuts  
& bolts, suitable  
gasket etc.
  - b) Steel globe type  
drain valve
  - c) ½”NPT cable gland

d) Stainless steel nameplate with alpha-numeric engraved for service and tag

15. Application : During Detail Engineering on Owner's approval

3.04.00 FLOW SWITCH

1. Type : Paddle /Piston/Disk
2. Wetted part material : Stainless steel or Hastelloy for acidic application
3. End connection :
  - a) Threaded upto 1" line size with integral Tee
  - b) Flanged for line size > 1 ½"
4. Enclosure material : Stainless Steel
5. Enclosure class : IP 65
6. Switch configuration : 2 SPDT (5A, 240 V AC, 0.5A, 220V DC)
7. Repeatability : 2%
8. Cable connection : ½"NPTF
9. Accessories :
  - a) Tee, Counter flange, nuts & bolts, suitable gasket etc
  - b) ½"NPT cable gland
  - c) Stainless steel nameplate with alpha-numeric engraved for service and tag

3.05.00 RF LEVEL SWITCH

1. Type : RADIO FREQUENCY  
Sensing probe
2. Material : SS-316
3. Mounting : Threaded
4. Application : 250°C (Max.)  
Temperature  
Electronic Controller
5. Input Supply Voltage : 240V AC ±10%, 50 Hz.
6. Relay Output : 2 SPDT (240V AC, 5A)
7. Ambient Temperature : 50 °C
8. Enclosure Protection : IP-66
9. Enclosure Housing : SS  
Normal Level  
Power On
10. Local LED Indication : Alarm Level  
Probe Healthy
11. Switching Repeatability : ±0.5%  
Co-axial cable for probe connection to  
controller
12. Accessories : SS Tag plate  
½" NPT Cable Glands
13. Application : Solid level

3.06.00 CONDUCTIVITY TYPE LEVEL SWITCH

1. Type : Conductivity discrimination
2. Probe MOC : SS-316
3. Mounting : Flanged on external cage
4. Application : 250°C (Max.)  
Temperature
5. Test Pressure : Two times rated pressure

- 
6. Input Supply Voltage : 240V AC  $\pm$ 10%, 50 Hz.  
Four independent channel with
7. Input : selectable switching threshold for water conductivity
8. Relay Output : 2 SPDT (240V AC, 5A)
9. Ambient Temperature : 50 °C
10. Enclosure Protection : IP-65 (Explosion proof for NEC Class-1, Division-1 area)
11. Enclosure Housing : SS  
HI,LO, HIGH-HIGH, LOW-LOW
12. Local LED Indication : Power  
Fault
13. Accessories : a) Interconnecting cable from probe to electronics  
b) Mounting accessories  
c) External cage  
d) Washer & Gasket  
e) 1/2" NPT Cable Glands  
f) SS Tag Plate
14. Application : During Detail Engineering on Owner's approval

3.07.00 TEMPERATURE SWITCH

1. Type : Bimetallic or gas filled
2. Sensing Element : SS-316  
Material
3. Bulb Material : SS-316
4. Capillary : Stainless Steel armored

- 
5. Movement Material : Stainless Steel
6. Case material : Stainless Steel with neoprene gasket and clear glass where applicable cover conforming to IP-65. (Explosion proof for NEC Class-1, Division 1 area).
- 7.. Scale : Black graduation on white linear scale. Graduation 0-100% with red pointer for set points
8. Over range Protection : 120 %
9. Instrument connection : Bottom
10. Switch configuration : Two SPDT (240V, 5A AC/220V, 0.5A DC)
11. Switch type : Snap acting, shock and vibration-proof
12. Adjustability : Internal Set point adjustable over span range
13. Compensation : a) Capillary compensation with invar wire throughout the capillary length  
b) Case compensation
14. Performance  
a) Scale Accuracy :  $\pm 1.0$  % of full scale  
b) Repeatability : < 0.5 % of full range  
c) Response time : Less than 40 seconds with thermowell
15. Capillary length : 5 meters (minimum) for local mounting/15 meters for local panel mounting
16. Nameplate : Tag number, service engraved in stainless steel tag plate
17. Accessories : Mounting accessories, 1/2" NPT cable gland
18. Applications : During Detail Engineering on Owner's

approval

4.00.00 **LOCAL INSTRUMENTS**

4.01.00 PRESSURE GAUGE AND DIFFERENTIAL PRESSURE GAUGE

1. Type : Bourdon/Bellows/Diaphragm
2. Sensing & Socket : SS-316
3. Movement Material : SS-316
4. Case Material : Stainless steel. IP-65 (Explosion proof for NEC Class-1, Division 1 area)
5. Dial Size : Generally 150 mm
6. Scale : Black lettering on white in 270 O arc.
7. Window : Shatterproof glass
8. Range Selection : Normal process pressure: 50~70 % of range
9. Over-range Protection : 125% of maximum range by internal stop. External stop at zero  
For Zero adjustment (Micrometer screw external)
10. Adjustment : For Range adjustment (Micrometer screw internal).
11. Element Connection : Argon welding
12. Process Connection : 1/2" NPT (M) Bottom for local, back for panel mounting
13. Performance : Accuracy of  $\pm 1.0$  % of span or better
14. Operating ambient : 0 - 50 °C
15. Safety Feature : Blow out disc /diaphragm at the back
16. Accessories :
  - a) Snubbers for pulsating fluid application. discharge
  - b) Stainless steel Diaphragm seals

for corrosive/ viscous/ solid bearing or slurry type fluid applications

c) 3-Way SS316 Gauge cock for pressure gauges

d) 5-valve SS316 manifold from barstock for differential pressure gauge

e) Siphons for steam and hot water services

17. Nameplate : Tag number, service engraved in stainless steel tag plate

4.02.00 LEVEL INDICATOR (FLOAT & BOARD TYPE)

1. Type : Float and Board
2. Float Material : SS-316
3. Float Cable : SS-316
4. Indicator Assembly : Epoxy painted Aluminium
5. Guide wire spring assembly : SS-316 (2 Nos.)
6. Guide Wire Anchor : SS-316  
Anodized Aluminium with engraved marking ( Minimum graduation 10mm),
7. Scale Board :  
mounting brackets and suitable hardware required as per tank height
8. Elbow Assembly : Anodized Aluminium
9. Flanges : RF , ANSI 150 , SS (3 Nos.)
10. Accuracy :  $\pm 10$  mm or better
11. Accessories : All mounting accessories including counter flange, nuts & bolts, suitable


 Development Consultants  
 VIVEK KUMAR, SA KHAN, Praveen Kishore

gasket etc. as applicable, SS Tag plate

4.03.00 GAUGE GLASS

1. Type : Reflex /Transparent
2. Material : Toughened borosilicate resistant to thermal shock
  - Glass : Toughened borosilicate resistant to thermal shock
  - Body Material : ~~Carbon Steel~~ Stainless Steel
  - Enclosure : IP-65 (Explosion proof for NEC Class-1, Division 1 area)
3. Integral cocks & valves/Fittings : i. SS 316
4. : ii. Rubber lined corrosion resistant stainless steel (for DM/RO service)
5. Vessel Connection : ANSI Flanged SS316
6. Accessories : i. Integral cocks  
ii. Drain Valves  
iii. Companion Flanges, Bolts, nuts, gaskets, SS Tag plate  
iv. Illuminating lamps, Mica shield as required  
v. Calibrated scale
7. Pressure rating : Twice the maximum working pressure
8. Temperature : 300 °C
9. Other details : For larger lengths (greater than 1200mm), additional gauge glasses shall be provided with minimum of 50 mm overlap.

- 4.04.00 SLIGHT GLASS
1. Type : Flap-type.
  2. End connection : Screwed / Flanged
  3. Material
    - a) Body : SS- 304
    - b) Cover plate : SS- 304
    - c) Indicator : SS- 316
  4. Sight Glass : Toughened Borosilicate
  5. Gasket : Neoprene
  6. Bolts & Nuts : High tensile steel.
  7. Hydraulic Test Pressure : 1.5 times maximum working pressure
  8. Accessories : Companion Flanges, Bolts, nuts, gaskets as required, SS Tag plate.
- 4.05.00 ROTAMETER
1. Type : ON-LINE for line upto and including 50 mm NB.  
: Borosilicate BY-PASS for line size above 50 NB
  2. Metering tube : Toughened Borosilicate
  3. Float : SS-316
  4. End fittings : SS-316
  5. Packing material : Teflon / PTFE
  6. Casing : Stainless Steel
  7. Gland Rings : Stainless Steel  
/Followers/ Other :  
wetted parts
  8. Orifice Plate : Stainless Steel (for bypass type)
  9. Operating Temperature : 0-50 Deg. c

- 10. Test Pressure : 200% of maximum operating pressure
- 11. Scale : 250 mm nominal length
- 12. Graduation : Direct reading
- 13. Process Connection : Flanged (RF) to line size as per ANSI standards (150#)
- 14. Tapping : D & D/2
- 15. Accuracy : +/- 2% of full scale reading
- 16. Reproducibility : Within 0.5% of instantaneous reading
- 17. Accessories : SS Tag Plate, orifice plate

5.00.00 **TEMPERATURE ELEMENTS & ACCESSORIES**

5.01.00 RESISTANCE TEMPERATURE DETECTOR

- 1. Type : Platinum (Duplex), Ungrounded
- 2. Platinum (Duplex), Ungrounded : 100 ohm at 0 °C
- 3. Base : Wound on ceramic (anti-inductive)
- 4. Wiring : 3 Wire
- 5. Protecting Tube
  - a) O.D. : 6 mm
  - b) Material : SS-316, Seamless
  - c) Filling : Magnesium oxide (Purity above 99.4%).
- 6. Response time :
  - a) 15 sec. (bare).
  - b) 30 sec. (with thermowell)
- 7. Calibration : DIN 43760
- 8. Accuracy : ± 0.5%
- 9. Head
  - a) Type : IP-65 universal screwed type

- b) Material : Stainless Steel
- c) Terminal blocks : Nickel plated Brass-screw type / silver plated
- d) Cable connection : ½” NPT gland and grommet
- e) Others : Terminal head cover with SS chain and suitable gasket.

Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable).

- 10. Accessories :
  - a) Adjustable nipple-union-nipple [1/2” Sch 80 X ½” NPT] with thermowell connection
  - b) Compression fittings/unions
  - c) Flanges etc. (for flanged connections only)
  - d) Thermowell (As specified below)
- 11. Thermowell connection : ½” NPT (M) or 150 RF Flanged
- 12. Nameplate : Tag number, service engraved in stainless steel tag plate

SA Khan, Praveen Kishore  
VIVEK KUMAR

*Note:* The specifications for RTDs of winding/ bearing of motor/pump, can be as per their manufacturer standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice. However, the type of RTD shall be Pt-100.

5.02.00 THERMOCOUPLES

1. Type :
  - a) 16 SWG wire of Chromel Alumel) (Type-K)
  - b) Duplex
  - c) Ungrounded
2. Protecting Tube
  - a) O.D. : 6 mm
  - b) Material : SS-316, Seamless
  - c) Filling : Magnesium oxide (Purity above 99.4%).
3. Response time :
  - a) < 20 seconds for measurement
  - b) < 10 seconds for control
4. Accuracy :  $\pm 1.1^{\circ} \text{C}$  up to  $300^{\circ} \text{C}$  & 0.4% of measured temperature range above  $300^{\circ} \text{C}$
5. Head
  - a) Type : IP-65 universal screwed type
  - b) Material : Stainless Steel
  - c) Terminal blocks : Nickel plated Brass-screw type / silver plated
  - d) Cable connection :  $\frac{1}{2}$ " NPT gland and grommet
6. e) Others : Terminal head cover with SS chain and suitable gasket.

Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable).

7. Accessories :
- a) Adjustable nipple-union-nipple [1/2" Sch 80 X 1/2" NPT] with thermowell connection
  - b) Compression fittings/unions
  - c) Flanges etc. (for flanged connections only)
  - d) Thermowell (As specified below)
8. Thermowell connection : 1/2" NPT (M) or 150 RF Flanged
9. Nameplate : Tag number, service engraved in stainless steel tag plate

5.03.00 TEMPERATURE GAUGE

1. Type : Expansion type (Liquid filled system)
2. Sensing Element : Bourdon – SS-316
3. Material : SS-316
4. Bulb and Capillary : SS-316
5. Capillary Tubing : Inner sheath - solid drawn Material  
copper tube  
Outer sheath - PVC tube
6. Movement Materials : Stainless Steel / Direct Bourdon tip connection to pointer spindle
7. Case Material : Stainless Steel stove enameled, black finish, threaded bezel ring, clear glass



3. Process connection : M33x2
4. Certification : Not applicable
5. Bore concentricity : +5% of wall thickness
6. Identification mark : Tag number punched on head
7. Surface treatment : Polish after machining
8. Element connection : ½” NPT (M) or 150 RF Flanged
9. Head : Hex
10. Length of the hex head : 31.75 mm (min.)
11. Accessories : SS Plug and chain for test thermo wells  
SS Nameplate, Flange with companion  
flange & all required accessories for  
flanged connections.

*Note: Wake frequency calculations shall be furnished for all thermowells for approval.*

*Thermowells shall be designed such that the resonant frequency is above the exciting frequencies generated by vortex shedding in the process fluid.*

5.05.00 METAL TEMPERATURE THERMOCOUPLE

1. Measuring medium : Metal temperature
2. Type : Chromel Alumel (Type-K)  
Duplex, Ungrounded
3. Insulation : Mineral Insulation Magnesium Oxide
4. Wire gauge : 16 AWG
5. Protective sheath : SS
6. Protective sheath :  
diameter : 8 mm O.D.
7. Characteristics : Special limits of error as in ANSI  
thermocouple MC 96.01
8. Accessories : ½” BSP SS sliding end connector, weld  
pad, clamps of heat resistant steel

1. Type : Hydrometer Type
2. Mounting : On line
3. Accuracy : +/- 2% of range
4. Scale : Black letter on white scale
5. End connection : PVC flange

9.06.00 DENSITY/ CONCENTRATION METER

1. Wetted Part : Stainless Steel
2. Enclosure : Stainless Steel (IP-65)
3. Power Supply : 24 V DC
4. Output signal : 4-20 mA DC (isolated) into 600 ohms
5. Accuracy : ±0.001 g/cc
6. Indication : LCD display
7. Temp. Compensation : Integral
8. Accessories : Mounting hardware, integral amplifier (if required), cable glands, tag plate etc.

10.00.00 SOLENOID VALVES

1. Operating Principle : Electromagnetic (noiseless)
2. Coil voltage rating : 240 V AC /24 V DC (as required)
3. Ways : 2/3/4 way
4. Port size : 1/4" NPT all ports
5. Body : SS bar stock
- Trim : SS-316
6. Duty : Suitable for continuous energization
7. Sealing : Airtight and leak proof
8. Ambient Temperature : 0 - 50 ° C

- 
- |     |                   |   |  |
|-----|-------------------|---|--|
| 9.  | Fluid Temperature | : | 0-150 ° C (approx.)                                      |
| 10. | Coil Enclosure    | : | Stainless Steel  |
| 11. | Insulation        | : | Class-H  |
| 12. | Coil Casing       | : | IP-65 (Explosion proof for NEC Class-1, Division-1 area) |
| 13. | Mounting          | : | On pipe or on panel                                      |
| 14. | Cable Connection  | : | ½” NPT   |
| 15. | Accessories       | : | Cable glands, SS Tag plate                               |



Technical specification for  
**CONTROL & INSTRUMENTATION**

**1X800 MW KOTHAGUDEM**

SPEC NO.: **PE-TS-410-145-I**

VOLUME

SECTION

REV. NO. 00

DATE : 18.03.2015

SHEET OF

# Instrumentation Quality Plan

  
VIVEK KUMAR SA Khan Praveen Kishore



**STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)**

**CHECK LIST FOR PRESSURE SWITCH**

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks	
				M	C	B		
1	CHECK FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS	P	V	V		
	1.1 MODEL NO/TAG NO							
	1.2 RANGE							
	1.3 END CONN							
	1.4 NO. OF CONTACT							
2	CALIBRATION				P	V	V	
	2.1 REPEATABILITY							
	2.2 SET POINT ADJUSTMENT							
	2.3 DIFFERENTIAL							
3	OVER PR & LEAK TEST				P	V	V	
4	ELECT. INSULATION/HV TEST	ONE		P	V	V		
5	REVIEW OF TC FOR MATERIALS OF	FOR LOT		V	V	V		
	5.1 SENSOR							
	5.2 MOVEMENT							
	5.3 PROCESS CONNECTION							
	5.4 HOUSING							
6	REVIEW OF TC FOR DEGREE OF PROTECTION	TYPE TEST		V	V	V		
7	REVIEW OF TC OF MICROSWITCH	FOR LOT		V	V	V		

\*\* M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification

**Note :**

1. Quantum of check shall be as below :  
100 % - By Manufacturer
2. Manufacturer to carry out ROUTINE TEST on 100 %.
3. Contractor to provide compliance certificate for tests/checks verified by contractor and the same alongwith test certificates to be verified by BHEL

  
 VIVEK KUMAR SA Khan Praveen Kishore



## STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)

### CHECK LIST FOR TRANSMITTER

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECKS FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS	P	W	V	
	VISUAL.						
	MODEL/TAG No						
2	PROCESS CONNECTION			P	W	V	
3	ACCURACY			P	W	V	
4	REPEATABILITY			P	W	V	
5	HYSTERESIS	P		W	V		
6	EFFECT OF TEMP VARIATION ON ACCURACY	P		W	V		
7	SPAN / ZERO ADJUSTMENT	ONE / TYPE		P	W	V	
8	EFFECT OF SUPPLY VOLTAGE VARIATION			P	W	V	
9	EFFECT OF LOADING (500 OHM METERS)			P	W	V	
10	HIGH PRESSURE TEST	SEE NOTE-1 BELOW		P	W	V	
11	BURN-IN TEST	ONE / TYPE		P	W	V	
12	DEGREE OF PROTECTION		P	W	V		
13	ACCESSORIES AS APPLICABLE	SEE NOTE-1 BELOW	V	V	V		

#### Legend :

\*\* M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification

#### Note :

- Quantum of check shall be as below :  
100 % - By Manufacturer
- Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
- When material correlation are not available manufacturer's compliance to be provided.
- Contractor to provide compliance certificate for tests/checks verified by contractor and submit the same alongwith test certificates to be verified by BHEL.



**STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)**

**CHECK LIST FOR PRESSURE & DP GAUGE**

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECK FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS	P	W	V	
	SENSOR TYPE						
	DIAL SIZE						
	MODEL NO/TAG NO						
	RANGE/SCALE						
	SWITCH CONTACT RATING & NOS.						
	END CONNECTION						
2	CALIBRATION	ONE	APPROVED SPEC./ DATA SHEETS	P	W	V	
	ACCURACY						
	REPEATABILITY						
	SET POINT ADJUSTMENT						
3	OVER PRESSURE & LEAK TEST			P	W	V	
4	OPERATION OF PRESSURE. RELIEF DEVICE	ONE		P	W	V	
5	REVIEW OF TC FOR	FOR LOT	APPROVED SPEC./ DATA SHEETS	V	V	V	
	MATERIALS OF SENSOR						
	MOVEMENT						
	PROCESS CONNECTION						
6	HOUSING			V	V	V	
	REVIEW OF TC FOR DEGREE OF PROTECTION	TYPE TEST		V	V	V	
7	ACCESSORIES AS APPLICABLE	SEE NOTE-1 BELOW		V	V	V	

  
 VIVEK KUMAR SA Khan Praveen Kishore

**Legend :**

\*\* M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification

**Note :**

- Quantum of check shall be as below :  
100 % - By Manufacturer
- Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
- Manufacturer to carry out ROUTINE TEST on 100 %.
- When material correlation is not available, MFR's compliance to be provided
- Contractor to provide compliance certificate for tests/checks verified by contractor and submit the same alongwith test certificates to be verified by BHEL.



**STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)**

**CHECK LIST FOR LEVEL GAUGE**

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECK FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS / DRWGS	P	W	V	
	TYPE						
	MODEL/ TAG NO.						
	DAIL SIZE						
	RANGE/SCALE						
	END CONNECTION						
2	DIMENSIONS, PROCESS CONNECTION	ONE / LOT		P	W	V	
3	ACCURACY			P	W	V	
4	MATERIAL TC FOR			P	V	V	
	BODY ISO.						
	VALVE						
	GAUGE GLASS						
5	HYD. TEST	SEE NOTE-1 BELOW		P	W	V	
6	ACCESSORIES AS APPLICABLE			P	W	V	

VIVEK KUMAR SA KHAN Praveen Kishore

**Legend :**

\*\* M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification

**Note :**

- Quantum of check shall be as below :  
100 % - By Manufacturer
- Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
- Manufacturer to carry out ROUTINE TEST on 100 %.
- Contractor to provide compliance certificate for tests/checks verifid by contractor and submit the same alongwith test certificates to be verified by BHEL.



**STANDARD CHECK LIST FOR C&I INSTRUMENTS (for Maux Pkgs)**

**CHECK LIST FOR ANNUNCIATORS**

Sl. No.	Test / Checks	Quantum of check	Reference Doc. / Acceptance Norms	Agency **			Remarks
				M	C	B	
1	CHECK FOR	SEE NOTE-1 BELOW	APPROVED SPEC./ DATA SHEETS	P	W	V	
	TYPE/ MODEL						
	DIMENSIONS OF HARDWARE						
	MODULARITY						
	SEQUENCE						
	FACIA DETAILS						
2	FUNCTIONAL TEST	100%		P	W	V	
3	IMMUNE TO STEP VARIATIONS IN THE POWER SUPPLY	SEE NOTE-1 BELOW		P	W	V	
4	DEGREE OF PROTECTION FOR ENCLOSURE	TYPE TEST		P	W	V	
5	I/R CHECK	SEE NOTE-1 BELOW		P	W	V	
6	RESPONSE			P	W	V	

VIVEK KUMAR SA Khan Praveen Kishore

**Legend :**

\*\* M = Manufacturer / Sub-contractor, C = Contractor / Nominated Inspecting Agency, B = BHEL, P = Perform, W = Witness, V = Verification

**Note :**

- Quantum of check shall be as below :  
100 % - By Manufacturer
- Manufacturer to maintain calibrated instrument having better accuracy than the item under test. Inspecting engineer shall check the same.
- Manufacturer to carry out ROUTINE TEST on 100 %.
- Contractor to provide compliance certificate for tests/checks verified by contractor and submit the same alongwith test certificates to be verified by BHEL.



Technical specification for  
**CONTROL & INSTRUMENTATION**

**1X800 MW KOTHAGUDEM**

SPEC NO.: **PE-TS-410-145-I**

VOLUME

SECTION

REV. NO. 00

DATE : 18.03.2015

SHEET OF

# LCP and JUNCTION BOXES SPECIFICATION

  
VIVEK KUMAR SA Khan Praveen Kishore

1.00.00 **GENERAL REQUIREMENT**

1.01.00 ENCLOSURES FOR INSTRUMENTS AND OTHER EQUIPMENT

1.01.01 All panels, cabinets, distribution boxes, junction boxes, terminal boxes and all other field mounted equipment / enclosures shall have suitable environmental protection as detailed in Section-I of this volume of the specification.

1.02.00 SURFACE PREPARATION & PAINTING

1.02.01 All sheet metal panel/ desk exterior steel surfaces shall be sand blasted, ground smooth and painted as specified below.

1.02.02 Suitable filler shall be applied to all pits, blemishes and voids in the surface. The filler shall be sanded so that surfaces are level and flat; corners are smooth and even. Exposed raw metal edges shall be ground burr-free. The entire surface shall be blast clean to remove rust and scale and all other residue due to the fabrication operation. Oil, grease and salts etc. shall be removed from the panels by one or more solvent cleaning methods prior to blasting.

1.02.03 Two spray coats of inhibitive epoxy primer surfacer shall be applied to all exterior and interior surfaces, each coat of primer surfacer shall be of dry film thickness of 1.5 mil. A minimum of two spray coats of final finish color (Catalyzed epoxy or polyurethane) shall be applied to all surface of dry film thickness 2.0 Mil. The finish colors for exterior and interior surfaces shall conform to the following shades:

- Exterior – Opaline green shade 275 of IS: 5 or equivalent international code..
- Interior - Brilliant White.

1.02.04 Paint films, which show sags, cheeks, blisters, teardrops, fat edges or other painting imperfections, shall not be acceptable.

1.03.00 WIRING

1.03.01 All spare contacts of relays, switches and push buttons shall be wired up to the terminal blocks. All intercommunications between sections of panels/desks shall be furnished.

1.03.02 Each wire shall be identified at both ends with wire designation as per approved wiring diagram. Heat shrinkable type ferrules with indelible computerized ink print shall be used with cross- identification.

1.03.03 All wire termination shall be made with insulated sleeve and crimping type lugs. Wire shall not be spliced or tapped between terminals. Open-ended terminal lugs will not be accepted. Wires shall not be looped around the terminal screws or studs.

- 1.03.04 Internal wiring should be terminated uniformly on one side of the terminal block leaving the other side available for termination of outgoing cables. Internal wiring shall be grouped so that all outgoing wiring to each particular remote location is terminated on adjacent terminal blocks. Interior wiring and jumperings shall be arranged so that external connections can be made from internal side of terminal blocks. Common connections shall be limited to two (2) wires per terminal.
- 1.03.05 Wiring shall be arranged to ensure free access to all instrument or devices for maintenance. No wire shall be routed across the face or rear of any device in a manner, which will impede the opening of covers or obstruct access to leads, terminals or devices
- 1.03.06 Wires shall be dressed and run in trays or troughs with clamp-on type covers. Wirings may be neatly bunched in groups by non-metallic cleats or bands. Each group shall be adequately supported along its run to prevent sagging or strain on termination.
- 1.03.07 Shield wires shall be terminated on separate terminal blocks. Common connections shall be limited to two wires per terminal. Signal circuit shields shall be grounded at the power supply end only or as recommended by manufacturer.
- 1.03.08 All low level signal cables shall be separately bundled to from control cable and maintained at 300 mm minimum spacing from control bundles.
- 1.03.09 Panel internal wiring shall follow distinct color-coding to segregate different voltage levels viz. 24V DC, 48V, 110V AC, 240V AC, 220V DC etc.
- 1.03.10 Thermocouple lead wires, analyzer measuring lead wires, or any other lead wires carrying measuring signal of the order of low milli volt or micro volt shall be electrically and physically isolated from other AC and DC wiring. Shielded wires used in such cases for panel internal wiring shall be continuous and ungrounded with the shield terminated individually and separately in panel terminal block.
- 1.03.11 Wiring to door mounted devices shall be provided with multi-strand wires of (49 strands minimum) adequate loop lengths of hinge-wire so that multiple door openings will not cause fatigue failure of the conductor.
- 1.03.12 Internal wiring in factory pre-wired electronic systems cabinets may be installed according to the Contractor's standard wire size, insulation, and method of termination on internal equipment. Insulation for all wiring, including circuit board wiring, back panel wiring, power supply wiring and interconnecting cables between devices shall pass the vertical flame test per IPCEAS-1981. Identification of conductors may be done by insulation color-coding identified on drawings or by printed wiring lists.

- 1.04.00 TERMINAL BLOCKS
- 1.04.01 All terminal blocks shall be rail mounted/ post mounted type, cage clamp type with high quality non-flammable insulating material of melamine suitable for working temperature of 105 Deg C. The terminal blocks in field mounted junction boxes, instrument enclosures racks etc. shall be suitable for cage clamp connections. The terminal blocks in Control Equipment Room termination/ marshalling cubicles shall be suitable for post mounted cage clamp connection at the field input end. The exact type of terminal blocks to be provided by Bidder shall be subject to Owner.
- 1.04.02 All terminal blocks shall be provided complete with all required accessories including assembly rail, locking pin and section, end brackets, small partitions, transparent covers, support brackets, distance sleeves, warning level, marking etc. For RTDs ring - tong type lugs shall be used at Junction Boxes.
- 1.04.03 The characteristics of the terminal blocks shall be as follows.
- i) High contact force, independent of conductor cross-section and large contact surface area.
  - ii) Integrated self-loosening protection to avoid shifting of contact surface that may allow contamination of connection point.
  - iii) Inspection and maintenance free (resistant to thermal aging and vibration)
  - iv) Low and constant voltage drop
- 1.04.04 The insulation of the terminal blocks shall be of suitable thermoplastic material.
- 1.04.05 The spacing between Terminal blocks channels in panels and cubicles shall be adequate for routing the cable troughs and to allow adequate free workspace for termination and removal of wires. The terminal blocks shall be arranged with atleast 100 mm clearance between two sets of terminal blocks and junction box walls.
- 1.04.06 Signals of different voltage levels shall be clearly segregated by providing separate rows to each type of signal and by using terminal blocks of different color for each type of signal and by providing barrier strips between them.
- 1.04.07 Terminal blocks shall be provided with white marking strips / self-adhesive marker cards and where permitted by the safety codes and standards, shall be without covers. Power terminals and high voltage (above 48 volts) terminals shall have protection covers. All terminals shall be provided with permanent terminal identification numbers on both sides.
- 1.04.08 At least 20% spare unused terminals shall be provided on each terminal block for circuit modifications and for termination of all conductors in a multi-conductor control cable.

- 1.04.09 The bottom of the terminal block shall be at least 200 mm above the cable gland for bottom entry type panels.
- 1.04.10 For extending 24 V DC supply to panels, the size of the terminals shall be decided based on voltage drop and not based on current.
- 1.04.11 Other requirements of the terminal blocks are as follows:
- i) The last terminal in a rail-mounted assembly shall be closed with an end plate and end bracket.
  - ii) For visual and electrical separation of terminal groups, partition plates shall be provided, which can be push fitted after forming an assembly.
  - iii) Design shall permit testing of incoming and outgoing signals by using suitable test plug and socket without disconnecting the cable connections.
  - iv) It shall be possible to use jumper plugs through the above test plug socket to connect adjacent terminals. Adequate number of short circuit jumper plugs shall be provided for the purpose.
  - v) Where more than one connection to a terminal block is required, two tier terminals shall be used.

1.05.00 **GROUNDING**

1.05.01 Separate Protective and Electronic system ground as required shall be provided.

1.05.02 All panels, desks, cabinets shall be provided with a continuous bare copper ground bus (Frame ground), bolted to the panel structure at bottom on both sides and effectively ground the entire structure. The bolts shall face inside of panels.

1.05.03 For electronic system cabinets the electronic system ground bus (Electronic ground) shall be similar but insulated from the cabinet and shall be separately connected to the system ground .The same ground may be used to earth the shield of shielded signal cables, otherwise a separate ground bus shall be provided for connecting the signal cable shields. Cable shields shall be grounded at the panel end only and shall never be left open .The electronic ground between panels of a shipping section shall be firmly looped.

2.00.00 **CONTROL DESKS & PANELS**

2.01.00 **GENERAL**

2.01.01 All control desk, panels etc. shall be furnished fully wired with necessary provision for convenience outlets, internal lighting, utility receptacles, grounding, ventilation, space heating, anti-vibration pads, internal piping &

be mounted on the back up panels.

2.04.00 PANELS/CABINETS

2.04.01 All DDCMIS system modules, power supply components and other Local Control panels (PLC/Relay based) shall be housed in cabinets as specified below.

2.04.02 The cabinet mounted equipments shall be fully assembled, installed in mounting racks, wired and fully tested as per specification requirements and Owner approved drawings prior to shipment to the project site.

2.04.03 The Bidder shall ensure that the cabinets are complete & ready for installation before dispatch from manufacturing works. The installation work at project site for these cabinets shall only involve connections through multi-pair cables from marshalling cabinets (wherever provided) to system cabinets and inter-cabinet/cabinet to Control Desk/ Back up Panel.

2.04.04 All electronic cards, network components, power supply modules etc. located shall be suitably housed in cabinets and shall be neatly arranged in sub-racks. Network components shall be visible in door closed condition (e.g. Glass doors etc.) as approved by Owner.

2.04.05 Bidder shall design the cabinet internal arrangement, floor cutout and cable gland plate such that all the cables entering or leaving the cabinet can be properly glanded in the gland plate.

2.04.06 The packaging density of panels shall be such that the temperature rise within the panels shall never exceed 10°C above ambient even under worst operating conditions. Cooling Fans shall be provided wherever required and this shall be of industrial grade.

2.04.07 TECHNICAL PARTICULARS

1. Material of Construction : Cold Rolled Coal Annealed (CRCA) steel sheet
2. Thickness of Sheet : a) 2.0 mm for faces supporting instruments / terminals  
: b) 1.6 mm for other sides and top
3. Construction : Welded throughout as per approved National Standards
4. Post welding operation : a) Grounding of all welds to smoothness  
: b) Rounding of corners

- : c) Cleaning of weld spatters
5. Panel height : 2300 mm (approx)
6. Corners : 7 mm inner radius
7. Dimensional Tolerances : a) In height & length - 3 mm  
b) In height between adjacent sections - 2 mm  
c) Total for a group - 6 mm
8. Doors : Double, recessed, turned back edges, full height front & rear
- i) Thickness of Sheet : 2 mm
- ii) Hinges : Stainless steel
- iii) Door latches : Three point type
- iv) Door gaskets : Neoprene rubber on fixed frame to result dust proof/weatherproof enclosure
- v) Opening of the doors : Outward
- vi) Louvers : With removable wire mesh to ensure dust and vermin proof
9. Gland plates : Removable in sections  
4 mm thick (bottom)
10. Cable entry : Bottom
11. Hardware : a) Anti vibration pad- 15 mm  
b) Predrilled base channel ISMC – 100 or equivalent for all sides  
c) Stainless steel buff- finished 2 mm thick kick plate for all sides  
d) Stainless steel scratch strips along desk edges fixed with pan-head recessed screws  
e) Rubber strips to ensure air

tightness between kick plate and finished floor

f) Lifting hook / Eye bolt

g) Drawing pocket

h) Door switch, lamps, thermostat, heaters and industrial grade cooling fans,, illumination fixtures

12. Name Plate : Both at front and back surface of the panel
13. Fixing of name plate : Stainless steel pan head screws
14. Name plate material : Laminated phenolic (3 layers)
15. Lettering : Black with white engraved
16. Mounting of terminal blocks : Vertical angle support bracket tack welded on sheet steel plate, screwed on internal wall of enclosure

2.05.00 FURNITURE

All the furnitures in the Central / Local control Room (s), Engineers' rooms, Instrument laboratory , SWAS Room & any other rooms with C&I equipments located in different plant buildings under Bidder's scope shall be included in Bidder's scope of supply. Bidder shall provide following industrial grade furniture items as a minimum from reputed manufacturers/suppliers meeting International Standards. The furniture shall be modular and latest with ease of operational features. The furniture shall be modern, aesthetically designed, modular, flexible, space saving and future safe.

2.05.01 WORK STATION FURNITURE

Modular work station furniture, suitable for mounting servers & historians, programmer stations, PC based systems, printers (A4/A3 color laserjet) etc. shall be provided.

2.05.02 PC RACK

PC Racks shall be provided to mount CPUs of workstations/PCs of OWS/LVS etc. in control room. For each PC / workstation / monitor at least one chair shall be included.

2.05.03 CHAIRS

- clearly brought out by the Contractor in his offer, alongwith all relevant details/basis.
- 3.03.00 Any other requirement for proper LVS mounting & functioning & viewing shall also be specifically brought out by the Contractor in his offer, along with all relevant details.
- 4.00.00 **LOCAL INSTRUMENT RACK (LIR) & LOCAL INSTRUMENT ENCLOSURE (LIE)**
- 4.01.00 GENERAL
- 4.01.01 Devices (Transmitters/ Switches) located in the field shall be suitably grouped together to the extent possible and installed in the LIE (Closed Rack) and LIR (Open Rack) in Boiler/TG Building and Off-site plant areas.
- 4.01.02 Racks and enclosure shall be factory prefabricated & painted and shall complete with internal piping, tubing, manifold, isolation valves, blowdown valves, integral junction box, illumination etc.
- 4.01.03 No more than six instruments shall be grouped in a single rack / enclosure.
- 4.01.04 Racks shall be installed above the tapping points for air, flue gas and coal air mixture application whereas for applications such as for water and steam, racks to be installed below the source point.
- 4.01.05 Attention shall be paid in the layout to avoid air traps in liquid piping and water accumulation in air /gas piping.
- 4.01.06 Racks used for furnace, flue gas and air application shall be provided with intermittent & continuous air purging
- 4.01.07 Welding of impulse lines shall comply with the provisions of the latest applicable ANSI Code for Pressure Piping.
- 4.01.08 Earth stud shall be furnished at rack for safety grounding.
- 4.02.00 LOCAL INSTRUMENT ENCLOSURE (LIE)
- 4.02.01 Enclosure shall be free standing type. Racks shall be adequately reinforced to ensure true surfaces and to provide support. Major load - bearing posts shall be suitably supported by gusset plates or moment members.
- 4.02.02 Enclosure outer shall be constructed from at least 3 mm thick steel plate and epoxy painted to shade gray. Base frame shall be made of ISMC 100 and black colour finish.
- 4.02.03 2" NB galvanized pipes shall be laid horizontally and supported at two end channels to mount transmitters at accessible height. Center posts or any

member, which would reduce access, shall be avoided.

- 4.02.04 Double leaf interlocking front opening doors with three point locking shall be provided and shall be arranged for maximum possible access to the interior. Key shall be of identical for all enclosures.
- 4.02.05 Doors shall have concealed quick removal type pinned stainless steel hinges and locking handles. Gaskets shall be used between all mating sections to achieve dust and weather proof enclosure rated for IP-65 including the internal junction box. All enclosures shall have access doors on front side.
- 4.02.06 Removable type bulkhead plates of thickness not less than 6 mm shall be mounted at the racks with suitable high temperature gasket. Impulse lines within the enclosures shall be properly clamped.
- 4.02.07 All internal wirings between the instruments and junction box shall run through flexible conduits. No exposed wirings within transmitter racks both open and closed type, is admissible.
- 4.02.08 Racks shall have a common blowdown drain header, which will connect individual instrument blowdown line after suitable pressure breaking through regulating globe type blowdown valves. Covered funnels shall be used for saturated liquid and steam service, whereas, open funnels may be used for cold liquid services. Header (2" NB ASTM A 106, Sch-80 Gr. C) shall be suitably sloped and shall have one end flanged and extending beyond the rack for connection to plant drain header..
- 4.02.09 Each rack shall be provided with one receptacle, light fixtures with wire guard and one lighting switch each at instrument & Junction box compartments with wire guard. Lighting switches may be door actuated & mounted inside the panel. Outlet box, switch box and device covers shall be of galvanized stamped steel. Light switches and receptacles shall be installed inside the enclosure on the wall near the latch side of the enclosure door. Light fixtures shall be installed on the ceilings of the enclosures.
- 4.02.10 Power supplies for miscellaneous devices shall be provided with MCB located within the enclosures. MCB shall be mounted in fuse blocks. Nameplates shall be furnished above the MCB blocks, identifying the devices being served.
- 4.02.11 Vibration dampeners shall be installed for supporting each enclosure. The loading at each corner of the enclosure shall be determined by actual test weighting when construction is complete to determine the correct length of each dampener for proper loading of the dampener in accordance with manufacturer's recommendations
- 4.03.00 LOCAL INSTRUMENT RACK (LIR)
- 4.03.01 Rack shall be free standing type constructed from 6 mm thick steel channel frame provided with a canopy to protect the instrument from dripping water or

falling objects and shall be epoxy painted. Canopy shall be of CRCA steel sheet of at least 3 mm thickness.

4.03.02 Rack Major load-bearing posts shall be suitably supported by gusset plates or moment members. Suitable fenders grill shall be welded to the end-posts of the rack to outline a boundary beyond which no mounted equipment shall project to protect instrument from accidental contact during personnel movement. Center posts or any member, which would reduce access, shall be avoided.

4.03.03 2" NB galvanized pipes laid horizontally and supported at two end channels shall be employed at working accessible height for mounting of instruments.

4.03.04 All internal wirings between the instruments and junction box shall run through flexible conduits. No exposed wirings are admissible.

4.03.05 Racks shall have a common blowdown drain header, which will connect individual instrument blowdown line after suitable pressure breaking through regulating globe type blowdown valves. Covered funnels shall be used for saturated liquid and steam service, whereas, open funnels may be used for cold liquid services. Header (2" NB ASTM A 106, Sch-80 Gr. C) shall be suitably sloped and shall have one end flanged and extending beyond the rack for connection to plant drain header..

Each rack shall be provided with one receptacle, one light fixture with wire guard and one lighting switch. Outlet box, switch box and device covers shall be galvanized stamped steel. Light fixtures shall be installed on the canopy of the rack

4.03.06 Power supplies for miscellaneous devices shall be provided with MCB located within the enclosures. MCB shall be mounted in fuse blocks. Nameplates shall be furnished above the MCB blocks, identifying the devices being served.

4.04.00 JUNCTION BOX

1. Type of Enclosure : Dust tight & weatherproof conforming to IP 65
2. Material : 3 mm sheet steel / fiberglass reinforced polyester(UV stabilized)
3. Type of Cover : Solid unhinged with retention chain / Screwed at all four corners
4. Paint :
  - i) Exterior : Opaline green shade 275 of IS: 5
  - ii) Interior - Brilliant Glossy White.

- Surface / Two (2) inch Pipe stanchion
5. Mounting : (At a dry compartment at one side of the enclosure / rack with front opening type door)
6. Cable Entry : 3 mm (min) Bottom / side Gland plate
7. Gasket : Neoprene
8. Grounding : Brass earth lug with green screw head  
External-2 nos , Internal-1no. (M6)
9. Number of Drain Holes : Two at bottom capped
10. Identification : Label for JB and Tags for cable
11. Accessories : a) Rail mounted cage clamp type screwless terminals (suitable for conductor size up to 2.5sq.mm of suitable voltage grade) with markers and 20% spare terminals  
b) Cable gland (Brass) & raceways  
c) Ferrules & lugs (Brass)  
d) Aluminum back panel  
e) Canopy at top  
f) Mounting brackets  
g) bolts and nuts made of brass etc.



Technical specification for  
**CONTROL & INSTRUMENTATION**

**1X800 MW KOTHAGUDEM**

SPEC NO.: **PE-TS-410-145-I**

VOLUME

SECTION

REV. NO. 00

DATE : 18.03.2015

SHEET OF

# CABLE BOQ

  
VIVEK KUMAR SA Khan Praveen Kishore

CABLE SIZES FOR 1X800 MW KOTHAGUDEM TPS	
Sl no.	Cable Type
	G-TYPE
1	2P X 0.5 sqmm
2	4P X 0.5 sq mm
3	8P X 0.5 sqmm
4	12P X 0.5 sqmm
5	2P X 1.5 sqmm
	F-TYPE
1	4P X 0.5 sqmm
2	8P X 0.5 sqmm
3	12P X 0.5 sqmm
4	20P X 0.5 sqmm
	CONTROL CABLE
1	3C X 2.5 sqmm
2	5C x 2.5 sq mm
3	12C x 2.5 sqmm



Technical specification for  
**CONTROL & INSTRUMENTATION**

**1X800 MW KOTHAGUDEM**

SPEC NO.: **PE-TS-410-145-I**

VOLUME

SECTION

REV. NO. 00

DATE : 18.03.2015

SHEET OF

# KKS PHILOSOPHY

  
VIVEK KUMAR SA Khan Praveen Kishore



DOCUMENT TITLE

**KKS NUMBERING PHILOSOPHY**

1X800MW KOTHAGUDEM

**KKS NUMBERING PHILOSOPHY**

For identifying (tagging) an instrument / equipment in Power plant KKS numbering scheme is used. The purpose is to assign a unique number to every equipment in the power plant. For C&I equipment unique number are to be provided up to the signal level so that a unique number Input / Output exist in DCS for every signal.

Normally KKS number is a 10 digit alpha-numeric code and is typically split into the following:

X	X	X	A A Y			Y B B	B		
---	---	---	-------	--	--	-------	---	--	--

First three digits indicate the Sub-System. The Code for the major system are given as per **Annexure-1**.

Fourth and Fifth digits are the **Numerical Keys at System Code Level** and used to distinguish between main systems having same Alpha Codes.

Sixth and Seventh digits are the **Equipment / Apparatus / Measuring Circuit Code**. The code of various Equipment / Apparatus / Measuring Circuit is shown in **Annexure-2**

Eight, Nine and tenth digits are the **Numerical Keys at Equipment / Apparatus / Measuring Circuit Code** and used to distinguish between various instruments in the same sub-group. Numerical keys at System / Equipment / Apparatus / Measuring Circuit is shown in **Annexure-3**.

**ANNEXURE-1****List of System / Sub-System Codes used in Power Plant:**

- 1) Compressed air system : QEA, QEC
- 2) Ventilation System : SAA TO SAZ
- 3) Fire Detection & Protection System + Fire Water pumps : SGM, SGN, SGO, SGP
- 4) Sewage Treatment : SJA TO SJZ
- 5) Pre-treatment Plant : GBI, GBM, GBV
- 6) RO DM Plant : GCI, GCM, GBV
- 7) AC SYSTEM : QKA, QKB TO QKZ

**ANNEXURE-2****Standard Equipment Codes:**

AA	Valves including drives, also hand operated
AB	Seclusions, Lock, Gates, Doors
AC	Heat Exchanger
AE	Turning, Driving, Lifting equipment
AF	Continuous conveyors, Feeders
AG	Generator Units
AH	Heating and Cooling Units
AK	Pressing and Packaging equipment
AM	Mixer, Stirrer
AN	Blower, Air Pumps / Fans, Compressor Units
AP	Pump Units
AT	Purification, Drying, Filter
AV	Combustion Equipment e.g. grates

**Standard Apparatus Codes:**

BB	Vessels and Tank
BF	Foundation
BG	Boiler Heating Surfaces
BN	Injector, Ejector
BP	Flow and throughput limitation equipment (Orifice)
BQ	Holders, Carrying Equipment, Support
BR	Piping, Ducts, Chutes, Compensator
BS	Sound Absorber
BU	Insulations, Sheatings



### Standard Measuring Circuits Codes:

CD	Density
CE	Electrical Quantities
CF	Flow, throughput
CG	Distance, Length, Position
CK	Time
CL	Level
CM	Humidity
CQ	Analysis (SWAS)
CS	Speed, Velocity, Frequency
CT	Temperature
CY	Vibration, Expansion

### ANNEXURE-3

### Numerical Keys

#### A) Numerical Keys at System Code Level

- i) Use 10, 20, 30, ..... To distinguish between main systems having same Alpha Codes. Examples:
  - a) Main Steam (Left) and Main Steam (Right)
  - b) BFP – A/B/C
  - c) ID Fan – A/B, FD Fan A/B, AH – A/B
- ii) For branch off from main system path having code say 10, keep the same alpha code and use 11, 12, 13 etc. Similarly for other branch off from main system path having code say 20, keep the same alpha code and use 21, 22, 23 etc and shall carry on further in the same way.
- iii) If the branch off from main system / sub system path is used for some other system, where different alpha codes can be applied, then in that case the said branch line will be designated by the alpha codes of the system to which it is providing the input.

#### B) Numerical keys at Equipment Code level:

There are three numerical keys available for each type of equipment code. Following has been agreed upon considering present practice, better flexibility and ease in sorting.

- i) Valves and Dampers --- *Equipment Code – AA*

N1

N2 N3



## DOCUMENT TITLE

**KKS NUMBERING PHILOSOPHY**

1X800 MW KOTHAGUDEM

Motorised ( <i>on/off duty</i> )	-	0	01 to 50
Motorised ( <i>inching duty</i> )	-	0	51 to 99
Pneumatic (Control)	-	1	01 to 50
Motorised ( <i>thyrestor Control</i> )	-	1	51 to 99
Sol. Operated (Open / Close duty (Valves, NRVs, Gate)	-	2	01 to 99
Hydraulic	-	3	01 to 99
NRV (Without actuation)	-	4	01 to 99
Manual	-	5	01 to 99
Manual	-	6	01 to 99
Relief & Safety Valves	-	7	01 to 99
Reserve	-	8	01 to 99
Reserve	-	9	01 to 99

ii) **Field Instruments**

Field Transmitters & Analog Signals	-	0	01 to 99
Field Switches & Binary Signals	-	1	00 to 99
PG Test Point	-	4	00 to 99
Gauges	-	5	00 to 99
Automatic Turbine Tester (ATT)-HWR	-	2	00 to 99
(Reserved for protection Signals used by Hardwar)			

**Example of Numerical Key Usage:**

In line with the philosophy adopted for Valves / Dampers /instruments etc. pumps and fans in the main systems (having different system code) can be numbered as AP/N100 and as AP/N101, 102, ..... Where system code is same.



Technical specification for  
**CONTROL & INSTRUMENTATION**

**1X800 MW KOTHAGUDEM**

SPEC NO.: **PE-TS-410-145-I**

VOLUME

SECTION

REV. NO. 00

DATE : 18.03.2015

SHEET OF

# LIST OF DELIVERABLES

  
VIVEK KUMAR SA Khan Praveen Kishore

## LIST OF DELIVERABLES OF PEM - C&amp;I DEPARTMENT FOR VENTILATION SYSTEM

1X800MW KOTHAGUDEM TPS

DOCUMENT NUMBER PE-GL-410-145-I100

Sl.No.	DRAWING NO.	DRAWING/DOCUMENT TITLE	CATEGORY	CUSTOMER	FROM	USER	REMARKS
INSTRUMENTATION							
1	PE-V9-410-553-I901	INSTRUMENT DATA SHEETS	A	-	VENDOR	C&I	
2	PE-V9-410-553-I902	INSTRUMENT SCHEDULE	I	-	VENDOR	C&I	
3	PE-V9-410-553-I903	INSTRUMENT INSTALLATION/ HOOK UP DIAGRAMS	A	-	VENDOR	C&I	
4	PE-V9-410-553-I904	FIELD JB TERMINATIONS /GROUPING DOCUMENT	I	-	VENDOR	C&I	
5	PE-V9-410-553-I905	QUALITY PLANS (CV,FE, Tx and Analyser)	A	-	VENDOR	C&I	
6	PE-V9-410-553-I906	CONFIGURATION DRAWING	A	A	VENDOR	C&I	
7	PE-V9-410-553-I907	PANEL GA (INTERNAL & EXTERNAL) DRAWING	A	-	VENDOR	C&I	
8	PE-V9-410-553-I908	CONTROL SCHEMES (BLOCK LOGIC)	A	-	VENDOR	C&I	
9	PE-V9-410-553-I909	PLC INPUT / OUTPUT SIGNAL LIST	I	-	VENDOR	C&I	
10	PE-V9-410-553-I916	CATALOGUES	I	-	VENDOR	C&I	
11	PE-V9-410-553-I918	LIST OF SIGNAL EXCHANGE WITH DDCMIS (BOTH HARDWIRED & SERIAL INTERFACE IN BHEL FORMAT)	A	-	VENDOR	C&I	
12	PE-V9-410-553-I919	PROCESS GRAPHIC MANUSCRIPTS FOR PLC	I	-	VENDOR	C&I	
13	PE-V9-410-553-I920	PROCESS GRAPHIC MANUSCRIPTS FOR DDCMIS	I	-	VENDOR	C&I	
14	PE-V9-410-553-I921	CABLE SCHEDULE (IN BHEL EXCEL FORMAT) & CABLE INTERCONNECTION DETAILS	I	-	VENDOR	C&I	
15	PE-V9-410-553-I923	PANEL & ELECTRONIC EARTHING REQUIREMENT	I	-	VENDOR	C&I	
16	PE-V9-410-553-I924	PANEL HEAT DISSIPATION DATA	I	-	VENDOR	C&I	
17	PE-V9-410-553-I925	MANDATORY SPARES BILL OF MATERIAL	A	A	VENDOR	C&I	
18	PE-V9-410-553-I926	O & M MANUAL	I	-	VENDOR	C&I	
19	PE-V9-410-553-I927	EARTHING SCHEME	I	-	VENDOR	C&I	
	Notes:	410 - Project No					
		XXX -SI No of MAX Package					
		\$\$ -Approval by BHEL if Vendor BBU Item Approval by Customer if Customer BBU Item					

**C&I MANDATORY SPARES LIST FOR  
AUXILIARY PACKAGE  
FOR 1 X 800 MW KOTHAGUDEM**

**C&I MANDATORY SPARES FOR VENTILATION SYSTEM FOR 1 X 800 MW KOTHGUDEM (ANNEXURE-I)**

<b>A</b>	<b>Field Instruments</b>	
1	Transmitters/ Gauges/Switches etc. along with relevant accessories	10% of total or at least two (whichever is higher) for each type along with accessories.
2	Temperature Element (RTD/Thermo-couple) with thermowell	10% of each type , range and immersion length . Minimum 5 nos.
3	Furnace Temperature Probe	Thermocouple 1 no.
<b>B</b>	<b>Actuator</b>	
1	Complete set of Actuator	1No. for each type and rating
2	Limit Switch	3 Nos each type and rating
3	Torque Switch	3 Nos each type and rating
4	Auxiliary Contact	1 no each type and rating
5	Motor	1 no each type and rating
6	Complete Seal kit	1Set for each type and rating
7	Complete O-Ring Set	1Set
8	Electronic Card	One(1) for each type/make
9	Feedback Assembly (4-20mA) for Inching type	One(1) for each type/make


  
 Vivek Kumar SA Khan Praveen Kishore


  
 VIVEK KUMAR SA Khan Praveen Kishore

**ANNEXURE-I**  
**LIST OF MAKES**

  
VIVEK KUMAR SA Khan Praveen Kishore



**1 X 800MW KOTHAGUDEM  
VENTILATION SYSTEM  
LIST OF MAKES OF SUB-VENDOR  
ITEMS**

**SPECIFICATION NO. PE-TS-410-554-A001**

**VOLUME : II B**

**REV 02**

**DATE: 07.07.2015**

**SHEET**

S.No.	ITEM / EQUIPMENT	SUB SUPPLIER
1.	AIR WASHER & UAF*	HYDERABAD POLLUTION CONTROL / SK SYSTEM / ADVANCE VENTILATION / DRAFT AIR / BLUE STAR / VOLTAS / STERLING WILSON & ROOTS COOLING SYSTEM / C.DOCTOR
2.	CENTRIFUGAL FAN (For Air washers and UAF)	FLAKT / KRUGGER / DRAFT AIR / HYDERABAD POLLUTION CONTROL / ADVANCE VENTILATION / PATEL AIR / NICOTRA/ SK SYSTEM / MARATHON / CB DOCTOR / SARLA
3.	AXIAL FLOW FANS/RE UNITS	HYDERABAD POLLUTION/ SK SYSTEM / ADVANCE VENTILATION / KRUGER / NICOTRA / MARATHON / FLAKT / CB DOCTOR/ PATEL AIR /SITAL
4.	CENTRIFUGAL WATER PUMP	BEST & CROMPTON / JYOTI / SAM TURBO / KBL / KSB / M&P / VOLTAS / BEACON-WEIR / WORTHINGTON / FLOWMORE / SULZER / BHARAT PUMPS & COMPRESSORS LTD / FLOWSERVE INDIA CONTROL PVT LTD / V-FLOW PUMPS & SYSTEMS CO/ KISHORE PUMP
5.	INDUCTION MOTORS (LT)	SIEMENS / ABB / CGL / MARATHON / KEC / BHARAT BIJLEE / NGEF /JYOTI / LHP / BHARAT ELECTRIC
6.	AIR FILTER	PUROLATOR / FMI / ANFILCO / TENACITY / JOHN FOWLER /SPECTRUM / AIR TECH / PUROMATIC
7.	INSULATION MATERIAL (Fibreglass / EPS/ PUF / Nitrile /EPDM)	BEARDSHELL / K-FLEX / PARAMONT / ARMAFLEX / SUPREME / LLOYDS / UP TWIGA
8.	FIRE DAMPER	TSC / CARRYAIRE / RAVISTAR (SYSTEM AIR )
9.	BUTTERFLY VALVE	ADVANCE / AUDCO / FOURESS / INTER VALVE / BDK / WEIR BDK / TYCO / CRANE PROCESS / KEYSTONE / FLUIDLINE / INSTRUMENTATION LTD / R and D MULTIPLES (METAL CAST) PVT LTD / SURYA VALVES AND INSTRUMENTS MFG CO / PENTAIR VALVES AND CONTROLS INDIA PRIVATE LIMITED / UPADHAYA VALVES MANUFACTURERS PRIVATE LIMITED / VENUS PUMPS AND ENGG. WORKS
10.	NON RETURN VALVE(CI)	LEADER / H.SARKAR / FLUID LINE / HI -TECH / CRESENT / A V VALVES / BANKIM & COMPANY / SHIVADURGA / SURYA VALVES AND INSTRUMENT MANUFACTURING / ATAM VALVES / GM DAULI & SONS / KBL / VENUS PUMPS AND ENGINEERING WORKS
11.	GATE/GLOBE VALVES (CI)	CRESENT / BDK / AUDCO / FOURESS / KIRLOSCHAR / SANT / BOMBAY METAL & ALLOYS / LEADER / H.SARKAR / FLUID LINE / HI -TECH / A V VALVES / BANKIM & COMPANY / SHIVADURGA / SURYA VALVES AND INSTRUMENT MANUFACTURING / ATAM VALVES / GM DAULI & SONS / KBL / VENUS PUMPS AND ENGINEERING WORKS.
12.	GUN METAL VALVES	LEADER / A V VALVES / ATAM VALVES / VALTECH INDUSTRY / SANT VALVES
13.	PIPING - ERW	SURYA ROHNI / TISCO / DADU PIPES / INDUS TUBE / WELSPUN / TATA TUBES / BST / JINDAL / SAIL / PSL / LALIT PROFILE / SAMSHI PIPE INDUSTRIES / MUKUT PIPES / MANN INDUSTRIES/ SURENDRA ENGINEERING / PRATIBHA PIPES AND STRUCTURES PVT LTD / JCO GAS PIPES / NUKAT TANK AND VESSELS / GOODLUCK TUBES / ADVANCE STEEL TUBES / BIHAR TUBES / HITECH PIPES / RATNAMANI / MAHARASHTRA SEAMLESS
14.	GI SHEETS FOR DUCTING	TISCO / INDIAN IRON & STEEL CO LTD. / RASHITRYA ISPAT NIGAM LTD. / ESSAR/ ISPAT INDUSTRIES / JSW STEEL / LLOYDS STEEL / BHUSHAN / TATA / SAIL / JINDAL
15.	HUMID STAT	JHONSON CONTROL / HONEYWELL / PENN



**1 X 800MW KOTHAGUDEM  
VENTILATION SYSTEM  
LIST OF MAKES OF SUB-VENDOR  
ITEMS**

**SPECIFICATION NO. PE-TS-410-554-A001**

**VOLUME : II B**

**REV 02**

**DATE: 07.07.2015**

**SHEET**

16.	<b>PRESSURE GAUGE / DP GAUGE</b>	GENERAL INST CONSORTIUM / BELL / H.GURU INST/ H GURU / WAAREE INSTRUMENTS / FORBES MARSHALL / MANOMETER / A.N. INST / GAUGES BOURDON / GLUCK / WIKA / ASHCROFT / BAUMER TECHNOLOGIES
17.	<b>TEMPERATURE GAUGE</b>	H.GURU IND/ H.GURU INST/ FORBES MARSHALL/DETRIVE INST & ELECTRONICS / PYRO ELECTRIC /TOSHNIWAL BROSS / WAREE INSTRUMENTS / A.N.INST / GOA INSTRUMENTS / WIKA/ ASHCROFT / H GURU (SI) / BUDENBERG GAUGE CO.LTD./ GOA THERMOSTATIC INSTRUMENTS PVT.LTD./ GAUGE BOURDON INDIA PVT. LTD/ Baumer Technologies India Pvt. Ltd
18.	<b>LEVEL GAUGE</b>	GENERAL INSTRUMENTS / CHEMTROLS / SBEM, PUNE/ AUTOMAT MUMBAI /SIGMA / TOSHNIWAL / TECHNOMATIC / TELACO /LEVCON / D K INSTRUMENTS / PUNE TECHTROL / FLOW STAR
19.	<b>PRESSURE SWITCH / DP SWITCHES</b>	BELLS / DANFOSS / DK INSTRUMENTS/ DRESSER / SOR INC / VASU / SWITZER / INDOFOSS / TRAFAG / GIC / ASHCROFT / DELTA CONTROL
20.	<b>LEVEL SWITCH</b>	SBEM / BLISS ANAND / HI TECH / RAMAN INST / SIGMA / SOR INC / WAREE INST / LEVCON / DK INSTURMENT / V ATUOMATE /CHEMTROLS / SIEMENS / FLOW STAR / TRAC
21.	<b>LEVEL INDICATOR</b>	SBEM / SIGMA / LEVCON / DK INSTURMENT / V ATUOMATE / FLOW STAR / SCIENTIFIC DEVICES / GAUGES BOURDON / PNE TECHTROL
22.	<b>TRANSMITTERS</b>	EMERSON / LAXONS AUTOMATION / YIL / TAYLOR / ABB/BRISTOL BABCOCK / BIRLA KENT TAYLOR / BLISS ANAND /SBEM/ SMART INST / V AUTOMATION & INST / FISHER-ROSEMOUNT / SIEMENS/ HONEYWELL / YOKOGAWA / FUJI
23.	<b>Y / POT STRAINER</b>	MULTITEX / GREAVES COTTON / JAYPEE / SANT / OTOKLIN / GRAND PRIX / GUJARAT OTOLIFT / DS ENGG / SAROJINI ENTERPRISE / BHATIA ENGINEERING / FILTERATION ENGINEERS INDIA PVT LTD / SUNGOV ENGINEERING/ OTOKLIN GLOBAL BUSINESS LTD
24.	<b>CONTROL PANEL</b>	INDUSTRIAL CONTROL & APPLIANCE/ PYROTECH /POSITRONICS / CONTROL & SWITCHGEAR /SIEMENS / L&T /GE POWER /RITTAL / HOFFMAN
25.	<b>INSTRUMENT FITTINGS</b>	AURA INCORPORATED / Astec Valves & Fittings Pvt. Ltd., / Arya Crafts & Engineering Pvt. Ltd./ Comfit & Valve Pvt. Ltd./ FLUIDFIT ENGINEERS PVT. LTD / Fluid Controls Pvt. Ltd./ HP VALVES & FITTINGS INDIA PVT. LTD. / PRECISION ENGINEERING INDUSTRIES / Panam Engineers, / Perfect Instrumentation Control (India) Pvt. Ltd. / VIKAS INDUSTRIAL PRODUCTS
26.	<b>PAINT</b>	Asian Paints (I) Ltd./ Berger Paints India Ltd /Goodlass Nerolac/Jenson & Nicholson (I) Ltd /CDC carboline (I) Ltd. /Shalimar Paints Ltd. /Addison Paints Ltd/Grand Polycoat/Bombay Paints/Hemple Paints (Singapore)/ Jotun Paints
<b>NOTE</b>		
<p><b>Above sub-vendor are also subjected to Customer approval during detailed engineering without any cost and time implication.</b></p>		

## ANNEXURE-II A FOR MECHANICAL ITEMS

### LIST OF MANDATORY SPARES - MECHANICAL

<b>V</b>	<b>Ventilation</b>		
<b>1</b>	<b>Ventilation System</b>		
<b>1.1</b>	<b>Centrifugal fans</b>		
1.1.1	Set of bearings for Air washer fans	1Set for each Type of Fan	
1.1.2	Set of bearings for U.A.F. fans	1Set for each Type of Fan	
1.1.3	Impeller for the Fan	1Set for each Type of Fan	
<b>1.2</b>	<b>Centrifugal pumps</b>		
1.2.1	Set of bearings for Air washer pumps	1Set for each Type and rating of Pump	
1.2.2	Set of bearings for U.A.F. pumps	1Set for each Type and rating of Pump	
1.2.3	Gland packing, shaft sleeve & casing wearing ring	1Set for each Type and rating of Pump	
1.2.4	Impeller for the Pump	1Set for each Type and rating of Pump	
<b>1.3</b>	<b>Spray Nozzles</b>		
1.3.1	Spray nozzles for air washer unit	5%	
1.3.2	Spray nozzles for U.A.F. unit	5%	
<b>1.4</b>	<b>SS Filters</b>		
1.4.1	SS Filters for Air washer	10%	
1.4.2	SS Filter for Unitary air filtration unit	10%	
<b>1.5</b>	<b>Flow Regulating Valve</b>		
1.5.1	For Air Washer	10% or Minimum 1No. Whichever is higher	
1.5.2	For Unitary Air Filtration Unit	10% or Minimum 1No. Whichever is higher	
<b>1.6</b>	<b>Basket for POT Strainer</b>		
1.6.1	Strainer Basket for Air Washer	1No. for each type and size	
1.6.2	Strainer Basket for Unitary Air Filtration unit	1No. for each type and size	
<b>1.7</b>	<b>Valves</b>		
1.7.1	Gate valve for Air washer	10% or Minimum 1No. Whichever is higher	
1.7.2	NR Valve for Air Washer	10% or Minimum 1No. Whichever is higher	
1.7.3	Gate valve for Unitary Air Filtration Unit	10% or Minimum 1No. Whichever is higher	
1.7.4	NR valve for Unitary Air Filtration Unit	10% or Minimum 1No. Whichever is higher	
1.7.5	Gate Valve for Make-up Drain of Air washer	10% or Minimum 1No. Whichever is higher	
1.7.6	Gate valve for UAF	20% or Minimum 2Nos. Whichever is higher	
1.9	<b>Fan-Filter Units</b>		
1.9.1	Filter	1 set for each FFU	
1.9.2	Fan-motor Bearing	1 set for each rating of FFU	
1.9.3	Vibration Isolators	1 set for each FFU	
1.9.4	Back Draft Dampers	1 no. of each size	
1.9.5	Any other spare parts recommended by the Manufacturer	As recommended by the Manufacturer	
<b>1.10</b>	<b>Wall mounted supply/ Exhaust fan</b>		
1.10.1	Fan-motor Bearing	1 set for each rating of fan	
1.10.2	Vibration Isolators	1 set for each fan	
1.10.3	Fan Motor	1 set for each rating of fan	

**ANNEXURE-II B FOR C&I ITEMS**

**C&I MANDATORY SPARES LIST FOR  
AUXILIARY PACKAGE  
FOR 1 X 800 MW KOTHAGUDEM**

**C&I MANDATORY SPARES FOR VENTILATION SYSTEM FOR 1 X 800 MW KOTHGUDEM (ANNEXURE-I)**

<b>A</b>	<b>Field Instruments</b>	
1	Transmitters/ Gauges/Switches etc. along with relevant accessories	10% of total or at least two (whichever is higher) for each type along with accessories.
2	Temperature Element (RTD/Thermo-couple) with thermowell	10% of each type , range and immersion length . Minimum 5 nos.
3	Furnace Temperature Probe	Thermocouple 1 no.
<b>B</b>	<b>Actuator</b>	
1	Complete set of Actuator	1No. for each type and rating
2	Limit Switch	3 Nos each type and rating
3	Torque Switch	3 Nos each type and rating
4	Auxiliary Contact	1 no each type and rating
5	Motor	1 no each type and rating
6	Complete Seal kit	1Set for each type and rating
7	Complete O-Ring Set	1Set
8	Electronic Card	One(1) for each type/make
9	Feedback Assembly (4-20mA) for Inching type	One(1) for each type/make

## ANNEXURE-II C FOR ELECTRICAL ITEMS

### Mandatory Spares for Electrical


S.No.	Items	Qty.	Remarks
<b>1</b>	<b>Electrical Spares for panels</b>		
1.1	Control Supply Transformer	2 Nos. of each type and rating	
1.2	Contractor	2 Nos. of each type and rating	
1.3	Coils for contractor & aux. contractor	5 Nos. for each contractor	
1.4	Main & Aux. Contacts sets for contractor and Aux. Contractor	5 Sets. For each contractor	
1.5	Air Break Switch	1 No. for each rating	
1.6	Control, Isolating and selector switches	5% of each type and rating	
1.7	MCB/ MCCB	10% of installed quantity	
1.8	Circuit Breaker	1 No. for each rating	
1.9	Indicating Lamps	10% of installed quantity	
1.10	Indicating Lamps cover of different colour and holders	5% of installed quantity	
1.11	Push Buttons of various colours	10 nos. of each type and colour	
1.12	Terminal Blocks	5% of installed quantity	
<b>2</b>	<b>Electrical Spares for Motors</b>		
2.1	Terminal plates	10 Nos. each for small motors up to 30KW and 4 Nos. each for motors above 30KW	
2.2	Heaters	1 Set for each motor of rating above 30KW	
2.3	Greasing arrangements	4 sets for each type of motors	
2.4	Motors below 0.75 KW	10% of the installed quantity or minimum 1 no. whichever is higher	
2.5	Bearings (DE & NDE)	4 sets of each type and rating	
<b>3</b>	<b>Motor</b>		
3.1	HT Motor (other than BFP Motor)		
3.1.1	Driving End Bearing	1 no. (or 1 Set as applicable)for each type and rating of Motor	
3.1.2	Non-Driving End Bearing	1 no. (or 1 Set as applicable)for each type and rating of Motor	
3.1.3	Cooling Fan Internal & External	1 no. for each type and rating of Motor	
3.1.4	Bearing temperature Gauge Driving & Non-Driving End	1 no. for each type and rating of Motor	
3.1.5	Phase-Segregated Terminal Box	1 no. for each type and rating of Motor	
3.1.6	Neutral End terminal Bushing with Fastenes	1 no. for each type and rating of Motor	
3.1.7	RTD for Bearing Temperature	1 no. for each type and rating of Motor	
3.1.8	Motor Space Heater	1 no. for each type and rating of Motor	
3.1.9	Complete set of Coupling	1 Set for each Application	
<b>4</b>	<b>415 Volt Motor (above 30KW Rating upto 200KW)</b>		
4.1	End Shield Cover Driving & Non-Driving End	1 no. for each type and rating of Motor	
4.2	Driving End & Non-Driving End Bearing	1 no. for each type and rating of Motor	
4.3	Cooling Fan	1 no. for each type and rating of Motor	
4.4	Motors Space Heater	1 no. for each type and rating of Motor	
4.5	Motor Terminal Block	1 no. for each type and rating of Motor	
4.6	Complete Set of Coupling	1 Set for each Application	
<b>5</b>	<b>415 Volt Motor (Upto 30KW Rating)</b>		
5.1	Driving End & Non-Driving End Bearing	3 Set for each type and rating of Motor	
5.2	Cooling Fan	2 no. for each type and rating of Motor	
5.3	Motor Terminal Block	5 no. for each type and rating of Motor	
5.4	Complete Set of Coupling	1 Set for each Application	
<b>6</b>	<b>D C Motors</b>		
6.1	Carbon brushes	10 sets each type	
6.2	Brush assemblies	2 sets each type	
6.3	Terminal blocks	2 sets each type	
6.4	Heaters	2 sets each type	
6.5	Pulleys	2 sets each type	
6.6	Bearings (DE and NDE) for each type and rating of motor	4 sets	


## ANNEXURE-III

### LIST OF TOOLS & TACKLES

MEASURING TAPE	SET	1
TECHOMETER	SET	1
DOUBLE ENDED SPANNER	SET	1
RING SPANNERS	SET	1
GASKET PUNCH	NO.	1
CENTRE PUNCH	NO.	1
HAMMER WITH WOODEN HANDLES	NO.	1
SCISSORS FOR SHEET METAL CUTTING	NO.	1
TORCH WITH 2 DRY CELLS	NO.	1
MULTIMETER	NO.	1
ANIMOMETER	NO.	1
COMPOUND PRESSURE GAUGE	NO.	1
SLIDE WRENCH 8"	NO.	1
SLIDE WRENCH 10"	NO.	1
SLIDE WRENCH 6"	NO.	1
BOX SPANNER SET	NO.	1
SCREW DRIVER SET	NOS.	1
ALIGN KEY SET	NO.	1

## ANNEXURE-IV

	TITLE	SPECIFICATION NO. PE-TS-410-554-A001
	<b>VENTILATION SYSTEM INSPECTION AND TESTING</b>	REV 01      DATE:04.07.2015 SHEET 1 OF 3
1.00.00	<b>INSPECTION AND TESTING</b>	
1.01.00	Inspection and Tests during Manufacture.	
1.01.01	The method and techniques to be used by the Bidder for the control of quality during manufacture of all plant and equipment shall be agreed with the Owner.	
1.01.02	The Owner's general requirements with respect to quality control and the required shop tests are set out elsewhere in this specification.	
1.01.03	Before any item of plant or equipment leaves its place of manufacture the Owner shall be given the option of witnessing inspections and tests for compliance with the specification and related standards.	
1.01.04	<p>Advance notice shall be given to the Owner as agreed in the Contract, prior to the stage of manufacture being reached, and the piece of plant must be held at this stage until the Owner has inspected the piece, or has advised in writing that inspection is waived. If having consulted the Owner and given reasonable notice in writing of the date on which the piece of plant will be available for inspection, the Owner does not attend the Bidder may proceed with manufacture having forwarded to the Owner duly certified copies of his own inspection and test results.</p> <p>The owner's representative shall have at all reasonable times access to bidder's or his sub-vendor's premises and shall have power to inspect/ examine materials and workmanship or equipment under manufacture.</p> <p>The Bidder shall forthwith forward to the engineer duly certified copies of the Test Certificates in six copies (one to the Purchaser and five to the Consulting Engineer) for approval. Further nine (9) copies of Shop Test Certificates shall be bound with Instruction Manuals referred to elsewhere.</p> <p>For electrical equipment, routine tests as per relevant IS spec are to be carried out on all equipment. Type tests are also to be carried out on selected equipment as detailed in the specs of concerned electrical equipment.</p>	
1.01.05	Under no circumstances any repair or welding of castings be carried out without the consent of the Engineer. Proof of the effectiveness of each repair by radiographic and/or other non-destructive testing technique, shall be provided to the Engineer.	
1.01.06	<p>All the individual and assembled rotating parts shall be statically and dynamically balanced in the works.</p> <p>Where accurate alignment is necessary for component parts of machinery normally assembled on site, the Bidder shall allow for trial assembly prior to despatch from place of manufacture.</p>	

	TITLE	SPECIFICATION NO. PE-TS-410-554-A001	
	<b>VENTILATION SYSTEM INSPECTION AND TESTING</b>		
		REV 01	DATE:04.07.2015
		SHEET 2 OF 3	

1.01.07 All materials used for the manufacture of equipment covered under this specification shall be of tested quality. Relevant test certificates shall be made available to the Purchaser. The certificates shall include tests for mechanical properties and chemical analysis of representative material. Equipment or parts coming under any statutory Regulations shall be certified by a Competent Authority under the regulations in the specified format.

1.01.08 All pressure parts connected to pumping main shall be subjected to hydraulic testing at a pressure of 150% of shut-off head for a period not less than one hour. Other parts shall be tested for one and half times the maximum operating pressure, for a period not less than one hour.

1.01.09 All necessary non-destructive examinations shall be performed to meet the applicable code requirements.

1.01.10 All welding procedures adopted for performing welding work shall be qualified in accordance with the requirements of Section-IX of ASME code or IBR as applicable. All welded joints for pressure parts shall be tested by liquid penetrant examination according to the method outlined in ASME Boiler and Pressure Vessel code. Radiography, magnetic particle examination magnuflux and ultrasonic testing shall be employed wherever necessary/ recommended by the applicable code. At least 10% of all major but welding joints shall be radiographed unless otherwise stipulated.

Statutory payments in respect of IBR approvals including inspection shall be made by the bidder. Bidder's scope shall include to preparation of all necessary documents, co-ordination and follow-up for above approval. Owner shall only forward assistance/endorsement of documents /design /drawings /reports/records to be submitted for approval as stipulated/ required by Statutory Authorities till registration of the unit and clearance for commercial operation.

1.02.00 **Performance Tests at Site**

1.02.01 The full requirements for testing the system shall be agreed between the Owner and the Bidder prior to Award of Contract. The completely erected System shall be tested by the Bidder on site under normal operating conditions. The Bidder shall also ensure the correct performance of the System under abnormal conditions, i.e. the correct working of the various emergency and safety devices, interlocks, etc.

1.02.02 The Bidder shall provide complete details of his normal procedures for testing, for the quality of erection and for the performance of the erected plant. These tests shall include site pressure test on all erected pipe work to demonstrate the quality of the piping and the adequacy of joints made at site.

1.02.03 The Bidder shall furnish the quality procedures to be adopted for assuring quality from the receipt of material at site, during storage, erection, pre-commissioning to tests on completion and commissioning of the complete system/equipment.



TITLE

**VENTILATION SYSTEM  
INSPECTION AND TESTING**

SPECIFICATION NO. PE-TS-410-554-A001

REV 01

DATE:04.07.2015

SHEET 3 OF 3

1.03.00

For details of specific tests required on individual equipment refer to respective section of this specification.

All Statutory testing / clearance is in Bidder's scope including payment of all fees, etc. as required



## ANNEXURE-VI

### MASTER DRAWING LIST FOR VENTILATION

S.NO.	BHEL DRG NO	DRG TITLE	SCHEDULE(WEEK AFTER PLACEMENT OF LOI TO VENDOR)
1	PE-V0-392-554-A001	INSPECTION CATEGORISATION PLAN	2
2	PE-V0-392-554-A002	QUALITY PLAN OF AIR WASHER & UAF	10
3	PE-V0-392-554-A003	QUALITY PLAN OF CENTRIFUGAL PUMPS	10
4	PE-V0-392-554-A004	QUALITY PLAN OF CENTRIFUGAL FANS	10
5	PE-V0-392-554-A005	QUALITY PLAN OF MOTOR	10
6	PE-V0-392-554-A101	VENTILATION FAN SCHEDULE.	8
7	PE-V0-392-554-A201	DATA SHEET & GA FOR AIR WASHER ALONGWITH FAN AND PUMP WITH FOUNDATION DETAILS.	8
8	PE-V0-392-554-A202	DATA SHEET & GA FOR UAF ALONGWITH FAN AND PUMP FOUNDATION DETAILS.	8
9	PE-V0-392-554-A203	DATA SHEET & GA FOR ROOF EXTRACTOR, AXIAL EXHAUST AND SUPPLY AIR FANS WITH FIXING ARRANGEMENT.	10
10	PE-V0-392-554-A204	DATA SHEET & GA FOR VALVES AND STRAINER.	10
11	PE-V0-392-554-A205	DATA SHEET FOR INSULATION.	4
12	PE-V0-392-554-A206	DATA SHEET & GA FIRE DAMPER.	4
13	PE-V0-392-554-A207	DATA SHEET FOR INSTRUMENTS (PRESSURE GAUGE, TEMP GAUGE, LEVEL GAUGE, PRESSURE SWITCH, LEVEL SWITCH).	10
14	PE-V0-392-554-A208	DATA SHEET OF PIPE.	4
15	PE-V0-392-554-A209	DATA SHEET OF GI AND MS SHEET.	4
16	PE-V0-392-554-A210	DATA SHEET & GA FOR PRE AND FINE FILTERS.	10
17	PE-V0-392-554-A211	DATA SHEET FOR MOTORS (A/W Fan, A/W pumps, UAF Fan, UAF Pump, RE units, Supply and Exhaust axial fans)	10
18	PE-V0-392-554-A401	TYPICAL Details DUCT FABRICATION DRAWING / SUPPORT / ERECTION. INSULATION OF DUCTING / PIPING & EQUIPMENTS	10
19	PE-V0-392-554-A403	GA OF PROPELLER FAN.	4
20	PE-V0-392-554-A601	SCHEME FOR AIR DISTRIBUTION ALONG WITH CALCULATION IN TG BUILDING AND ESP BUILDING.	4
21	PE-V0-392-554-A602	PID FOR AIRWASHER AND UAF UNIT.	4
22	PE-V0-392-554-A603	AIR WASHER LAYOUT OUTSIDE "A ROW" SIDE ALONGWITH FOUNDATION DETAILS - TG BUILDING	7
23	PE-V0-392-554-A604	AIR WASHER LAYOUT FOR "B-C BAY" SIDE ALONGWITH FOUNDATION DETAILS - TG BUILDING	7

S.NO.	BHEL DRG NO	DRG TITLE	SCHEDULE(WEEK AFTER PLACEMENT OF LOI TO VENDOR)
24	PE-V0-392-554-A605	UAF LAYOUT ALONGWITH FOUNDATION DETAILS - ESP BUILDING.	8
25	PE-V0-392-554-A606	VENTILATION DUCT LAYOUT FOR TG BUILDING - 'A' ROW SIDE (UNIT I).	8
26	PE-V0-392-554-A607	VENTILATION DUCT LAYOUT FOR TG BUILDING - 'BC BAY' SIDE (UNIT I).	10
27	PE-V0-392-554-A608	VENTILATION DUCT LAYOUT FOR ESP BUILDINGS.(UNIT I).	5
28	PE-V0-392-554-A609	LOCATION OF ROOF EXTRACTOR UNIT IN TG BUILDING ALONGWITH FIXING DETAILS.	5
29	PE-V0-392-554-A610	VENT. ARRANGEMENT FOR BATTERY ROOM.	8
30	PE-V0-392-554-A611	VENT. ARRANGEMENT FOR VARIOUS AUXILIARY BUILDING.	5
31	PE-V0-392-554-A701	ELECTRICAL FEEDER LIST.	8
32	PE-V0-392-554-A702	VENTILATION CABLE SCHEDULE	8
33	PE-V0-392-554-A901	P.G. TEST PROCEDURE.	8
34	PE-V0-392-554-A902	O & M MANUAL.	13